

---

# **Alberta Fire Code 2006**

**Published by the National Research Council of Canada**

---

First Edition 1992  
Second Edition 1998  
Third Edition 2006

ISBN 0-660-19639-5  
NR24-10/2-2006E

NRCC 48674

© National Research Council of Canada 2006  
Ottawa  
World Rights Reserved

Printed in Canada

Second Printing  
Includes all revisions and errata approved to March 2009  
by Safety Services and the Safety Codes Council

2 4 6 8 10 9 7 5 3 1

---

# Table of Contents

## **Preface**

### **Relationship of the Alberta Fire Code 2006 to Standards Development and Conformity Assessment**

### **Alberta Fire Technical Council Members**

#### **Division A Compliance, Objectives and Functional Statements**

- Part 1 Compliance
- Part 2 Objectives
- Part 3 Functional Statements
- Appendix A Explanatory Material

#### **Division B Acceptable Solutions**

- Part 1 General
- Part 2 Building and Occupant Fire Safety
- Part 3 Indoor and Outdoor Storage
- Part 4 Flammable and Combustible Liquids
- Part 5 Hazardous Processes and Operations
- Part 6 Fire Protection Equipment
- Part 7 Fire Emergency Systems in High Buildings
- Appendix A Explanatory Material

#### **Division C Administrative Provisions**

- Part 1 General
- Part 2 Administrative Provisions
- Appendix A Explanatory Material

## **Index**



---

# Preface

The National Fire Code of Canada 2005, together with the National Building Code of Canada 2005 and the National Plumbing Code of Canada 2005, is an objective-based National Model Code that can be adopted by provincial and territorial governments.

In Canada, provincial and territorial governments have the authority to enact legislation that regulates the following activities within their jurisdictions:

- activities related to the construction, use or demolition of buildings and facilities
- the condition of specific elements of buildings and facilities
- the design or construction of specific elements of facilities related to certain hazards
- protection measures for the current or intended use of buildings

This legislation may include the adoption of the National Fire Code of Canada without change or with modifications to suit local needs, and the enactment of other laws and regulations related to these activities, including the requirements for professional involvement.

The National Fire Code of Canada is a model code that helps promote consistency among provincial and territorial fire codes.

## Alberta Fire Code 2006

By agreement with the National Research Council of Canada, Alberta is committed to using the National Fire Code of Canada 2005 with changes and modifications to suit Alberta's needs in regulating fire standards.

The Alberta Fire Code 2006 was established by the Alberta Safety Codes Council after consultation with municipal authorities, provincial government departments, associations, other affected parties and Code users.

The Alberta Fire Code 2006 succeeds the 1997 edition.

The Alberta Fire Code 2006 sets out technical provisions regulating

- activities related to the construction, use or demolition of buildings and facilities
- the condition of specific elements of buildings and facilities
- the design or construction of specific elements of facilities related to certain hazards
- protection measures for the current or intended use of buildings

The Alberta Fire Code 2006 establishes provisions to address the following three objectives, which are fully described in Division A of the Code:

- safety
- health
- fire protection of buildings and facilities

Code provisions do not necessarily address all the characteristics of buildings and facilities that might be considered to have a bearing on the Code's objectives. Through the extensive consensus process used to develop and maintain Canada's National and Provincial Codes, the code-user community has decided which characteristics should be regulated through the Alberta Fire Code 2006.

The Alberta Fire Code 2006 is a code that, when adopted becomes a regulation. It is not a textbook on the operation, maintenance, protection, design or construction of buildings and

facilities. Executing these activities in a technically sound manner depends upon many factors beyond simple compliance with fire regulations. Such factors include the availability of knowledgeable practitioners who have received appropriate education, training and experience and have some degree of familiarity with the principles of good practice and experience using textbooks, reference manuals and technical guides.

The Alberta Fire Code 2006 does not list acceptable proprietary products. It establishes the criteria that materials, products and assemblies must meet. Some of these criteria are explicitly stated in the Alberta Fire Code 2006 while others are incorporated by reference to material or product standards published by standards development organizations. Only those portions of the standards related to the objectives of this Code are mandatory parts of the Alberta Fire Code 2006.

## **Relationship between the Alberta Building Code and the Alberta Fire Code**

The Alberta Building Code and Alberta Fire Code each contain provisions that deal with the safety of persons in buildings in the event of a fire and the protection of buildings from the effects of fire.<sup>(1)</sup> These two Codes are developed as complementary and coordinated documents to minimize the possibility of their containing conflicting provisions. It is expected that buildings comply with both the Alberta Building Code 2006 and the Alberta Fire Code 2006. The Alberta Building Code 2006 generally applies at the time of construction and reconstruction while the Alberta Fire Code 2006 applies to the operation and maintenance of the fire-related features of buildings in use.

The scope of each of these Codes with respect to fire safety and fire protection can be summarized as follows:

The Alberta Building Code covers the fire safety and fire protection features that are required to be incorporated in a building at the time of its original construction. Building codes typically no longer apply once a building is occupied, unless the building is undergoing alteration or change of use, or being demolished.

The Alberta Fire Code includes provisions for:

- the on-going maintenance and use of the fire safety and fire protection features incorporated in buildings
- the conduct of activities that might cause fire hazards in and around buildings
- limitations on hazardous contents in and around buildings
- the establishment of fire safety plans
- fire safety at construction and demolition sites

In addition, the Alberta Fire Code 2006 contains provisions regarding fire safety and fire protection features that must be added to existing buildings when certain hazardous activities or processes are introduced in these buildings.

Some of the Alberta Fire Code 2006 provisions are not duplicated directly in the Alberta Building Code 2006 but are in fact adopted through cross-references to the Alberta Fire Code 2006. Thus, some Alberta Fire Code 2006 provisions may apply to original construction, alterations, or changes in use.

## **Code Development**

### **Development of the National Model Codes**

The Canadian Commission on Building and Fire Codes (CCBFC) is responsible for the content of the National Model Codes. The CCBFC is an independent body made up of volunteers from across the country and from all facets of the code-user community. Members of the CCBFC and its standing committees include builders, engineers,

(1) The Alberta Fire Code also applies to other types of facilities besides buildings (e.g. tank farms and storage yards). Those applications are not discussed here.

---

architects, building owners, building operators, fire and building officials, manufacturers and representatives of general interests.

The CCBFC is advised on scope, policy and technical issues pertaining to the Codes by the Provincial/Territorial Policy Advisory Committee on Codes (PTPACC), which is a committee of senior representatives from provincial/territorial ministries responsible for the regulation of buildings, fire safety and plumbing in their jurisdictions. The PTPACC was created by the provinces and territories, with provision of guidance to the CCBFC as one of its main functions. Through the PTPACC and its subcommittees on building, fire and plumbing regulation, the provinces and territories are engaged in every phase of the model code development process.

The Canadian Codes Centre of the National Research Council's Institute for Research in Construction provides technical and administrative support to the CCBFC and its standing committees. The National Research Council publishes the National Model Codes and periodic revisions to the Codes to address pressing issues.

The broader code-user community also makes a significant contribution to the model code development process by submitting requests for changes or additions to the Codes and by commenting on the collected proposed changes during the public consultations that precede each new edition.

The CCBFC takes into consideration the advice received from the provinces and territories as well as code users' comments at each stage of code development. The scope and content of the Model Codes are determined on a consensus basis, which involves the review of technical, policy and practical concerns and debate on the implications of these concerns.

More information on the code development process and guidelines for requesting changes to the National Fire Code are available on the Internet at [www.nationalcodes.ca](http://www.nationalcodes.ca). Printed copies of this information and guidelines may also be requested from the Secretary of the CCBFC, at the address provided at the end of this Preface.

## **Development of the Alberta Safety Codes**

The Safety Codes Act is the legislation under which the Alberta Fire Code is adopted. The Act also provides for the accreditation of organizations, certification and powers of the authority having jurisdiction, enforcement, appeals and penalties. Printed copies of the Safety Codes Act can be obtained from Alberta Queen's Printer on the Internet at [www.qp.gov.ab.ca](http://www.qp.gov.ab.ca) or at the address at the end of this Preface.

Under the authority of the Safety Codes Act, the Safety Codes Council is a statutory corporation that formulates and oversees the development and administration of safety codes and standards in Alberta. The Fire Technical Council is one of ten councils forming the Safety Codes Council.

Based on public review of a proposed new edition of the Alberta Fire Code, the Fire Technical Council established the content of the Code and proposed its adoption to the Minister of Municipal Affairs and Housing as an Alberta Regulation, the Alberta Fire Code 2006.

Under the Safety Codes Act, Alberta adopts the latest edition of the National Fire Code of Canada and makes changes so the resulting document fits the Alberta legislative framework and meets the needs of Albertans.

Guidelines for requesting changes to the Alberta Fire Code are available on the Internet at [www.municipalaffairs.gov.ab.ca/ss\\_index.htm](http://www.municipalaffairs.gov.ab.ca/ss_index.htm). Printed copies of the guidelines may also be requested from Alberta Municipal Affairs and Housing at the address provided at the end of this Preface.

## Code Provisions

Every Alberta Fire Code 2006 provision must address at least one of the Code's three stated objectives, namely:

- safety
- health
- fire protection of buildings and facilities

In dealing with proposed changes or additions to any of the Alberta Safety Codes, the Safety Codes Council considers many issues such as the following:

- Does the proposed provision provide the minimum level of performance—and no more than the minimum—needed to achieve the Code's objectives?
- Will persons responsible for code compliance be able to act on or implement the provision using commonly accepted practices?
- Will enforcement agencies be able to enforce the provision?
- Are the costs of implementing the provision justifiable?
- Have the potential policy implications of the provision been identified and addressed?
- Is there broad consensus on this provision among code users?

## Objective-Based Code Format

The Alberta Fire Code is published in an objective-based code format for the first time in the 2006 edition. This is the result of ten years of work on an initiative that arose out of the strategic plan adopted by the Canadian Commission on Building and Fire Codes (CCBFC) in 1995.

The objective-based code format organizes the Alberta Fire Code 2006 into three Divisions:

- Division A, which defines the scope of the Code and contains the objectives, the functional statements and the conditions necessary to achieve compliance;
- Division B, which contains acceptable solutions (formerly referred to as "technical requirements") deemed to satisfy the objectives and functional statements listed in Division A; and
- Division C, which contains administrative provisions.

A more complete description of this division-based structure is included in the section entitled Structure of Objective-Based Codes.

Apart from the inclusion of changes resulting from the normal code development process, the provisions in Division B are essentially the same as the technical provisions found in the 1997 edition of the Alberta Fire Code. However, in the Alberta Fire Code 2006, most provisions in Division B are linked to:

- one or more objectives (such as safety or health) that individual provisions help to address, and
- one or more functional statements (statements on the functions of the building or facility that a particular provision helps to achieve).

In addition, each Code provision is linked to two new types of explanatory material:

- intent statements (detailed statements on the specific intent of the provision), and
- application statements (detailed statements on what the provision applies to).

## Objectives

The Alberta Fire Code 2006 objectives are fully defined in Section 2.2. of Division A. Most top-level objectives have two levels of sub-objectives.

The objectives describe, in very broad terms, the overall goals that the Alberta Fire Code 2006 provisions are intended to achieve. They serve to define the boundaries of the subject areas the Code addresses. However, the Code does not deal with all the issues that might be considered to fall within those boundaries.

---

The objectives describe undesirable situations and their consequences, which the Code aims to avoid occurring in buildings or facilities. The wording of the definitions of the objectives includes two key phrases: “limit the probability” and “unacceptable risk.” The phrase “limit the probability” is used to acknowledge that the Alberta Fire Code cannot entirely prevent those undesirable situations from happening. The phrase “unacceptable risk” acknowledges that the Alberta Fire Code cannot eliminate all risk: the “acceptable risk” is the risk remaining once compliance with the Code has been achieved.

The objectives are entirely qualitative and are not intended to be used on their own in determining compliance with the Code.

## Functional Statements

The Alberta Fire Code 2006 functional statements are listed in Section 3.2. of Division A.

The functional statements are more detailed than the objectives: they describe conditions in the building or facility that help satisfy the objectives. The functional statements and the objectives are interconnected: there may be several functional statements related to any one objective and a given functional statement may describe a function of the building or facility that serves to achieve more than one objective. There is a table at the end of each Part in Division B listing the sets of functional statements and objectives that have been attributed to provisions or portions of provisions in that Part.

Like objectives, functional statements are entirely qualitative and are not intended to be used on their own in determining compliance with the Code.

## Intent Statements

Intent statements explain, in plain language, the basic thinking behind each Code provision contained in Division B. Each intent statement, which is unique to the provision with which it is associated, explains how that provision helps to achieve its attributed objectives and functional statements. Like the objectives, the intent statements are expressed in terms of risk avoidance. They offer insight into the views of the responsible standing committees on what the Code provisions are intended to achieve.

The intent statements serve explanatory purposes only and do not form an integral part of the Code provisions: as such, they are similar in function to appendix notes. Due to the sheer volume of intent statements—thousands for the Alberta Fire Code 2006 alone—they are only published in the electronic version of the Code.

## Application Statements

Application statements summarize what each Code provision does and does not apply to. They provide greater detail than the application information found in the body of the Code.

The application statements serve explanatory purposes only and do not form an integral part of the Code provisions: as such, they are similar in function to appendix notes. Due to the sheer volume of application statements—thousands for the Alberta Fire Code 2006 alone—they are only published in the electronic version of the Code.

All this additional information—objectives and functional, intent and application statements—is intended to facilitate the implementation of the Code in three ways:

- **Clarity of intent:** The objectives, functional statements and intent statements linked to a Code provision clarify the reasoning behind that provision and facilitate understanding of what must be done to satisfy that provision. This added information may also help avoid disputes between practitioners and officials over these types of issues.
- **Clarity of application:** The application statement of a provision helps clarify whether the provision applies in a given situation.
- **Flexibility:** The additional information allows for flexibility in Code compliance. A person seeking to propose a new method or material not described or covered in the

Code will be able to use the added information to understand the expected level of performance that their alternative solution must achieve to satisfy the Code.

## Structure of Objective-Based Codes

The Alberta Fire Code 2006 is organized into three Divisions.

### Division A: Compliance, Objectives and Functional Statements

Division A defines the scope of the Alberta Fire Code 2006 and presents the objectives that the Code addresses and the functions the building or facility must perform to help to satisfy those objectives.

Division A cannot be used on its own as a basis for operating a building or facility, or for evaluating a building's or facility's compliance with the Code.

### Division B: Acceptable Solutions

The term "requirements," which was used to describe the technical provisions contained in the Alberta Fire Code 1997, has been replaced with the term "acceptable solutions" in the Alberta Fire Code 2006. The change in terminology reflects the principle that fire codes establish an acceptable level of risk and underlines the fact that a code cannot describe all possible valid Code compliance options. The new term provokes the question "To whom are these solutions considered acceptable?" As indicated previously in this Preface, the acceptable solutions represent the minimum level of performance that will satisfy the Alberta Fire Code 2006 objectives and has been adopted by regulation in Alberta.

Division B of the Alberta Fire Code 2006 contains most of the provisions from the Alberta Fire Code 1997, which code users are familiar with, together with the changes and additions resulting from the normal updating process. Compliance with the acceptable solutions is deemed to automatically satisfy the linked Division A objectives and functional statements.

Most provisions in Division B—now acceptable solutions—are linked to at least one objective and functional statement found in Division A. These linkages play an important role in allowing objective-based codes to accommodate innovation.

It is expected that the majority of Code users will primarily follow the acceptable solutions given in Division B and that they will consult Division A only in cases where it may serve to clarify the application of Division B's provisions to a particular situation or when they are considering an alternative solution.

### Division C: Administrative Provisions

Division C includes some new administrative provisions and others formerly found throughout the Alberta Fire Code 1997.

### Relationship between Division A and Division B

Sentence 1.2.1.1.(1) of Division A is a very important new sentence: it is a precise statement of the relationship between Divisions A and B and is central to the concept of objective-based codes.

- 1)** Compliance with this Code shall be achieved by
  - a) complying with the applicable acceptable solutions in Division B (see Appendix A), or
  - b) using alternative solutions that will achieve at least the minimum level of performance required by Division B in the areas defined by the objectives and functional statements attributed to the applicable acceptable solutions (see Appendix A).

Clause (a) makes it clear that the acceptable solutions in Division B are automatically deemed to satisfy the linked objectives and functional statements of Division A.

Clause (b) introduces the new term “alternative solutions,” which echoes the concept of “equivalents” described in the Alberta Fire Code 1997. This Clause makes it clear that alternative solutions can be used in lieu of compliance with the acceptable solutions. However, to do something different from the acceptable solutions described in Division B, a proponent must show that their proposed alternative solution will perform at least as well as the acceptable solution(s) it is replacing. The objectives and functional statements attributed to the acceptable solution(s) identify the areas of performance where this equivalence must be demonstrated.

In Alberta the Safety Codes Act recognizes “alternative solutions” as Variances. The Safety Codes Act has provisions to ensure that Variances are issued by appropriate individuals such as safety codes officers and administrators and registered with the Safety Codes Council. The Safety Codes Council can provide additional information on policy and procedures regarding the issuance of variances.

## **Additional Information**

### **Numbering System**

A consistent numbering system has been used throughout the Alberta Fire Code 2006. The first number indicates the Part of the Code; the second, the Section in the Part; the third, the Subsection; and the fourth, the Article in the Subsection. The detailed provisions are found at the Sentence level (indicated by numbers in brackets), and Sentences may be broken down into Clauses and Subclauses. This structure is illustrated as follows:

3	Part
3.5.	Section
3.5.2.	Subsection
3.5.2.1.	Article
3.5.2.1.(2)	Sentence
3.5.2.1.(2)(a)	Clause
3.5.2.1.(2)(a)(i)	Subclause

### **Change Indication**

Where a technical change or addition has been made relative to the 1995 edition of the National Fire Code, a vertical line has been added in the margin next to the affected provision. A heavy vertical line in the margin indicates an addition or amendment to the National Fire Code 2005 at the time it was adopted in Alberta as the Alberta Fire Code 2006. No change indication has been provided in cases where provisions have been renumbered or deleted.

### **Metric Conversion**

All values in the Alberta Fire Code 2006 are given in metric units. A conversion table of imperial equivalents for the most common units used in building design and construction is located at the end of the Code.

## **Commercial Rights to Reproduce the Alberta Fire Code**

Portions of the Alberta Fire Code copyright 2005 National Research Council of Canada (NRC). Portions of the Alberta Fire Code copyright 2006 Minister of Alberta Municipal Affairs and Housing. All rights are reserved.

---

While copyright in a portion of the Alberta Fire Code is held by NRC, the provisions of the Alberta Fire Code are developed by the Minister of Alberta Municipal Affairs and Housing pursuant to the Safety Codes Act (R.S.A. 2000, ch. S-1). NRC makes no representation, warranties or conditions, statutory or otherwise, as to the accuracy or completeness of its copyright material, the copyright material of others that is included in the Alberta Fire Code, or the suitability of any of the published material for any user's requirements.

Reproduction by any means of this copyright material is prohibited without the written consent of NRC. Request for permission to reproduce the Alberta Fire Code must be sent to [codes@nrc-cnrc.gc.ca](mailto:codes@nrc-cnrc.gc.ca), or to the following address:

Manager  
Codes Production and Marketing  
Institute for Research in Construction  
National Research Council of Canada  
Ottawa, Ontario K1A 0R6

## Revisions, Errata and Bulletins

From time to time, Alberta Municipal Affairs and Housing and the Safety Codes Council issue revisions, errata or bulletins for the Alberta Fire Code.

Errata are corrections that have been identified and are issued to facilitate correct use of the Code.

Revisions are changes to the Code that are implemented after publication. They are brought into force through a Fire Code Amendment Regulation made pursuant to the Safety Codes Act.

Bulletins are known as STANDATA and come in three formats: Fire Code Variances, Fire Code Interpretations and Fire Code Bulletins.

Persons interested in receiving automatic e-mail notification of revisions, errata or bulletins can subscribe to a list server at [www.municipalaffairs.gov.ab.ca/ss\\_ss-standata.htm](http://www.municipalaffairs.gov.ab.ca/ss_ss-standata.htm).

## Contact Information

The CCBFC, Alberta Municipal Affairs and Housing, and the Safety Codes Council welcome comments and suggestions for improvements to the National and Alberta Fire Codes.

Persons interested in requesting a change to a technical provision of the NFC should refer to the guidelines available on the Internet at [www.nationalcodes.ca](http://www.nationalcodes.ca), where additional information is also presented.

Persons interested in requesting a change to a technical provision of the Alberta Fire Code should refer to the guidelines available on the Internet at [www.municipalaffairs.gov.ab.ca/ss\\_index.htm](http://www.municipalaffairs.gov.ab.ca/ss_index.htm).

Comments, suggestions and requests for printed copies of Code change guidelines referred to in this Preface should be sent to the CCBFC or Alberta Municipal Affairs and Housing at:

The Secretary  
Canadian Commission on Building and Fire Codes  
Institute for Research in Construction  
National Research Council of Canada  
Ottawa, Ontario K1A 0R6

or

Chief Fire Administrator  
Alberta Municipal Affairs and Housing  
16th Floor, Commerce Place  
10155 - 102 Street  
Edmonton, Alberta T5J 4L4

---

Phone: 1-866-421-6929 (within Canada)  
1-780-644-1010 (outside Canada)  
Fax: 1-780-427-8686  
E-mail: [safety.services@gov.ab.ca](mailto:safety.services@gov.ab.ca)  
Web: [www.municipalaffairs.gov.ab.ca/ss\\_index.htm](http://www.municipalaffairs.gov.ab.ca/ss_index.htm)

Requests to purchase printed copies of the Safety Codes Act and its regulations should be sent to the Alberta Queen's Printer at:

Alberta Queen's Printer  
Main Floor, Park Plaza  
10611 - 98 Avenue  
Edmonton, Alberta T5K 2P7  
Phone: 1-780-427-4952  
Fax: 1-780-452-0668  
Web: [www.qp.gov.ab.ca/index.cfm](http://www.qp.gov.ab.ca/index.cfm)



---

# Relationship of the Alberta Fire Code 2006 to Standards Development and Conformity Assessment

The development of many provisions in the National Fire Code and the Alberta Fire Code and the assessment of conformity to those provisions are supported by several of the member organizations of Canada's National Standards System (NSS).

The NSS is a federation of accredited organizations concerned with standards development, certification, testing, inspection, personnel and management systems registration that is established under the auspices of the Standards Council of Canada Act. Activities of the NSS are coordinated by the Standards Council of Canada (SCC), which has accredited 4 standards development organizations, 27 certification organizations, 21 registration organizations, and almost 400 calibration and testing laboratories.

The SCC is a federal non-profit Crown corporation responsible for the coordination of voluntary standardization in Canada. It also has responsibilities for Canada's activities in voluntary international standardization.

## Canadian Standards

The Alberta Fire Code 2006 contains many references to standards published by accredited standards development organizations in Canada. As part of the accreditation requirements, these organizations adhere to the principles of consensus. This generally means substantial majority agreement of a committee comprising a balance of producer, user and general interest members, and the consideration of all negative comments. The organizations also have formal procedures for the second-level review of the technical preparation and balloting of standards prepared under their auspices. (The Canadian Commission on Building and Fire Codes follows these same principles of consensus in the operation of its code development process.) The following organizations are accredited as standards development organizations in Canada:

- Bureau de normalisation du Québec (BNQ)
- Canadian General Standards Board (CGSB)
- Canadian Standards Association (CSA)
- Underwriters' Laboratories of Canada (ULC)

Table 1.3.1.2. of Division B lists the standards referenced in the Alberta Fire Code 2006. Standards proposed to be referenced in the Alberta Fire Code 2006 are reviewed to ensure their contents are compatible with the Code. Thereafter, referenced standards are reviewed several times during each Code cycle. Standards development organizations are asked to provide information on any changes in the status of their standards referenced in the Alberta Fire Code 2006—withdrawals, amendments, new editions, etc. This information is passed on to the CCBFC, its standing committees, the Safety Codes Council, and interested stakeholders on particular issues, all of whom are given the opportunity to identify any problems associated with the changes. These bodies do not necessarily review in detail the revised standards; rather, the approach relies on the consensus process involved in the maintenance of the standards and on the extensive knowledge and backgrounds of committee members, provincial or territorial staff, NRC staff, and consulted stakeholders to identify changes in the standards that might create problems in the Code.

---

## Non-Canadian Standards

A number of subject areas for which the Canadian standards development organizations have not developed standards are covered in the Alberta Fire Code 2006. In these cases, the Code often makes reference to standards developed by organizations in other countries, such as the American Society for Testing and Materials (ASTM) and the National Fire Protection Association (NFPA). These standards are developed using processes that may differ from those used by the Canadian standards development organizations; nevertheless, these standards have been reviewed by the relevant standing committees and found to be acceptable.

## Conformity Assessment

The Alberta Fire Code 2006 establishes minimum measures, either within its own text or that of referenced standards. However, the Alberta Fire Code 2006 does not deal with the question of who is responsible for assessing conformity to the measures or how those with this responsibility might carry it out. In Alberta the responsibility for conformity assessment is established through the Safety Codes Act.

Those persons responsible for ensuring that a material, appliance, system or equipment meets the performance requirements of this Code have several means available to assist them. These means vary from on-site inspection to the use of certification services provided by accredited third-party organizations. Test reports or mill certificates provided by manufacturers or suppliers can also assist in the acceptance of products. Engineering reports may be required for more complex products.

### Testing

The accreditation programs of the SCC include one for testing and calibration laboratories. Almost 400 organizations are accredited, with 68 accredited as capable of reliably testing building products to specified standards. The test results produced by these organizations can be used in the evaluation, qualification and certification of building products to Code provisions.

### Certification

Certification is the confirmation by an independent organization that a product or service meets a requirement. Certification of a product, process, or system entails physical examination, testing as specified in the appropriate standards, plant examination, and follow-up unannounced plant inspections. This procedure leads to the issuing of a formal assurance or declaration, by means of a certification mark or certificate, that the product, process or system is in full conformity with specified provisions.

In some cases, a product for which no standard exists can be certified using procedures and criteria developed by the accredited certifying organization and specifically designed to measure the performance of that product.

A complete list of accredited certification bodies can be found on SCC's Web site at [www.scc.ca](http://www.scc.ca). Certification bodies publish lists of certified products and companies.

### Registration

Quality Registration Organizations assess a company's conformance to quality assurance standards like the International Organization for Standardization ISO 9000.

### Evaluation

An evaluation is a written opinion by an independent professional organization that a product will perform its intended function in a building. An evaluation is very often done to determine the ability of an innovative product, for which no standards exist, to satisfy

---

the intent of a Code requirement. Follow-up plant inspections are not normally part of the evaluation process. Several organizations, including the Canadian Construction Materials Centre (CCMC), offer such evaluation services.

### **Qualification**

The qualification of products also evaluates the ability of a product to perform its intended function by verifying that it meets the requirements of a standard. Qualification normally includes some follow-up plant inspection. Some organizations publish lists of qualified products that meet the specified requirements. Some organizations qualify manufacturing and/or testing facilities for products for compliance with the Code and relevant standards.



# Alberta Fire Technical Council Members

## Fire Technical Council

Ron Robinson, Chair <sup>(1)</sup>	- Alberta Urban Municipalities Association	Keven Lefebvre	- Electrical Contractors Association of Alberta
Dick Veldhuis, Chair <sup>(2)</sup>	- City of Calgary/City of Edmonton	Jeff Light	- Electrical Contractors Association of Alberta
Les McMillan, Chair <sup>(3)</sup>	- City of Calgary/City of Edmonton	Brian McEvoy	- Alberta Fire Chiefs Association
Loyd Bacon	- Canadian Petroleum Products Institute	Keith Metcalfe	- Public Representative
Lyle Birnie	- Alberta Urban Municipalities Association	Kelly Morris	- Electrical Contractors Association of Alberta
Randy Brown	- Building Owners & Managers Association	Michael (Todd) Nixon	- Alberta Fire Fighters Association
Ray Caouette	- Alberta Fire Safety Association	Gilles Proulx	- Insurers' Advisory Organization Inc.
Michael Cham	- Alberta Association of Architects	Doug Rowan	- Building Owners & Managers Association
Ben Chan	- Electrical Contractors Association of Alberta	Larry Spiess	- Alberta Building Officials Association
Russ Clark	- Association of Professional Engineers, Geologists, and Geophysicists of Alberta	Ian Sterling	- City of Calgary/City of Edmonton
Barry Colledge	- Association of Professional Engineers, Geologists, and Geophysicists of Alberta	Larry Tebb	- Alberta Fire Chiefs Association
Steve Coolidge	- Insurers' Advisory Organization Inc.	Steve Walton	- Building Owners & Managers Association
Ron Foxcroft	- Alberta Fire Safety Association		
Zed Freudenreich	- Alberta Association of Architects		
Pat Hanlon	- Alberta Fire Safety Association		
Dave Harrison	- Canadian Petroleum Products Institute		
Chris Hill <sup>(4)</sup>	- Building Owners & Managers Association		
Dale Kelly	- Alberta Building Officials Association		
Ken Knox	- Alberta Fire Fighters Association		

## Technical Support

Chris Tye	- Administrator, MA&H
Ray Cox	- Technical Advisor, MA&H
Ray Ligenza	- Technical Advisor, MA&H

- 
- (1) September 2005 to present  
 (2) May 2002 to December 2004  
 (3) June 1993 to February 2002  
 (4) Deceased





## **Division A**

# **Compliance, Objectives and Functional Statements**



# Part 1

## Compliance

<b>1.1.</b>	<b>General</b>	
1.1.1.	Application of this Code .....	1- 1
<b>1.2.</b>	<b>Compliance</b>	
1.2.1.	Compliance with this Code .....	1- 1
<b>1.3.</b>	<b>Divisions A, B and C of this Code</b>	
1.3.1.	General .....	1- 1
1.3.2.	Application of Division A .....	1- 2
1.3.3.	Application of Division B .....	1- 2
1.3.4.	Application of Division C .....	1- 2
<b>1.4.</b>	<b>Terms and Abbreviations</b>	
1.4.1.	Definitions of Words and Phrases .....	1- 2
1.4.2.	Symbols and Other Abbreviations .....	1- 8
<b>1.5.</b>	<b>Referenced Documents and Organizations</b>	
1.5.1.	Referenced Documents .....	1- 9
1.5.2.	Organizations .....	1- 9



# **Part 1 Compliance**

## **Section 1.1. General**

### **1.1.1. Application of this Code**

#### **1.1.1.1. Application of this Code**

**1)** This Code applies to all new and existing *buildings* and facilities, and to *building* construction, renovation or demolition sites. (See Appendix A.)

## **Section 1.2. Compliance**

### **1.2.1. Compliance with this Code**

#### **1.2.1.1. Compliance with this Code**

- 1)** Compliance with this Code shall be achieved by
- a) complying with the applicable acceptable solutions in Division B (see Appendix A), or
  - b) using alternative solutions that will achieve at least the minimum level of performance required by Division B in the areas defined by the objectives and functional statements attributed to the applicable acceptable solutions (see Appendix A).

**2)** For the purposes of compliance with this Code as required in Clause 1.2.1.1.(1)(b), the objectives and functional statements attributed to the acceptable solutions in Division B shall be the objectives and functional statements referred to in Subsection 1.1.2. of Division B.

## **Section 1.3. Divisions A, B and C of this Code**

### **1.3.1. General**

#### **1.3.1.1. Scope of Division A**

**1)** Division A contains the compliance and application provisions, objectives and functional statements of this Code.

#### **1.3.1.2. Scope of Division B**

**1)** Division B contains the acceptable solutions of this Code.

#### **1.3.1.3. Scope of Division C**

**1)** Division C contains the administrative provisions of this Code.

#### **1.3.1.4. Internal Cross-references**

**1)** Where the Division of a referenced provision is not specified in this Code, it shall mean that the referenced provision is in the same Division as the referencing provision.

**1.3.2.1.****1.3.2. Application of Division A****1.3.2.1. Application of Parts 1, 2 and 3**

1) Parts 1, 2 and 3 of Division A apply to all *buildings* and facilities covered in this Code. (See Article 1.1.1.1.)

**1.3.3. Application of Division B****1.3.3.1. Application of Parts 1 to 6**

1) Parts 1 to 6 of Division B apply to all *buildings* and facilities covered in this Code. (See Article 1.1.1.1.)

**1.3.3.2. Application of Part 7**

1) Part 7 of Division B applies to high *buildings* as defined in the Alberta Building Code 2006.

**1.3.4. Application of Division C****1.3.4.1. Application of Parts 1 and 2**

1) Parts 1 and 2 of Division C apply to all *buildings* and facilities covered in this Code. (See Article 1.1.1.1.)

**Section 1.4. Terms and Abbreviations****1.4.1. Definitions of Words and Phrases****1.4.1.1. Non-defined Terms**

1) Words and phrases used in this Code that are not included in the list of definitions in Article 1.4.1.2. shall have the meanings defined in the Safety Codes Act, Alberta Building Code 2006, and National Plumbing Code 2005, or that are commonly assigned to them in the context in which they are used, taking into account the specialized use of terms by the various trades and professions to which the terminology applies.

2) Where objectives and functional statements are referred to in this Code, they shall be the objectives and functional statements described in Parts 2 and 3.

3) Where acceptable solutions are referred to in this Code, they shall be the provisions stated in Parts 2 to 7 of Division B.

4) Where alternative solutions are referred to in this Code, they shall be the alternative solutions mentioned in Clause 1.2.1.1.(1)(b).

5) For words not defined in this Code, the Safety Codes Act, Alberta Building Code 2006, or National Plumbing Code 2005, reference should be made to the Canadian Oxford Dictionary (Second Edition), published by Oxford University Press.

**1.4.1.2. Defined Terms**

1) The words and terms in italics in this Code shall have the following meanings:

*Access to exit* means that part of a *means of egress* within a *floor area* that provides access to an *exit* serving the *floor area*.

*Air-supported structure* means a structure consisting of a pliable membrane that achieves and maintains its shape and support by internal air pressure.

*Appliance* means a device to convert fuel into energy and includes all components, controls, wiring and piping required to be part of the device by the applicable standard referred to in this Code.

*Approved* means acceptable to the *Chief Fire Administrator*.

*Assembly occupancy* (Group A) means the *occupancy* or the use of a *building*, or part thereof, by a gathering of persons for civic, political, travel, religious, social, educational, recreational or like purposes, or for the consumption of food or drink.

*Atmospheric storage tank* means a *storage tank* designed to operate at pressures from atmospheric to 3.5 kPa (gauge).

*Authority having jurisdiction* means a safety codes officer in the fire discipline exercising authority pursuant to designation of powers and terms of employment in accordance with the Safety Codes Act. (See Appendix A.)

*Basement* means a *storey* or *storeys* of a *building* located below the *first storey*.

*Breeching* means a *flue pipe* or chamber for receiving *flue* gases from one or more *flue* connections and for discharging these gases through a single *flue* connection.

*Building* means any structure used or intended for supporting or sheltering any use or *occupancy*.

*Business and personal services occupancy* (Group D) means the *occupancy* or use of a *building* or part thereof for the transaction of business or the rendering or receiving of professional or personal services.

*Cardlock installation* means a *self-service outlet* that is equipped with card, key or similar activation method dispensing devices that

- do not display the price of the fuel being dispensed, and
- are for the exclusive use of persons who are under contract with a supplier.

*Care or detention occupancy* (Group B) means the *occupancy* or use of a *building* or part thereof by persons who require special care or treatment because of cognitive or physical limitations or by persons who are restrained from, or are incapable of, self-preservation because of security measures not under their control.

*Cathodic protection or cathodically protected* means a method of preventing corrosion to a metal surface by introducing another metal (anode) into the ground to create a corrosion cell in which the surface to be protected becomes a cathode. Deterioration or corrosion occurs at the anode (introduced metal). The cathodic protection may be of a sacrificial type or of an impressed current design.

*Chief Fire Administrator* means a person in the fire discipline appointed as an Administrator under the Safety Codes Act.

*Chimney* means a primarily vertical shaft enclosing at least one *flue* for conducting *flue* gases to the outdoors.

*Class A fire* means a fire involving combustible materials such as wood, cloth and paper.

*Class B fire* means a fire involving a *flammable liquid* or *combustible liquid*, fat or grease.

*Class C fire* means a fire involving energized electrical equipment.

*Class D fire* means a fire involving a combustible metal.

*Closed container* means a container sealed by means of a lid or other device such that neither liquid nor vapour will escape from it at ordinary temperatures.

*Closure* means a device or assembly for closing an opening through a *fire separation* or an exterior wall, such as a door, a shutter, wired glass or glass block, and includes all components such as hardware, closing devices, frames and anchors.

*Combustible construction* means that type of construction that does not meet the requirements for *noncombustible construction*.

*Combustible dusts* means dusts and particles that are ignitable and liable to produce an explosion.

*Combustible fibres* means finely divided, combustible vegetable or animal fibres and thin sheets or flakes of such materials which, in a loose, unbaled condition, present a flash fire hazard, including cotton, wool, hemp, sisal, jute, kapok, paper and cloth.

*Combustible liquid* means a liquid having a *flash point* at or above 37.8°C and below 93.3°C. (See Subsection 4.1.2. of Division B.)

*Dangerous goods* means those products or substances that are regulated by the "Transportation of Dangerous Goods Act" and its Regulations. (See Table 3.2.7.1. of Division B.)

*Distilled beverage alcohol* means a beverage that is produced by fermentation and contains more than 20% by volume of water-miscible alcohol.

*Distillery* means a *process plant* where *distilled beverage alcohols* are produced, concentrated or otherwise processed, and includes facilities on the same site where the concentrated products may be blended, mixed, stored or packaged.

*Dwelling unit* means a *suite* operated as a housekeeping unit, used or intended to be used by one or more persons and usually containing cooking, eating, living, sleeping and sanitary facilities.

*Exit* means that part of a *means of egress*, including doorways, that leads from the *floor area* it serves to a separate *building*, an open public thoroughfare, or an exterior open space protected from fire exposure from the *building* and having access to an open public thoroughfare. (See Appendix A.)

*Fire brigade* means an organized body at an *industrial occupancy* or institutional occupancy which has been assigned responsibility for fire protection by the employer.

*Fire compartment* means an enclosed space in a *building* that is separated from all other parts of the *building* by enclosing construction providing a *fire separation* having a required *fire-resistance rating*.

*Firecracker* means any device that explodes instantaneously when ignited and does not produce any subsequent display or visible effect after the explosion and, without restricting the generality of the foregoing, includes those devices commonly known as Chinese firecrackers, but does not include paper caps containing not more than 16.2 mg (1/4 grain) of explosive per cap or devices to be used with the paper caps.

*Fire damper* means a *closure* consisting of a damper that is installed in an air distribution system or a wall or floor assembly and that is normally held open but designed to close automatically in the event of a fire in order to maintain the integrity of the *fire separation*.

*Fire-protection rating* means the time in minutes or hours that a *closure* will withstand the passage of flame when exposed to fire under specified conditions of test and performance criteria, or as otherwise prescribed in the Alberta Building Code 2006.

*Fire-resistance rating* means the time in minutes or hours that a material or assembly of materials will withstand the passage of flame and the transmission of heat when exposed to fire under specified conditions of test and performance criteria, or as determined by extension or interpretation of information derived therefrom as prescribed in the Alberta Building Code 2006. (See Appendix A.)

*Fire separation* means a construction assembly that acts as a barrier against the spread of fire. (See Appendix A.)

*Fire stop flap* means a device intended for use in horizontal assemblies required to have a *fire-resistance rating* and incorporating protective ceiling membranes that operates to close off a duct opening through the membrane in the event of a fire.

*Firewall* means a type of *fire separation* of *noncombustible construction* that subdivides a *building* or separates adjoining *buildings* to resist the spread of fire and that has a *fire-resistance rating* as prescribed in this Code and has structural stability to remain intact under fire conditions for the required fire-rated time.

*Fireworks* means the fireworks listed in Class 7, Division 1, and Class 7, Division 2, Subdivisions 1 and 2 in Section 14 of the Explosives Act (Canada) and regulations under the Act.

*First storey* means the uppermost *storey* having its floor level not more than 2 m above grade.

*Flame-spread rating* means an index or classification indicating the extent of spread-of-flame on the surface of a material or an assembly of materials as determined in a standard fire test as prescribed in the Alberta Building Code 2006.

- Flammable liquid* means a liquid having a *flash point* below 37.8°C and having a vapour pressure not more than 275.8 kPa (absolute) at 37.8°C as determined by ASTM D 323, "Vapor Pressure of Petroleum Products (Reid Method)." (See Subsection 4.1.2. of Division B.)
- Flash point* means the minimum temperature at which a liquid within a container gives off vapour in sufficient concentration to form an ignitable mixture with air near the surface of the liquid. (See Subsection 4.1.3. of Division B.)
- Floor area* means the space on any *storey* of a *building* between exterior walls and required *firewalls*, including the space occupied by interior walls and *partitions*, but not including *exits*, *vertical service spaces*, and their enclosing assemblies.
- Flue* means an enclosed passageway for conveying *flue* gases.
- Flue collar* means the portion of a fuel-fired *appliance* designed for the attachment of the *flue pipe* or *breeching*.
- Flue pipe* means the pipe connecting the *flue collar* of an *appliance* to a *chimney*.
- Forest officer* means a person appointed as a *forest officer* pursuant to Section 2 of the Forests Act.
- Fuel-dispensing station* means any premises or part thereof at which *flammable liquids* or *combustible liquids* are dispensed from fixed equipment into the fuel tanks of motor vehicles, watercraft or aircraft.
- High-hazard fireworks* means fireworks listed in Class 7, Division 2, Subdivision 2 in Section 14 of the Explosives Act (Canada) and its Regulations.
- High-hazard industrial occupancy* (Group F, Division 1) means an *industrial occupancy* containing sufficient quantities of highly combustible and flammable or explosive materials which, because of their inherent characteristics, constitute a special fire hazard.
- Individual storage area* means the area occupied by piles, bin boxes, *racks* or shelves, including subsidiary aisles providing access to the stored products, and separated from adjacent storage by aisles not less than 2.4 m in width. (See Appendix A.)
- Industrial occupancy* (Group F) means the *occupancy* or use of a *building* or part thereof for the assembling, fabricating, manufacturing, processing, repairing or storing of goods and materials.
- Interconnected floor space* means superimposed *floor areas* or parts of *floor areas* in which floor assemblies that are required to be *fire separations* are penetrated by openings that are not provided with *closures*.
- Labelled* means equipment or materials to which has been attached a label, symbol or other identifying mark indicating that it has been manufactured under a certification programme administered by an accredited Certification Organization or Standards Writing Organization under the National Standards System of Canada.
- Listed* means equipment or materials included in a list published by an accredited Certification Organization or Standards Writing Organization under the National Standards System of Canada.
- Low-hazard fireworks* means fireworks listed in Class 7, Division 2, Subdivision 1 in Section 14 of the Explosives Act (Canada) and regulations under the Act.
- Low-hazard industrial occupancy* (Group F, Division 3) means an *industrial occupancy* in which the combustible content is not more than 50 kg/m<sup>2</sup> or 1200 MJ/m<sup>2</sup> of *floor area*.
- Low pressure storage tank* means a *storage tank* designed to operate at pressures greater than 3.5 kPa (gauge) and up to 100 kPa (gauge).
- Lower explosive limit* means the minimum concentration of vapour in air at which the propagation of flame occurs on contact with a source of ignition.
- Major occupancy* means the principal *occupancy* for which a *building* or part thereof is used or intended to be used, and shall be deemed to include the subsidiary

*occupancies* that are an integral part of the principal *occupancy*. The *major occupancy* classifications used in this Code are as follows:

- A1 – *Assembly occupancies* intended for the production and viewing of the performing arts
- A2 – *Assembly occupancies* not elsewhere classified in Group A
- A3 – *Assembly occupancies* of the arena type
- A4 – *Assembly occupancies* in which the occupants are gathered in the open air
- B1 – *Care or detention occupancies* in which persons are under restraint or are incapable of self-preservation because of security measures not under their control
- B2 – *Care or detention occupancies* in which persons having cognitive or physical limitations require special care or treatment
- C – *Residential occupancies*
- D – *Business and personal services occupancies*
- E – *Mercantile occupancies*
- F1 – *High-hazard industrial occupancies*
- F2 – *Medium-hazard industrial occupancies*
- F3 – *Low-hazard industrial occupancies*

*Marine fuel-dispensing station* means a *fuel-dispensing station* at which *flammable liquids* or *combustible liquids* are dispensed into the fuel tanks of watercraft or aircraft.

*Means of egress* means a continuous path of travel provided for the escape of persons from any point in a *building* or contained open space to a separate *building*, an open public thoroughfare, or an exterior open space protected from fire exposure from the *building* and having access to an open public thoroughfare. *Means of egress* includes *exits* and *access to exits*.

*Medium-hazard industrial occupancy* (Group F, Division 2) means an *industrial occupancy* in which the combustible content is more than 50 kg/m<sup>2</sup> or 1200 MJ/m<sup>2</sup> of *floor area* and not classified as a *high-hazard industrial occupancy*.

*Mercantile occupancy* (Group E) means the *occupancy* or use of a *building* or part thereof for the displaying or selling of retail goods, wares or merchandise.

*Noncombustible construction* means that type of construction in which a degree of fire safety is attained by the use of noncombustible materials for structural members and other *building* assemblies.

*Occupancy* means the use or intended use of a *building* or part thereof for the shelter or support of persons, animals or property.

*Occupant load* means the maximum number of persons that may occupy a *building* or an area of a *building* at one time.

*Overfill protection device* means a device or combination of components that is installed in a *storage tank*, fill tube or vent that prevents a *storage tank* from being overfilled when product is being delivered to the *storage tank*.

*Owner* means a lessee, a person in charge, a person who has care and control and a person who holds out that the person has the powers and authority of ownership or who for the time being exercises the powers and authority of ownership.

*Oxidizing substance* means a product or substance that causes or contributes to the combustion of other material by yielding oxygen or other *oxidizing substances*, whether or not the product is itself combustible.

*Partition* means an interior wall 1 *storey* or part-*storey* in height that is not loadbearing.

*Pressure vessel* means a *storage tank* designed to operate at pressures greater than 100 kPa (gauge).

*Process plant* means an *industrial occupancy* where materials, including *flammable liquids*, *combustible liquids* or Class 2 gases, are produced or used in a process. (See Table 3.2.7.1. of Division B.)

*Rack* means any combination of vertical, horizontal or diagonal members that support stored materials on solid or open shelves, including both fixed and portable units.

*Refinery* means any *process plant* in which *flammable liquids* or *combustible liquids* are produced from crude petroleum, including areas on the same site where the resulting products are blended, packaged or stored on a commercial scale.

*Residential occupancy* (Group C) means the *occupancy* or use of a *building* or part thereof by persons for whom sleeping accommodation is provided but who are not harboured or detained to receive medical care or treatment or are not involuntarily detained.

*Secondary containment* means containment that prevents any materials spilled or leaked from the primary *storage tank system* from reaching the land or water outside the containment area before cleanup occurs and includes double-walled *storage tank systems* and impermeable membranes or liners.

*Secondary suite* means a second self-contained *dwelling unit* that is located within a primary *dwelling unit*, where both *dwelling units* are registered under the same land title. (See Appendix A.)

*Self-service outlet* means a *fuel-dispensing station* other than a *marine fuel-dispensing station* where the public handles the dispenser.

*Service room* means a room provided in a *building* to contain equipment associated with *building services*. (See Appendix A.)

*Service space* means space provided in a *building* to facilitate or conceal the installation of *building service facilities* such as chutes, ducts, pipes, shafts or wires.

*Smoke alarm* means a combined smoke detector and audible alarm device designed to sound an alarm within the room or *suite* in which it is located upon the detection of smoke within that room or *suite*.

*Spill containment device* means a liquid-tight container fitted to the fill inlet of a *storage tank* which is intended to catch, retain and drain any product spilled at the time of filling.

*Sprinklered* (as applying to a *building* or part thereof) means that the *building* or part thereof is equipped with a system of automatic sprinklers.

*Storage garage* means a *building* or part thereof intended for the storage or parking of motor vehicles and which contains no provision for the repair or servicing of such vehicles.

*Storage tank* means a vessel for *flammable liquids* or *combustible liquids* having a capacity of more than 230 L, and designed to be installed in a fixed location.

*Storage tank system* means a system for the storage and dispensing of *flammable liquids* and *combustible liquids* and is not limited to *storage tanks*, associated piping, vents, pumps, and dispensing equipment.

*Storey* means that portion of a *building* situated between the top of any floor and the top of the floor next above it, and if there is no floor above it, that portion between the top of such floor and the ceiling above it.

*Street* means any highway, road, boulevard, square or other improved thoroughfare 9 m or more in width, that has been dedicated or deeded for public use and is accessible to fire department vehicles and equipment.

*Suite* means a single room or series of rooms of complementary use, operated under a single tenancy, and includes *dwelling units*, individual guest rooms in motels, hotels, boarding houses, rooming houses and dormitories as well as individual stores and individual or complementary rooms for *assembly, business and personal services occupancies*, and *medium- and low-hazard industrial occupancies*. (See Appendix A.)

*Supervisory staff* means those occupants of a *building* who have some delegated responsibility for the fire safety of other occupants under the fire safety plan.

*Tank vehicle* means any vehicle, other than railroad tank cars and boats, with a cargo tank having a capacity of more than 450 L, mounted or built as an integral part of

the vehicle and used for the transportation of *flammable liquids* or *combustible liquids* and including tank trucks, trailers and semi-trailers.

*Underground storage tank system* means a system for storing and dispensing *flammable liquids* or *combustible liquids* including one or more *storage tanks*, installed at least partially underground, and all piping, pumps and dispensing equipment connected to the system.

*Unstable liquid* means a liquid, including *flammable liquids* and *combustible liquids*, that is chemically reactive to the extent that it will vigorously react or decompose at or near normal temperature and pressure conditions or that is chemically unstable when subject to impact.

*Vertical service space* means a shaft oriented essentially vertically that is provided in a *building* to facilitate the installation of *building* services including mechanical, electrical and plumbing installations and facilities such as elevators, refuse chutes and linen chutes.

## 1.4.2. Symbols and Other Abbreviations

### 1.4.2.1. Symbols and Other Abbreviations

**1)** The symbols and other abbreviations in this Code shall have the meanings assigned to them in this Article and Article 1.3.2.1. of Division B.

cm .....	centimetre(s)
°C .....	degree(s) Celsius
h .....	hour(s)
kg .....	kilogram(s)
kPa .....	kilopascal(s)
L .....	litre(s)
m .....	metre(s)
max. ....	maximum
min. ....	minimum
min .....	minute(s)
MJ .....	megajoule(s)
mL .....	millilitre(s)
mm .....	millimetre(s)
mm <sup>2</sup> /s .....	centistoke(s)
n/a .....	not applicable
No. ....	number(s)
pS/m .....	pico Siemens per metre
s .....	second(s)
> .....	greater than
≤ .....	less than or equal to
% .....	per cent

## **Section 1.5. Referenced Documents and Organizations**

### **1.5.1. Referenced Documents**

#### **1.5.1.1. Application of Referenced Documents**

- 1)** The provisions of documents referenced in this Code, and of any documents referenced within those documents, apply only to the extent that they relate to
  - a) *buildings* and facilities, and
  - b) the objectives and functional statements attributed to the applicable acceptable solutions in Division B where the documents are referenced.(See Appendix A.)

#### **1.5.1.2. Conflicting Requirements**

- 1)** In case of conflict between the provisions of this Code and those of a referenced document, the provisions of this Code shall govern.

#### **1.5.1.3. Applicable Editions**

- 1)** Where documents are referenced in this Code, they shall be the editions designated in Subsection 1.3.1. of Division B.

### **1.5.2. Organizations**

#### **1.5.2.1. Abbreviations of Proper Names**

- 1)** The abbreviations of proper names in this Code shall have the meanings assigned to them in Article 1.3.2.1. of Division B.



# **Part 2**

## **Objectives**

<b>2.1.</b>	<b>Application</b>	
2.1.1.	Application .....	2- 1
<b>2.2.</b>	<b>Objectives</b>	
2.2.1.	Objectives .....	2- 1



## **Part 2 Objectives**

### **Section 2.1. Application**

#### **2.1.1. Application**

##### **2.1.1.1. Application**

**1)** This Part applies to all *buildings* and facilities covered in this Code. (See Article 1.1.1.1.)

##### **2.1.1.2. Application of Objectives**

- 1)** The objectives described in this Part apply
- a) to all *buildings* and facilities covered in this Code (see Article 1.1.1.1.), and
  - b) only to the extent that they relate to compliance with this Code as required in Article 1.2.1.1.

### **Section 2.2. Objectives**

#### **2.2.1. Objectives**

##### **2.2.1.1. Objectives**

**1)** The objectives of this Code are as follows (see Appendix A):

**OS Safety**

An objective of this Code is to limit the probability that, as a result of specific circumstances related to the *building* or facility, a person in or adjacent to the *building* or facility will be exposed to an unacceptable risk of injury.

**OS1 Fire Safety**

An objective of this Code is to limit the probability that, as a result of

- (a) activities related to the construction, use or demolition of the *building* or facility,
- (b) the condition of specific elements of the *building* or facility,
- (c) the design or construction of specific elements of the facility related to certain hazards, or
- (d) inadequate built-in protection measures for the current or intended use of the *building*,

a person in or adjacent to the *building* or facility will be exposed to an unacceptable risk of injury due to fire. The risks of injury due to fire addressed in this Code are those caused by—

- OS1.1 – fire or explosion occurring
- OS1.2 – fire or explosion impacting areas beyond its point of origin
- OS1.3 – collapse of physical elements due to a fire or explosion
- OS1.4 – fire safety systems failing to function as expected
- OS1.5 – persons being delayed in or impeded from moving to a safe place during a fire emergency

**OS3 Safety in Use**

An objective of this Code is to limit the probability that, as a result of

- (a) activities related to the construction, use or demolition of the *building* or facility,
- (b) the condition of specific elements of the *building* or facility,
- (c) the design or construction of specific elements of the facility related to certain hazards, or
- (d) inadequate built-in protection measures for the current or intended use of the *building*,

a person in or adjacent to the *building* or facility will be exposed to an unacceptable risk of injury due to hazards. The risks of injury due to hazards addressed in this Code are those caused by—

- OS3.1 – tripping, slipping, falling, contact, drowning or collision
- OS3.2 – contact with hot surfaces or substances
- OS3.3 – contact with energized equipment
- OS3.4 – exposure to hazardous substances
- OS3.7 – persons being delayed in or impeded from moving to a safe place during an emergency (see Appendix A)

**OH Health**

An objective of this Code is to limit the probability that, as a result of specific circumstances related to the *building* or facility, a person will be exposed to an unacceptable risk of illness.

**OH5 Hazardous Substances Containment**

An objective of this Code is to limit the probability that, as a result of

- (a) activities related to the construction, use or demolition of the *building* or facility,
- (b) the condition of specific elements of the *building* or facility,
- (c) the design or construction of specific elements of the facility related to certain hazards, or
- (d) inadequate built-in protection measures for the current or intended use of the *building*,

the public will be exposed to an unacceptable risk of illness due to the release of hazardous substances from the *building* or facility.

**OP Fire Protection of Buildings and Facilities**

An objective of this Code is to limit the probability that, as a result of specific circumstances related to the *building* or facility, the *building* or facility will be exposed to an unacceptable risk of damage due to fire.

**OP1 Fire Protection of the Building or Facility**

An objective of this Code is to limit the probability that, as a result of

- (a) activities related to the construction, use or demolition of the *building* or facility,
- (b) the condition of specific elements of the *building* or facility,
- (c) the design or construction of specific elements of the facility related to certain hazards, or
- (d) inadequate built-in protection measures for the current or intended use of the *building*,

the *building* or facility will be exposed to an unacceptable risk of damage due to fire. The risks of damage due to fire addressed in this Code are those caused by—

- OP1.1 – fire or explosion occurring
- OP1.2 – fire or explosion impacting areas beyond its point of origin
- OP1.3 – collapse of physical elements due to a fire or explosion
- OP1.4 – fire safety systems failing to function as expected

**OP3 Protection of Adjacent Buildings or Facilities from Fire**

An objective of this Code is to limit the probability that, as a result of

- (a) activities related to the construction, use or demolition of the *building* or facility,
- (b) the condition of specific elements of the *building* or facility,
- (c) the design or construction of specific elements of the facility related to certain hazards, or
- (d) inadequate built-in protection measures for the current or intended use of the *building*,

adjacent *buildings* or facilities will be exposed to an unacceptable risk of damage due to fire. The risks of damage to adjacent *buildings* and facilities due to fire addressed in this Code are those caused by—

- OP3.1 – fire or explosion impacting areas beyond the *building* or facility of origin



# **Part 3**

## **Functional Statements**

<b>3.1.</b>	<b>Application</b>	
3.1.1.	Application .....	3- 1
<b>3.2.</b>	<b>Functional Statements</b>	
3.2.1.	Functional Statements .....	3- 1



## **Part 3**

# **Functional Statements**

### **Section 3.1. Application**

#### **3.1.1. Application**

##### **3.1.1.1. Application**

**1)** This Part applies to all *buildings* and facilities covered in this Code. (See Article 1.1.1.1.)

##### **3.1.1.2. Application of Functional Statements**

- 1)** The functional statements described in this Part apply
- a) to all *buildings* and facilities covered in this Code (see Article 1.1.1.1.), and
  - b) only to the extent that they relate to compliance with this Code as required in Article 1.2.1.1.

### **Section 3.2. Functional Statements**

#### **3.2.1. Functional Statements**

##### **3.2.1.1. Functional Statements** ◇

**1)** The objectives of this Code are achieved by measures, such as those described in the acceptable solutions in Division B, that are intended to allow the *building* or facility or its elements to perform the following functions (see Appendix A):

- F01** To minimize the risk of accidental ignition.
- F02** To limit the severity and effects of fire or explosions.
- F03** To retard the effects of fire on areas beyond its point of origin.
- F04** To retard failure or collapse due to the effects of fire.
- F05** To retard the effects of fire on emergency egress facilities.
- F06** To retard the effects of fire on facilities for notification, suppression and emergency response.
  
- F10** To facilitate the timely movement of persons to a safe place in an emergency.
- F11** To notify persons, in a timely manner, of the need to take action in an emergency.
- F12** To facilitate emergency response.
- F13** To notify emergency responders, in a timely manner, of the need to take action in an emergency.
  
- F20** To support and withstand expected loads and forces.
- F21** To limit or accommodate dimensional change.
- F22** To limit movement under expected loads and forces.

- F30** To minimize the risk of injury to persons as a result of tripping, slipping, falling, contact, drowning or collision.
- F31** To minimize the risk of injury to persons as a result of contact with hot surfaces or substances.
- F32** To minimize the risk of injury to persons as a result of contact with energized equipment.
- F34** To resist or discourage unwanted access or entry.
- F36** To minimize the risk that persons will be trapped in confined spaces.
  
- F40** To limit the level of contaminants.
- F43** To minimize the risk of release of hazardous substances.
- F44** To limit the spread of hazardous substances beyond their point of release.
  
- F51** To maintain appropriate air and surface temperatures.
- F52** To maintain appropriate relative humidity.
- F53** To maintain appropriate indoor/outdoor air pressure differences.
  
- F80** To resist deterioration resulting from expected service conditions.
- F81** To minimize the risk of malfunction, interference, damage, tampering, lack of use or misuse.
- F82** To minimize the risk of inadequate performance due to improper maintenance or lack of maintenance.

# Appendix A

## Explanatory Material

**A-1.1.1.1.(1) Application of this Code.** This Code applies to buildings and facilities, whether occupied or vacant. For the purposes of Sentence 1.1.1.1.(1), the term “facilities” is used in its broadest sense to include all premises that are not included in the definition of “building” in this Code, such as outdoor and underground areas, structures and equipment. Such “facilities” are often associated with storage, distribution and manufacturing activities.

The Alberta Fire Code 2006 contains references to the Alberta Building Code 2006 for the design, construction and installation of many fire protection features. Some Alberta Building Code 2006 requirements are most readily applied to new buildings and their retroactive application to existing situations as prescribed by this Code could result in some difficulty in achieving compliance. It is the intent of the Alberta Fire Code 2006 that an equivalent level of safety be achieved rather than necessarily achieving strict conformance to the Alberta Building Code 2006. The application of this Code to the upgrading of existing facilities should be based on the judgment of the enforcement authority, who must deal with each case on its own merits.

The Alberta Fire Code 2006 states that the owner or the owner’s authorized agent is responsible for carrying out the provisions of the Code (see Article 2.2.1.1. of Division C). However, the owner is expected to communicate with the authority having jurisdiction, who is in a position to assess the relative significance of variations from the Alberta Building Code 2006 requirements. Such authority may then determine that upgrading measures are not necessary, on the basis that the existing arrangement represents an equivalent level of fire and life safety. The Alberta Fire Code 2006 presumes that the adopting legislation provides for the exercise of the necessary discretionary judgment on the part of the enforcing officials, along with appropriate rights to appeal (see Appendix Note A-2.2. of Division C). See also Appendix Note A-2.1.3.1.(1) of Division B and Appendix Note A-1.1.1.1.(1) of Division A of the Alberta Building Code 2006.

**A-1.2.1.1.(1)(a) Code Compliance via Acceptable Solutions.** If a building design (e.g. material, component, assembly or system) can be shown to meet all provisions of the applicable acceptable solutions in Division B (e.g. it complies with the applicable provisions of a referenced standard), it is deemed to have satisfied the objectives and functional statements linked to those provisions and thus to have complied with that part of the Code. In fact, if it can be determined that a design meets all the applicable acceptable solutions in Division B, there is no need to consult the objectives and functional statements in Division A to determine its compliance.

**A-1.2.1.1.(1)(b) Code Compliance via Alternative Solutions.** Where a design differs from the acceptable solutions in Division B, then it should be treated as an “alternative solution.” A proponent of an alternative solution must demonstrate that the alternative solution addresses the same issues as the applicable acceptable solutions in Division B and their attributed objectives and functional statements. However, because the objectives and functional statements are entirely qualitative, demonstrating compliance with them in isolation is not possible. Therefore, Clause 1.2.1.1.(1)(b) identifies the principle that Division B establishes the quantitative performance targets that alternative solutions must meet. In many cases, these targets are not defined very precisely by the acceptable solutions—certainly far less precisely than would be the case with a true performance code, which would have quantitative performance targets and prescribed methods of performance measurement for all aspects of building performance. Nevertheless, Clause 1.2.1.1.(1)(b) makes it clear that an effort must be made to demonstrate that an alternative solution will perform as well as a design that would satisfy the applicable acceptable solutions in Division B—not “well enough” but “as well as.”

---

This Appendix is included for explanatory purposes only and does not form part of the requirements. The numbers that introduce each Appendix Note correspond to the applicable requirements in this Division.

In this sense, it is Division B that defines the boundaries between acceptable risks and the “unacceptable” risks referred to in the statements of the Code’s objectives, i.e. the risk remaining once the applicable acceptable solutions in Division B have been implemented represents the residual level of risk deemed to be acceptable by the broad base of Canadians who have taken part in the consensus process used to develop the Code.

**Level of Performance**

Where Division B offers a choice between several possible designs, it is likely that these designs may not all provide exactly the same level of performance. Among a number of possible designs satisfying acceptable solutions in Division B, the design providing the lowest level of performance should generally be considered to establish the minimum acceptable level of performance to be used in evaluating alternative solutions for compliance with the Code.

Sometimes a single design will be used as an alternative solution to several sets of acceptable solutions in Division B. In this case, the level of performance required of the alternative solution should be at least equivalent to the overall level of performance established by all the applicable sets of acceptable solutions taken as a whole.

Each provision in Division B has been analyzed to determine to what it applies and what it is intended to achieve. The resultant application and intent statements clarify what undesirable results each provision seeks to preclude. These statements are not a legal component of the Code, but are advisory in nature, and can help Code users establish performance targets for alternative solutions.

**Areas of Performance**

A subset of the acceptable solutions in Division B may establish criteria for particular types of designs (e.g. certain types of materials, components, assemblies, or systems). Often such subsets of acceptable solutions are all attributed to the same objective: Fire Safety for example. In some cases, the designs that are normally used to satisfy this subset of acceptable solutions might also provide some benefits that could be related to some other objective: Fire Protection of the Building or Facility for example. However, if none of the applicable acceptable solutions are linked to Objective OP1, Fire Protection of the Building or Facility, it is not necessary that alternative solutions proposed to replace these acceptable solutions provide a similar benefit related to Fire Protection of the Building or Facility. In other words, the acceptable solutions in Division B establish acceptable levels of performance for compliance with the Code only in those areas defined by the objectives and functional statements attributed to the acceptable solutions.

**Applicable Acceptable Solutions**

In demonstrating that an alternative solution will perform as well as a design that would satisfy the applicable acceptable solutions in Division B, its evaluation should not be limited to comparison with the acceptable solutions to which an alternative is proposed. It is possible that acceptable solutions elsewhere in the Code also apply. The proposed alternative solution may be shown to perform as well as the most apparent acceptable solution, which it is replacing, but may not perform as well as other relevant acceptable solutions. For example, the use of sprinklers to protect the exterior wall of a building may permit combustible materials to be stored closer to that wall than otherwise permitted by the Code, but the proximity of the stored materials to the wall may contravene firefighter access provisions elsewhere in the Code. All applicable acceptable solutions should be taken into consideration in demonstrating the compliance of an alternative solution.

**A-1.4.1.2.(1) Defined Terms.****Authority having jurisdiction**

The defined term “authority having jurisdiction” refers to a safety codes officer as the appointed individual responsible for decision making in a number of areas. In most cases, this individual will be a member of an accredited municipal fire department. In municipalities that use accredited agencies for their inspection and enforcement, the fire department may not be involved. It is important that accredited municipalities employing accredited agencies properly designate the person(s) acting as the authority having jurisdiction. In addition, municipalities using accredited agencies should ensure that the agency has a close working relationship with the fire department during the decision-making process.

**Exit**

Exits include doors or doorways leading directly into an exit stair or directly to the outside. In the case of an exit leading to a separate building, exits also include vestibules, walkways, bridges or balconies.

**Fire-resistance rating**

Since it is not practicable to measure the fire resistance of constructions in situ, they must be evaluated under some agreed test conditions. A specified fire-resistance rating is not necessarily the actual time that the assembly would endure in situ in a building fire, but is that which the particular construction must meet under the specified methods of test.

**Fire separation**

A fire separation may or may not have a fire-resistance rating.

**Individual storage area**

The width of subsidiary aisles providing access to stored products within an individual storage area may be determined by material handling methods, or other criteria such as minimum width for access to exits or fire protection equipment.

**Secondary Suite**

An existing secondary suite is located within a primary dwelling unit, where the primary dwelling unit is a townhouse, row house, single- or semi-detached home, or duplex.

**Service room**

Typical examples of service rooms include boiler rooms, furnace rooms, incinerator rooms, garbage handling rooms and rooms to accommodate air-conditioning or heating appliances, pumps, compressors and electrical equipment. Rooms such as elevator machine rooms and common laundry rooms are not considered to be service rooms.

**Suite**

Tenancy in the context of the term "suite" applies to both rental and ownership tenure. In a condominium arrangement, for example, dwelling units are considered separate suites even though they are individually owned. In order to be of complementary use, a series of rooms that constitute a suite must be in reasonably close proximity to each other and have access to each other either directly by means of a common doorway or indirectly by a corridor, vestibule or other similar arrangement.

The term "suite" does not apply to rooms such as service rooms, common laundry rooms and common recreational rooms that are not leased or under a separate tenure in the context of the Code. Similarly, the term "suite" is not normally applied in the context of buildings such as schools and hospitals, since the entire building is under a single tenure. However, a room that is individually rented is considered a suite. A warehousing unit in a mini-warehouse is a suite. A rented room in a nursing home could be considered as a suite if the room was under a separate tenure. A hospital bedroom on the other hand is not considered to be under a separate tenure, since the patient has little control of that space, even though he pays the hospital a per diem rate for the privilege of using the hospital facilities, which include the sleeping areas.

For certain requirements in the Alberta Building Code 2006, the expression "room or suite" is used (e.g., travel distance). This means that the requirement applies within the rooms of suites as well as to the suite itself and to rooms that may be located outside the suite. In other places the expression "suite, and rooms not located within a suite" is used (e.g., for the installation of smoke and heat detectors). This means that the requirement applies to individual suites as defined, but not to each room within the suite. The rooms "not within a suite" would include common laundry rooms, common recreational rooms and service rooms, which are not considered as tenant-occupied space.

**A-1.5.1.1.(1) Application of Referenced Documents.** Documents referenced in the Alberta Fire Code 2006 may contain provisions covering a wide range of issues, including issues that are unrelated to the objectives and functional statements stated in Parts 2 and 3 of Division A respectively; e.g. protection of stored products against damage or loss due to fire. Sentence 1.5.1.1.(1) is intended to make it clear that, whereas referencing a document in the Alberta Fire Code 2006 generally has the effect of making the provisions of that document part of the Code, provisions that are unrelated to buildings and facilities or to the objectives and functional statements attributed to the provisions in Division B where the document is referenced are excluded.

Furthermore, many documents referenced in the Alberta Fire Code 2006 contain references to other documents, which may also, in turn, refer to other documents. These secondary and tertiary referenced documents may contain provisions that are unrelated to buildings and facilities or to the objectives and functional statements of the Alberta Fire Code 2006: such provisions—no matter how far down the chain of references they occur—are not included in the intent of Sentence 1.5.1.1.(1) of Division A.

### **A-2.2.1.1.(1) Objectives.**

#### **Listing of objectives**

Any gaps in the numbering sequence of the objectives are due to the fact that there is a master list of objectives covering the three principal Code Documents adopted in Alberta—the Alberta Building Code, the Alberta Fire Code and the National Plumbing Code—but not all objectives are pertinent to all Codes.

#### **The building or facility**

Where the term “the building or facility” is used in the wording of the objectives, it refers to the building or facility for which compliance with the Alberta Fire Code 2006 is being assessed.

#### **Emergency**

The term “emergency”—in the context of safety in buildings or facilities—is often equated to the term “fire emergency;” however, the wording of objective OS3.7 makes it clear that the Code addresses any type of emergency that would require the rapid evacuation of the building or facility, such as a bomb threat or the presence of intruders.

### **A-3.2.1.1.(1) Functional Statements.**

#### **Listing of functional statements**

The numbered functional statements are grouped according to functions that deal with closely related subjects. For example, the first group deals with fire risks, the second group deals with emergency egress and response, etc. Within the Alberta Codes there may be gaps in the numbering sequence for the following reasons:

- Each group has unused numbers which allows for the possible future creation of additional functional statements within any one group.
- There is a master list of functional statements covering the three principal Code Documents adopted in Alberta—the Alberta Building Code, the Alberta Fire Code and the National Plumbing Code—but not all functional statements are pertinent to all Codes.



## **Division B**

# **Acceptable Solutions**



# **Part 1**

## **General**

<b>1.1.</b>	<b>General</b>	
1.1.1.	Application .....	1- 1
1.1.2.	Objectives and Functional Statements .....	1- 1
<b>1.2.</b>	<b>Terms and Abbreviations</b>	
1.2.1.	Definitions of Words and Phrases .....	1- 1
1.2.2.	Symbols and Other Abbreviations .....	1- 2
<b>1.3.</b>	<b>Referenced Documents and Organizations</b>	
1.3.1.	Referenced Documents .....	1- 2
1.3.2.	Organizations .....	1-10



# **Part 1 General**

## **Section 1.1. General**

### **1.1.1. Application**

#### **1.1.1.1. Application**

**1)** This Part applies to all *buildings* and facilities covered in this Code. (See Article 1.1.1.1. of Division A.)

### **1.1.2. Objectives and Functional Statements**

#### **1.1.2.1. Attribution to Acceptable Solutions**

**1)** For the purposes of compliance with this Code as required in Clause 1.2.1.1.(1)(b) of Division A, the objectives and functional statements attributed to the acceptable solutions in Division B shall be the objectives and functional statements identified in Sections 2.17., 3.4., 4.12., 5.8., 6.10. and 7.4. (See Appendix A.)

## **Section 1.2. Terms and Abbreviations**

### **1.2.1. Definitions of Words and Phrases**

#### **1.2.1.1. Non-defined Terms**

**1)** Words and phrases used in Division B that are not included in the list of definitions in Article 1.4.1.2. of Division A shall have the meanings defined in the Safety Codes Act, Alberta Building Code 2006, and National Plumbing Code 2005, or that are commonly assigned to them in the context in which they are used, taking into account the specialized use of terms by the various trades and professions to which the terminology applies.

**2)** Where objectives and functional statements are referred to in Division B, they shall be the objectives and functional statements described in Parts 2 and 3 of Division A.

**3)** Where acceptable solutions are referred to in Division B, they shall be the provisions stated in Parts 2 to 7.

**4)** For words not defined in this Code, the Safety Codes Act, the Alberta Building Code 2006, or the National Plumbing Code 2005, reference should be made to the Canadian Oxford Dictionary (Second Edition), published by Oxford University Press.

#### **1.2.1.2. Defined Terms**

**1)** The words and terms in italics in Division B shall have the meanings assigned to them in Article 1.4.1.2. of Division A.

**1.2.2.1.**

**1.2.2. Symbols and Other Abbreviations**

**1.2.2.1. Symbols and Other Abbreviations**

1) The symbols and other abbreviations in Division B shall have the meanings assigned to them in Article 1.4.2.1. of Division A and Article 1.3.2.1.

**Section 1.3. Referenced Documents and Organizations**

**1.3.1. Referenced Documents**

**1.3.1.1. Effective Date**

1) Unless otherwise specified herein, the documents referenced in this Code shall include all amendments, revisions and supplements effective to 30 September 2005.

**1.3.1.2. Applicable Editions**

1) Where documents are referenced in this Code, they shall be the editions designated in Table 1.3.1.2. (See Appendix A.)

**Table 1.3.1.2.**  
**Documents Referenced in the Alberta Fire Code 2006**  
Forming Part of Sentence 1.3.1.2.(1)

Issuing Agency	Document Number	Title of Document	Code Reference
ANSI/ASME	B16.5-1996	Pipe Flanges and Flanged Fittings NPS ½ Through NPS 24	4.5.5.3.(1)
ANSI/ASME	B31.3-2002	Process Piping	4.5.2.1.(5)
API	5L-2004	Line Pipe	4.5.2.1.(4)
API	620-2002	Design and Construction of Large, Welded, Low-Pressure Storage Tanks	4.3.1.3.(1) 4.3.3.1.(1)
API	650-1998	Welded Steel Tanks for Oil Storage	4.3.1.2.(1) 4.3.3.1.(1)
API	653-2001	Tank Inspection, Repair, Alteration, and Reconstruction	Table 4.4.1.2.B.
API	1104-1999	Welding of Pipelines and Related Facilities	4.5.5.2.(1) 4.5.10.7.(6)
API	2000-1998	Venting Atmospheric and Low-Pressure Storage Tanks: Nonrefrigerated and Refrigerated	4.3.4.1.(1)
API	2200-1998	Repairs to Crude Oil, Liquefied Petroleum Gas and Products Pipelines	4.5.10.7.(6)
API	2201-2003	Welding or Hot Tapping on Equipment in Service	4.5.10.7.(6)
ASTM	A 53/A 53M-02	Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless	4.5.2.1.(4)
ASTM	A 193/A 193M-04	Alloy-Steel and Stainless Steel Bolting Materials for High-Temperature Service	4.5.5.4.(1)
ASTM	D 56-00	Flash Point by Tag Closed Cup Tester	4.1.3.1.(1)
ASTM	D 93-02a	Flash Point by Pensky-Martens Closed Cup Tester	4.1.3.1.(2)
ASTM	D 323-1999	Vapor Pressure of Petroleum Products (Reid Method)	1.4.1.2.(1) <sup>(1)</sup>
ASTM	D 3278-96e1	Flash Point of Liquids by Small Scale Closed-Cup Apparatus	4.1.3.1.(4)
ASTM	D 3828-05	Flash Point by Small Scale Closed Cup Tester	4.1.3.1.(3)

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays

**Table 1.3.1.2. (Continued)**

Issuing Agency	Document Number	Title of Document	Code Reference
CCBFC	NRCC 48673	Alberta Building Code 2006	1.2.1.1.(1) 1.2.1.1.(1) <sup>(2)</sup> 1.2.1.1.(4) 1.2.1.1.(5) <sup>(2)</sup> 1.3.2.1.(1) 1.3.3.2.(1) <sup>(1)</sup> 1.4.1.1.(1) <sup>(1)</sup> 1.4.1.1.(5) <sup>(1)</sup> 1.4.1.2.(1) <sup>(1)</sup> 2.1.1.1.(2) <sup>(2)</sup> 2.1.1.1.(3) <sup>(2)</sup> 2.1.2.1.(1) 2.1.3.1.(1) 2.1.3.2.(1) 2.1.3.3.(3) 2.1.3.4.(1) 2.1.3.6.(1) 2.2.1.1.(1) 2.2.1.1.(2) 2.2.1.1.(3) 2.2.2.1.(1) 2.2.2.1.(2) 2.2.2.4.(2) 2.3.1.1.(1) 2.3.1.2.(1) <sup>(2)</sup> 2.3.1.4.(1) 2.3.1.5.(1) 2.3.1.5.(2) 2.4.1.2.(1) 2.4.4.3.(1) 2.5.1.1.(1) 2.5.1.3.(2) 2.5.1.3.(4) 2.6.1.1.(1) 2.6.1.5.(1) 2.6.1.9.(1) 2.6.2.1.(1) 2.7.1.1.(1) 2.7.1.2.(1) 2.7.1.3.(1) 2.7.1.4.(2) 2.7.2.1.(5) 2.7.3.1.(1) 2.8.1.1.(1) 2.8.2.4.(1) 2.8.2.4.(2) 2.8.2.5.(2) 2.8.3.1.(1) 2.8.3.2.(1) 2.9.1.1.(1) 2.9.3.6.(1) 2.10.1.1.(1) 2.11.1.1.(1) 2.12.1.4.(2) 2.12.1.4.(3) 2.13.2.1.(1) 2.13.2.2.(1) 2.14.1.1.(2) 3.2.6.2.(1) 3.2.7.12.(3) 3.2.9.2.(7)

Table 1.3.1.2. (Continued)

Issuing Agency	Document Number	Title of Document	Code Reference
CCBFC	NRCC 48673	Alberta Building Code 2006	3.3.2.5.(1) 3.3.6.8.(1) 4.1.7.1.(1) 4.2.7.1.(2) 4.2.7.5.(2) 4.2.11.3.(1) 4.3.2.4.(2) 4.3.3.2.(1) 4.3.12.1.(2) 4.3.13.1.(1) 4.3.13.4.(1) 4.5.8.2.(3) 4.6.3.3.(2) 4.6.3.3.(3) 4.9.3.5.(1) 5.1.3.1.(1) 5.5.2.2.(1) 5.6.1.6.(1) 5.6.1.6.(2) 5.6.1.11.(2) 5.6.1.19.(1) 6.3.1.5.(1) 7.1.1.1.(1) 7.1.1.2.(1) 7.1.1.2.(2) 7.2.3.3.(1)
CCBFC	NRCC 47668	National Plumbing Code of Canada 2005	1.2.1.1.(1) 1.2.1.1.(1) <sup>(2)</sup> 1.2.1.1.(4) 1.2.1.1.(5) <sup>(2)</sup> 1.4.1.1.(1) <sup>(1)</sup> 1.4.1.1.(5) <sup>(1)</sup>
CCBFC	NRCC 40383	User's Guide – NBC 1995 Fire Protection, Occupant Safety and Accessibility (Part 3)	7.1.1.2.(2)
CCME	PN 1326	Environmental Code of Practice for Aboveground and Underground Storage Tank Systems Containing Petroleum Products and Allied Petroleum Products	4.4.2.1.(3)
CGA	CAN/CGA-B149.5-05	Installation Code for Propane Fuelled Systems and Tanks on Highway Vehicles	2.4.4.5.(1)
CGSB	CAN/CGSB-4.162-M80	Hospital Textiles — Flammability Performance Requirements	2.3.2.3.(1)
CNSC	2000	Nuclear Safety and Control Act and its Regulations	3.1.1.2.(1)
CPPI	1990	Using the CPPI Colour-Symbol System to Mark Equipment and Vehicles for Product Identification	4.3.1.7.(1) 4.5.4.1.(3) 4.5.7.6.(1)
CPPI	PACE Report No. 87-1	Impressed Current Method of Cathodic Protection of Underground Petroleum Storage Tanks	4.3.9.1.(2) 4.5.3.1.(2) 4.6.10.2.(1)
CSA	CAN/CSA-B72-M87 (R2003)	Installation Code for Lightning Protection Systems	6.9.1.1.(1)
CSA	CAN/CSA-B139-04	Installation Code for Oil-Burning Equipment	4.1.1.1.(3) 4.3.12.2.(2) 5.6.1.12.(1)
CSA	B306-M1977 (R2002)	Portable Fuel Tanks for Marine Use	4.2.3.1.(1)
CSA	B346-M1980 (R2002)	Power-Operated Dispensing Devices for Flammable Liquids	4.6.3.1.(1)
CSA	B376-M1980 (R2003)	Portable Containers for Gasoline and Other Petroleum Fuels	4.2.3.1.(1)

**Table 1.3.1.2. (Continued)**

Issuing Agency	Document Number	Title of Document	Code Reference
CSA	B620-03	Highway Tanks and Portable Tanks for the Transportation of Dangerous Goods	4.2.3.1.(1)
CSA	CAN/CSA-C282-05	Emergency Electrical Power Supply for Buildings	6.5.1.1.(1) 6.5.1.4.(1)
CSA	CAN/CSA-W117.2-01	Safety in Welding, Cutting and Allied Processes	5.2.1.1.(2)
CSA	CAN/CSA-Z32-04	Electrical Safety and Essential Electrical Systems in Health Care Facilities	6.5.1.1.(2)
CSA	Z245.1-02	Steel Pipe	4.5.2.1.(4)
EPA	EPA 510-B-93-004	Doing Inventory Control Right for Underground Storage Tanks	4.4.2.1.(2)
EPA	EPA 510-B-95-009	Introduction to Statistical Inventory Reconciliation: For Underground Storage Tanks	4.4.2.1.(4)
EPA	EPA 530/UST-90/007	Evaluating Leak Detection Methods: Statistical Inventory Reconciliation Methods (SIR)	4.4.2.1.(4)
EUB	Guide 55-2001	Storage Requirements for the Upstream Petroleum Industry	4.1.1.1.(3)
Govt. of Alberta		Corrections Act and its Regulations	5.7.1.5.(1)
Govt. of Alberta		Forests Act and its Regulations	1.4.1.2.(1) <sup>(1)</sup>
Govt. of Alberta		Forest and Prairie Protection Act and its Regulations	5.7.1.3.(1)
Govt. of Alberta		Hospitals Act and its Regulations	5.7.1.5.(1)
Govt. of Alberta		Mental Health Act and its Regulations	5.7.1.5.(1)
Govt. of Alberta		Nursing Homes Act and its Regulations	5.7.1.5.(1)
Govt. of Alberta		Occupational Health and Safety Act and its Regulations	3.2.7.15.(2) 4.5.5.2.(1)
Govt. of Alberta		Public Lands Act and its Regulations	5.7.1.3.(1)

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays

Table 1.3.1.2. (Continued)

Issuing Agency	Document Number	Title of Document	Code Reference
Govt. of Alberta		Safety Codes Act and its Regulations (also see Alberta Building Code)	1.2.1.1.(1) 1.2.1.1.(1) <sup>(2)</sup> 1.2.1.1.(4) 1.2.1.1.(5) <sup>(2)</sup> 1.4.1.1.(1) <sup>(1)</sup> 1.4.1.1.(5) <sup>(1)</sup> 1.4.1.2.(1) <sup>(1)</sup> 2.1.1.1.(2) <sup>(2)</sup> 2.2.5.1.(1) <sup>(2)</sup> 2.4.4.5.(3) 2.4.4.6.(1) 2.9.3.1.(1) 3.1.1.4.(2) 3.1.1.4.(3) 3.1.4.1.(1) 3.2.8.2.(3) 4.1.1.1.(3) 4.1.4.1.(1) 4.1.4.1.(2) 4.3.1.3.(1) 4.3.1.3.(2) 4.5.1.1.(2) 4.5.9.5.(2) 4.5.9.6.(1) 4.6.1.1.(2) 5.1.2.1.(1) 5.1.2.2.(1) 5.3.1.2.(2) 5.3.1.2.(3) 5.3.1.10.(2) 5.5.3.4.(1) 5.6.1.10.(3) 5.6.1.12.(1) 7.1.1.4.(6)
Govt. of Alberta		Social Care Facilities Licensing Act and its Regulations	2.10.2.1.(1) 5.7.1.5.(1)
Govt. of Alberta		Uniform Building Standards Act	2.1.1.1.(2) <sup>(2)</sup>
HC	2005	Hazardous Products Act and its Regulations	4.2.3.2.(2)
HC	1985	Pest Control Products Act and its Regulations	4.2.3.2.(2)
HC	2004	Workplace Hazardous Materials Information System (WHMIS) of the Hazardous Products Act	Table 3.2.7.1.
IMO	2002	International Maritime Dangerous Goods Code	3.3.4.8.(1)
NFPA	10-2002	Portable Fire Extinguishers	2.1.5.1.(2) 6.2.1.1.(1)
NFPA	11-2005	Low-, Medium-, and High-Expansion Foam	2.1.3.5.(3) 4.3.2.5.(2)
NFPA	12-2005	Carbon Dioxide Extinguishing Systems	2.1.3.5.(3)
NFPA	12A-2004	Halon 1301 Fire Extinguishing Systems	2.1.3.5.(3)
NFPA	13-2002	Installation of Sprinkler Systems	3.2.1.1.(1) 3.2.2.4.(3) 3.2.3.3.(1) 3.2.4.3.(1)
NFPA	15-2001	Water Spray Fixed Systems for Fire Protection	2.1.3.5.(4) 4.3.2.5.(2)
NFPA	16-2003	Installation of Foam-Water Sprinkler and Foam-Water Spray Systems	2.1.3.5.(4)

**Table 1.3.1.2. (Continued)**

Issuing Agency	Document Number	Title of Document	Code Reference
NFPA	17-2002	Dry Chemical Extinguishing Systems	2.1.3.5.(3)
NFPA	17A-2002	Wet Chemical Extinguishing Systems	2.1.3.5.(3)
NFPA	18-2006	Wetting Agents	2.1.3.5.(5)
NFPA	25-2002	Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems	6.4.1.1.(1)
NFPA	30-2003	Flammable and Combustible Liquids Code	3.2.5.2.(1) 4.2.7.6.(1)
NFPA	30B-2002	Manufacture and Storage of Aerosol Products	3.2.5.2.(1) 3.2.5.5.(1)
NFPA	32-2004	Drycleaning Plants	5.4.2.1.(1)
NFPA	33-2003	Spray Application Using Flammable or Combustible Materials	5.4.5.2.(1)
NFPA	34-2003	Dipping and Coating Processes Using Flammable or Combustible Liquids	5.4.6.2.(1)
NFPA	37-2002	Installation and Use of Stationary Combustion Engines and Gas Turbines	4.3.12.2.(1)
NFPA	51-2002	Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting and Allied Processes	5.2.2.4.(1)
NFPA	68-2002	Venting of Deflagrations	3.2.8.2.(1) 4.2.9.5.(1) 4.3.13.3.(1) 4.9.3.1.(1) 4.9.4.2.(1) 5.3.1.6.(2)
NFPA	69-2002	Explosion Prevention Systems	4.3.2.5.(2) 4.9.4.2.(1) 5.3.1.7.(2)
NFPA	72 <sup>®</sup> -2002	National Fire Alarm Code <sup>®(3)</sup>	6.3.1.3.(2)
NFPA	80A-2001	Protection of Buildings from Exterior Fire Exposures	3.3.6.3.(2)
NFPA	82-2004	Incinerators and Waste and Linen Handling Systems and Equipment	2.6.2.2.(1)
NFPA	86-2003	Ovens and Furnaces	5.4.1.2.(1)
NFPA	91-2004	Exhaust Systems for Air Conveying of Vapors, Gases, Mists, and Noncombustible Particulate Solids	3.2.2.3.(5) 4.1.7.2.(5) 5.5.4.3.(1)
NFPA	96-2004	Ventilation Control and Fire Protection of Commercial Cooking Operations	2.6.1.9.(2)
NFPA	101 <sup>®</sup> -2006 <sup>(3)</sup>	Life Safety Code <sup>®(3)</sup>	2.7.1.5.(4)
NFPA	505-2006	Powered Industrial Trucks Including Type Designations, Areas of Use, Conversions, Maintenance, and Operation	3.1.3.1.(1)
NFPA	664-2002	Prevention of Fires and Explosions in Wood Processing and Woodworking Facilities	5.3.1.3.(2) 5.3.2.1.(1)
NFPA	705-2003	Field Flame Test for Textiles and Films	2.3.2.2.(1) 2.9.2.1.(1)
NFPA	750-2003	Water Mist Fire Protection Systems	2.1.3.5.(4)
NFPA	1142-2001	Water Supplies for Suburban and Rural Firefighting	3.3.2.16.(1)
NFPA	2001-2004	Clean Agent Fire Extinguishing Systems	2.1.3.5.(3)
NFPA	FPS-00	Fire Protection Systems: Inspection, Test, and Maintenance Manual, 3rd Edition	6.1.1.5.(2)

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays

Table 1.3.1.2. (Continued)

Issuing Agency	Document Number	Title of Document	Code Reference
NRCan	1985	Explosives Act and its Regulations	1.4.1.2.(1) <sup>(1)</sup> 3.1.1.3.(1) 3.2.10.5.(2) 3.2.10.5.(3) 3.2.10.6.(1) 3.2.10.6.(2) 5.1.1.2.(1) 5.7.1.2.(1) 5.7.1.4.(2) 5.7.1.7.(3)
NRCan	1999	Display Fireworks Manual	5.7.1.11.(1)
Oxford University Press	2nd Edition, June 2004	Canadian Oxford Dictionary	1.2.1.1.(4) 1.2.1.1.(5) <sup>(2)</sup> 1.4.1.1.(5) <sup>(1)</sup>
TC TC	2005	Canadian Aviation Regulations - Part III Transportation of Dangerous Goods Act and its Regulations (TDGR)	2.13.1.1.(1) 1.4.1.2.(1) <sup>(1)</sup> 3.1.2.1.(1) 3.1.2.5.(1) Table 3.2.7.1. 3.2.7.1.(2) 3.2.7.14.(1) 3.2.7.14.(4) 3.2.7.15.(2) 3.3.4.1.(3) 4.1.1.1.(3) 4.2.3.1.(1) 4.2.3.2.(2) 4.7.4.7.(1) 5.7.1.2.(2)
TC	2001	Standards Respecting Pipeline Crossings Under Railways	4.5.6.4.(3)
TC	CTC 1982-8 RAIL	Railway Prevention of Electric Sparks Regulations	4.7.4.5.(2) 4.8.5.1.(1)
TC	General Order No. O-32	Flammable Liquids Bulk Storage Regulations	4.5.6.4.(4) 4.7.2.2.(1) 4.7.4.1.(2)
ULC	CAN/ULC-S102-03	Method of Test for Surface Burning Characteristics of Building Materials and Assemblies	2.3.1.3.(2) 2.3.1.3.(3) 2.4.1.3.(6)
ULC	CAN/ULC-S109-03	Flame Tests of Flame-Resistant Fabrics and Films	2.3.1.3.(2) 2.3.2.1.(1)
ULC	ULC-S513-1978	Threaded Couplings for 1 1/2 inch and 2 1/2 inch Fire Hose	6.8.1.1.(3)
ULC	CAN/ULC-S531-02	Smoke Alarms	2.1.3.3.(1) 2.16.2.15.(1)
ULC	CAN/ULC-S536-04	Inspection and Testing of Fire Alarm Systems	6.1.1.5.(2) 6.3.1.2.(1)
ULC	CAN/ULC-S537-04	Verification of Fire Alarm Systems	6.1.1.5.(2)
ULC	CAN4-S543-M84	Internal Lug Quick-connect Couplings for Fire Hose	6.8.1.1.(4)
ULC	CAN/ULC-S552-02	Maintenance and Testing of Smoke Alarms	6.7.1.1.(1)
ULC	CAN/ULC-S561-03	Installation and Services for Fire Signal Receiving Centres and Systems	6.3.1.3.(1)
ULC	ULC-S601-00	Shop Fabricated Steel Aboveground Horizontal Tanks for Flammable and Combustible Liquids	4.3.1.2.(1)
ULC	ULC-S601(A)-2001	Refurbishing of Steel Aboveground Horizontal Tanks for Flammable and Combustible Liquids	4.3.1.10.(2)

**Table 1.3.1.2. (Continued)**

Issuing Agency	Document Number	Title of Document	Code Reference
ULC	CAN/ULC-S602-03	Aboveground Steel Tanks for the Storage of Combustible Liquids Intended to be Used as Heating and/or Generator Fuels	4.3.1.2.(1)
ULC	ULC-S603-00	Steel Underground Tanks for Flammable and Combustible Liquids	4.3.1.2.(1) 4.3.9.3.(1) 4.4.3.3.(3)
ULC	ULC-S603(A)-2001	Refurbishing of Steel Underground Tanks for Flammable and Combustible Liquids	4.3.1.10.(3)
ULC	CAN/ULC-S603.1-03	External Corrosion Protection Systems for Steel Underground Tanks for Flammable and Combustible Liquids	4.3.1.2.(1) 4.3.8.5.(1) 4.3.9.1.(1) 4.5.3.1.(2) 4.6.10.2.(1)
ULC	CAN/ULC-S612-99	Hose for Flammable and Combustible Liquids	4.6.5.1.(1)
ULC	ULC-S615-98	Reinforced Plastic Underground Tanks for Flammable and Combustible Liquids	4.3.1.2.(1) 4.3.8.5.(2) 4.4.3.3.(3)
ULC	ULC-S615(A)-2002	Refurbishing of Reinforced Plastic Underground Tanks for Flammable and Combustible Liquids	4.3.1.10.(3)
ULC	CAN/ULC-S620-99	Hose Nozzle Valves for Flammable and Combustible Liquids	4.5.7.1.(2) 4.6.5.2.(1)
ULC	ULC-S630-00	Shop Fabricated Steel Aboveground Vertical Tanks for Flammable and Combustible Liquids	4.3.1.2.(1) 4.3.3.2.(1)
ULC	ULC-S630(A)-2001	Refurbishing of Steel Aboveground Vertical Tanks for Flammable and Combustible Liquids	4.3.1.10.(2)
ULC	CAN/ULC-S633-99	Flexible Underground Hose Connectors for Flammable and Combustible Liquids	4.5.6.13.(2)
ULC	CAN/ULC-S642-M87	Compounds and Tapes for Threaded Pipe Joints	4.5.5.1.(1)
ULC	ULC-S643-00	Shop Fabricated Steel Aboveground Utility Tanks for Flammable and Combustible Liquids	4.3.1.2.(1)
ULC	ULC-S644-00	Emergency Breakaway Fittings for Flammable and Combustible Liquids	4.6.5.2.(4)
ULC	ULC-S651-00	Emergency Valves for Flammable and Combustible Liquids	4.5.7.1.(3) 4.6.6.3.(1)
ULC	ULC-S652-93 (R2000)+	Tank Assemblies for Collection of Used Oil	4.3.1.2.(1)
ULC	ULC-S653-94	Aboveground Steel Contained Tank Assemblies for Flammable and Combustible Liquids	4.3.1.2.(1)
ULC	ULC-S655-98	Aboveground Protected Tank Assemblies for Flammable and Combustible Liquids	4.3.1.2.(1) 4.3.2.1.(7)
ULC	ULC/ORD-C30-1995	Safety Containers	4.1.5.8.(2) 4.2.3.1.(1) 4.2.6.4.(1) 5.5.5.2.(2)
ULC	ULC/ORD-C58.9-1997	Secondary Containment Liners for Underground and Aboveground Flammable and Combustible Liquid Tanks	4.3.7.2.(2)
ULC	ULC/ORD-C58.10-1992	Jacketed Steel Underground Tanks for Flammable and Combustible Liquids	4.3.1.2.(1)
ULC	ULC/ORD-C58.12-1992	Leak Detection Devices (Volumetric Type) for Underground Flammable Liquid Storage Tanks	4.4.2.1.(5) 4.4.2.1.(10)
ULC	ULC/ORD-C58.14-1992	Non-Volumetric Leak Detection Devices for Underground Flammable Liquid Storage Tanks	4.4.2.1.(5) 4.4.2.1.(10)
ULC	ULC/ORD-C58.15-1992	Overfill Protection Devices for Flammable Liquid Storage Tanks	4.3.1.8.(1) 4.3.7.4.(3) 4.3.8.1.(6)

Table 1.3.1.2. (Continued)

Issuing Agency	Document Number	Title of Document	Code Reference
ULC	ULC/ORD-C58.19-1992	Spill Containment Devices for Underground Flammable Liquid Storage Tanks	4.3.8.1.(6)
ULC	ULC/ORD-C107.12-1992	Line Leak Detection Devices for Flammable Liquid Piping	4.4.2.1.(11) 4.4.3.5.(2) 4.4.4.2.(1)
ULC	ULC/ORD-C107.21-1992	Under-Dispenser Sumps	4.3.7.4.(3) 4.3.8.1.(6) 4.3.8.1.(7) 4.6.3.2.(1)
ULC	ULC/ORD-C142.5-1992	Concrete Encased Steel Aboveground Tank Assemblies for Flammable and Combustible Liquids	4.3.1.2.(1)
ULC	ULC/ORD-C142.18-1995	Rectangular Steel Aboveground Tanks for Flammable and Combustible Liquids	4.3.1.2.(1)
ULC	ULC/ORD-C142.19-1994	Spill Containment Devices for Aboveground Flammable and Combustible Liquid Storage Tanks	4.3.7.4.(3)
ULC	ULC/ORD-C142.22-1995	Contained Vertical Steel Aboveground Tank Assemblies for Flammable and Combustible Liquids	4.3.1.2.(1)
ULC	ULC/ORD-C536-1998	Flexible Metallic Hose	4.5.6.13.(2)
ULC	ULC/ORD-C558-1975	Internal Combustion Engine-Powered Industrial Trucks	3.1.3.1.(2)
ULC	ULC/ORD-C583-1974	Electric Battery Powered Industrial Trucks	3.1.3.1.(3)
ULC	ULC/ORD-C842-84	Valves for Flammable and Combustible Liquids	4.5.7.1.(1)
ULC	ULC/ORD-C971-2005	Nonmetallic Underground Piping for Flammable and Combustible Liquids	4.5.2.1.(3) 4.5.6.13.(2)
ULC	ULC/ORD-C1275-84	Storage Cabinets for Flammable Liquid Containers	4.2.10.5.(1)

**Notes to Table 1.3.1.2.:**

- (1) Code reference is in Division A.  
(2) Code reference is in Division C.  
(3) NFPA 101®, Life Safety Code®, NFPA 72® and National Fire Alarm Code® are registered trademarks of the National Fire Protection Association, Inc., Quincy, MA 02169-7471.

**1.3.2. Organizations****1.3.2.1. Abbreviations of Proper Names**

**1)** The abbreviations of proper names in this Code shall have the meanings assigned to them in this Article (the appropriate addresses of the organizations are shown in brackets).

- ACGIH ..... American Conference of Governmental Industrial Hygienists  
(1330 Kemper Meadow Drive, Cincinnati, Ohio 45240-1634 U.S.A.;  
www.acgih.org)
- ANSI ..... American National Standards Institute (25 West 43rd Street, 4th Floor,  
New York, New York 10036 U.S.A.; www.ansi.org)
- API ..... American Petroleum Institute (1220 L Street NW, Washington, D.C.  
20005-4070 U.S.A.; www.api.org)
- ASME ..... American Society of Mechanical Engineers (22 Law Drive, P.O. Box  
2900, Fairfield, New Jersey 07007-2900 U.S.A.; www.asme.org)
- ASTM ..... American Society for Testing and Materials International (100 Barr  
Harbor Drive, West Conshohocken, Pennsylvania 19428-2959 U.S.A.;  
www.astm.org)

- CAN ..... National Standard of Canada designation (The number or name following the CAN designation represents the agency under whose auspices the standard is issued. CAN1 designates CGA, CAN2 designates CGSB, CAN3 designates CSA, and CAN4 designates ULC.)
- CCBFC ..... Canadian Commission on Building and Fire Codes (National Research Council of Canada, Ottawa, Ontario K1A 0R6; [www.nationalcodes.ca](http://www.nationalcodes.ca))
- CCME ..... Canadian Council of Ministers of the Environment (360-123 Main Street, Winnipeg, Manitoba R3C 1A3; [www.ccme.ca](http://www.ccme.ca))
- CGA ..... Compressed Gas Association (4221 Walney Road, 5th Floor, Chantilly, Virginia 20151-2923 U.S.A.; [www.cganet.com](http://www.cganet.com))
- CGSB ..... Canadian General Standards Board (Place du Portage, Phase III, 6B1, 11 Laurier Street, Gatineau, Quebec K1A 1G6; [www.pwgsc.gc.ca/cgsb](http://www.pwgsc.gc.ca/cgsb))
- CNSC ..... Canadian Nuclear Safety Commission [formerly the Atomic Energy Control Board] (280 Slater Street, P.O. Box 1046, Station B, Ottawa, Ontario K1P 5S9; [www.cnscc.gc.ca](http://www.cnscc.gc.ca))
- CPPI ..... Canadian Petroleum Products Institute (275 Slater Street, Suite 1000, Ottawa, Ontario K1P 5H9; [www.cppei.ca](http://www.cppei.ca))
- CSA ..... Canadian Standards Association (5060 Spectrum Way, Suite 100, Mississauga, Ontario L4W 5N6; [www.csa.ca](http://www.csa.ca))
- EPA ..... Environmental Protection Agency (Office of Radiation and Indoor Air, 1200 Pennsylvania Avenue, NW, 6609G, Washington, D.C. 20460 U.S.A.; [www.epa.gov](http://www.epa.gov))
- EUB ..... Alberta Energy and Utilities Board (640 - 5th Avenue SW, Calgary, Alberta Canada T2P 3G4; [www.eub.gov.ab.ca](http://www.eub.gov.ab.ca))
- FM Global ... FM Global (1151 Boston-Providence Turnpike, P.O. Box 9102, Norwood, Massachusetts 02062 U.S.A.; [www.fmglobal.com](http://www.fmglobal.com))
- GEIS ..... GE Insurance Solutions (200 Wellington Street West, P.O. Box 166, Suite 400, Toronto, Ontario M5V 3C7; [www.geinsurancesolutions.com](http://www.geinsurancesolutions.com))
- HC ..... Health Canada (Communications Directorate, Ottawa, Ontario K1A 0K9; [www.hc-sc.gc.ca](http://www.hc-sc.gc.ca))
- IAO ..... Insurers' Advisory Organization Inc. (90 Allstate Parkway, Markham, Ontario L3R 6H3; [www.iao.ca](http://www.iao.ca))
- ICAO ..... International Civil Aviation Organization (999 University Street, Montréal, Quebec H3C 5H7; [www.icao.int](http://www.icao.int))
- IMO ..... International Maritime Organization (4 Albert Embankment, London, SE1 7SR United Kingdom; [www.imo.org](http://www.imo.org))
- IRC ..... Institute for Research in Construction (National Research Council of Canada, Ottawa, Ontario K1A 0R6; [irc.nrc-cnrc.gc.ca](http://irc.nrc-cnrc.gc.ca))
- MA&H ..... Alberta Municipal Affairs and Housing (16th Floor, Commerce Place, 10155 – 102 Street, Edmonton, Alberta, T5J 4L4; [www.municipalaffairs.gov.ab.ca](http://www.municipalaffairs.gov.ab.ca))
- NBC ..... National Building Code of Canada 2005 (see CCBFC)
- NFC ..... National Fire Code of Canada 2005 (see CCBFC)
- NFPA ..... National Fire Protection Association (1 Batterymarch Park, Quincy, Massachusetts 02169-7471 U.S.A.; [www.nfpa.org](http://www.nfpa.org))
- NRC ..... National Research Council of Canada (Ottawa, Ontario K1A 0R6; [www.nrc-cnrc.gc.ca](http://www.nrc-cnrc.gc.ca))
- NRCan ..... Natural Resources Canada (580 Booth Street, Ottawa, Ontario K1A 0E4; [www.nrcan-rncan.gc.ca](http://www.nrcan-rncan.gc.ca))

- OCIMF ..... Oil Companies International Marine Forum (27 Queen Anne's Gate, London, SW1H 9BU United Kingdom; [www.ocimf.com](http://www.ocimf.com))
- PTMAA ..... Petroleum Tank Management Association of Alberta (Suite 1560, 10303 Jasper Avenue, Edmonton, Alberta, T5J 3N6; [www.ptmaa.ab.ca](http://www.ptmaa.ab.ca))
- RMA ..... Rubber Manufacturers Association, Inc. (1400 K Street N.W., Suite 900, Washington, D.C. 20005 U.S.A.; [www.rma.org](http://www.rma.org))
- SFPE ..... Society of Fire Protection Engineers (7315 Wisconsin Avenue, Suite 620E, Bethesda, Maryland 20814 U.S.A.; [www.sfpe.org](http://www.sfpe.org))
- TC ..... Transport Canada (Public Affairs, Tower C, Place de Ville, 330 Sparks Street, Area B, 19th Floor, Ottawa K1A 0N5; [www.tc.gc.ca](http://www.tc.gc.ca))
- TDGR ..... Transportation of Dangerous Goods Regulations (see TC)
- UL ..... Underwriters Laboratories Inc. (333 Pfingsten Road, Northbrook, Illinois 60062-2096 U.S.A.; [www.ul.com](http://www.ul.com))
- ULC ..... Underwriters' Laboratories of Canada (7 Underwriters Road, Toronto, Ontario M1R 3B4; [www.ulc.ca](http://www.ulc.ca))
- UN ..... United Nations (UN Headquarters, First Avenue at 46th Street, New York, New York 10017 U.S.A.; [www.un.org](http://www.un.org))
- WHMIS ..... Workplace Hazardous Materials Information System (see HC) (Occupational Health and Safety, 902, Labour Building, 10808 - 99 Avenue, Edmonton, Alberta T5K 0G5; [www3.gov.ab.ca/hre/whs](http://www3.gov.ab.ca/hre/whs))

# **Part 2**

## **Building and Occupant Fire Safety**

<b>2.1.</b>	<b>General</b>	
2.1.1.	Scope .....	2- 1
2.1.2.	Classification of Buildings .....	2- 1
2.1.3.	Fire Safety Installations .....	2- 1
2.1.4.	Posted Information .....	2- 3
2.1.5.	Portable Extinguishers .....	2- 3
<b>2.2.</b>	<b>Fire Separations</b>	
2.2.1.	General .....	2- 3
2.2.2.	Closures .....	2- 3
<b>2.3.</b>	<b>Interior Finishing, Furnishing and Decorative Materials</b>	
2.3.1.	General .....	2- 4
2.3.2.	Flame Resistance .....	2- 5
<b>2.4.</b>	<b>Fire Hazards</b>	
2.4.1.	Combustible Materials .....	2- 6
2.4.2.	Smoking .....	2- 7
2.4.3.	Open Flames .....	2- 7
2.4.4.	Use of Dangerous Goods .....	2- 8
2.4.5.	Open Air Fires .....	2- 8
2.4.6.	Vacant Buildings .....	2- 9
2.4.7.	Electrical Installations .....	2- 9
<b>2.5.</b>	<b>Fire Department Access to Buildings</b>	
2.5.1.	General .....	2- 9
<b>2.6.</b>	<b>Service Equipment</b>	
2.6.1.	Heating, Ventilating and Air-conditioning .....	2-10
2.6.2.	Incinerators .....	2-11
2.6.3.	Electrical Equipment Vaults .....	2-12
<b>2.7.</b>	<b>Safety to Life</b>	
2.7.1.	Means of Egress .....	2-12
2.7.2.	Doors and Means of Egress .....	2-14
2.7.3.	Exit Lighting, Exit Signs and Emergency Lighting .....	2-15
<b>2.8.</b>	<b>Emergency Planning</b>	
2.8.1.	General .....	2-15
2.8.2.	Fire Safety Plan .....	2-15
2.8.3.	Fire Drills .....	2-17
<b>2.9.</b>	<b>Tents and Air-Supported Structures</b>	
2.9.1.	General .....	2-17
2.9.2.	Materials .....	2-18
2.9.3.	Fire Hazards and Control .....	2-18

<b>2.10.</b>	<b>Day-Care Centres</b>	
2.10.1.	Construction .....	2-19
2.10.2.	Supervision of Children .....	2-19
2.10.3.	Combustible Materials .....	2-19
2.10.4.	Fire Safety Measures .....	2-19
<b>2.11.</b>	<b>Boarding and Lodging Houses</b>	
2.11.1.	General .....	2-19
2.11.2.	Fire Safety Measures .....	2-19
<b>2.12.</b>	<b>Covered Malls</b>	
2.12.1.	General .....	2-20
<b>2.13.</b>	<b>Helicopter Landing Areas on Roofs</b>	
2.13.1.	Construction .....	2-21
2.13.2.	Fire Safety Measures .....	2-21
<b>2.14.</b>	<b>Industrial Relocatable Accommodation</b>	
2.14.1.	General .....	2-22
<b>2.15.</b>	<b>Homes and Hospitals</b>	
2.15.1.	General .....	2-22
<b>2.16.</b>	<b>Secondary Suites</b>	
2.16.1.	Scope .....	2-23
2.16.2.	General .....	2-23
<b>2.17.</b>	<b>Objectives and Functional Statements</b>	
2.17.1.	Objectives and Functional Statements .....	2-24

# **Part 2**

## **Building and Occupant Fire Safety**

### **Section 2.1. General**

#### **2.1.1. Scope**

##### **2.1.1.1. Application**

**1)** This Part provides for the safety of the occupants in existing *buildings*, the elimination or control of fire hazards in and around *buildings*, the installation and maintenance of certain life safety systems in *buildings*, the installation and maintenance of posted signs and information, and the establishing of a fire safety plan in those *occupancies* where it is considered necessary.

#### **2.1.2. Classification of Buildings**

##### **2.1.2.1. Classification**

**1)** For the purpose of applying this Code, every *building* or part thereof shall be classified according to its *major occupancy* in conformance with the Alberta Building Code 2006. (See Appendix A.)

##### **2.1.2.2. Hazardous Activities**

**1)** Activities that, in the opinion of the *authority having jurisdiction*, create a hazard and that are not allowed for in the original design shall not be carried out in a *building* unless provisions are made to alleviate the hazard and permission to carry out the activities is obtained in writing from the *authority having jurisdiction*. (See Appendix A.)

**2)** No *major occupancy* of Group F, Division 1 shall be contained within a *building* with any *occupancy* classified as an *assembly, care or detention* or *residential occupancy*.

#### **2.1.3. Fire Safety Installations**

##### **2.1.3.1. Fire Alarm, Standpipe and Sprinkler Systems**

**1)** Fire alarm, standpipe and sprinkler systems shall be provided in all *buildings* where required by and in conformance with the Alberta Building Code 2006. (See Appendix A.)

**2)** When changes in the use of *buildings* or *floor areas* create a hazard exceeding the criteria for which the fire protection systems were designed, such fire protection systems shall be upgraded to accommodate the increased hazard.

##### **2.1.3.2. Voice Communication Systems**

**1)** A voice communication system or systems integrated with the general fire alarm system shall be provided in *buildings* as specified in Subsection 3.2.6. of Division B of the Alberta Building Code 2006.

##### **2.1.3.3. Smoke Alarms**

**1)** *Smoke alarms* conforming to CAN/ULC-S531, "Smoke Alarms," shall be installed in each *dwelling unit* and, except for *care or detention occupancies* required to have a fire alarm system, in each sleeping room not within a *dwelling unit*.

2) Reserved

3) Except as permitted by Sentence (4), *smoke alarms* required by Sentence (1) shall be installed in conformance with the Alberta Building Code 2006. (See Appendix A.)

4) *Smoke alarms* are permitted to be battery-operated in *dwelling units* constructed before July 5, 1977. (See Appendix A.)

#### 2.1.3.4. Protection of Combustible Sprinkler Piping

1) Materials installed to protect combustible sprinkler piping, as required by the Alberta Building Code 2006, shall be maintained in accordance with the provisions of the same edition used for their installation. (See Appendix A.)

#### 2.1.3.5. Special Fire Suppression Systems

1) Where a special fire suppression system is required by this Code, the system shall conform to one of the standards listed in Sentences (3) and (4).

2) If a water-based fire suppression system is not compatible with the fire suppression requirements for certain types of *dangerous goods*, a special fire suppression system conforming to one of the standards listed in Sentence (3) is permitted to be installed in lieu of a water-based system.

3) The design and installation of a special fire suppression system that is not water-based shall conform to one of the following standards:

- a) NFPA 11, "Low-, Medium-, and High-Expansion Foam,"
- b) NFPA 12, "Carbon Dioxide Extinguishing Systems,"
- c) NFPA 12A, "Halon 1301 Fire Extinguishing Systems" (see Appendix A),
- d) Reserved
- e) NFPA 17, "Dry Chemical Extinguishing Systems,"
- f) NFPA 17A, "Wet Chemical Extinguishing Systems," or
- g) NFPA 2001, "Clean Agent Fire Extinguishing Systems."

4) The design and installation of a water-based special fire suppression system shall conform to one of the following standards:

- a) NFPA 15, "Water Spray Fixed Systems for Fire Protection,"
- b) NFPA 16, "Installation of Foam-Water Sprinkler and Foam-Water Spray Systems," or
- c) NFPA 750, "Water Mist Fire Protection Systems."

5) Wetting agents used in conjunction with water-based fire suppression systems shall conform to NFPA 18, "Wetting Agents."

6) A hazard for which a fire suppression system has been designed is not permitted to be increased unless the level of fire protection is also commensurately increased.

7) Operating and maintenance instructions for a special fire suppression system shall be posted in proximity to the equipment and, if manual controls are provided, shall be posted near the manual controls.

8) Valves and controls for a special fire suppression system shall be clearly marked to indicate their function and shall be accessible at all times.

#### 2.1.3.6. Design and Installation of Automatic Sprinkler Systems

1) An automatic sprinkler system required by this Code shall be designed and installed in conformance with the Alberta Building Code 2006. (See Appendix A.)

#### 2.1.3.7. Inspection, Maintenance and Testing of Fire Safety Devices

(See Appendix A.)

1) The inspection, maintenance and testing of fire safety devices shall be conducted in accordance with this Code.

2) Where specific references to the inspection, maintenance and testing of fire safety devices are not made in this Code, such devices shall be maintained to ensure they operate as per their design requirements.

**2.1.4. Posted Information****2.1.4.1. Posting**

- 1) Where a sign, notice, placard or information is required to be posted, it shall be
  - a) clearly legible, and
  - b) except as provided in Sentence (2), permanently mounted in a conspicuous or prominent location in proximity to the situation to which it refers.
- 2) Where the situation for which posting is required is of a temporary nature, permanent mounting need not be provided.

**2.1.4.2. Maintenance**

- 1) Every sign, notice, placard or information that is required to be posted shall be maintained in conformance with Article 2.1.4.1.

**2.1.5. Portable Extinguishers****2.1.5.1. Selection and Installation**

- 1) Portable extinguishers shall be installed in all *buildings* except *dwelling units*.
- 2) Except as otherwise required by this Code, portable extinguishers shall be selected and installed in accordance with NFPA 10, "Portable Fire Extinguishers." (See Appendix A.)
- 3) Portable extinguishers in proximity to a fire hazard shall be located so as to be accessible without exposing the operator to undue risk. (See Appendix A.)
- 4) Portable extinguishers that are subject to corrosion shall not be installed in a corrosive environment unless they are provided with appropriate corrosion protection.
- 5) Portable extinguishers shall not be distributed, sold, leased, offered for sale or lease or installed unless the portable extinguisher is *listed* and *labelled*.

**Section 2.2. Fire Separations****2.2.1. General****2.2.1.1. Fire Separations**

- 1) Where a *building* contains more than one *major occupancy*, such *occupancies* shall be separated from each other in conformance with the Alberta Building Code 2006.
- 2) Where rooms or spaces within a *building* contain a *high-hazard industrial occupancy*, such *occupancy* shall be separated from the remainder of the *building* by *fire separations* in conformance with this Code and the Alberta Building Code 2006.
- 3) Rooms, corridors, shafts and other spaces shall be separated where practicable by *fire separations* conforming to the Alberta Building Code 2006.

**2.2.1.2. Damage to Fire Separations**

- 1) Where *fire separations* are damaged so as to affect their integrity, they shall be repaired so that the integrity of the *fire separation* is maintained.

**2.2.2. Closures****2.2.2.1. Openings in Fire Separations**

- 1) Openings in *fire separations* shall be protected with *closures* in conformance with the Alberta Building Code 2006.
- 2) Where *closures* in *fire separations* are replaced, the replacements shall be in conformance with the Alberta Building Code 2006.

**2.2.2.2.****2.2.2.2. Damage to Closures**

**1)** Where *closures* are damaged so as to affect the integrity of their *fire-protection rating*, they shall be repaired so that their integrity is maintained in conformance with Article 2.2.2.1.

**2.2.2.3. Protective Guarding Devices**

- 1)** Protective guarding devices shall be
- a) provided where necessary to prevent damage to the mechanical components of doors in *fire separations*, and
  - b) installed so as not to interfere with the proper operation of the doors.

**2.2.2.4. Inspection and Maintenance**

**1)** Defects that interfere with the operation of *closures* in *fire separations* shall be corrected, and such *closures* shall be maintained to ensure that they are operable at all times by

- a) keeping fusible links and other heat-actuated devices undamaged and free of paint and dirt,
- b) keeping guides, bearings and stay rolls clean and lubricated,
- c) making necessary adjustments and repairs to door hardware and accessories to ensure proper closing and latching, and
- d) repairing or replacing inoperative parts of hold-open devices and automatic releasing devices.

**2)** Doors in *fire separations* shall be inspected at intervals not greater than 24 h to ensure that they remain closed unless the door is equipped with a hold-open device conforming to the Alberta Building Code 2006.

**3)** Doors in *fire separations* shall be operated at intervals not greater than one month to ensure that they are properly maintained in accordance with Sentence (1), as specified in the fire safety plan prepared in conformance with Section 2.8.

**4)** *Closures* in *fire separations* shall not be obstructed, blocked, wedged open, or altered in any way that would prevent the intended operation of the *closure*.

**5)** *Fire dampers* and *fire stop flaps* shall be inspected at intervals not greater than 12 months to ensure that they are in place and are not obviously damaged or obstructed.

## Section 2.3. Interior Finishing, Furnishing and Decorative Materials

**2.3.1. General****2.3.1.1. Interior Finish**

**1)** Interior finish material that forms part of the interior surface of a floor, wall, *partition* or ceiling shall conform to the Alberta Building Code 2006.

**2.3.1.2. Movable Partitions and Screens**

**1)** Movable *partitions* or screens, including acoustical screens, shall have a *flame-spread rating* not greater than that required for the interior finish of the area in which they are located.

**2.3.1.3. Decorative Materials**

**1)** Except as permitted by Sentences (2) and (3), decorative materials on walls or ceilings of *occupancies* shall have a *flame-spread rating* not greater than that required for the interior finish of the space in which they are located.

**2)** In *assembly occupancies* and *care or detention occupancies*, combustible materials used for festive decorations, including but not limited to crepe paper decorations, other combustible trimming or ornaments and Christmas trees, shall be of the flame-resistant type, or conform to CAN/ULC-S109, "Flame Tests of Flame-Resistant Fabrics and Films." (See Appendix A.)

**3)** Combustible materials, such as student artwork and teaching aids attached to school classroom and *access to exits* walls and ceilings shall not exceed 20% of a wall or ceiling surface unless

- a) the combustible materials have been tested to CAN/ULC-S102, "Method of Test for Surface Burning Characteristics of Building Materials and Assemblies," and
- b) the *flame-spread rating* does not exceed that required for the interior finish of the space in which they are located.

#### **2.3.1.4. Interconnected Floor Spaces**

**1)** Combustible contents in *interconnected floor spaces* in which the ceiling is more than 8 m above the floor, shall not exceed the limit specified in Subsection 3.2.8. of Division B of the Alberta Building Code 2006.

#### **2.3.1.5. Combustible Display or Exhibit**

**1)** No person shall operate or install a combustible display or exhibit in a Group A, Division 1, 2 or 3 *major occupancy* unless the *building* is protected by an automatic sprinkler system designed and installed in conformance with the Alberta Building Code 2006 or until precautions have been taken to protect the occupants from the hazards of fire. (See A-2.1.2.2.(1) in Appendix A.)

**2)** An arena type *building* intended for occasional use for trade shows and similar exhibition purposes shall be classified in accordance with the Alberta Building Code 2006.

### **2.3.2. Flame Resistance**

#### **2.3.2.1. Drapes, Curtains and Decorative Materials**

**1)** Drapes, curtains and other decorative materials including textiles and films used in *buildings* shall conform to CAN/ULC-S109, "Flame Tests of Flame-Resistant Fabrics and Films," when such drapes, curtains and other decorative materials are used in

- a) any *assembly occupancy* or Group B, Division 1 *care or detention occupancy*,
- b) any lobby or *exit*, or
- c) any open *floor areas* exceeding 500 m<sup>2</sup> in any *business and personal services, mercantile* or *industrial occupancy*, except when the *floor area* is divided into *fire compartments* not exceeding 500 m<sup>2</sup> in area and separated from the remainder of the *floor area* by *fire separations* having at least a 1 h *fire-resistance rating*.

#### **2.3.2.2. Flame Retardant Treatments**

**1)** Flame retardant treatments shall be renewed as often as is required to ensure that the material will pass the match flame test in NFPA 705, "Field Flame Test for Textiles and Films." (See Appendix A.)

**2)** A written record of tests and flameproofing treatment carried out in accordance with Sentence (1) shall be retained in conformance with Article 2.2.1.2. of Division C.

#### **2.3.2.3. Hospital Textiles**

**1)** Mattresses, bed linen, window drapes and cubicle curtains used in Group B, Division 2 *care or detention occupancies* shall conform to CAN/CGSB-4.162-M, "Hospital Textiles – Flammability Performance Requirements."

## Section 2.4. Fire Hazards

### 2.4.1. Combustible Materials

#### 2.4.1.1. Accumulation of Combustible Materials

(See also Sections 3.2. and 3.3.)

- 1) Combustible waste materials in and around *buildings* shall not be permitted to accumulate in quantities or locations that will constitute an undue fire hazard. (See Appendix A.)
- 2) Combustible materials, other than those for which the location, room or space is designed, shall not be permitted to accumulate in any part of an elevator shaft, ventilation shaft, *means of egress*, *service room* or *service space*. (See Appendix A.)
- 3) Horizontal concealed spaces, such as crawl spaces and ceiling spaces, shall not be used for the storage of combustible materials.
- 4) Combustible materials shall not be stored on a roof or adjacent to any *building* so as to create a fire hazard to the *building* or its occupants.
- 5) Abandoned optical fibre cables and electrical wires and cables with combustible insulation, jackets, or sheathes, and nonmetallic raceways shall be removed from a plenum unless
  - a) they are permanently enclosed by the structure or finish of the *building*,
  - b) their removal would disturb the structure or finish of the *building*, or
  - c) their removal could affect the performance of cables in use.
- 6) Outdoor storage receptacles, such as dumpsters, used for combustible materials shall be located so that they do not create an undue fire hazard to surrounding *buildings*. (See Appendix A.)

#### 2.4.1.2. Storage Rooms for Combustible Waste Materials

- 1) Where rooms are provided for the storage of combustible waste materials, such rooms shall conform to the Alberta Building Code 2006.

#### 2.4.1.3. Waste Receptacles

- 1) Materials subject to spontaneous ignition, such as oily rags, shall be deposited in a receptacle conforming to Sentence (4) or be removed from the premises. (See Appendix A.)
- 2) All ashes shall be stored in receptacles conforming to Sentence (4) and combustible materials shall not be stored with ashes in the same container.
- 3) Except as permitted in Sentence (4), noncombustible receptacles as required in Sentences (1) and (2) shall not be placed closer than 1 m to combustible materials.
- 4) A receptacle required by Sentences (1) and (2) shall be *listed* and *labelled*, or
  - a) be constructed of metal,
  - b) have a close-fitting, self-closing metal cover, and
  - c) if the flooring material upon which it is placed is combustible, have a flanged bottom or legs not less than 50 mm high.
- 5) Except as permitted in Sentence (6), receptacles for combustible recyclable material having a capacity greater than 0.125 m<sup>3</sup> used within a *building* shall be
  - a) of noncombustible, fully enclosed construction with a tight-fitting lid, or
  - b) located in a storage room conforming to Article 2.4.1.2.
- 6) Receptacles for the collection of combustible recyclable materials are permitted provided they
  - a) conform to CAN/ULC-S102, "Method of Test for Surface Burning Characteristics of Building Materials and Assemblies," and
  - b) have a *flame-spread rating* not more than 150 on any exposed surface.
- 7) Unless acceptable to the *authority having jurisdiction*, only one receptacle for combustible recyclable materials per *suite* shall be permitted.

8) Receptacles for combustible recyclable material shall be emptied when full or at least weekly.

9) Receptacles for combustible recyclable material shall not be placed in rooms or areas where smoking is permitted unless the receptacles are noncombustible with a tight-fitting lid. (See Appendix A.)

#### 2.4.1.4. Lint Traps for Laundry Equipment

1) Lint traps, vents and associated piping in laundry equipment shall be cleaned at intervals frequent enough to prevent the lint accumulating in quantities that will constitute a fire hazard.

### 2.4.2. Smoking

#### 2.4.2.1. Smoking Areas

1) Smoking shall not be permitted in areas where conditions are such as to make smoking a fire or explosion hazard.

2) An area where smoking is not permitted in Sentence (1) shall be identified by signs conforming to Article 2.4.2.2.

3) Where smoking is permitted, an adequate number of ash trays shall be provided.

#### 2.4.2.2. Signs

1) Signs prohibiting smoking shall have black lettering not less than 50 mm high with a 12 mm stroke on a yellow background, except that symbols of not less than 150 mm by 150 mm are permitted to be used in lieu of lettering.

### 2.4.3. Open Flames

#### 2.4.3.1. Open Flames in Processions

1) Open flames whose quantity and method of use create a fire hazard shall not be permitted in processions, at displays, or as part of an act or entertainment.

#### 2.4.3.2. Flaming Meals and Drinks

1) In Group B, Division 2 *care or detention occupancies*, flaming meals or drinks shall not be served.

2) In *assembly occupancies*, flaming meals or drinks shall be ignited only at the location of serving.

3) In *assembly occupancies*, the refuelling of equipment used to flame meals or drinks, or to warm food, shall be carried out

- outside the serving area, and
- away from ignition sources.

4) A portable extinguisher having a minimum rating of 5-B:C shall be located on the serving cart or table where flaming meals and drinks referred to in Sentences (2) and (3) are served.

#### 2.4.3.3. Devices Having Open Flames

1) Devices having open flames shall be securely supported in noncombustible holders and shall be located or protected so as to prevent accidental contact of the flame with combustible materials.

**2.4.4.1.****2.4.4. Use of Dangerous Goods****2.4.4.1. Flammable and Combustible Liquids**

- 1) *Flammable liquids* and *combustible liquids* shall be classified, stored and handled in conformance with Part 4.
- 2) Class 1 liquids shall not be used for cleaning purposes except where such cleaning is an essential part of a process.
- 3) Spills of *flammable liquids* or *combustible liquids* within *buildings* shall be removed in conformance with Subsection 4.1.6.

**2.4.4.2. Flammable Gases**

- 1) Class 2.1 flammable gases shall not be used to inflate balloons.

**2.4.4.3. Internal Combustion Powered Equipment**

- 1) Unless acceptable to the *authority having jurisdiction*, equipment utilizing an internal combustion engine stored within a *building* shall have the storage room or area separated from the remainder of the *building* by a *fire separation* in accordance with the Alberta Building Code 2006. (See Appendix A.)

**2.4.4.4. Emergency Shutoff Valves in Schools**

- 1) The person in charge of a school shall ensure that the emergency shutoff valves that control multiple gas outlets that are not equipped with automatic shutoff valves are in the closed position when the gas outlets are not in use.

**2.4.4.5. Propane Fuelled Vehicles**

- 1) Except as permitted by Sentence (2), only a propane fuelled vehicle bearing a label in accordance with the CAN/CGA-B149.5, "Installation Code for Propane Fuelled Systems and Tanks on Highway Vehicles," is permitted to enter or be parked in
  - a) an underground parking facility, or
  - b) an enclosed structure.(See Appendix A.)
- 2) A propane fuelled vehicle may be parked in an enclosed structure that is
  - a) a garage serving not more than one *dwelling unit*, or
  - b) not used by the public and is acceptable to the *authority having jurisdiction*.
- 3) No person shall park a propane fuelled vehicle inside a *building* for repair or maintenance unless safety precautions are taken in conformance with gas regulations made pursuant to the Safety Codes Act.

**2.4.4.6. Gas Containers**

- 1) No person shall store or use a natural gas or liquefied petroleum gas container for use with fuel-burning *appliances* or equipment except in conformance with gas regulations made pursuant to the Safety Codes Act.

**2.4.5. Open Air Fires****2.4.5.1. Open Air Fires**

- 1) Except for fires used for cooking in fireplaces, grills or barbecues, open air fires shall not be set unless appropriate measures are taken to limit their spread. (See Appendix A.)
- 2) No person shall use a solid fuel-fired barbecue in a *building* or on the balcony of a *building* containing more than 2 *dwelling units*.

**2.4.6. Vacant Buildings****2.4.6.1. Security**

- 1) Vacant *buildings* shall be secured against unauthorized entry. (See Appendix A.)

**2.4.7. Electrical Installations****2.4.7.1. Use and Maintenance**

- 1) Electrical installations shall be used and maintained so as not to constitute an undue fire hazard.

**Section 2.5. Fire Department Access to Buildings****2.5.1. General****2.5.1.1. Access to Building**

- 1) Fire department vehicles shall have direct access to at least one face of every *building* by means of a *street*, yard or roadway in conformance with the Alberta Building Code 2006.

**2.5.1.2. Access Panels and Windows**

- 1) Access panels or windows provided to facilitate access for firefighting operations shall be maintained free of obstruction.

**2.5.1.3. Fire Department Building Access**

- 1) A *building* that incorporates fire protection equipment, elevator control or door access outlined in Sentence (2) shall provide a key box constructed, keyed, and located in a manner acceptable to the *authority having jurisdiction* containing a set or sets of keys or devices required to be used in an emergency. (See Appendix A.)

- 2) A fire department key box shall be installed and provided with keys and devices in conformance with Sentence (1) in a *building* equipped with
  - a) a fire alarm system whose control features, including those for emergency voice communication systems, are located behind a locked panel,
  - b) a fire alarm system in which manually operated devices require a key or device in order to be reset,
  - c) a fire alarm system in which the electrical circuit breaker is located within a locked panel or room,
  - d) an automatic sprinkler system in which the main control valve is locked in the open position,
  - e) an automatic sprinkler system in which the main control valve is located within a locked room or enclosure,
  - f) firefighting standpipe and water supply connections in a locked room or area,
  - g) a key-operated elevator control feature that will permit exclusive use of elevators by firefighting personnel,
  - h) a key-operated elevator control feature that will switch selected elevators to operate on emergency power,
  - i) stairway doors that have been locked on the stairway side in conformance with the Alberta Building Code 2006, or
  - j) locked access doors to a roof provided for firefighting purposes.

- 3) Keys or devices provided in conformance with Sentence (2) shall be affixed to a key ring or rings, and identified with tags indicating their function.

- 4) If a fire alarm system or sprinkler system is required to transmit a signal to the fire department in conformance with the Alberta Building Code 2006, a key box shall be installed on the exterior wall of the *building* in proximity to the principal entrance.

**2.5.1.4.**

5) A key box installed in conformance with Sentence (4) shall contain an entrance door key with a tag affixed to this key in conformance with Sentence (3).

**2.5.1.4. Access to Fire Department Connections**

1) Access to fire department connections for sprinkler or standpipe systems by firefighters and their equipment shall be maintained free of obstructions at all times.

**2.5.1.5. Maintenance of Fire Department Access**

1) *Streets*, yards and roadways provided for fire department access shall be maintained so as to be ready for use at all times by fire department vehicles.

2) Vehicles shall not be parked to obstruct access by fire department vehicles and signs shall be posted prohibiting such parking. (See Appendix A.)

3) Signs posted in conformance with Sentence (2) shall be permanently installed not more than 20 m apart and not more than 2.3 m above surrounding ground level to ensure they are clearly visible to approaching vehicles.

**Section 2.6. Service Equipment****2.6.1. Heating, Ventilating and Air-conditioning****2.6.1.1. Installation**

1) Heating, ventilating and air-conditioning *appliances* and equipment shall be installed in conformance with the Alberta Building Code 2006.

**2.6.1.2. Coal and Wood Bins**

1) Coal and wood bins shall be located not less than 1.2 m from the *appliance* served.

**2.6.1.3. Hoods, Ducts and Filters**

1) Hoods, ducts and filters subject to accumulations of combustible deposits shall be inspected at intervals not greater than 7 days, and shall be cleaned if the accumulation of such deposits creates a fire hazard.

**2.6.1.4. Chimneys, Flues and Flue Pipes**

1) Every *chimney*, *flue* and *flue pipe* shall be inspected to identify any dangerous condition

- a) at intervals not greater than 12 months,
- b) at the time of addition of any *appliance*, and
- c) after any *chimney* fire.

(See Appendix A.)

2) *Chimneys*, *flues* and *flue pipes* shall be cleaned as often as necessary to keep them free from dangerous accumulations of combustible deposits. (See Appendix A.)

3) A *chimney*, *flue*, or *flue pipe* shall be replaced or repaired to eliminate

- a) any structural deficiency or decay (see Appendix A), and
- b) all abandoned or unused openings that are not effectively sealed in a manner that would prevent the passage of fire or smoke.

**2.6.1.5. Clearances**

1) Required clearances between *chimneys*, *flue pipes* or *appliances* and *combustible construction* shall be maintained in conformance with the Alberta Building Code 2006.

2) Combustible materials shall not be located within the required clearance space surrounding *chimneys*, *flue pipes* or *appliances*, or adjacent to ash pit or cleanout doors.

**2.6.1.6. Operation and Maintenance Procedures**

1) Heating, ventilating and air-conditioning systems, including *appliances, chimneys* and *flue pipes*, shall be operated and maintained so as not to create a hazardous condition.

2) Except for self-contained systems within *dwelling units*, disconnect switches for mechanical air-conditioning and ventilating systems shall be operated at intervals not greater than 12 months to establish that the system can be shut down in an emergency.

3) A record of the tests required by Sentence (2) shall be retained in conformance with Article 2.2.1.2. of Division C.

**2.6.1.7. Ventilation Shafts**

1) Ventilation shafts shall be used only for ventilating purposes.

**2.6.1.8. Repairs and Renovations**

1) Work on ducts involving the use of heat-producing devices for cutting, welding or soldering shall not be undertaken before

- a) the system has been shut down,
- b) the duct has been cleaned of any accumulations of combustible deposits, and
- c) any combustible lining and covering material that could be ignited by such work has been removed.

2) Precautions shall be taken, where necessary, to ensure that there is no damage to fuel supply piping or equipment that would result in fuel leakage or a fire hazard during renovations or excavation.

**2.6.1.9. Commercial Cooking Equipment**

1) Commercial cooking equipment exhaust and fire protection systems shall be designed and installed in conformance with the Alberta Building Code 2006.

2) Except as required in Sentences (3) to (5), the use, inspection and maintenance of commercial cooking equipment exhaust and fire protection systems shall be in conformance with NFPA 96, "Ventilation Control and Fire Protection of Commercial Cooking Operations."

3) Hoods, grease removal devices, fans, ducts, and other appurtenances shall be cleaned at frequent intervals to prevent surfaces from becoming heavily contaminated with grease or other residues. (See Appendix A.)

4) Flammable cleaning materials or solvents shall not be used for the cleaning of exhaust systems.

5) Instructions for manually operating the fire protection systems shall be posted conspicuously in the kitchen as part of the fire safety plan.

6) Commercial cooking equipment that is certified shall be installed and maintained in conformance with its certification.

7) Uncertified commercial cooking equipment shall be installed and maintained so as not to create a fire hazard.

**2.6.2. Incinerators****2.6.2.1. Indoor Incinerators**

1) The installation and alteration of indoor incinerators shall conform to the Alberta Building Code 2006.

**2.6.2.2. Outdoor Incinerators**

1) The design, construction, installation, alteration and maintenance of outdoor incinerators shall conform to NFPA 82, "Incinerators and Waste and Linen Handling Systems and Equipment," except that the *flue* venting an incinerator shall not serve as the chute conveying waste material to the incinerator.

**2.6.2.3.****2.6.2.3. Spark Arresters**

- 1) Spark arresters installed in conformance with Articles 2.6.2.1. and 2.6.2.2. shall be inspected and cleaned at intervals not greater than 12 months or more frequently where accumulations of debris will adversely affect operations.
- 2) Burnt-out spark arresters shall be repaired or replaced.

**2.6.3. Electrical Equipment Vaults****2.6.3.1. Use**

- 1) Electrical equipment vaults shall not be used for storage purposes.

**2.6.3.2. Security**

- 1) Electrical equipment vaults shall be kept locked so that unauthorized persons will not have access to them.

**Section 2.7. Safety to Life****2.7.1. Means of Egress****2.7.1.1. Means of Egress**

- 1) *Means of egress* shall be provided in *buildings* in conformance with the Alberta Building Code 2006.

**2.7.1.2. Open Floor Areas**

- 1) Aisles in conformance with Sentences (2) to (4) shall be provided in every *floor area* that
  - a) is not subdivided into rooms or *suites* served by corridors giving *access to exits*, and
  - b) is required by the Alberta Building Code 2006 to have more than one egress doorway.
- 2) Every required egress doorway shall be served by an aisle that
  - a) has a clear width not less than 1100 mm,
  - b) has access to at least one additional egress doorway, and
  - c) at every point on the aisle, provides a choice of 2 opposite directions by which to reach an egress doorway.
- 3) A subsidiary aisle with only a single direction of travel to an aisle described in Sentence (2) is permitted provided it has a clear width not less than 900 mm and a length not greater than
  - a) 7.5 m in *business and personal services, mercantile and high-hazard industrial occupancies*,
  - b) 10 m in *medium-hazard industrial occupancies*, or
  - c) 15 m in *low-hazard industrial occupancies*.
- 4) Every individual work area in *business and personal services occupancies* shall be located adjacent to an aisle or subsidiary aisle.

**2.7.1.3. Occupant Load**

- 1) The maximum permissible *occupant load* for any room shall be calculated on the basis of the lesser of
  - a) the number of occupants determined in accordance with Table 3.1.17.1. of Division B of the Alberta Building Code 2006,
  - b) the *occupant load* for which *means of egress* are provided, or
  - c) the *occupant load* as calculated and posted in accordance with the Alberta Building Code.
 (See Appendix A.)

**2)** The number of occupants permitted to enter a room shall not exceed the maximum *occupant load* calculated in conformance with Sentence (1).

**3)** The *owner* shall ensure that a plan showing the floor layout and designed use of the rooms specified in Sentence (1) is made available in conformance with Article 2.2.1.2. of Division C.

#### 2.7.1.4. Signs

**1)** In *assembly occupancies* with *occupant loads* exceeding 60 persons, the *occupant load* shall be posted in conspicuous locations near the principal entrances to the room or *floor area*.

**2)** Signs required by the Alberta Building Code 2006 to indicate the *occupant load* for a *floor area* shall be posted in conspicuous locations near the principal entrances to the *floor area*. (See Appendix A.)

**3)** Signs required by Sentences (1) and (2) shall be acceptable to the *authority having jurisdiction*.

#### 2.7.1.5. Nonfixed Seating

- 1)** When nonfixed seats are provided in *assembly occupancies*,
- except as provided in Sentence (3), the seats shall be arranged in rows having an unobstructed passage of not less than 400 mm between rows measured horizontally between plumb lines from the backs of the seats in one row and the edges of the furthest forward projection of the seats in the next row behind in the unoccupied position,
  - except as provided in Sentence (2), aisles shall be located so that there are not more than 7 seats, or 12 seats without backs, between every seat and the nearest aisle,
  - except as provided in Sentence (2), the clear width of an aisle in millimetres shall be not less than the greater of 1100 or the product of the number of seats served by that aisle and 6.1,
  - the width of an aisle is permitted to be reduced to not less than 750 mm when serving 60 seats or fewer,
  - dead-end aisles shall not be longer than 6 m, and
  - except as provided in Sentence (3), when the *occupant load* exceeds 200 persons,
    - the seats in a row shall be fastened together in units of no fewer than 8 seats, or
    - where there are 7 seats or fewer in a row, all the seats in the row shall be fastened together.
  - the distance to an exit door by means of any aisle shall be not more than
    - 30 m in the case of an *assembly occupancy* that is not *sprinklered*, or
    - 45 m in the case of an *assembly occupancy* that is *sprinklered*, and
  - every aisle shall terminate in a cross aisle, foyer or *exit* and the width of the cross aisle, foyer or *exit* shall be at least the required width of the widest aisle that it serves, plus 50% of the total required width of the remaining aisles that it serves.
- 2)** When nonfixed seats are provided in outdoor places of public assembly,
- aisles shall be located so that there are not more than 15 seats between every seat and the nearest aisle, and
  - the clear width of an aisle in millimetres shall be not less than the greater of 1200 or the product of the number of seats served by that aisle and 1.8.
- 3)** When nonfixed seats are provided at tables arranged in rows, the spacing between the nearest edges of tables in 2 successive rows shall be not less than
- 1400 mm where seating is arranged on both sides of tables (back to back), or
  - 1000 mm where seating is on one side only.

4) The arrangement of nonfixed tables and chairs shall conform to NFPA 101®, "Life Safety Code®." (1)

#### 2.7.1.6. Maintenance

1) *Means of egress* shall be maintained in good repair and free of obstructions.

#### 2.7.1.7. Exterior Passageways and Exit Stairs

1) Exterior passageways and exterior *exit* stairs serving occupied *buildings* shall be maintained free of snow and ice accumulations.

2) Where equipment is provided to melt snow or ice on exterior passageways and exterior *exit* stairs serving an occupied *building*, such equipment shall be maintained in working order or alternative measures shall be taken to comply with Sentence (1).

3) A stairway *exit* door from a floor level in a *building* that is more than 3 storeys in *building* height shall bear a number that indicates the floor on which the door is located and shall be

- a) located on the stairwell side of the door,
- b) centrally located 1.7 m above the bottom of the door,
- c) at least 100 mm high with a 20 mm stroke, and
- d) contrasting in colour so as to be clearly visible.

4) Where an *exit* door is located so that there is a possibility of obstruction by vehicles or other objects, the door shall be identified with a sign as described in Sentence (5).

- 5) Signs required by Sentence (4) shall
- a) read "Fire Exit. No parking within 3 m,"
  - b) have red lettering on a contrasting background, and
  - c) have letters 100 mm high with a 15 mm stroke.

### 2.7.2. Doors and Means of Egress

#### 2.7.2.1. Exit Doors and Door Release Hardware

1) Except as permitted by Sentences (2), (3) and (4), all doors forming part of a *means of egress* shall be tested at intervals not greater than one month to ensure that they are operable.

2) The safety features of revolving doors shall be tested at intervals not greater than 12 months.

3) Sliding doors that are required to swing on their vertical axes in the direction of egress when pressure is applied shall be tested at intervals not greater than 12 months.

4) When doors are equipped with electromagnetic locks, these locks shall be tested at intervals not greater than 12 months.

5) Door release hardware shall be installed on doors in conformance with the Alberta Building Code 2006.

6) Door release hardware, latches and locks shall be maintained in good working condition at all times.

7) An *exit* door shall not be bolted, barred or locked other than with a device that complies with Sentence (5).

#### 2.7.2.2. Records

1) Records of tests required in Sentences 2.7.2.1.(2), (3) and (4) shall be retained in conformance with Article 2.2.1.2. of Division C.

(1) NFPA 101® and Life Safety Code® are registered trademarks of the National Fire Protection Association, Inc., Quincy, MA 02169-7471

### 2.7.3. Exit Lighting, Exit Signs and Emergency Lighting

#### 2.7.3.1. Installation and Maintenance

- 1) *Exit* lighting, *exit* signs and emergency lighting shall be provided in *buildings* in conformance with the Alberta Building Code 2006. (See Appendix A.)
- 2) *Exit* lighting and *exit* signs shall be illuminated during times when the *building* is occupied.
- 3) Emergency lighting shall be maintained in operating condition, in conformance with Section 6.5.

## Section 2.8. Emergency Planning

### 2.8.1. General

#### 2.8.1.1. Application

- 1) Fire emergency procedures conforming to this Section shall be provided for
  - a) every *building* containing an *assembly* or a *care or detention occupancy*,
  - b) every *building* required by the Alberta Building Code 2006 to have a fire alarm system,
  - c) demolition and construction sites regulated under Section 5.6.,
  - d) storage areas required to have a fire safety plan in conformance with Articles 3.2.2.5., 3.3.2.9. and 3.3.6.7.,
  - e) areas where *flammable liquids* or *combustible liquids* are stored or handled, in conformance with Article 4.1.5.5., and
  - f) areas where hazardous processes or operations occur, in conformance with Article 5.1.5.1.

#### 2.8.1.2. Training of Supervisory Staff

- 1) *Supervisory staff* shall be trained in the fire emergency procedures described in the fire safety plan before they are given any responsibility for fire safety. (See Appendix A.)

#### 2.8.1.3. Keys and Special Devices

- 1) Any keys or special devices needed to operate the fire alarm system or provide access to any fire protection systems or equipment shall be readily available to on-duty *supervisory staff* or located in fire department key boxes conforming to Article 2.5.1.3.

### 2.8.2. Fire Safety Plan

#### 2.8.2.1. Measures in a Fire Safety Plan

- 1) In *buildings* or areas described in Article 2.8.1.1., a fire safety plan conforming to this Section shall be prepared in cooperation with the fire department and other applicable regulatory authorities and shall include
  - a) the emergency procedures to be used in case of fire, including
    - i) sounding the fire alarm (see Appendix A),
    - ii) notifying the fire department,
    - iii) instructing occupants on procedures to be followed when the fire alarm sounds,
    - iv) evacuating occupants, including special provisions for persons requiring assistance (see Appendix A),
    - v) confining, controlling and extinguishing the fire,
  - b) the appointment and organization of designated *supervisory staff* to carry out fire safety duties,
  - c) the training of *supervisory staff* and other occupants in their responsibilities for fire safety,

- d) documents, including diagrams, showing the type, location and operation of the *building* fire emergency systems,
- e) the holding of fire drills,
- f) the control of fire hazards in the *building*, and
- g) the inspection and maintenance of *building* facilities provided for the safety of occupants.

(See Appendix A.)

**2)** The fire safety plan shall be reviewed at intervals not greater than 12 months to ensure that it takes account of changes in the use and other characteristics of the *building*.

### 2.8.2.2. Care or Detention Occupancies

**1)** A sufficient number of *supervisory staff* shall be on duty in *care or detention occupancies* to perform the tasks outlined in the fire safety plan described in Clause 2.8.2.1.(1)(a).

### 2.8.2.3. Assembly Occupancies

**1)** In Group A, Division 1 *assembly occupancies* containing more than 60 occupants, there shall be at least one *supervisory staff* member on duty in the *building* to perform the tasks outlined in the fire safety plan in Clause 2.8.2.1.(1)(a) whenever the *building* is open to the public.

### 2.8.2.4. High Buildings

**1)** In *buildings* within the scope of Subsection 3.2.6. of Division B of the Alberta Building Code 2006, the fire safety plan shall, in addition to the requirements of Sentence 2.8.2.1.(1), include

- a) the training of *supervisory staff* in the use of the voice communication system,
- b) the procedures for the use of elevators,
- c) the action to be taken by *supervisory staff* in initiating any smoke control or other fire emergency systems installed in a *building* in the event of fire until the fire department arrives,
- d) instructions to the *supervisory staff* and fire department for the operation of the systems referred to in Clause (c), and
- e) the procedures established to facilitate fire department access to the *building* and fire location within the *building*.

**2)** Firefighting procedures shall be prepared by the fire department in cooperation with the person in charge of the *building* for all *buildings* within the scope of Subsection 3.2.6. of Division B of the Alberta Building Code 2006.

### 2.8.2.5. Retention of Fire Safety Plans

**1)** The fire safety plan shall be kept in the *building* for reference by the fire department, *supervisory staff* and other personnel.

**2)** The fire safety plan for a *building* within the scope of Subsection 3.2.6. of Division B of the Alberta Building Code 2006 shall be kept at the central alarm and control facility.

### 2.8.2.6. Distribution

**1)** A copy of the fire emergency procedures and other duties for *supervisory staff*, as laid down in the fire safety plan, shall be given to all *supervisory staff*.

### 2.8.2.7. Posting of Fire Emergency Procedures

**1)** At least one copy of the fire emergency procedures shall be prominently posted on each *floor area*. (See Appendix A.)

**2)** In every hotel and motel bedroom, the fire safety rules for occupants shall be posted showing the locations of *exits* and the paths of travel to *exits*.

3) Where a fire alarm system has been installed with no provisions to transmit a signal to the fire department, a sign shall be posted at each manually actuated signalling box requesting that the fire department be notified, and including the telephone number of that department.

#### 2.8.2.8. Shutdown of Fire Alarm Systems

1) If a fire alarm and detection system, or part thereof, is inoperative for more than 2 hours for any reason, the *owner* shall notify the fire department, and when directed, provide acceptable surveillance within the *building* continuously until the fire alarm and detection system is restored to operating condition.

2) Procedures acceptable to the fire department shall be developed to notify occupants if a fire or other emergency occurs while the fire alarm and detection system is inoperative. (See Appendix A.)

#### 2.8.3. Fire Drills

##### 2.8.3.1. Fire Drill Procedures

1) The procedure for conducting fire drills shall be determined by the person in responsible charge of the *building*, taking into consideration

- a) the *building occupancy* and its fire hazards,
- b) the safety features provided in the *building*,
- c) the desirable degree of participation of occupants other than *supervisory staff*,
- d) the number and degree of experience of participating *supervisory staff*,
- e) the features of fire emergency systems installed in *buildings* within the scope of Subsection 3.2.6. of Division B of the Alberta Building Code 2006, and
- f) the requirements of the fire department.

(See Appendix A.)

##### 2.8.3.2. Fire Drill Frequency

1) Fire drills as described in Sentence 2.8.3.1.(1) shall be held at intervals not greater than 12 months for the *supervisory staff*, except that

- a) in day-care centres and in Group B *major occupancies*, such drills shall be held at intervals not greater than one month,
- b) in schools attended by children, total evacuation fire drills shall be held at least 3 times in each of the fall and spring school terms, and
- c) in *buildings* within the scope of Subsection 3.2.6. of Division B of the Alberta Building Code 2006, such drills shall be held at least every 6 months.

2) The person in charge of a *building* shall maintain and make available to the fire department a written record of all fire drills held in accordance with this Section, showing

- a) the date of the drill,
- b) the evacuation time, and
- c) comments and recommendations.

3) The record required by Sentence (2) shall be retained in conformance with Article 2.2.1.2. of Division C.

## Section 2.9. Tents and Air-Supported Structures

### 2.9.1. General

#### 2.9.1.1. Tents and Air-Supported Structures

1) Tents and *air-supported structures* shall be in conformance with the Alberta Building Code 2006.

**2.9.2.1.****2.9.2. Materials****2.9.2.1. Flame Retardant Treatments**

1) Flame retardant treatments shall be renewed as often as is required to ensure that the material will pass the match flame test in NFPA 705, "Field Flame Test for Textiles and Films." (See A-2.3.2.2.(1) in Appendix A.)

**2.9.3. Fire Hazards and Control****2.9.3.1. Electrical Systems**

1) The electrical system and equipment in a tent or *air-supported structure* shall be maintained and operated in accordance with the electrical regulations made pursuant to the Safety Codes Act.

2) Portable electrical systems shall be inspected for fire hazards and defects shall be corrected before the tent or *air-supported structure* is occupied by the public.

3) The electrical system and equipment in a tent or *air-supported structure*, including electrical fuses and switches, shall be inaccessible to the public.

4) Cables on the ground in areas used by the public in a tent or *air-supported structure* shall be placed in trenches or protected by covers to prevent damage from traffic.

**2.9.3.2. Combustible Materials**

1) Hay, straw, shavings or similar combustible materials other than necessary for the daily feeding and care of animals shall not be permitted within a tent or *air-supported structure* used for an *assembly occupancy*, except that sawdust and shavings are permitted to be used if kept damp.

2) The ground enclosed by a tent or *air-supported structure* and for not less than 3 m outside the structure shall be cleared of all flammable material or vegetation that will spread fire. (See Appendix A.)

**2.9.3.3. Smoking and Open Flame Devices**

1) Smoking and open flame devices shall not be permitted in a tent or *air-supported structure* while it is occupied by the public.

**2.9.3.4. Fire Watch**

1) A person shall be employed to watch for fires when a tent or *air-supported structure* is occupied by more than 1 000 persons.

- 2) A person employed to watch for fires as described in Sentence (1) shall
- be familiar with all fire safety features, including the fire safety plan as provided in conformance with Section 2.8. and the condition of *exits*, and
  - patrol the area to ensure that the *means of egress* are kept clear and that requirements of the *authority having jurisdiction* are enforced.

**2.9.3.5. Fire Alarm System**

1) Where tents and *air-supported structures* are designed to accommodate more than 1000 persons, a fire alarm and emergency communication system shall be provided. (See Appendix A.)

**2.9.3.6. Blower Engines**

1) Internal combustion engines used to power supplementary blowers required by the Alberta Building Code 2006 shall be operated and maintained in conformance with Section 6.5.

## Section 2.10. Day-Care Centres

### 2.10.1. Construction

#### 2.10.1.1. Construction

1) Day-care centres shall be constructed in conformance with the Alberta Building Code 2006.

### 2.10.2. Supervision of Children

#### 2.10.2.1. Supervision of Children

1) The operators of day-care centres shall provide a staffing ratio for the supervision of children as required by the Social Care Facilities Licensing Act and its Regulations.

2) Where handicapped children are being cared for in a centre, sufficient staff shall be present to escort the children to safety during the period they are in the centre.

### 2.10.3. Combustible Materials

#### 2.10.3.1. Combustible Materials Attached to Walls

1) Combustible materials, such as artwork and teaching aids, shall conform to Sentence 2.3.1.3.(3).

#### 2.10.3.2. Waste Receptacles

1) Waste receptacles shall be made of noncombustible materials.

#### 2.10.3.3. Flammable and Combustible Liquids

1) *Flammable liquids* and *combustible liquids* shall be stored in conformance with Part 4 and in areas inaccessible to children.

### 2.10.4. Fire Safety Measures

#### 2.10.4.1. Fire Prevention Inspections

1) Staff members of day-care centres in which more than 10 children are cared for shall conduct fire prevention inspections in conformance with the fire safety plan at intervals not greater than one month.

## Section 2.11. Boarding and Lodging Houses

### 2.11.1. General

#### 2.11.1.1. Construction

1) *Buildings* altered or occupied for purposes of providing accommodation for boarders, lodgers or roomers shall conform to the Alberta Building Code 2006.

### 2.11.2. Fire Safety Measures

#### 2.11.2.1. Portable Extinguishers

1) At least one portable extinguisher having a 2-A rating shall be installed on each *storey* of a *building* described in Article 2.11.1.1.

## Section 2.12. Covered Malls

### 2.12.1. General

#### 2.12.1.1. Use

- 1) Except as permitted in Sentence (2), covered malls designed for ornamental and pedestrian oriented uses only shall not be used for merchandising or public activities.
- 2) A covered mall referred to in Sentence (1) is permitted to be used for merchandising or public activities on a temporary basis provided
  - a) it conforms to Articles 2.12.1.2. to 2.12.1.9., and
  - b) the fire safety plan required in Section 2.8. includes additional provisions to offset any hazard that may be created by such activity.

#### 2.12.1.2. Adequacy of Sprinkler System

- 1) Merchandising or public activities in a *sprinklered* covered mall described in Article 2.12.1.1. shall not be permitted where such activity will create a hazard exceeding the design criteria for which the sprinkler system was designed.

#### 2.12.1.3. Alternatives to Spatial Separation

- 1) When a covered mall having a width of not less than 9 m has been provided for the purpose of considering each portion of the *building* separated by the mall as a separate *building*, merchandising or public activities are permitted within the required 9 m width provided alternative protection is installed in conformance with Article 1.2.1.1. of Division A.

#### 2.12.1.4. Access to Exits

- 1) *Access to exits* within a covered mall shall be provided and maintained in conformance with Subsection 2.7.1.
- 2) If a public corridor conforming to Subclause 3.4.2.5.(1)(d)(i) of Division B of the Alberta Building Code 2006 contains an *occupancy*, the *occupancy* shall be located so that there is an unobstructed width for pedestrian travel of not less than 3 m at all times adjacent and parallel to all *occupancies*, rooms and *suites* that front onto the public corridor, and the combined area of all *occupancies* shall be not more than 15% of the area of the public corridor.
- 3) Where the *occupancy* referred to in Sentence (2) is immediately adjacent to a room or *suite* fronting the public corridor, it shall be separated from the room or *suite* in accordance with Article 3.3.1.1. of Division B of the Alberta Building Code 2006.

#### 2.12.1.5. Access to Fire Protection Equipment

- 1) Where a covered mall is used for merchandising or public activities, the activity shall be arranged so that access to fire protection equipment, including sprinkler control valves, fire hose stations, portable extinguishers and fire alarm stations, is not restricted.

#### 2.12.1.6. Decorative Materials

- 1) Decorative materials used for merchandising or public activities in a covered mall shall conform to Subsection 2.3.2.

#### 2.12.1.7. Flammable and Combustible Liquids and Flammable Gases

- 1) *Flammable liquids*, *combustible liquids* and Class 2.1 flammable gases shall not be used or displayed in a covered mall.

**2.12.1.8. Fuelled Equipment**

1) Where a covered mall is used for the display of fuelled equipment, batteries shall be disconnected and caps for fuel tanks shall be locked or secured against tampering.

**2.12.1.9. Propane Fuelled Automotive Vehicles**

1) A propane fuelled automotive vehicle shall not be displayed in a covered mall.

## Section 2.13. Helicopter Landing Areas on Roofs

**2.13.1. Construction****2.13.1.1. Construction**

1) Helicopter landing areas on roofs shall be constructed in conformance with the requirements for heliports contained in the "Canadian Aviation Regulations - Part III," published by Transport Canada.

**2.13.2. Fire Safety Measures****2.13.2.1. Fire Separations**

1) Areas or rooms communicating with the landing area shall be separated therefrom by a *fire separation* conforming to the Alberta Building Code 2006.

**2.13.2.2. Fire Alarm**

1) Where a fire alarm system is installed, a manually operated fire alarm station shall be installed on the roof at each *exit* from a helicopter landing area.

2) Helicopter landing areas on roofs shall be provided with telephone extensions or means to notify the fire department in conformance with the Alberta Building Code 2006.

**2.13.2.3. Smoking**

1) Smoking shall not be permitted on helicopter landing areas on roofs, and signs conforming to Article 2.4.2.2. shall be placed at the *exits* from the rooftop and in the vicinity of the landing area.

**2.13.2.4. Fire Watch**

1) Two persons knowledgeable in the use of firefighting equipment shall be in attendance on the roof deck at each landing area when it is in use.

**2.13.2.5. Refuelling, Repair and Maintenance Operations**

1) Helicopter refuelling, repair and maintenance operations shall not be carried out on helicopter landing areas on roofs except in an emergency and when appropriate acceptable safety procedures have been prepared in cooperation with the fire department.

**2.13.2.6. Inspection of Separators**

1) Aviation fuel and oil separators provided in the drainage system shall be inspected at intervals not greater than 7 days to ensure safe operation and shall be serviced when necessary.

## Section 2.14. Industrial Relocatable Accommodation

### 2.14.1. General

#### 2.14.1.1. General

- 1)** In this Section, industrial relocatable accommodation means a *building* that is used to provide accommodation for an industrial work force that lives and works at a temporary location.
- 2)** Industrial relocatable accommodation shall conform with the requirements of the Alberta Building Code 2006.
- 3)** The *owner* of industrial relocatable accommodation shall, at a camp location
  - a) appoint a fire crew and ensure that it is trained for firefighting duties at the camp (see Appendix A),
  - b) ensure that the work force is familiar with the fire hazards that exist in and around the camp, and
  - c) appoint one person to be responsible for fire prevention and inspection duties in the camp.
- 4)** The person appointed under Clause (3)(c) shall inspect the camp complex, including all industrial relocatable accommodation, for fire hazards on a monthly basis.
- 5)** The person making the inspection required by Sentence (4) shall provide the *owner* with a written report of their findings.
- 6)** The inspections required by Sentence (4) are permitted to be suspended if
  - a) the camp is vacated for a period of 2 months or more,
  - b) the final inspection report is considered during the closing down process, and
  - c) the final inspection report is incorporated as an integral part of the re-inspection plans before the camp is re-occupied.

## Section 2.15. Homes and Hospitals

### 2.15.1. General

#### 2.15.1.1. Inspection

- 1)** The person in charge of a *building* classified as a Group B, Division 2 *occupancy* shall appoint a fire marshal.
- 2)** A fire marshal appointed under Sentence (1) shall, at least every 6 months, inspect the *building* and all related *buildings* for fire hazards and provide a written report to the person in charge indicating
  - a) the condition of the *exits*, fire extinguishers and fire alarm equipment, and
  - b) any other conditions relative to fire safety in the *building* or related *buildings*.
- 3)** The person in charge shall forward a copy of the report referred to in Sentence (2) to the *authority having jurisdiction*.

## Section 2.16. Secondary Suites

(See Appendix A.)

### 2.16.1. Scope

#### 2.16.1.1. Application

1) Except as provided in Sentences (2) and (3), *secondary suites* shall conform to the requirements of the Alberta Building Code 2006.

2) Except as provided in Sentence (3), *secondary suites* that existed on or before 31 December 2006 shall conform to the requirements of Subsection 2.16.2.

3) Subsection 2.16.2. does not come into force for *secondary suites* until 31 December 2008.

### 2.16.2. General

#### 2.16.2.1. Height of Rooms and Spaces

1) Unless acceptable to the *authority having jurisdiction*, the height of rooms or spaces in a *secondary suite* over the required minimum area in accordance with Table 9.5.3.1. of Division B of the Alberta Building Code 2006 shall be not less than 1.95 m.

#### 2.16.2.2. Bedroom Windows

1) Except as permitted in Sentence 9.7.1.2.(1) of Division B of the Alberta Building Code 2006, each bedroom within a *secondary suite* shall have at least one outside window that meets the requirements of Articles 9.7.1.2. and 9.7.1.3. of Division B of the Alberta Building Code 2006.

#### 2.16.2.3. Exit Stairs

1) *Exit* stairs shall have a clear width of not less than 860 mm.

#### 2.16.2.4. Landings

1) Landings for stairs shall be at least as wide as the stairs and not less than 900 mm in length.

#### 2.16.2.5. Handrails and Guards

1) Handrails and guards shall conform to the requirements of Subsections 9.8.7. and 9.8.8. of Division B of the Alberta Building Code 2006.

#### 2.16.2.6. Public and Exit Corridor Width

1) The clear width of every public corridor and *exit* corridor shall be not less than 860 mm.

#### 2.16.2.7. Unenclosed Exterior Stair or Ramp

1) Where an unenclosed exterior *exit* stair or ramp provides the only *means of egress* from a *secondary suite* and is exposed to the hazards of fire from unprotected openings in the exterior wall of another *dwelling unit*, the openings shall be protected in conformance with Articles 9.10.13.5. and 9.10.13.7. of Division B of the Alberta Building Code 2006.

#### 2.16.2.8. Exit Doors

- 1) Every *exit* door or door that provides *access to exit* from a *secondary suite* shall be
- a) not less than 1 980 mm high,
  - b) not less than 810 mm wide, and
  - c) permitted to swing inward.

**2.16.2.9. Means of Egress**

1) Except as permitted in Sentence (2), each *dwelling unit* shall be provided with at least one *exit* that leads directly to the outside.

2) *Dwelling units* may share a common *exit* meeting the requirements of Article 2.16.2.10.

**2.16.2.10. Protection of Exits**

1) Every *exit*, other than an *exit* doorway, shall be separated from adjacent *floor areas* by not less than one layer of 12.7 mm thick gypsum wallboard or equivalent material on each side of the walls. (See Appendix A.)

**2.16.2.11. Dwelling Unit Separations**

1) *Dwelling units* shall be separated from each other by not less than one layer of 12.7 mm thick gypsum wallboard or equivalent material on the ceiling and on each side of the walls. (See A-2.16.2.10.(1) in Appendix A.)

**2.16.2.12. Protection of Public Corridors**

1) A public corridor shall be separated from the remainder of the *building* by not less than one layer of 12.7 mm thick gypsum wallboard or equivalent material on each side of the walls. (See A-2.16.2.10.(1) in Appendix A.)

**2.16.2.13. Furnace Room Separations**

1) A furnace room shall be separated from the remainder of the *building* by not less than one layer of 12.7 mm thick gypsum wallboard or equivalent material on the ceiling and on each side of the walls. (See A-2.16.2.10.(1) in Appendix A.)

2) A door shall be provided to each furnace room.

**2.16.2.14. Heating and Ventilation Systems**

1) For an existing *secondary suite*, a single heating and ventilation system may be used to serve both the *secondary suite* and main *dwelling unit*.

**2.16.2.15. Smoke Alarms**

1) *Smoke alarms* conforming to CAN/ULC-S531, "Smoke Alarms," installed in accordance with Subsection 9.10.19. of Division B of the Alberta Building Code 2006 shall be provided in each *dwelling unit*.

2) *Smoke alarms* shall be installed by permanent connections to an electrical circuit and wired so that activation of one *smoke alarm* will cause all alarms within both *dwelling units* to sound.

3) *Smoke alarms* shall be installed in areas that are common to both *dwelling units* and connected in conformance with Sentence (2).

**2.16.2.16. Inspection, Testing and Maintenance of Smoke Alarms**

1) *Smoke alarms* required by this Section shall be inspected, tested and maintained in conformance with the manufacturer's instructions.

**Section 2.17. Objectives and Functional Statements****2.17.1. Objectives and Functional Statements****2.17.1.1. Attribution to Acceptable Solutions**

1) For the purposes of compliance with this Code as required in Clause 1.2.1.1.(1)(b) of Division A, the objectives and functional statements attributed to the acceptable solutions in this Part shall be the objectives and functional statements listed in Table 2.17.1.1. (See A-1.1.2.1.(1) in Appendix A.)

**Table 2.17.1.1.**  
**Objectives and Functional Statements Attributed to the Acceptable Solutions in Part 2**  
 Forming Part of Sentence 2.17.1.1.(1)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>2.1.2.2. Hazardous Activities</b>	
(1)	[F01–OP1.2]
	[F01–OS1.1]
	[F01,F30,F31,F43,F32,F81–OS3.1,OS3.2,OS3.3,OS3.4]
(2)	[F02,F03–OS1.2] [F10–OS1.5]
<b>2.1.3.1. Fire Alarm, Standpipe and Sprinkler Systems</b>	
(2)	[F02–OP1.2]
	[F02–OS1.2]
<b>2.1.3.3. Smoke Alarms</b>	
(1)	[F11,F81–OS1.5]
(2)	Reserved
(3)	[F11,F81–OS1.5]
(4)	[F11,F81–OS1.5]
<b>2.1.3.4. Protection of Combustible Sprinkler Piping</b>	
(1)	[F06,F82–OP1.2]
	[F06,F82–OP3.1]
	[F06,F82–OS1.2]
<b>2.1.3.5. Special Fire Suppression Systems</b>	
(2)	[F02,F81–OP1.1]
	[F02,F81–OS1.1]
(3)	[F02,F81–OP1.2]
	[F02,F81–OS1.2]
(4)	[F02,F81–OP1.2]
	[F02,F81–OS1.2]
(5)	[F02,F81–OP1.2]
	[F02,F81–OS1.1]
(6)	[F02–OP1.2]
	[F02–OS1.2]
(7)	[F82,F12–OP1.2]
	[F82,F12–OS1.2]
(8)	[F12–OP1.2]
	[F12–OS1.2]
<b>2.1.3.6. Design and Installation of Automatic Sprinkler Systems</b>	
(1)	[F02,F81–OP1.2]
	[F02,F81–OS1.2]

Table 2.17.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>2.1.3.7. Inspection, Maintenance and Testing of Fire Safety Devices</b>	
(2)	[F82-OS1.4]
<b>2.1.4.1. Posting</b>	
(1)	[F12,F10,F82,F81-OS1.1,OS1.2]
<b>2.1.5.1. Selection and Installation</b>	
(1)	[F02-OP1.2]
	[F02-OS1.2]
(2)	[F02,F12-OP1.2]
	[F02,F12-OS1.2]
(3)	[F12,F06-OP1.2]
	[F12,F06-OS1.2]
(4)	[F80-OP1.2]
	[F80-OS1.2]
<b>2.2.1.1. Fire Separations</b>	
(2)	[F03-OP1.2] Applies to conformance with the Alberta Building Code 2006.
	[F03-OS1.2] Applies to conformance with the Alberta Building Code 2006.
<b>2.2.1.2. Damage to Fire Separations</b>	
(1)	[F03-OP1.2]
	[F03-OS1.2]
<b>2.2.2.2. Damage to Closures</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2]
<b>2.2.2.3. Protective Guarding Devices</b>	
(1)	[F81-OP1.2]
	[F81-OS1.2]
<b>2.2.2.4. Inspection and Maintenance</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2]
(2)	[F82-OP1.2]
	[F82-OS1.2]
(3)	[F82-OP1.2]
	[F82-OS1.2]
(4)	[F81-OP1.2]
	[F81-OS1.2]
(5)	[F82-OP1.2]
	[F82-OS1.1]

**Table 2.17.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>2.3.1.2. Movable Partitions and Screens</b>	
(1)	[F02-OS1.2]
<b>2.3.1.3. Decorative Materials</b>	
(1)	[F02-OS1.2]
(2)	[F02-OS1.2]
(3)	[F02-OS1.2]
<b>2.3.1.4. Interconnected Floor Spaces</b>	
(1)	[F02-OP1.2]
	[F02-OS1.2]
<b>2.3.1.5. Combustible Display or Exhibit</b>	
(1)	[F01-OS1.1] [F02-OS1.2]
<b>2.3.2.1. Drapes, Curtains and Decorative Materials</b>	
(1)	[F02-OP1.2]
	[F02-OS1.2,OS1.5]
<b>2.3.2.2. Flame Retardant Treatments</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
<b>2.3.2.3. Hospital Textiles</b>	
(1)	[F02-OP1.2]
	[F02-OS1.2]
<b>2.4.1.1. Accumulation of Combustible Materials</b>	
(1)	[F01,F02-OP1.2,OP1.1]
	[F01,F02-OS1.2,OS1.1]
(2)	[F01,F02-OP1.2]
	[F01,F02-OS1.2]
(3)	[F01,F02-OP1.2]
	[F01,F02-OS1.2]
(4)	[F01,F02-OP1.2]
	[F01,F02-OS1.2]
(5)	[F02-OP1.2]
	[F02-OS1.2]
(6)	[F01-OS1.2,OS1.1]
	[F01,F02-OP1.2,OP1.1]
<b>2.4.1.2. Storage Rooms for Combustible Waste Materials</b>	
(1)	[F03,F02-OP1.2]
	[F03,F02-OS1.2]

Table 2.17.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>2.4.1.3. Waste Receptacles</b>	
(1)	[F01–OS1.1] Applies to portion of Code text: "... be removed from the premises."
(2)	[F01–OS1.1] Applies to the storage of combustible materials and ashes in the same container.
(3)	[F03–OP1.2]
	[F03–OS1.2]
(4)	[F03,F02,F01–OP1.2]
	[F03,F02,F01–OS1.2]
(5)	[F03,F02,F01–OS1.2]
	[F03,F02,F01–OP1.2]
(6)	[F03,F02,F01–OS1.2]
	[F03,F02,F01–OP1.2]
(7)	[F02,F03–OS1.2]
	[F02,F03–OP1.2]
(8)	[F02,F03–OS1.2]
	[F02,F03–OP1.2]
(9)	[F02–OS1.2] [F01–OS1.1]
	[F02–OP1.2] [F01–OP1.1]
<b>2.4.1.4. Lint Traps for Laundry Equipment</b>	
(1)	[F01–OS1.1]
	[F01–OP1.1]
<b>2.4.2.1. Smoking Areas</b>	
(1)	[F01–OS1.1]
(3)	[F01–OS1.1]
<b>2.4.2.2. Signs</b>	
(1)	[F01–OS1.1]
<b>2.4.3.1. Open Flames in Processions</b>	
(1)	[F01–OS1.1]
	[F01–OP1.1]
<b>2.4.3.2. Flaming Meals and Drinks</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
(3)	[F01–OS1.1]
(4)	[F12,F02–OP1.2]
	[F12,F02–OS1.2]
<b>2.4.3.3. Devices Having Open Flames</b>	
(1)	[F01–OS1.1]

Table 2.17.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>2.4.4.1. Flammable and Combustible Liquids</b>	
(2)	[F01–OS1.1]
<b>2.4.4.2. Flammable Gases</b>	
(1)	[F01–OS1.1]
<b>2.4.4.4. Emergency Shutoff Valves in Schools</b>	
(1)	[F01,F43–OS1.1]
	[F01–OP1.1]
<b>2.4.4.5. Propane Fuelled Vehicles</b>	
(1)	[F01,F81–OS1.1]
	[F01,F81–OP1.1]
<b>2.4.5.1. Open Air Fires</b>	
(1)	[F01,F03,F02–OP1.2]
	[F01,F03,F02–OS1.2]
(2)	[F01,F02–OS1.1]
	[F01,F02–OP1.1]
<b>2.4.6.1. Security</b>	
(1)	[F34–OP3.1]
	[F34–OS1.1,OS1.2]
<b>2.4.7.1. Use and Maintenance</b>	
(1)	[F01,F82,F81–OP1.1]
	[F01,F82,F81–OS1.1]
<b>2.5.1.2. Access Panels and Windows</b>	
(1)	[F12–OP1.2]
	[F12–OS1.2]
<b>2.5.1.3. Fire Department Building Access</b>	
(1)	[F12–OP1.2]
(4)	[F12–OP1.2]
<b>2.5.1.4. Access to Fire Department Connections</b>	
(1)	[F12–OP1.2]
	[F12–OS1.2]
<b>2.5.1.5. Maintenance of Fire Department Access</b>	
(1)	[F12–OP1.2]
	[F12–OS1.2]
(2)	[F12–OP1.2]
	[F12–OS1.2]

Table 2.17.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>2.6.1.2. Coal and Wood Bins</b>	
(1)	[F01-OP1.1]
	[F01-OS1.1]
<b>2.6.1.3. Hoods, Ducts and Filters</b>	
(1)	[F01,F02-OP1.2]
	[F01,F02-OS1.2]
<b>2.6.1.4. Chimneys, Flues and Flue Pipes</b>	
(1)	[F01-OP1.2] [F82-OP1.1]
	[F01-OS1.2] [F82-OS1.1]
(2)	[F01-OP1.2]
	[F01-OS1.2]
(3)	[F82-OP1.2,OP1.1]
	[F82-OS1.1,OS1.2]
	[F82-OS3.4]
	(a) [F82-OS3.1] Applies to portion of Code text: "... any structural deficiency or decay ..."
<b>2.6.1.5. Clearances</b>	
(1)	[F01-OP1.2,OP1.1]
	[F01-OS1.1,OS1.2]
(2)	[F01-OP1.2,OP1.1]
	[F01-OS1.1,OS1.2]
<b>2.6.1.6. Operation and Maintenance Procedures</b>	
(1)	[F01,F81,F82-OP1.2,OP1.1]
	[F01,F81,F82-OS1.1,OS1.2]
	[F81,F82-OS3.4]
(2)	[F82-OP1.2]
	[F82-OS1.2]
<b>2.6.1.7. Ventilation Shafts</b>	
(1)	[F01,F81-OP1.2]
	[F01,F81-OS1.2]
<b>2.6.1.8. Repairs and Renovations</b>	
(1)	[F02,F03-OP1.2]
	[F02,F03-OS1.2] [F01-OS1.1]
(2)	[F81,F43-OH5]
	[F81,F43-OP1.1]
	[F81,F43-OS1.1]

**Table 2.17.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>2.6.1.9. Commercial Cooking Equipment</b>	
(1)	[F01–OS1.1,OS1.2] [F02,F81–OS1.2] [F02,F81–OP1.2]
(2)	[F01–OS1.2,OS1.1] [F81,F82–OS1.2] [F01,F81,F82–OP1.2]
(3)	[F02–OP1.2] [F82–OS1.1] [F02–OS1.2]
(4)	[F01–OS1.1]
(5)	[F12–OP1.2] [F12–OS1.2]
(6)	[F01,F81,F82–OS1.1]
(7)	[F01,F81,F82–OS1.1]
<b>2.6.2.2. Outdoor Incinerators</b>	
(1)	[F03–OS1.2] [F82,F81–OS1.1] [F03–OS1.2] Applies to portion of Code text: "... except that the <i>flue</i> venting an incinerator shall not serve as the chute conveying waste material to the incinerator."
<b>2.6.2.3. Spark Arresters</b>	
(1)	[F81,F82–OS1.1]
(2)	[F82,F01–OS1.1]
<b>2.6.3.1. Use</b>	
(1)	[F02–OP1.2] [F02–OS1.2] [F01–OS1.4,OS1.5]
<b>2.6.3.2. Security</b>	
(1)	[F34–OP1.1] [F34–OS1.1] [F34–OS3.3]
<b>2.7.1.2. Open Floor Areas</b>	
(2)	[F10,F05–OS3.7]
(3)	[F10–OS3.7]
(4)	[F10–OS3.7]
<b>2.7.1.3. Occupant Load</b>	
(1)	[F10–OS3.7]
(2)	[F10–OS3.7]
<b>2.7.1.4. Signs</b>	
(1)	[F10–OS3.7]
(2)	[F10–OS3.7]

Table 2.17.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F10–OS3.7]
<b>2.7.1.5. Nonfixed Seating</b>	
(1)	[F10–OS3.7]
(2)	[F10–OS3.7]
(3)	[F10–OS3.7]
(4)	[F10–OS3.7]
<b>2.7.1.6. Maintenance</b>	
(1)	[F10,F12,F82–OS3.7]
	[F12,F82–OP1.2]
	[F12,F82–OS1.2]
<b>2.7.1.7. Exterior Passageways and Exit Stairs</b>	
(1)	[F10,F12–OS3.7] [F30–OS3.1]
	[F12–OP1.2]
	[F12–OS1.2]
(2)	[F82,F10,F12–OS3.7] [F82,F30–OS3.1]
	[F82,F12–OP1.2]
	[F82,F12–OS1.2]
(3)	[F10,F12–OS1.5]
	[F10,F12–OS3.7]
(4)	[F10,F12–OS1.5]
	[F10,F12–OS3.7]
(5)	[F81–OS1.1] [F81,F02,F12–OS1.2]
	[F81,F02,F12–OP1.2]
<b>2.7.2.1. Exit Doors and Door Release Hardware</b>	
(1)	[F82–OP1.2]
	[F82–OS1.2]
	[F82–OS3.7]
(2)	[F82–OS3.7]
(3)	[F82–OS3.7]
(4)	[F82–OS3.7]
(6)	[F82–OS3.7]
(7)	[F10,F12–OS1.5]
	[F10,F12–OS3.7]
<b>2.7.3.1. Installation and Maintenance</b>	
(2)	[F10–OS3.7]

**Table 2.17.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>2.8.1.2. Training of Supervisory Staff</b>	
(1)	[F12-OP1.2]
	[F12-OS1.2,OS1.5]
<b>2.8.1.3. Keys and Special Devices</b>	
(1)	[F12-OP1.2]
	[F12-OS1.5,OS1.2]
<b>2.8.2.1. Measures in a Fire Safety Plan</b>	
(1)	(a)(i) [F11,F13-OS1.5] (a)(ii) [F13-OS1.5, OS1.2] (a)(iii) [F11-OS1.2,OS1.5] (a)(iv) [F10-OS1.5] (a)(v) [F02-OS1.2] (b) to (d) [F12-OS1.2,OS1.5] (e) [F10,F12-OS1.5] (f) [F01-OS1.1] (g) [F82-OS1.2,OS1.5]
	(a)(i) [F12,F13-OP1.2] (a)(ii) [F13-OP1.2] (a)(iii) [F11-OP1.2] (a)(v) [F02-OP1.2] (b) to (d) [F12-OP1.2] (f) [F01-OP1.1] (g) [F82-OP1.2]
(2)	[F11,F13,F12,F10-OS1.5,OS1.2] [F01,F82-OS1.1] [F02,F82-OS1.2]
	[F13,F12-OP1.2] [F01,F82-OP1.1] [F02,F82-OP1.2]
<b>2.8.2.2. Care or Detention Occupancies</b>	
(1)	[F12-OS1.5,OS1.2] [F01-OS1.1] [F02-OS1.2]
<b>2.8.2.3. Assembly Occupancies</b>	
(1)	[F12-OS1.5,OS1.2] [F01-OS1.1] [F02-OS1.2]
<b>2.8.2.4. High Buildings</b>	
(1)	[F02,F12,F11,F13,F36-OS1.5,OS1.2]
	[F02,F12,F13-OP1.2]
<b>2.8.2.5. Retention of Fire Safety Plans</b>	
(1)	[F12-OP1.2]
	[F12-OS1.5,OS1.2]
(2)	[F12-OP1.2]
	[F12-OS1.2,OS1.5]
<b>2.8.2.6. Distribution</b>	
(1)	[F11,F13,F12,F10-OS1.2,OS1.5] [F01,F82-OS1.1] [F02,F82-OS1.2]
	[F12,F13-OP1.2] [F01,F82-OP1.1] [F02,F82-OP1.2]
<b>2.8.2.7. Posting of Fire Emergency Procedures</b>	
(1)	[F10-OS1.5]

Table 2.17.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(2)	[F10–OS1.5]
(3)	[F13–OP1.2]
	[F13–OS1.2]
<b>2.8.2.8. Shutdown of Fire Alarm Systems</b>	
(1)	[F10,F11,F12,F13–OS1.5]
	[F10,F11,F12,F13–OS3.7]
(2)	[F11–OS1.5]
	[F11–OS3.7]
<b>2.8.3.1. Fire Drill Procedures</b>	
(1)	[F12–OP1.2]
	[F12–OS1.2,OS1.5] [F10–OS1.5]
<b>2.8.3.2. Fire Drill Frequency</b>	
(1)	[F12–OP1.2]
	[F12–OS1.2,OS1.5] [F10–OS1.5]
<b>2.9.2.1. Flame Retardant Treatments</b>	
(1)	[F82–OP1.2]
	[F82–OS1.2,OS1.5]
<b>2.9.3.1. Electrical Systems</b>	
(1)	[F82,F81–OS3.1,OS3.2,OS3.3,OS3.4]
	[F82,F81,F01–OP1.1]
	[F82,F81,F01–OS1.1]
(2)	[F82–OP1.1]
	[F82–OS1.1]
(3)	[F34–OP1.2]
	[F34–OS1.1]
	[F34–OS3.3]
(4)	[F81–OP1.1]
	[F81–OS1.1]
<b>2.9.3.2. Combustible Materials</b>	
(1)	[F02–OS1.2] Applies to portion of Code text: "... except that sawdust and shavings are permitted to be used if kept damp."
	[F02–OS1.2] Applies to the restriction of combustible materials within tents or <i>air-supported structures</i> .
(2)	[F01,F02,F03–OS1.2]
	[F01,F02,F03–OP1.2]
<b>2.9.3.3. Smoking and Open Flame Devices</b>	
(1)	[F01–OS1.1]

**Table 2.17.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>2.9.3.4. Fire Watch</b>	
(1)	[F12-OS1.2,OS1.5]
(2)	(a) [F10,F12-OS1.5] [F12-OS1.2] Applies to familiarity with the condition of the <i>exits</i> . (b) [F10,F12-OS1.5] [F12-OS1.2] Applies to the <i>means of egress</i> being kept clear.
	(a) [F12-OS1.2,OS1.5] Applies to familiarity with the fire safety plan. (b) [F12-OS1.2,OS1.5] Applies to the requirements of the <i>authority having jurisdiction</i> .
<b>2.9.3.5. Fire Alarm System</b>	
(1)	[F11-OS1.5] [F13-OS1.2]
	[F13-OP1.2]
<b>2.10.2.1. Supervision of Children</b>	
(1)	[F01-OS1.1,OS1.2] [F10-OS1.5] [F12,F13-OS1.2]
(2)	[F12-OS1.5]
<b>2.10.3.1. Combustible Materials Attached to Walls</b>	
(1)	[F02-OP1.2]
	[F02-OS1.2]
<b>2.10.3.2. Waste Receptacles</b>	
(1)	[F02,F01-OP1.2]
	[F02,F01-OS1.2]
<b>2.10.3.3. Flammable and Combustible Liquids</b>	
(1)	[F01,F34-OS1.1] Applies to storage in areas inaccessible to children.
<b>2.10.4.1. Fire Prevention Inspections</b>	
(1)	[F01,F82-OS1.1]
<b>2.11.2.1. Portable Extinguishers</b>	
(1)	[F02,F12-OP1.2]
	[F02,F12-OS1.2]
<b>2.12.1.1. Use</b>	
(1)	[F01,F02-OP1.1,OP1.2]
	[F01,F02-OS1.1,OS1.2] [F10-OS1.5]
(2)	[F01,F02,F03-OP1.1,OP1.2]
	[F01,F02,F03-OS1.1,OS1.2]
<b>2.12.1.2. Adequacy of Sprinkler System</b>	
(1)	[F02-OP1.2]
	[F02-OS1.2]
<b>2.12.1.4. Access to Exits</b>	
(2)	[F05-OS1.5]
	[F10,F12-OS3.7]

Table 2.17.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>2.12.1.5. Access to Fire Protection Equipment</b>	
(1)	[F12–OP1.2]
	[F12–OS1.2,OS1.5]
<b>2.12.1.7. Flammable and Combustible Liquids and Flammable Gases</b>	
(1)	[F01,F02–OS1.1,OS1.2,OS1.5]
<b>2.12.1.8. Fuelled Equipment</b>	
(1)	[F01,F34–OS1.1,OS1.5]
<b>2.12.1.9. Propane Fuelled Automotive Vehicles</b>	
(1)	[F01,F43–OS1.1,OS1.2]
	[F01,F43–OS3.4]
	[F01,F43–OP1.1,OP1.2]
<b>2.13.1.1. Construction</b>	
(1)	[F01,F02,F81–OP1.2,OP1.1]
	[F01,F02,F81–OS1.1,OS1.2]
<b>2.13.2.1. Fire Separations</b>	
(1)	[F03–OP1.2]
	[F03–OS1.2]
<b>2.13.2.2. Fire Alarm</b>	
(1)	[F11–OS1.5] [F13–OS1.2]
	[F13–OP1.2]
(2)	[F13–OP1.2]
	[F13–OS1.2]
<b>2.13.2.3. Smoking</b>	
(1)	[F01–OS1.1] Applies to portion of Code text: “Smoking shall not be permitted on helicopter landing areas on roofs ...”
<b>2.13.2.4. Fire Watch</b>	
(1)	[F12–OP1.2]
	[F12–OS1.2]
<b>2.13.2.5. Refuelling, Repair and Maintenance Operations</b>	
(1)	[F01–OS1.1]
<b>2.13.2.6. Inspection of Separators</b>	
(1)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
<b>2.16.2.1. Height of Rooms and Spaces</b>	
(1)	[F10–OS3.7] [F30–OS3.1]

**Table 2.17.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>2.16.2.2. Bedroom Windows</b>	
(1)	[F10–OS3.7]
<b>2.16.2.3. Exit Stairs</b>	
(1)	[F10–OS3.7] [F30–OS3.1]
<b>2.16.2.4. Landings</b>	
(1)	[F10–OS3.7] [F30–OS3.1]
<b>2.16.2.6. Public and Exit Corridor Width</b>	
(1)	[F10–OS3.7] [F30–OS3.1]
<b>2.16.2.7. Unenclosed Exterior Stair or Ramp</b>	
(1)	[F05–OS1.5]
<b>2.16.2.8. Exit Doors</b>	
(1)	[F10–OS3.7] [F30–OS3.1]
<b>2.16.2.9. Means of Egress</b>	
(1)	[F10–OS1.5]
<b>2.16.2.10. Protection of Exits</b>	
(1)	[F03–OS1.2] [F05–OS1.5]
	[F03–OP1.2]
<b>2.16.2.11. Dwelling Unit Separations</b>	
(1)	[F03–OS1.2]
	[F03–OP1.2]
<b>2.16.2.12. Protection of Public Corridors</b>	
(1)	[F03,F05–OS1.5]
	[F03–OP1.2]
<b>2.16.2.13. Furnace Room Separations</b>	
(1)	[F03–OS1.2]
	[F03–OP1.2]
(2)	[F03–OS1.2]
	[F03–OP1.2]
<b>2.16.2.15. Smoke Alarms</b>	
(1)	[F11,F81–OS1.5]
(2)	[F11,F81–OS1.5]
(3)	[F11,F81–OS1.5]
<b>2.16.2.16. Inspection, Testing and Maintenance of Smoke Alarms</b>	
(1)	[F82–OS1.2,OS1.5]

**Notes to Table 2.17.1.1.:**

(1) See Parts 2 and 3 of Division A.

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays



# **Part 3**

## **Indoor and Outdoor Storage**

<b>3.1.</b>	<b>General</b>	
3.1.1.	Scope .....	3- 1
3.1.2.	Dangerous Goods .....	3- 1
3.1.3.	Industrial Trucks .....	3- 3
3.1.4.	Electrical Installations .....	3- 3
3.1.5.	Basements .....	3- 3
<b>3.2.</b>	<b>Indoor Storage</b>	
3.2.1.	Scope .....	3- 3
3.2.2.	General .....	3- 4
3.2.3.	General Indoor Storage .....	3- 5
3.2.4.	Indoor Tire Storage .....	3- 6
3.2.5.	Indoor Storage of Aerosol Products .....	3- 7
3.2.6.	Indoor Storage of Combustible Fibres .....	3- 8
3.2.7.	Indoor Storage of Dangerous Goods .....	3- 9
3.2.8.	Indoor Storage of Compressed Gases .....	3-14
3.2.9.	Indoor Storage of Ammonium Nitrate .....	3-15
3.2.10.	Indoor Storage of Fireworks .....	3-16
<b>3.3.</b>	<b>Outdoor Storage</b>	
3.3.1.	Scope .....	3-17
3.3.2.	General .....	3-18
3.3.3.	General Outdoor Storage .....	3-20
3.3.4.	Outdoor Storage of Dangerous Goods .....	3-21
3.3.5.	Outdoor Storage of Compressed Gases .....	3-22
3.3.6.	Outdoor Storage of Used Tires .....	3-23
<b>3.4.</b>	<b>Objectives and Functional Statements</b>	
3.4.1.	Objectives and Functional Statements .....	3-24



# Part 3

## Indoor and Outdoor Storage

### Section 3.1. General

#### 3.1.1. Scope

##### 3.1.1.1. Application

1) This Part applies to the storage of combustible products and *dangerous goods*, both inside and outside of *buildings*. (See Appendix A.)

##### 3.1.1.2. Radioactive Materials

1) Class 7 radioactive materials shall be stored in conformance with the “Nuclear Safety and Control Act” and its Regulations, published by the CNSC.

##### 3.1.1.3. Explosives

1) Except as required by Subsection 3.2.10. for *fireworks*, the storage of Class 1 *dangerous goods* shall be in conformance with the “Explosives Act” and its Regulations, published by Natural Resources Canada.

##### 3.1.1.4. Compressed Gases

(See Appendix A.)

1) This Part shall not apply to

- a) facilities operated by manufacturers or distributors at which Class 2 gases are manufactured, or containers are filled or distributed, provided that storage and handling is in conformance with good engineering practice (see Appendix A), and
- b) the storage and dispensing of Class 2.1 flammable gases at *fuel-dispensing stations* covered in Section 4.6.

2) Except as provided in this Part, the storage and handling of liquefied petroleum gases shall conform to gas regulations made pursuant to the Safety Codes Act.

3) Except as provided in this Part, the storage and handling of natural gas shall conform to gas regulations made pursuant to the Safety Codes Act.

#### 3.1.2. Dangerous Goods

##### 3.1.2.1. Classification

1) Classes and divisions of *dangerous goods* referred to in this Code shall mean their primary and first subsidiary classification, as defined in Part II of the “Transportation of Dangerous Goods Regulations.”

2) Class 9 *dangerous goods* shall be stored according to the hazard they present based on their properties as *dangerous goods*.

3) For the purposes of this Code, Class 3 *dangerous goods* shall mean *flammable liquids* and *combustible liquids* as defined in Subsection 4.1.2.

##### 3.1.2.2. Ambient Temperature

1) Class 5.1 ammonium nitrate and Class 2 gases shall not be stored in an area where the ambient air temperature is higher than 52°C.

**3.1.2.3.**

- 2)** *Dangerous goods* shall not be stored in areas where the ambient temperature may cause them to become unstable or susceptible to undesirable reactions.
- 3)** *Dangerous goods* shall be stored in refrigerated areas where such refrigeration is necessary to stabilize the substances.

**3.1.2.3. Packages and Containers**

- 1)** *Dangerous goods* shall be stored in packages or containers
  - a) made of materials that are compatible with the product they contain, and
  - b) of durable construction and designed to resist damage from normal material handling activities.
- 2)** Where the package or container for a specific type of *dangerous goods* is subject to a standard established by a transportation regulatory authority, such package or container shall conform with the applicable standard. (See Appendix A.)

**3.1.2.4. Compressed Gases**

- 1)** Cylinders and tanks of Class 2 gases shall be protected against mechanical damage.
- 2)** Cylinders of Class 2 gases that are in storage shall be
  - a) protected against valve damage (see Appendix A), and
  - b) firmly secured in a position that will not interfere with the operation of the cylinder valve assembly.
- 3)** Cylinders of Class 2 gases shall be transported in devices designed to provide restraint against movement in any direction.
- 4)** Except for portable fire extinguishers, cylinders of Class 2 gases shall not be stored
  - a) in any *exit* or corridor providing *access to exits*,
  - b) under any fire escape, outside *exit* stair, passage or ramp, or
  - c) within 1 m of any *exit*.

**3.1.2.5. Reactive Substances**

- 1)** Reactive substances shall be stored based on their properties when classified as *dangerous goods* according to Part II of the "Transportation of Dangerous Goods Regulations." (See Appendix A.)
- 2)** Reactive substances that are unstable and susceptible to reactions, such as polymerization, or self-accelerating decomposition initiated by heat, shock, vibration, light or sound waves, shall be stored in a location and manner that will prevent the undesired reaction.
- 3)** Reactive substances that may react with water shall be stored in sealed containers in a dry location.
- 4)** Reactive substances that ignite spontaneously in air shall be stored in a liquid that is inert to the material, in an inert atmosphere or in sealed containers.
- 5)** Every *building* or part of a *building* that is used for the storage or use of any substance that reacts violently with water shall be plainly and conspicuously marked on the outside with signage legible from 6 m using the words "REACTIVE SUBSTANCE, USE NO WATER."

**3.1.2.6. Fire Safety Plan**

- 1)** In addition to the information required in Section 2.8., where *dangerous goods* are stored or handled, the fire safety plan shall include the names, addresses and telephone numbers of persons to be contacted in case of fire during non-operating hours.
- 2)** When the *dangerous goods* referred to in Sentence (1) consist of Class 7 radioactive materials, the fire safety plan shall also include
  - a) methods to control a fire emergency and to recover radioactive materials and equipment containing radioactive materials safely and efficiently,

- b) the names, addresses and telephone numbers of primary and alternative sources of expert radiation safety advice and assistance, and
- c) the location of primary and alternative sources of radiation survey instruments.

### 3.1.3. Industrial Trucks

#### 3.1.3.1. Industrial Trucks

**1)** Except as provided in Sentences (2) and (3), the designation, use, maintenance and operation of industrial trucks shall conform to NFPA 505, "Powered Industrial Trucks Including Type Designations, Areas of Use, Conversions, Maintenance, and Operation."

**2)** Fuel-fired industrial trucks shall conform to ULC/ORD-C558, "Internal Combustion Engine-Powered Industrial Trucks."

**3)** Battery-powered industrial trucks shall conform to ULC/ORD-C583, "Electric Battery Powered Industrial Trucks."

### 3.1.4. Electrical Installations

#### 3.1.4.1. Hazardous Locations

**1)** Where wiring or electrical equipment is located in areas in which flammable gases or vapours, *combustible dusts* or *combustible fibres* are present in quantities sufficient to create a hazard, such wiring and electrical equipment shall conform to electrical regulations made pursuant to the Safety Codes Act for hazardous locations. (See A-5.1.2.1.(1) in Appendix A.)

### 3.1.5. Basements

#### 3.1.5.1. Use

**1)** A *basement* shall not be used for the storage, manufacture or handling of volatile solids, liquids or gases that generate explosive air-vapour mixtures or for processes that involve explosive dusts.

## Section 3.2. Indoor Storage

### 3.2.1. Scope

#### 3.2.1.1. Application

**1)** Except as permitted in Sentence (2), this Section shall apply to *buildings* or parts of *buildings* used for the storage of the following products:

- a) Class I, II, III and IV commodities, and Group A, B and C plastics, as defined in NFPA 13, "Installation of Sprinkler Systems" (see Appendix A),
- b) rubber tires and *combustible fibres*,
- c) packaged Level 1, 2 and 3 aerosols, as described in Subsection 3.2.5.,
- d) *dangerous goods* in packages or containers, as covered in Subsection 3.2.7., or
- e) *closed containers* of *distilled beverage alcohols*.

(See Appendix A.)

**2)** High *rack* storage warehouses with storage heights greater than 13 m, where conditions exist that must be addressed by design and operational details specific to the hazard, need not conform to this Section, where alternative protection is provided in conformance with Article 1.2.1.1. of Division A.

**3.2.2.1.****3.2.2. General****3.2.2.1. Application**

1) Unless otherwise specified, this Subsection shall apply to the indoor storage of any product covered in this Section.

**3.2.2.2. Access Aisles**

(See Appendix A.)

1) Adequate access for firefighting purposes shall be provided and maintained to all portions of the storage area.

2) Access aisles not less than 1.0 m wide shall be provided to fire department access panels and to fire protection equipment.

3) Aisles shall be maintained free of obstruction.

4) A storage room or area that is greater than 100 m<sup>2</sup> shall be provided with at least one main aisle conforming to Sentences (5) to (8).

5) Except as permitted in Sentence (6), main access aisles shall have a minimum width of

- a) 2.4 m for storage heights of not more than 6 m, and
- b) 3.6 m for storage heights of more than 6 m.

6) The width of main access aisles referred to in Sentence (5) need not exceed 2.4 m where the products are stored in *racks* and the *building* is *sprinklered*.

7) Main access aisles shall extend

- a) the length of the storage area where only one main access aisle is provided, or
- b) the length or width of the storage area where 2 or more main access aisles are provided.

8) Main access aisles shall be accessible from at least 2 fire department access points, which shall be located such that, in the event one becomes unusable due to fire, the other will still allow emergency responders to access the *building*.

**3.2.2.3. Clearances**

1) Wall clearances of not less than 600 mm shall be maintained where stored products may swell or expand with the absorption of water.

2) In unsprinklered *buildings*, a clearance of not less than 1 m between the top of storage and the underside of the floor or roof deck shall be maintained. (See Appendix A.)

3) If the top of storage in piles, on shelves, in bin boxes or on *racks* is above the lower chords of floor or roof structural framing members, a clear space of not less than 300 mm shall be maintained between the storage and the structural members.

4) In *sprinklered buildings*, the clearance between the top of storage and ceiling sprinkler deflectors shall conform to the standard used to design the sprinkler system.

5) Clearance between stored products and ducts of exhaust ventilation systems shall be maintained in conformance with Section 4.6.4 of NFPA 91, "Exhaust Systems for Air Conveying of Vapors, Gases, Mists, and Noncombustible Particulate Solids." (See Appendix A.)

**3.2.2.4. Combustible Pallets**

1) Except as permitted in Sentences (2) and (3), combustible pallets shall be stored outdoors in conformance with Section 3.3.

2) Indoor storage of combustible pallets is permitted in a *building* that is not *sprinklered*, provided

- a) the height of storage of combustible pallets is not more than 1.2 m,

- b) the width of an *individual storage area* is not more than 7.5 m, and
- c) the aggregate area of storage is not more than
  - i) 100 m<sup>2</sup> for wood or solid deck non-expanded polyethylene pallets, or
  - ii) 50 m<sup>2</sup> for plastic pallets not designated in Subclause (c)(i).

**3)** In a *sprinklered building*, the storage of combustible pallets is permitted to exceed the values stated in Sentence (2) provided such storage conforms to NFPA 13, "Installation of Sprinkler Systems." (See Appendix A.)

### 3.2.2.5. Fire Safety Plan

- 1)** A fire safety plan conforming to Section 2.8. and Sentences (2) and (3) shall be prepared.
- 2)** The fire safety plan shall identify
  - a) the product classifications, as described in Sentence 3.2.1.1.(1), for each part of the *building* where products of different classification are stored,
  - b) the method of storage, including aisle widths for *rack* storage,
  - c) the maximum permitted height of storage for the *building* or part of the *building*, if different,
  - d) the maximum permitted size of *individual storage areas*, and
  - e) in *sprinklered buildings*, the sprinkler system design criteria, inside and outside hose allowances, and results of the benchmark sprinkler system main drain and water flow tests.
- 3)** The storage method and maximum height of storage as described in Clauses (2)(b) and (c) shall be posted in the storage area.
- 4)** Signs required in Sentence (3) shall have
  - a) a minimum dimension of 200 mm, and
  - b) letters not less than 25 mm high.
- 5)** When the products stored include Group A plastics, rubber products, Level 2 or 3 aerosols, or *dangerous goods*, a record of their location shall be available in a location that is readily accessible to emergency responders.

### 3.2.2.6. Smoking

- 1)** Except as provided in Subsection 2.4.2., smoking shall not be permitted in an indoor storage area.

### 3.2.2.7. Storage Arrangements

- 1)** The maximum permitted height of storage in any *individual storage area* shall be determined according to
  - a) its base area and shape, and the stability of the stored products, and
  - b) the height limitations otherwise set in this Section.

## 3.2.3. General Indoor Storage

### 3.2.3.1. Application

**1)** This Subsection applies to the indoor storage of Class I to IV commodities, Group A, B or C plastics, and *closed containers of distilled beverage alcohol*, in solid piles, on pallets, on shelves or in bin boxes or *racks*.

**2)** When *flammable liquids* or *combustible liquids* are stored with products covered by this Subsection, the liquids shall meet the requirements of the applicable provisions of Part 4.

### 3.2.3.2. Individual Storage Areas

- 1)** Except as provided in Sentence (2), the size of *individual storage areas* shall not exceed the limits shown in Table 3.2.3.2.

**2)** In a *sprinklered building*, the height of storage in *racks* is permitted to exceed the limits shown in Table 3.2.3.2. (See Appendix A.)

**Table 3.2.3.2.**  
**Size Limits for Individual Storage Areas**  
 Forming Part of Sentences 3.2.3.2.(1) and (2) and Clause 3.2.7.5.(1)(c)

Product Classification	Unsprinklered <i>Buildings</i>		<i>Sprinklered Buildings</i>	
	Area, m <sup>2</sup>	Height of Storage, m	Area, m <sup>2</sup>	Height of Storage, m
Class I commodities	500	6.5	1 500	9.0
Class II commodities	500	6.5	1 500	9.0
Class III commodities, Group C plastics	250	4.5	1 000	9.0
<i>Closed containers of distilled beverage alcohol</i>	250	4.5	1 000	9.0
Class IV commodities, Group B plastics	250	3.6	1 000	9.0
Group A plastics	250	1.5	500	6.1

### 3.2.3.3. Sprinkler Systems

**1)** Except as provided in Sentence (2), where a sprinkler system is required to accommodate *individual storage areas* referred to in Article 3.2.3.2., the sprinkler system shall be designed and installed in conformance with NFPA 13, "Installation of Sprinkler Systems."

**2)** For *closed containers of distilled beverage alcohol*, the sprinkler system referred to in Sentence (1) shall be designed in conformance with good engineering practice. (See Appendix A.)

### 3.2.4. Indoor Tire Storage

#### 3.2.4.1. Application

**1)** This Subsection shall apply to *buildings* or parts of *buildings* used for the storage of rubber tires.

#### 3.2.4.2. Fire Separations

**1)** A tire storage area designed to contain more than 375 m<sup>3</sup> of rubber tires shall be separated from the remainder of the *building* by a *fire separation* having a *fire-resistance rating* of not less than 2 h. (See Appendix A.)

#### 3.2.4.3. Sprinkler Protection

**1)** *Buildings* regulated by this Subsection shall be *sprinklered* in conformance with NFPA 13, "Installation of Sprinkler Systems," whenever

- the aggregate of *individual storage areas* in the *building* exceeds 500 m<sup>2</sup>,
- any *individual storage area* exceeds 250 m<sup>2</sup>, or
- the height of storage is more than 3.6 m, and the total volume of tires in the *building* is more than 375 m<sup>3</sup>.

#### 3.2.4.4. Portable Extinguishers

**1)** In addition to the requirements of Part 2, multi-purpose dry chemical portable extinguishers having a rating of 4-A:80-B shall be installed

- in every 500 m<sup>2</sup> of *floor area*, and
- so that the travel distance to any extinguisher does not exceed 25 m.

**3.2.5. Indoor Storage of Aerosol Products**

**3.2.5.1. Application**

1) This Subsection shall apply to the indoor storage of packaged aerosol products as classified in Article 3.2.5.2. (See Appendix A.)

**3.2.5.2. Classification**

1) For the purposes of this Subsection, aerosol products shall be classified as Level 1, 2 or 3 in conformance with NFPA 30B, "Manufacture and Storage of Aerosol Products." (See Appendix A.)

**3.2.5.3. Level 1 Aerosols**

1) Packaged Level 1 aerosol products shall be protected as required for Class III commodities, in both palletized and *rack* storage, in conformance with Article 3.2.3.2.

**3.2.5.4. Level 2 and 3 Aerosols**

1) The storage of packaged Level 2 and 3 aerosol products shall conform to Table 3.2.5.4. and Articles 3.2.5.5. to 3.2.5.8.

2) Where storage of packaged aerosol products is mixed, protection shall be provided for the most hazardous classification present.

**Table 3.2.5.4.**  
**Maximum Amount of Packaged Level 2 and 3 Aerosol Products, kg<sup>(1)</sup>**  
 Forming Part of Sentences 3.2.5.4.(1) and 3.2.5.5.(2)

Product Classification	Type of Dedicated Area Required					
	Unsprinklered <i>Building</i>			Sprinklered <i>Building</i>		
	None	A <sup>(2)</sup>	B <sup>(3)</sup>	None	A <sup>(2)</sup>	B <sup>(3)</sup>
Level 2 and 3	1 000	5 000	10 000	10 000	50 000	No Limit

**Notes to Table 3.2.5.4.:**

- (1) One pallet load of packaged aerosols is approximately 1 000 kg.
- (2) See Article 3.2.5.6.
- (3) See Article 3.2.5.7.

**3.2.5.5. Sprinkler Systems**

1) Where a sprinkler system is required to accommodate the storage limits in Sentence 3.2.5.4.(1), the sprinkler system shall be designed and installed in conformance with Sentence 3.2.3.3.(2), with additional sprinkler protection provided in conformance with NFPA 30B, "Manufacture and Storage of Aerosol Products," for areas in which packaged aerosol products are stored.

2) Where the sprinkler system required to accommodate the storage limits in Sentence 3.2.5.4.(1) does not conform to Sentence (1), the storage of packaged Level 2 or 3 aerosol products shall conform to Table 3.2.5.4. for unsprinklered *buildings*.

**3.2.5.6. Type A Dedicated Areas**

1) Where a Type A dedicated storage area is required to accommodate the storage limits stated in Sentence 3.2.5.4.(1), it shall be separated from the remainder of the *building* by chain link fencing or a noncombustible *partition* that is capable of withstanding the impact of rocketing cans and that extends to the underside of the roof deck or to the ceiling which must also be capable of withstanding the impact of rocketing cans.

2) Chain link fencing referred to in Sentence (1) shall be not lighter than 2.9 mm steel wire woven into a 50 mm diamond mesh.

**3.2.5.7. Type B Dedicated Areas**

- 1) Where a Type B dedicated storage area is required to accommodate the storage limits in Sentence 3.2.5.4.(1), it shall be separated from the remainder of the *building* by *partitions*
- having not less than a 1 h *fire-resistance rating*,
  - capable of withstanding the impact of rocketing cans, and
  - extending to the underside of the roof or to a ceiling of construction equivalent to the *partitions*.

**3.2.5.8. Storage Height**

- 1) Except as provided in Sentence (2), the height of storage of packaged Level 2 or 3 aerosols shall be not greater than
- 1.75 m where products are in solid piles or on pallets, or
  - 6.1 m where products are on *racks*.
- 2) Where the *building* is *sprinklered* in conformance with Article 3.2.5.5., and an enclosure conforming to Articles 3.2.5.6. or 3.2.5.7. is provided, the height of storage of packaged Level 2 or 3 aerosols shall be not greater than
- 6.1 m where products are in solid piles or on pallets, or
  - the height limit determined by the design capacity of the sprinkler system where products are on *racks*.

**3.2.5.9. Aisles**

- 1) Aisles separating *racks*, shelves, or piles of packaged Level 2 or 3 aerosol products shall be not less than 2.4 m wide.

**3.2.6. Indoor Storage of Combustible Fibres****3.2.6.1. Application**

- 1) This Subsection shall apply to the storage of *combustible fibres* inside *buildings*.

**3.2.6.2. Building Construction**

- 1) *Buildings* used for the storage of baled *combustible fibres* shall comply with the height and area limitations of the Alberta Building Code 2006 for *buildings* classified as Group F, Division 2.

**3.2.6.3. Loose Combustible Fibres**

- 1) Up to 3 m<sup>3</sup> of loose *combustible fibres* are permitted to be kept in a *fire compartment* provided they are stored in metal-lined bins equipped with self-closing metal-lined covers.
- 2) Quantities of loose *combustible fibres* exceeding 3 m<sup>3</sup> but not exceeding 15 m<sup>3</sup> shall be stored in rooms separated from the remainder of the *building* by a *fire separation* having a *fire-resistance rating* of not less than 1 h.
- 3) Quantities of loose *combustible fibres* exceeding 15 m<sup>3</sup> but not exceeding 30 m<sup>3</sup> shall be stored in rooms separated from the remainder of the *building* by a *fire separation* having a *fire-resistance rating* of not less than 2 h.
- 4) Quantities of loose *combustible fibres* that exceed 30 m<sup>3</sup> shall be stored in an individual room that is
- sprinklered*, and
  - separated from the remainder of the *building* by a *fire separation* having a *fire-resistance rating* of not less than 2 h.
- 5) The *individual storage areas* for *combustible fibres* described in Sentence (4) shall not exceed 250 m<sup>2</sup>.

**3.2.6.4. Baled Combustible Fibres**

- 1)** Except as permitted in Sentences (2), (3) and (4), baled *combustible fibres* shall be stored so that
  - a) no *individual storage area* exceeds 250 m<sup>2</sup>,
  - b) the height of storage in an *individual storage area* does not exceed 4.5 m,
  - c) subsidiary aisles within *individual storage areas* are not less than 1 m wide, and
  - d) the clearance between piles and *building* walls is not less than 1 m.
- 2)** Except as permitted in Sentence (4), where baled *combustible fibres* are stored in *sprinklered buildings*, the maximum area of any *individual storage area* shall be 500 m<sup>2</sup>.
- 3)** Where baled raw pulp is stored in an unsprinklered *building*,
  - a) the maximum area of any *individual storage area* shall be 500 m<sup>2</sup>, and
  - b) the maximum height of storage shall be 6 m.
- 4)** Where baled raw pulp is stored in a *sprinklered building*,
  - a) the maximum area of any *individual storage area* shall be 1000 m<sup>2</sup>, and
  - b) the maximum height of storage shall be 6 m.
- 5)** The sides of baled storage piles shall be inclined back from the base of the pile with a slope of not less than 1 m for each 10 m of height.

**3.2.6.5. Heating Equipment**

- 1)** Unless the use of fuel-fired *appliances* and electrical heating elements is controlled in a manner such that they will not create a fire or explosion hazard, they shall not be permitted in a storage area for *combustible fibres*.
- 2)** Shields shall be provided that will prevent stored material from coming within 300 mm of any part of a heating system's heat distribution network.

**3.2.7. Indoor Storage of Dangerous Goods**

**3.2.7.1. Application**

- 1)** Except as provided in Part 4 or otherwise specified in this Code, this Subsection shall apply to *buildings* or parts of *buildings* where *dangerous goods* in packages or containers are stored in a single *fire compartment* in quantities greater than those shown in Table 3.2.7.1.
- 2)** Where a product has a primary and a subsidiary class, the quantities referred to in Sentence (1) shall be determined by
  - a) using the class having precedence, as established in Section 2.8 of the "Transportation of Dangerous Goods Regulations," or
  - b) using the lesser of the two small quantity exemptions in Table 3.2.7.1. when the precedence referred to in Clause (a) is not established.

**Table 3.2.7.1.**  
**Small Quantity Exemptions for Dangerous Goods**  
 Forming Part of Sentences 3.2.7.1.(1) and (2), and 3.3.4.1.(2) and (3)

Class <sup>(1)</sup>	<i>Dangerous Goods</i>	Maximum Exempt Amount
1	Explosives	See Subsection 3.1.1.
2	Gases	
	Division 1 <sup>(1)(2)</sup> Flammable	25 kg <sup>(3)</sup>
	Division 2 Non-flammable and non-toxic	150 kg
	Division 3 Toxic or corrosive	0
3	<i>Flammable Liquids</i> and <i>Combustible Liquids</i>	0 <sup>(4)</sup>

Table 3.2.7.1. (Continued)

Class <sup>(1)</sup>	Dangerous Goods	Maximum Exempt Amount
4	Flammable Solids	
	Division 1 Flammable solids	100 kg <sup>(5)</sup>
	Division 2 Subject to spontaneous ignition	50 kg
	Division 3 Reactive with water	50 kg
5	Oxidizing Substances	
	Division 1 Oxidizers	
	Packing Group I <sup>(6)(7)</sup>	250 kg or 250 L
	Packing Group II <sup>(6)</sup>	
Packing Group III		
Division 2 Organic peroxides	100 kg or 100 L	
6	Poisonous and Infectious Substances	
	Division 1 Poisonous substances	
	Packing Group I	0
	Packing Group II	100 kg or 100 L
	Packing Group III	1 000 kg or 1 000 L
Division 2 Infectious substances	0	
7	Radioactive Materials	See Subsection 3.1.1.
8	Corrosive Substances	
	Packing Group I	500 kg or 500 L
	Packing Group II	1 000 kg or 1 000 L
Packing Group III	2 000 kg or 2 000 L	
9	Miscellaneous	See Article 3.1.2.1. <sup>(8)</sup>

**Notes to Table 3.2.7.1.:**

- (1) The numbers refer to the class and division of *dangerous goods*, as defined in the "Transportation of Dangerous Goods Regulations."  
(2) See Article 3.2.8.2.  
(3) See A-3.2.8.2.(2) in Appendix A.  
(4) See Part 4.  
(5) 50 kg for nitrocellulose-based products, and 10 kg for "strike anywhere" matches.  
(6) See Article 3.2.7.18.  
(7) The "Transportation of Dangerous Goods Act" and its Regulations defines "packing group" as "a group in which *dangerous goods* are included based on the inherent danger of the *dangerous goods*." Packing Group I products are more hazardous than Packing Group III products.  
(8) Small quantity exemptions may be determined by other authorities such as the "Transportation of Dangerous Goods Act," the "Workplace Hazardous Materials Information System" (WHMIS), and environmental protection legislation.

**3.2.7.2. Ignition Sources**

- 1)** Heating *appliances* shall not be permitted in a *fire compartment* used for the storage of Class 2.1, 3, 4 or 5 *dangerous goods* unless they are installed in a manner that will not create a fire or explosion hazard.
- 2)** Smoking shall not be permitted within a *fire compartment* used for the storage of *dangerous goods* and signs shall be posted in conformance with Article 2.4.2.2.
- 3)** Except as provided in Subsection 3.1.3. and in Section 5.2., open flames and spark-producing devices shall not be used in an area where *dangerous goods* are stored.

**3.2.7.3. Ambient Conditions**

- 1) Rooms or parts of *buildings* used for the storage of *dangerous goods*
  - a) shall be dry and cool, and
  - b) where the products being stored are capable of releasing flammable vapours or toxic gases under normal ambient conditions, shall be provided with a ventilation system to exhaust such vapours or gases outdoors to an area where they will not return to the *building* (see Appendix A).

**3.2.7.4. Housekeeping**

- 1) Areas where *dangerous goods* are stored shall be kept free of waste packaging materials, debris of any kind, or any spilled product.
- 2) Broken packages or containers of *dangerous goods* shall be moved to a safe location and the product repackaged and labelled as soon as possible.

**3.2.7.5. Storage Arrangements**

- 1) The method of storage of *dangerous goods* shall
  - a) be determined to ensure the physical and chemical stability of the stored products,
  - b) except as provided in Sentences (2) and (5), not exceed the maximum heights of storage shown in Table 3.2.7.5., and
  - c) not exceed the maximum base areas for *individual storage areas* shown in Table 3.2.3.2.
- 2) Storage heights for a protected storage area stated in Table 3.2.7.5. are permitted to be exceeded provided the *dangerous goods* are stored on *racks* or shelves.
- 3) When a storage area is required by this Article to be protected, it shall be *sprinklered* or protected with a special fire suppression system, in conformance with Part 2 and good engineering practice with respect to specific *dangerous goods*. (See A-3.2.7.9.(1) in Appendix A.)
- 4) Except for Class 2 gases, stored *dangerous goods* shall be kept not less than 100 mm above the floor level.
- 5) *Flammable liquids* and *combustible liquids* shall be stored in conformance with Part 4.

**Table 3.2.7.5.**  
**Storage Height Limits for Dangerous Goods, m**  
 Forming Part of Sentences 3.2.7.5.(1) and (2)

Packing Group <sup>(1)</sup>	Unprotected Storage	Protected Storage
Packing Group I	1.8	2.4
Packing Group II	2.4	4
Packing Group III	4.5	6

**Notes to Table 3.2.7.5.:**

(1) See Table 3.2.7.1.

- 6) Solid and liquid Class 5 *oxidizing substances* shall be separated from the remainder of the *building* by a *fire separation* having a *fire-resistance rating* of not less than 2 h.
- 7) Reactive substances shall be separated from the remainder of the *building* by a *fire separation* having a *fire-resistance rating* of not less than 2 h. (See A-3.1.2.5.(1) in Appendix A.)
- 8) Packages or containers of Class 5.2 organic peroxides shall not be opened, or the product dispensed, in the same area where it is stored.

9) Except where the width of storage of *dangerous goods* is not more than 1.5 m, measured out from the wall, wall clearances of not less than 400 mm shall be maintained.

### 3.2.7.6. Separation from Other Dangerous Goods

1) Except as required in Sentences (2) and (3), Clause 3.2.8.2.(1)(g) and Sentence 3.2.8.3.(2), *dangerous goods* shall be separated from other *dangerous goods* in conformance with Table 3.2.7.6. (See Appendix A.)

2) In addition to the separation requirements in Sentence (1), *dangerous goods* shall be stored in conformance with the information provided in the Material Safety Data Sheet for the specific *dangerous good*. (See Appendix A.)

3) *Flammable liquids* or *combustible liquids* or Class 8 corrosive substances shall not be stored with Class 7 radioactive materials in quantities or in a manner that would constitute an undue risk in the event of a fire.

**Table 3.2.7.6.**  
**Separation Chart for Storage of Dangerous Goods**  
Forming Part of Sentences 3.2.7.6.(1), 3.2.7.9.(2), 3.3.4.3.(2) and 4.2.2.3.(2)

Class <sup>(1)</sup>	2.1	2.2	2.3	3	4.1	4.2	4.3	5.1	5.2	6	8
2.1	-	P	X	P	P	A	DS	X	X	X	X
2.2	P	-	P	P	P	P	P	P	P	P	P
2.3	X	P	-	X	A	A	DS	A	X	DS	A
3	P	P	X	-	P	A	A	X	X	DS	A
4.1	P	P	A	P	-	A	DS	X	X	DS	A
4.2	A	P	A	A	A	-	DS	X	X	DS	A
4.3	DS	P	DS	A	DS	DS	-	X	X	DS	X
5.1	X	P	A	X	X	X	X	-	X	A	X
5.2	X	P	X	X	X	X	X	X	-	X	X
6	X	P	DS	DS	DS	DS	DS	A	X	-	A
8	X	P	A	A	A	A	X	X	X	A	-

X = Incompatible goods: do not store goods together in the same *fire compartment*.

A = Incompatible goods: separate goods by a horizontal distance of not less than 1 m.

P = Permitted: goods are permitted to be stored together.

DS = Refer to Material Safety Data Sheet.

#### Notes to Table 3.2.7.6.:

<sup>(1)</sup> The numbers refer to the class and division of *dangerous goods* in Table 3.2.7.1.

### 3.2.7.7. Corrosion Protection

1) Measures shall be taken to prevent or minimize corrosion or deterioration of shelving, *racks*, and piping system components, due to contact with stored *dangerous goods*.

### 3.2.7.8. Flooring Materials

1) Floors in areas where *dangerous goods* are stored shall be constructed of impermeable materials to prevent the absorption of chemicals.

2) Class 5 *oxidizing substances* shall not be stored on combustible floors or platforms.

**3.2.7.9. Fire Suppression Systems**

**1)** Except as permitted in Sentences (2) and (3) and in Part 4, *buildings* used for the storage of *dangerous goods* regulated by this Subsection shall be equipped throughout with a sprinkler system or other fire suppression system, designed in conformance with Part 2 and good engineering practice with respect to specific *dangerous goods*. (See Appendix A.)

**2)** *Buildings* described in Sentence (1) need not be equipped throughout with a sprinkler system or other fire suppression system provided that

- a) the sum of *individual storage areas* in the *building* used for the storage of *dangerous goods*, other than Class 9 *dangerous goods* with no other class and those covered in Part 4, does not exceed 100 m<sup>2</sup>, and
- b) the *dangerous goods* are
  - i) separated in conformance with Table 3.2.7.6., and
  - ii) stored in *fire compartments* separated from the remainder of the *building* by a *fire separation* having a *fire-resistance rating* of not less than 2 h.

**3)** *Buildings* described in Sentence (1) need not be equipped throughout with a sprinkler system or other fire suppression system provided that storage consists only of Class 2.2 gas with no Class 5 subsidiary class.

**3.2.7.10. Smoke Venting**

**1)** Where the collective *individual storage areas* for *dangerous goods* exceed 10 m<sup>2</sup> in a *fire compartment*, means shall be provided for manual or automatic venting of smoke and toxic gases from the storage area under fire conditions. (See Appendix A.)

**3.2.7.11. Spill Control**

**1)** Measures to control spilled liquid or solid *dangerous goods* shall be provided in conformance with Subsection 4.1.6.

**2)** Materials or liquids used in the cleanup of spills and leakages of *dangerous goods* shall be

- a) compatible and non-reactive with the *dangerous goods* being cleaned up, and
- b) disposed of in conformance with Subsection 4.1.6.

**3.2.7.12. Fire Department Access**

**1)** Except as provided in Sentences (2) and (3), fire department access to *buildings* described in Article 3.2.7.1. shall be in conformance with Section 2.5.

**2)** When the collective *individual storage area* for *dangerous goods* exceeds 10 m<sup>2</sup>, *buildings* regulated by Sentence (1) shall be accessible to fire department vehicles from at least 2 sides for the purpose of firefighting. (See Appendix A.)

**3)** In *buildings* regulated by Sentence (1), access openings to each *storey* provided in conformance with the Alberta Building Code 2006 shall be not less than 750 mm wide by 1100 mm high. (See Appendix A.)

**3.2.7.13. Labels**

**1)** Products classified as *dangerous goods* shall display appropriate identifying labels from the time they enter a facility until they are issued as finished products or waste material. (See Appendix A.)

**3.2.7.14. Placards**

**1)** *Individual storage areas* used for the storage of *dangerous goods* shall be clearly designated as such by posted placards conforming to the "Transportation of Dangerous Goods Regulations" and Sentences (2) to (4). (See Appendix A.)

**2)** Where storage consists of a single product, only the UN number need be posted.

**3)** Where storage consists of multiple products within the same class, the individual class and division placard shall be posted.

4) Where storage consists of more than one class of products, a placard for each individual class, or the "Danger" placard of the "Transportation of Dangerous Goods Regulations," shall be posted at the entrance to the storage area.

5) *Individual storage areas* described in Sentence (1) shall be identified in the fire safety plan as required in Article 3.2.2.5.

### 3.2.7.15. Training

- 1) In a *building* regulated by this Subsection, at least one person shall be
  - a) trained in conformance with Sentence (2),
  - b) in charge during operating hours, and
  - c) available to respond to a day or night emergency.

2) The person in charge specified in Sentence (1) shall be trained in the correct procedures for the handling, storing and offering for transport of *dangerous goods* in accordance with

- a) the Occupational Health and Safety Act and its Regulations, and
- b) the "Transportation of Dangerous Goods Regulations."

3) All employees involved in the storage and handling of *dangerous goods* shall be trained in safe handling procedures and correct responses to an emergency situation.

### 3.2.7.16. Unauthorized Access

1) An area used for the storage of *dangerous goods* shall be secured against unauthorized access.

### 3.2.7.17. Separation from Combustible Products

1) Except for Class I commodities, *dangerous goods* shall not be stored in the same *individual storage area* with other products listed in Sentence 3.2.1.1.(1).

### 3.2.7.18. Storage of Oxidizers in Mercantile Occupancies

1) This Article applies to *mercantile occupancies*.

2) Packing Group I or II *oxidizing substances* that are located within *mercantile occupancies* in quantities not exceeding those permitted by Table 3.2.7.1. shall be separated from ordinary combustible material by a distance of at least 1 m.

3) A clear space of not less than 2.4 m shall be maintained between the *oxidizing substances* identified in Sentence (2) and any other *dangerous goods*. (See A-3.1.2.5.(1) in Appendix A.)

## 3.2.8. Indoor Storage of Compressed Gases

### 3.2.8.1. Application

1) Except as provided in Subsection 3.1.1., this Subsection shall apply to the storage of Class 2 gases inside *buildings*.

### 3.2.8.2. Flammable Gases

1) Except as provided in Sentences (2) and (3), cylinders of Class 2.1 flammable gases stored indoors shall be located in a room that

- a) is separated from the remainder of the *building* by a gas-tight *fire separation* having a *fire-resistance rating* of at least 2 h,
- b) is located on an exterior wall of the *building*,
- c) can be entered from the exterior, and whose *closures* leading to the interior of the *building* are
  - i) equipped with self-closing devices that keep the *closures* closed when not in use, and
  - ii) constructed so as to prevent the migration of gases from the room into other parts of the *building*,

- d) is designed to prevent critical structural and mechanical damage from an internal explosion in conformance with good engineering practice such as that described in NFPA 68, "Venting of Deflagrations" (see Appendix A),
- e) is provided with natural or mechanical ventilation in conformance with Subsection 4.1.7.,
- f) does not contain fuel-fired *appliances* or high-temperature heating elements, and
- g) is used for no purpose other than the storage of Class 2 gases.

**2)** Cylinders of Class 2.1 flammable, lighter-than-air gases are permitted to be stored outside of a room described in Sentence (1) provided that the aggregate capacity per *fire compartment* of expanded gas outside of the room is not more than

- a) 60 m<sup>3</sup> in an *unsprinklered building of combustible construction*, and
- b) 170 m<sup>3</sup> in a *sprinklered building* or in a *building of noncombustible construction*.

(See Appendix A.)

**3)** The storage of "single-trip" non-refillable cylinders (i.e. TC-39, TC-2P, and TC-2Q) with water capacities of more than 375 g and less than 1.13 kg located within *mercantile occupancies* shall conform to gas regulations made pursuant to the Safety Codes Act.

### 3.2.8.3. Indoor Storage of Poisonous, Corrosive or Oxidizing Gases

**1)** Cylinders of Class 2.3 toxic or corrosive gases or Class 2.2 (5.1) oxidizing gases stored indoors shall be located in a room that

- a) is separated from the remainder of the *building* by gas-tight *fire separations* having a *fire-resistance rating* of at least 1 h,
- b) is located on an exterior wall,
- c) can be entered from the exterior, and whose *closures* leading to the interior of the *building* are
  - i) equipped with self-closing devices that keep the *closures* closed when not in use, and
  - ii) constructed so as to prevent the migration of gases from the room into other parts of the *building*, and
- d) is provided with ventilation to the outdoors.

**2)** Cylinders of gases described in Sentence (1) shall not be stored in a room containing combustible materials.

### 3.2.9. Indoor Storage of Ammonium Nitrate

#### 3.2.9.1. Application

**1)** This Subsection shall apply to the storage of Class 5.1 ammonium nitrate mixtures in quantities exceeding 1 000 kg inside *buildings*. (See Appendix A.)

**2)** The requirements of Subsection 3.2.3. regarding Class II commodities shall also apply to bagged storage of Class 5.1 ammonium nitrate. (See A-3.2.1.1.(1)(a) in Appendix A.)

#### 3.2.9.2. Storage Buildings

**1)** *Buildings* intended for the storage of ammonium nitrate shall be classified as *medium-hazard industrial occupancies* (Group F, Division 2).

**2)** *Buildings* intended for the storage of ammonium nitrate shall not be more than one *storey* in *building* height.

- 3)** *Buildings* intended for the storage of ammonium nitrate shall not
- a) have *basements* or crawl spaces, or
  - b) contain open floor drains, tunnels, elevator pits or other pockets that might trap molten ammonium nitrate.

**4)** *Buildings* intended for the storage of ammonium nitrate shall have not less than 0.007 m<sup>2</sup> of vent area for each square metre of storage area, unless mechanical ventilation is provided.

**3.2.9.3.**

- 5) All flooring in storage areas shall be constructed of noncombustible materials.
- 6) *Buildings* intended for the storage of ammonium nitrate shall be designed to prevent the ammonium nitrate from coming into contact with *building* materials that
  - a) will cause the ammonium nitrate to become unstable,
  - b) may corrode or deteriorate by reason of contact with the ammonium nitrate, or
  - c) will become impregnated with the ammonium nitrate.
 (See Appendix A.)
- 7) *Buildings* used for the storage of ammonium nitrate shall incorporate spatial separation and exposure protection in conformance with Subsection 3.2.3. of Division B of the Alberta Building Code 2006. (See Appendix A.)

**3.2.9.3. Industrial Trucks**

- 1) In addition to the requirements of Subsection 3.1.3., industrial trucks used or stored within *buildings* where ammonium nitrate is also stored shall be maintained so that fuels or hydraulic fluids do not contaminate the ammonium nitrate. (See Appendix A.)
- 2) Fuel-dispensing operations shall not be carried out in *buildings* where ammonium nitrate is stored.
- 3) An internal combustion engine shall not be permitted to remain unattended in a *building* where ammonium nitrate is stored, unless the engine is located in an area that will prevent the spread of a fire originating in the engine.
- 4) Industrial trucks used for the transportation of ammonium nitrate shall be cleaned of remaining material following use.

**3.2.9.4. Portable Extinguishers**

- 1) In addition to the requirements of Part 2, pressurized water portable fire extinguishers having a rating of 2-A or larger shall be installed. (See Appendix A.)

**3.2.10. Indoor Storage of Fireworks****3.2.10.1. Application**

- 1) Except as permitted in Sentence (2), this Subsection shall apply to the indoor storage of *fireworks*.
- 2) This Subsection shall not apply to the storage of *fireworks* commonly used as distress flares.

**3.2.10.2. Dwelling Units**

- 1) *High-hazard fireworks* shall not be stored in a *dwelling unit*.
- 2) Not more than 10 kg gross weight of *low-hazard fireworks* obtained in accordance with Part 5 shall be stored in a *dwelling unit*.
- 3) If *low-hazard fireworks* are stored in a *dwelling unit* they shall be stored
  - a) in a secure container,
  - b) in a cool, dry area, and
  - c) away from
    - i) an open flame,
    - ii) excessive heat, or
    - iii) spark-producing equipment or tools.

**3.2.10.3. Ignition Sources**

- 1) Smoking, open-flame devices or spark-producing equipment shall not be permitted in any place, site or *building* used for the sale, storage or retail display of *fireworks*.

2) Signs reading "FIREWORKS - NO SMOKING or OPEN FLAME" in letters at least 100 mm high shall be posted in locations acceptable to the fire department in areas described in Sentence (1).

#### 3.2.10.4. Storage

1) *Fireworks* shall not be stored or displayed for sale in a *building* or place unless the *building* or place is acceptable to the fire department in accordance with Part 5.

2) Explosives, other than small arms ammunition, shall not be stored in the same *building* in which *fireworks* are stored.

#### 3.2.10.5. Low-Hazard Storage

1) *Low-hazard fireworks* that are displayed for sale shall be

- a) in lots that do not exceed 25 kg each gross weight,
- b) in a package, glass case or other suitable receptacle away from flammable or combustible substances, and
- c) in a place that is not exposed to direct or refracted sunlight or excessive heat.

2) Where *low-hazard fireworks* that exceed 25 kg gross weight are stored, they shall be in a container meeting the requirements of the "Explosives Act" and its Regulations, published by Natural Resources Canada.

3) Where *low-hazard fireworks* that exceed 100 kg gross weight are stored, they shall be stored in a separate store or warehouse meeting the requirements of the "Explosives Act" and its Regulations, published by Natural Resources Canada.

#### 3.2.10.6. High-Hazard Storage

1) Where *high-hazard fireworks* that exceed 25 kg gross weight are stored, they shall be stored in a container meeting the requirements of the "Explosives Act" and its Regulations, published by Natural Resources Canada.

2) Where *high-hazard fireworks* that exceed 125 kg gross weight are stored, they shall be in a separate store or warehouse meeting the requirements of the "Explosives Act" and its Regulations, published by Natural Resources Canada.

3) *High-hazard fireworks* obtained for immediate use are permitted to be stored in quantities that exceed those specified in this Article if the storage place is

- a) situated in a location acceptable to the fire department,
- b) secured to prevent unauthorized entry,
- c) clean and adequately ventilated,
- d) not used for the storage of any other flammable, combustible or explosive substance, and
- e) identified with conspicuously posted signs warning of the explosive contents and the danger from open flames, smoking and the use of spark-producing tools or other objects in the storage place.

#### 3.2.10.7. Portable Extinguishers

1) Portable extinguishers shall be provided in all *buildings* and areas where *fireworks* are stored.

## Section 3.3. Outdoor Storage

### 3.3.1. Scope

#### 3.3.1.1. Application

1) Except as permitted in Sentence (2), this Section shall apply to the outdoor storage of the following products:

- a) Class III and IV commodities, and Group A, B and C plastics, as described in Section 3.2.,
- b) rubber tires,

**3.3.2.1.**

- c) forest products, including lumber, timber and wood pallets,
- d) forest by-products, including wood chips and hogged material (see Appendix A),
- e) manufactured *buildings* (see Appendix A),
- f) wrecked vehicles in salvage yards, and
- g) *dangerous goods* in packages or containers, as covered in Subsection 3.3.4.

**2)** This Section shall not apply to

- a) a site where the total storage area is not more than 100 m<sup>2</sup>, except
  - i) for distance requirements between stored products and a *building*, and
  - ii) requirements for Class 2 gases in Subsection 3.3.5.,
- b) Class I and II commodities, as classified in Section 3.2.,
- c) intermodal shipping containers, except when containing *dangerous goods* (see Appendix A),
- d) buried products and landfill operations,
- e) products stored on the roof of a *building*,
- f) vehicles in parking areas or parking lots,
- g) logs and similar untreated forest products in ranked piles (see Appendix A), or
- h) bulk products, except as described in Clause (1)(d).

**3.3.2. General****3.3.2.1. Application**

**1)** Unless otherwise specified, this Subsection shall apply to the outdoor storage of any product covered in this Section.

**3.3.2.2. Height**

- 1)** The maximum permitted height of any *individual storage area* shall
- a) be determined to ensure the physical stability of the stored products under normal circumstances as well as under fire conditions,
  - b) be determined according to its base area and shape, and the type of packaging, combustibility and chemical reactivity of the stored products, and
  - c) not exceed the limits specified in Subsections 3.3.3., 3.3.4. and 3.3.6.

**3.3.2.3. Individual Storage Areas and Clearances**

**1)** Except as provided in Sentence (2), the size limits and clearances for *individual storage areas* shall conform to Subsections 3.3.3., 3.3.4. and 3.3.6.

**2)** An outdoor storage area shall be arranged such that there is a clear space of not less than

- a) 30 m between stored products and brush or forested areas, and
- b) 6 m between stored products and uncontrolled grass or weeds.

**3.3.2.4. Storage beneath Power Lines**

**1)** Products covered in this Section shall not be stored beneath electrical power lines.

**3.3.2.5. Fire Department Access**

**1)** Except as provided in Sentence (2), an access route constructed in conformance with Subsection 3.2.5. of Division B of the Alberta Building Code 2006 shall be provided to permit the approach of fire department vehicles to within 60 m travelling distance of any part of an *individual storage area*.

**2)** Where the total storage area exceeds 6000 m<sup>2</sup>, the access route required in Sentence (1) shall be connected with a public thoroughfare in at least 2 locations.

**3.3.2.6. Fencing**

- 1) An outdoor storage area shall be surrounded by a firmly anchored fence that is
  - a) substantially constructed to discourage climbing and unauthorized entry,
  - b) not less than 1.8 m high, and
  - c) provided with gates that shall be locked when the storage area is not staffed.
- 2) When in a fire department access route, the gates required in Clause (1)(c) shall be of adequate width and design, and in a location that readily permits the entry of fire department vehicles, in conformance with Article 3.3.2.5. (See Appendix A.)

**3.3.2.7. Maintenance**

- 1) Any access route, gateway or clear space required in this Section shall be
  - a) maintained in conformance with Section 2.5., and
  - b) kept free of obstructions and piles of snow.
- 2) Private hydrants, fire department connections and private valves controlling water supplies to fire protection systems shall be
  - a) maintained in conformance with Part 6, and
  - b) kept accessible to firefighters and their equipment at all times.

**3.3.2.8. Ignition Sources**

- 1) Unless controlled in a manner that will not create a fire hazard, a device, operation or activity that produces open flames, sparks or heat shall not be permitted in an outdoor storage area. (See A-4.1.5.2.(1) in Appendix A.)
- 2) Except as provided in Subsection 2.4.2., smoking shall not be permitted in an outdoor storage area.
- 3) Except as provided in Subsection 2.6.2., the burning of materials in an outdoor storage area shall be performed only in a burner that is
  - a) designed, constructed and maintained in conformance with good engineering practice, and
  - b) located not less than 15 m from a *building* or stored products.

**3.3.2.9. Fire Safety Plan**

- 1) A fire safety plan conforming to Section 2.8. and Sentences (2) and (3) shall be prepared.
- 2) The fire safety plan required in Sentence (1) shall identify
  - a) the location and classification of the products currently stored, as described in Sentence 3.3.1.1.(1),
  - b) the method of storage, including the clear spaces required and the maximum permitted size of *individual storage areas*,
  - c) the location of fire alarm systems and firefighting equipment, and
  - d) the control of fire hazards in and around the outdoor storage area.
- 3) At least one copy of the fire emergency procedures shall be prominently posted at the outdoor storage site.

**3.3.2.10. Portable Extinguishers**

- 1) Any *building* located in an outdoor storage area shall be provided with portable extinguishers.
- 2) Each motorized vehicle operating in an outdoor storage area shall be equipped with at least one portable extinguisher having a minimum rating of 2-A:30-B:C.
- 3) Portable extinguishers shall be provided in all storage areas so that the travel distance from any part of the storage area to an extinguisher is not more than 25 m.

**3.3.2.11. Site Preparation**

- 1) The storage site shall be
  - a) level, and
  - b) solid ground or paved with asphalt, concrete or other hard surface material.

**3.3.2.12.****3.3.2.12. Fuel Dispensing**

1) Except as provided in Sentence (2), the dispensing of *flammable liquids* or *combustible liquids* into the fuel tank of a vehicle shall conform to Section 4.6.

2) A clear space of not less than 6 m shall be maintained between the stored products and fuel dispensers.

**3.3.2.13. Spill Control**

1) Provision shall be made for the safe drainage and containment of waste oils or *dangerous goods* emptied or escaping from stored products under normal storage conditions or in a fire situation, in conformance with Subsection 4.1.6.

**3.3.2.14. Fire Separation**

1) It is permitted to reduce the clear space between *individual storage areas* prescribed in this Section if a noncombustible *fire separation* or a dirt berm, not less than 1.5 times the height of the stored products, is provided.

**3.3.2.15. Fire Protection**

1) It is permitted to increase the height and size of *individual storage areas* prescribed in this Section if fire extinguishing measures conforming to good engineering practice are provided.

**3.3.2.16. Water Supply**

1) Except as permitted by Sentence (2), water supplies for firefighting shall be available from

- a) a public or private water system, or
- b) water supplies that conform to the requirements of NFPA 1142, "Water Supplies for Suburban and Rural Firefighting" (see Appendix A).

2) Other methods acceptable to the *authority having jurisdiction* are permitted to be used to supply water to a storage area in lieu of the water supplies specified in Sentence (1).

3) The water supply system shall be capable of supplying water for a period not less than 3 h at a minimum rate of

- a) 4 000 L/min if the storage volume is less than 600 m<sup>3</sup>, or
- b) 8 000 L/min if the storage volume is equal to or greater than 600 m<sup>3</sup>.

4) On-site storage of at least 300 m of 65 mm hose and sufficient nozzles shall be provided if not immediately available from responding public fire departments.

5) Water supply required by Sentences (1) and (2) shall be available so that any part of the storage area can be reached by using not more than 150 m of hose.

**3.3.2.17. Hydrant Systems**

1) Except as permitted by Sentence (2), where a municipal hydrant system exists and is adjacent to the storage yard, the hydrant system shall be extended into the yard area so that all parts of the yard can be reached by using not more than 60 m of hose.

2) If acceptable to the *authority having jurisdiction*, fire protection is permitted to be provided by municipal street hydrants and mobile pumping equipment. (See Appendix A.)

**3.3.3. General Outdoor Storage****3.3.3.1. Application**

1) This Subsection applies to the outdoor storage of products other than *dangerous goods*.

**3.3.3.2. Individual Storage Areas and Clearance**

- 1)** Except as provided in Sentences (2) to (4), the size and clearances for *individual storage areas* shall conform to Table 3.3.3.2. (See Appendix A.)
- 2)** Except as permitted in Sentences (3) and (4), a clear space of not less than 15 m shall be maintained between stored products and a *building* on the same property to reduce the risk of fire spreading from the outdoor storage area to the *building*.

**Table 3.3.3.2.**  
**Size and Clearances for Individual Storage Areas (ISA)**  
 Forming Part of Sentence 3.3.3.2.(1)

Product Classification <sup>(1)</sup>	Max. Base Area, m <sup>2</sup>	Max. Height of Storage, m	Min. Clear Space Around Each ISA, m
Class III and IV commodities, Group A, B and C plastics, lumber, timber, manufactured <i>buildings</i> , wrecked vehicles	1 000	≤ 3	6
	1 000	> 3 but ≤ 6	twice the height of storage
Wood chips, hogged material	15 000	18	9
Rubber tires, combustible pallets <sup>(2)</sup>	1 000	3	15

**Notes to Table 3.3.3.2.:**

- <sup>(1)</sup> See Sentence 3.3.1.1.(1).
- <sup>(2)</sup> See Subsection 3.3.6. for Outdoor Storage of Used Tires.

- 3)** It is permitted to waive the clearance required in Sentence (2) if
  - a) the stored products do not consist of wood chips, hogged material, rubber tires or combustible pallets,
  - b) the exposed wall of the *building* has a *fire-resistance rating* of not less than 2 h, and
  - c) the stored products are separated from any unprotected wall opening by a horizontal distance of not less than
    - i) 3 m on either side of the opening, and
    - ii) 6 m perpendicularly in front of the opening.

**4)** It is permitted to waive the clearance required in Sentence (2) if an *individual storage area* has a base area not greater than 5 m<sup>2</sup>.

**3.3.3.3. Rubber Tires**

**1)** Any access route required in Article 3.3.2.5. shall be located so that a clear space of not less than 6 m is provided between stored rubber tires and the nearest side of the access route.

**3.3.4. Outdoor Storage of Dangerous Goods**

**3.3.4.1. Application**

- 1)** Except as provided in Part 4 or otherwise specified in this Code, this Subsection applies to the outdoor storage of *dangerous goods* in packages or containers.
- 2)** The storage of *dangerous goods* in quantities greater than those shown in Table 3.2.7.1., in a single *individual storage area*, shall conform to this Subsection.
- 3)** When a product has a primary and a subsidiary class, the quantities referred to in Sentence (2) shall be determined by
  - a) using the class having precedence, as established in Section 2.8 of the “Transportation of Dangerous Goods Regulations,” or
  - b) using the lesser of the two small quantity exemptions in Table 3.2.7.1. when the precedence referred to in Clause (a) is not established.

**3.3.4.2.****3.3.4.2. Individual Storage Areas and Clearances**

1) Except as provided in Sentences (2) and (3), the size of an *individual storage area* for *dangerous goods* shall be not greater than 1000 m<sup>2</sup>.

2) Except for the distance between cylinders of Class 2 gases and a *building*, a clear space of not less than 6 m shall be provided around each *individual storage area* for *dangerous goods*. (See A-3.3.3.2.(1) in Appendix A.)

3) *Dangerous goods* shall not be stored to a height greater than 6 m.

**3.3.4.3. Separation from Other Dangerous Goods**

1) Except as provided in Sentences (2) and 3.3.4.8.(1), *dangerous goods* shall be separated from other *dangerous goods* in conformance with Article 3.2.7.6.

2) Incompatible *dangerous goods* that are not allowed in Table 3.2.7.6. to be stored in the same *fire compartment* are permitted to be separated by a minimum horizontal distance of 3 m in lieu of a *fire separation* when in an outdoor storage area.

**3.3.4.4. Separation from Combustible Products**

1) *Dangerous goods* and other products described in Sentence 3.3.1.1.(1) shall not be stored in the same *individual storage area*.

**3.3.4.5. Identification**

1) The outdoor storage of *dangerous goods* shall conform to Articles 3.2.7.13. and 3.2.7.14.

**3.3.4.6. Training**

1) The training of personnel involved in the outdoor storage of *dangerous goods* shall conform to Article 3.2.7.15.

**3.3.4.7. Safety Precautions**

1) When *dangerous goods* are stored outside of a *building*, safety precautions shall be taken to prevent undesirable reactions from the effects of atmospheric conditions.

2) Damaged or leaking packages or containers of *dangerous goods* shall be moved to a safe location and the product repackaged and labelled as soon as possible.

**3.3.4.8. Intermodal Shipping Containers**

1) Intermodal shipping containers used for the transportation of *dangerous goods*, as well as their contents, shall be stored in conformance with the segregation requirements stated in Section 15 of the "International Maritime Dangerous Goods Code" of the International Maritime Organization. (See A-3.3.1.1.(2)(c) in Appendix A.)

**3.3.5. Outdoor Storage of Compressed Gases****3.3.5.1. Application**

1) Except as provided in Subsection 3.1.1., this Subsection shall apply to the storage of Class 2 gases outside *buildings*.

**3.3.5.2. Location**

- 1) Where cylinders of Class 2 gases are stored outdoors, they shall be
  - a) supported on raised concrete or other noncombustible platforms, and
  - b) located in an enclosure fenced in conformance with Article 3.3.2.6.

**3.3.5.3. Clearances**

1) Except as provided in Sentence (2), cylinders of Class 2.1 flammable gases or Class 2.3 toxic or corrosive gases stored outdoors shall be not less than

- a) 1.5 m from any *building* opening, if the aggregate capacity of expanded gas is not more than 170 m<sup>3</sup>,
- b) 7.5 m from any *building* opening, if the aggregate capacity of expanded gas is more than 170 m<sup>3</sup> but less than 500 m<sup>3</sup>, and
- c) 15 m from any *building* opening, if the aggregate capacity of expanded gas is 500 m<sup>3</sup> or more.

(See A-3.2.8.2.(2) in Appendix A.)

2) The distances required in Sentence (1) need not apply when the opening referred to is into a room conforming to Subsection 3.2.8. that is used for storing Class 2 gases.

**3.3.6. Outdoor Storage of Used Tires****3.3.6.1. Application**

1) This Subsection shall apply to the outdoor storage of tires or shredded tires where the bulk volume of stored product exceeds 300 m<sup>3</sup>. (See Appendix A.)

**3.3.6.2. Covered Storage**

- 1) This Subsection shall not apply to the storage of tires or shredded tires that are
- a) covered by a minimum depth of 150 mm of noncombustible material, or
  - b) buried in a lined and covered trench system for recovery and reuse.

(See Appendix A.)

**3.3.6.3. Pile Size and Location**

1) No person shall store, or permit to be stored, tires or shredded tires in outdoor storage piles that exceed

- a) an individual pile volume of 300 m<sup>3</sup>,
- b) an *individual storage area* of 100 m<sup>2</sup>, or
- c) a storage pile height of 3 m.

2) No person shall store tires or shredded tires unless clearances from other stored product or salvage, including but not limited to tires, is maintained

- a) with a clear space of not less than 6 m,
- b) with at least 15 m from surrounding property lines, and
- c) with at least 15 m from *buildings* or as indicated in NFPA 80A, "Protection of Buildings from Exterior Fire Exposures," whichever is the greatest distance.

3) Storage piles shall not be located beneath electrical power lines.

**3.3.6.4. Fire Break**

1) A 22 m fire break shall be provided around the perimeter of individual storage piles where the total bulk volume of stored tires or shredded tires is greater than 4 800 m<sup>3</sup>.

**3.3.6.5. Fuel-fired Vehicles**

1) Fuel-fired vehicles operating in a storage area shall be maintained regularly so as not to be a fire hazard.

**3.3.6.6. Open Flame**

1) No person shall smoke or use an open-flame *appliance* or device, including welding or cutting equipment, in a storage area.

**3.3.6.7. Fire Safety Plan**

1) Emergency planning measures conforming to Section 2.8. shall be provided for storage areas described in Article 3.3.6.1.

2) The fire safety plan required as part of the emergency planning measures described in Sentence (1) shall be retained on site for reference by the *authority having jurisdiction* and the fire department.

3) Access to heavy-duty equipment such as bulldozers, front-end loaders and similar equipment shall be included in the fire safety plan.

### 3.3.6.8. Fire Department Access Routes

1) A minimum of two fire department access routes conforming to Article 3.2.5.6. of Division B of the Alberta Building Code 2006, located as remotely as possible from each other, shall be provided for each tire storage area.

2) A fire department access route shall be provided within 50 m of any point in the storage yard where storage piles are located, and not closer than 6 m to any individual storage pile.

### 3.3.6.9. Fencing

1) If the total volume of stored tires or shredded tires is more than 600 m<sup>3</sup>, the area occupied by the tires shall be fenced in conformance with Article 3.3.2.6.

### 3.3.6.10. Maintenance

1) Storage areas shall be maintained free of combustible vegetation for at least 4.5 m from the stored material and shall be not less than 30 m from brush and forested areas.

## Section 3.4. Objectives and Functional Statements

### 3.4.1. Objectives and Functional Statements

#### 3.4.1.1. Attribution to Acceptable Solutions

1) For the purposes of compliance with this Code as required in Clause 1.2.1.1.(1)(b) of Division A, the objectives and functional statements attributed to the acceptable solutions in this Part shall be the objectives and functional statements listed in Table 3.4.1.1. (See A-1.1.2.1.(1) in Appendix A.)

**Table 3.4.1.1.**  
**Objectives and Functional Statements Attributed to the Acceptable Solutions in Part 3**  
Forming Part of Sentence 3.4.1.1.(1)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.1.1.2. Radioactive Materials</b>	
(1)	[F01,F02,F03,F81-OS1.1,OS1.2]
<b>3.1.1.3. Explosives</b>	
(1)	[F01,F02,F03,F81-OS1.1,OS1.2]
<b>3.1.1.4. Compressed Gases</b>	
(2)	[F01,F02,F03,F81-OS1.1,OS1.2]
(3)	[F01,F02,F03,F81-OS1.1,OS1.2]
<b>3.1.2.2. Ambient Temperature</b>	
(1)	[F51-OS1.1]
(2)	[F51-OS1.1]
(3)	[F51-OS1.1]

**Table 3.4.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.1.2.3. Packages and Containers</b>	
(1)	[F20,F43,F80,F81-OH5]
	[F20,F43,F80,F81-OS3.4]
	[F20,F43,F80,F81,F01-OS1.1]
(2)	[F20,F43,F80,F81-OH5]
	[F20,F43,F80,F81-OS3.4]
	[F20,F43,F80,F81,F01-OS1.1]
<b>3.1.2.4. Compressed Gases</b>	
(1)	[F81-OS1.1]
	[F81-OS3.4]
(2)	[F81-OS1.1]
	[F81-OS3.4]
(3)	[F22,F81-OS1.1]
	[F81,F22-OS3.4]
(4)	[F05-OS1.5]
<b>3.1.2.5. Reactive Substances</b>	
(2)	[F22,F51,F81-OS1.1]
(3)	[F01,F52-OS1.1]
(4)	[F01-OS1.1]
(5)	[F12-OS3.4]
<b>3.1.2.6. Fire Safety Plan</b>	
(1)	[F12-OS1.1]
(2)	[F12-OS1.1]
<b>3.1.3.1. Industrial Trucks</b>	
(1)	[F01,F81,F82-OS1.1]
(2)	[F01,F81-OS1.1]
(3)	[F01,F81-OS1.1]
<b>3.1.4.1. Hazardous Locations</b>	
(1)	[F01-OS1.1]
<b>3.1.5.1. Use</b>	
(1)	[F02-OS1.2]
	[F02-OP1.2]
<b>3.2.1.1. Application</b>	
(2)	[F02-OP1.2]
	[F02-OS1.2]

Table 3.4.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.2.2.2. Access Aisles</b>	
(1)	[F12-OP1.2]
	[F12-OS1.2]
(2)	[F12-OP1.2]
	[F12-OS1.2]
(3)	[F12-OP1.2]
	[F12-OS1.2]
(4)	[F12-OP1.2]
	[F12-OS1.2]
(5)	[F12-OP1.2]
	[F12-OS1.2] [F06-OS1.5]
(6)	[F06-OS1.5] [F02-OS1.2]
	[F06,F02-OP1.2]
(7)	[F12-OP1.2]
	[F12-OS1.2]
(8)	[F12-OP1.2]
	[F12-OS1.2]
<b>3.2.2.3. Clearances</b>	
(1)	[F21-OP1.3,OP1.2]
	[F21-OS1.3,OS1.2]
(2)	[F12-OP1.2]
	[F12-OS1.2]
(3)	[F04-OP1.3,OP1.2]
	[F04-OS1.3,OS1.2]
(4)	[F02-OP1.2]
	[F02-OS1.2]
(5)	[F01-OS1.1]
<b>3.2.2.4. Combustible Pallets</b>	
(2)	[F02-OP1.2]
	[F02-OS1.2]
(3)	[F02-OP1.2]
	[F02-OS1.2]
<b>3.2.2.5. Fire Safety Plan</b>	
(2)	[F81-OS1.1] [F81,F02,F12-OS1.2]
	[F81,F02,F12-OP1.2]

**Table 3.4.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F81-OS1.1] [F81,F02,F12-OS1.2]
	[F81,F02,F12-OP1.2]
(4)	[F81-OS1.1] [F81,F02,F12-OS1.2]
	[F81,F02,F12-OP1.2]
(5)	[F81-OS1.1] [F81,F02,F12-OS1.2]
	[F81,F02,F12-OP1.2]
<b>3.2.2.6. Smoking</b>	
(1)	[F01-OS1.1]
<b>3.2.2.7. Storage Arrangements</b>	
(1)	[F20-OS1.1,OS1.2] [F04-OS1.2,OS1.5]
<b>3.2.3.2. Individual Storage Areas</b>	
(1)	[F02-OP1.2]
	[F02-OS1.2]
	[F04-OP1.2]
	[F20-OS1.1] [F04-OS1.2,OS1.5]
(2)	[F04,F02-OP1.2]
	[F20-OS1.1] [F04,F02-OS1.2]
<b>3.2.3.3. Sprinkler Systems</b>	
(1)	[F02,F81-OP1.2]
	[F02,F81-OS1.2]
(2)	[F02,F81-OP1.2]
	[F02,F81-OS1.2]
<b>3.2.4.2. Fire Separations</b>	
(1)	[F03-OP1.2]
	[F03-OS1.2]
<b>3.2.4.3. Sprinkler Protection</b>	
(1)	[F02,F81-OP1.2]
	[F02,F81-OS1.2]
<b>3.2.4.4. Portable Extinguishers</b>	
(1)	[F02,F12,F81-OP1.2]
	[F02,F12,F81-OS1.2]
<b>3.2.5.4. Level 2 and 3 Aerosols</b>	
(1)	[F02,F03-OP1.2] Applies to conformance to Table 3.2.5.4.
	[F02,F03-OS1.2] Applies to conformance to Table 3.2.5.4.
(2)	[F02,F03-OP1.2]
	[F02,F03-OS1.2]

Table 3.4.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.2.5.5. Sprinkler Systems</b>	
(1)	[F02,F81-OP1.2]
	[F02,F81-OS1.2]
(2)	[F02,F03-OP1.2]
	[F02,F03-OS1.2]
<b>3.2.5.6. Type A Dedicated Areas</b>	
(1)	[F20-OP1.2]
	[F20-OS1.2]
(2)	[F20-OS1.2]
<b>3.2.5.7. Type B Dedicated Areas</b>	
(1)	[F03,F20-OP1.2]
	[F03,F20-OS1.2]
<b>3.2.5.8. Storage Height</b>	
(1)	[F04-OP1.2]
	[F20,F81-OS1.1] [F04-OS1.2,OS1.5]
(2)	(a) [F02,F03,F20-OP1.2]
	(a) [F02,F03,F20-OS1.2]
	(b) [F02,F03,F04,F20-OP1.2]
	(b) [F02,F03,F20,F04-OS1.2] [F20-OS1.1]
<b>3.2.5.9. Aisles</b>	
(1)	[F03-OP1.2]
	[F03-OS1.2] [F06-OS1.5]
<b>3.2.6.3. Loose Combustible Fibres</b>	
(1)	[F03,F02-OP1.2]
	[F03,F02-OS1.2]
(2)	[F03,F02-OP1.2]
	[F03,F02-OS1.2]
(3)	[F03,F02-OP1.2]
	[F03,F02-OS1.2]
(4)	[F03,F02-OP1.2]
	[F03,F02-OS1.2]
(5)	[F03,F02-OP1.2]
	[F03,F02-OS1.2]

**Table 3.4.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.2.6.4. Baled Combustible Fibres</b>	
(1)	(a) [F02–OP1.2]
	(a) [F02–OS1.2]
	(b) [F04–OP1.2]
	(b) [F04–OS1.2,OS1.5]
	(c) [F21–OS1.5]
	(d) [F21–OP1.3,OP1.2]
	(d) [F21–OS1.3,OS1.2]
(2)	[F02–OP1.2]
	[F02–OS1.2]
(3)	(a) [F02–OP1.2]
	(a) [F02–OS1.2]
	(b) [F04–OP1.2]
	(b) [F04–OS1.5,OS1.2]
(4)	(a) [F02–OP1.2]
	(a) [F02–OS1.2]
	(b) [F04–OP1.2]
	(b) [F04–OS1.5,OS1.2]
(5)	[F04–OP1.2]
	[F04–OS1.5,OS1.2]
<b>3.2.6.5. Heating Equipment</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
<b>3.2.7.2. Ignition Sources</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1] Applies to portion of Code text: “Smoking shall not be permitted within a <i>fire compartment</i> used for the storage of <i>dangerous goods</i> ...”
(3)	[F01–OS1.1]
<b>3.2.7.3. Ambient Conditions</b>	
(1)	(a) [F51,F52–OS1.1]
	(a) [F51,F52–OS3.4]
	(b) [F01–OS1.1]
	(b) [F40–OS3.4]
<b>3.2.7.4. Housekeeping</b>	
(1)	[F81,F01–OS1.1]

Table 3.4.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(2)	[F43–OH5]
	[F43,F81–OS1.1]
	[F43,F81–OS3.4]
<b>3.2.7.5. Storage Arrangements</b>	
(1)	(c) [F02–OP1.2]
	(c) [F02–OS1.1]
	(a) [F20–OS3.4]
	(a) [F20–OS1.1,OS1.2] [F04–OS1.2,OS1.5]
	(b) [F20–OS3.4]
	(b) [F20–OS1.1,OS1.2] [F04–OS1.2,OS1.5]
(2)	[F20–OS1.1,OS1.2] [F04–OS1.2,OS1.5] [F02–OS1.2]
(3)	[F02–OP1.2]
	[F02–OS1.2]
(4)	[F81,F01,F12–OS1.1]
	[F81,F12–OH5]
	[F81,F43,F12–OS3.4]
(6)	[F03–OP1.2]
	[F03–OS1.2]
(7)	[F03–OP1.2]
	[F03–OS1.2]
(8)	[F01–OP1.2]
	[F01–OS1.2]
(9)	[F81,F82–OS3.4]
	[F81,F82–OS1.1] [F10–OS1.5]
<b>3.2.7.6. Separation from Other Dangerous Goods</b>	
(1)	[F01–OS1.1]
	[F43–OS3.4]
(2)	[F01–OS1.1]
	[F43–OS3.4]
(3)	[F02–OS1.1,OS3.4]
<b>3.2.7.7. Corrosion Protection</b>	
(1)	[F80–OH5]
	[F80–OS1.1]
	[F80–OS3.4]

**Table 3.4.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.2.7.8. Flooring Materials</b>	
(1)	[F01–OS1.1]
	[F43–OS3.4]
	[F44–OH5]
(2)	[F01–OS1.1]
<b>3.2.7.9. Fire Suppression Systems</b>	
(1)	[F02–OP1.2]
	[F02–OS1.2]
(2)	[F02,F03–OP1.2] [F01–OP1.1]
	[F02,F03–OS1.2] [F01–OS1.1]
<b>3.2.7.10. Smoke Venting</b>	
(1)	[F12,F02–OP1.2]
	[F12,F02–OS1.2,OS1.5]
<b>3.2.7.11. Spill Control</b>	
(2)	(a) [F01–OS1.1]
	(a) [F43–OS3.4]
<b>3.2.7.12. Fire Department Access</b>	
(2)	[F12–OP1.2]
	[F12–OS1.2]
(3)	[F12–OP1.2]
	[F12–OS1.2]
<b>3.2.7.13. Labels</b>	
(1)	[F12–OS1.1,OS1.2] [F81–OS1.1]
	[F12,F81–OS3.4]
<b>3.2.7.14. Placards</b>	
(1)	[F12–OS1.1,OS1.2] [F81–OS1.1]
	[F12,F81–OS3.4]
(2)	[F12–OS1.2]
	[F12–OS3.4]
(3)	[F12–OS1.2]
	[F12–OS3.4]
(4)	[F12–OS1.2]
	[F12–OS3.4]

Table 3.4.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.2.7.15. Training</b>	
(1)	(b) [F12–OS1.1,OS1.2] [F81–OS1.1]
	(b) [F12,F81–OS3.4]
	(c) [F12–OS3.4]
	(c) [F12–OS1.1,OS1.2] [F81–OS1.1]
(2)	[F81–OS1.1]
	[F81–OS3.4]
(3)	[F81,F12–OS1.1]
	[F81,F12–OS3.4]
<b>3.2.7.16. Unauthorized Access</b>	
(1)	[F34–OH5]
	[F34–OS1.1]
	[F34–OS3.4]
<b>3.2.7.17. Separation from Combustible Products</b>	
(1)	[F03–OS1.2] [F01–OS1.1]
<b>3.2.7.18. Storage of Oxidizers in Mercantile Occupancies</b>	
(2)	[F03–OS1.2] [F01–OS1.1]
(3)	[F03–OS1.2] [F01–OS1.1]
<b>3.2.8.2. Flammable Gases</b>	
(1)	(a) [F03–OS1.2] [F44–OS1.1]
	(b) [F02–OP1.3]
	(b) [F12–OS1.2] [F01–OS1.1] [F02–OS1.3]
	(c) [F12–OS1.1] Applies to portion of Code text: "... can be entered from the exterior ..." (c) [F44–OS1.1] Applies to the requirement for <i>closures</i> leading to the interior of the <i>building</i> .
	(d) [F02–OS1.3]
	(f) [F01–OS1.1]
	(g) [F01,F02–OS1.1]
(2)	(a) [F01–OS1.1]
	(b) [F01–OS1.1] [F02–OS1.2]
(3)	[F01,F02,F03,F81–OS1.1,OS1.2]

**Table 3.4.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.2.8.3. Indoor Storage of Poisonous, Corrosive or Oxidizing Gases</b>	
(1)	(a) [F03–OP1.2] Applies to the <i>fire separations</i> having a <i>fire-resistance rating</i> of 1 h.
	(a) [F03–OS1.2,OS1.5] Applies to the <i>fire separations</i> having a <i>fire-resistance rating</i> of 1 h.
	(a) [F44–OS1.2,OS1.5,OS1.1] Applies to gas-tight <i>fire separations</i> .
	(c) [F12–OS1.1] Applies to portion of Code text: “... can be entered from the exterior ...” (c) [F44–OS1.1] Applies to the requirement for <i>closures</i> leading to the interior of the <i>building</i> .
	(b) [F12–OS1.2] [F01–OS1.1]
	(d) [F44–OS1.2,OS1.5,OS1.1]
(2)	[F01,F02–OS1.1,OS1.2,OS1.5]
<b>3.2.9.2. Storage Buildings</b>	
(2)	[F01–OP1.1] [F02,F12–OP1.2]
	[F01–OS1.1] [F02,F12–OS1.2]
(3)	[F03–OP1.2] [F01–OP1.1]
	[F03–OS1.2] [F01–OS1.1]
(4)	[F12,F02–OP1.2]
	[F12,F02–OS1.1]
(5)	[F01–OS1.1] [F02–OS1.2]
	[F43–OS3.4]
	[F44–OH5]
(6)	[F01,F81–OS1.1]
<b>3.2.9.3. Industrial Trucks</b>	
(1)	[F01,F81–OS1.1]
(2)	[F01,F81–OS1.1]
(3)	[F03–OP1.2] [F01–OP1.1]
	[F03–OS1.2] [F01–OS1.1]
(4)	[F01–OS1.1]
<b>3.2.9.4. Portable Extinguishers</b>	
(1)	[F02–OS1.2]
<b>3.2.10.2. Dwelling Units</b>	
(1)	[F02–OS1.2]
	[F02–OP1.2]
(2)	[F02–OS1.2]
	[F02–OP1.2]
(3)	[F01,F02,F03–OS1.1,OS1.2]
	[F01,F02,F03–OP1.1,OP1.2]

Table 3.4.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.2.10.3. Ignition Sources</b>	
(1)	[F01–OS1.1]
	[F01–OP1.1]
(2)	[F01–OS1.1]
	[F01–OP1.1]
<b>3.2.10.4. Storage</b>	
(1)	[F02–OS1.2]
	[F02–OP1.2]
(2)	[F02–OS1.2]
	[F02–OP1.2]
<b>3.2.10.5. Low-Hazard Storage</b>	
(1)	[F01,F02–OS1.1,OS1.2]
	[F01,F02–OP1.1,OP1.2]
(2)	[F02–OS1.2]
	[F02–OP1.2]
(3)	[F02–OS1.2]
	[F02–OP1.2]
<b>3.2.10.6. High-Hazard Storage</b>	
(1)	[F02–OS1.2]
	[F02–OP1.2]
(2)	[F02–OS1.2]
	[F02–OP1.2]
(3)	[F01,F02–OS1.2]
	[F01,F02–OP1.2]
<b>3.2.10.7. Portable Extinguishers</b>	
(1)	[F02–OS1.2]
	[F02–OP1.2]
<b>3.3.2.2. Height</b>	
(1)	[F04–OP3.1]
	[F04–OS1.5]
<b>3.3.2.3. Individual Storage Areas and Clearances</b>	
(2)	[F03–OP3.1]
<b>3.3.2.4. Storage beneath Power Lines</b>	
(1)	[F01,F06–OP3.1]
	[F06–OS1.1]

**Table 3.4.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.3.2.5. Fire Department Access</b>	
(1)	[F12–OP3.1]
(2)	[F12–OP3.1]
<b>3.3.2.6. Fencing</b>	
(1)	[F34–OH5]
	[F34–OP3.1]
	[F34–OS3.4]
(2)	[F12–OP3.1]
<b>3.3.2.7. Maintenance</b>	
(1)	(b) [F12–OP3.1]
(2)	(b) [F12–OP3.1]
<b>3.3.2.8. Ignition Sources</b>	
(1)	[F01–OP3.1]
(2)	[F01–OP3.1]
(3)	[F01,F03–OP3.1]
	(b) [F03–OS1.2] Applies to portion of Code text: “... located not less than 15 m from a <i>building</i> ...”
<b>3.3.2.9. Fire Safety Plan</b>	
(2)	[F01,F81,F12,F02,F13–OP3.1]
	[F81,F12,F13–OH5]
(3)	[F81,F12–OH5]
	[F81,F12–OP3.1]
<b>3.3.2.10. Portable Extinguishers</b>	
(2)	[F02–OP3.1]
(3)	[F02–OS1.2]
	[F02–OP1.2]
<b>3.3.2.11. Site Preparation</b>	
(1)	[F04–OS1.2]
	[F04,F12–OP3.1]
	[F20–OS3.4]
<b>3.3.2.12. Fuel Dispensing</b>	
(2)	[F03–OP3.1]
<b>3.3.2.14. Fire Separation</b>	
(1)	[F03–OP3.1]
<b>3.3.2.15. Fire Protection</b>	
(1)	[F02–OP3.1]

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays

Table 3.4.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.3.2.16. Water Supply</b>	
(1)	[F03,F12-OP1.2]
	[F03,F12-OP3.1]
	[F03,F12-OS1.2]
(4)	[F03,F12-OP1.2]
	[F03,F12-OP3.1]
	[F03,F12-OS1.2]
(5)	[F03,F12-OP1.2]
	[F03,F12-OP3.1]
	[F03,F12-OS1.2]
<b>3.3.2.17. Hydrant Systems</b>	
(1)	[F03,F12-OP1.2]
	[F03,F12-OP3.1]
	[F03,F12-OS1.2]
<b>3.3.3.2. Individual Storage Areas and Clearance</b>	
(1)	[F04-OS1.5]
	[F02,F03-OP3.1] Applies to the maximum size (base area) and minimum clearances. [F04-OP3.1] Applies to the maximum height.
(2)	[F03-OP3.1]
	[F03-OS1.2]
(3)	[F02,F03-OP3.1]
	[F02,F03-OS1.2]
(4)	[F02-OP3.1]
	[F02-OS1.2]
<b>3.3.3.3. Rubber Tires</b>	
(1)	[F06-OP3.1]
<b>3.3.4.2. Individual Storage Areas and Clearances</b>	
(1)	[F02-OP3.1]
	[F02-OS1.2]
(2)	[F03-OP3.1]
	[F03-OS1.2]
(3)	[F20-OS3.4]
	[F20-OS1.1] [F04-OS1.2,OS1.5]
<b>3.3.4.3. Separation from Other Dangerous Goods</b>	
(2)	[F01-OS1.1]
	[F43-OS3.4]

**Table 3.4.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.3.4.4. Separation from Combustible Products</b>	
(1)	[F03,F01-OS1.1]
<b>3.3.4.7. Safety Precautions</b>	
(1)	[F43-OS1.1]
(2)	[F43-OH5]
	[F43,F81-OS1.1]
	[F43,F81-OS3.4]
<b>3.3.4.8. Intermodal Shipping Containers</b>	
(1)	[F01-OS1.1]
	[F43-OS3.4]
<b>3.3.5.2. Location</b>	
(1)	(a) [F80,F81,F02-OS1.1]
<b>3.3.5.3. Clearances</b>	
(1)	[F44-OS1.1]
	[F44-OS3.4]
(2)	[F01,F44-OS1.1] [F03-OS1.2]
	[F44-OS3.4]
<b>3.3.6.3. Pile Size and Location</b>	
(1)	[F02-OP1.2]
(2)	[F03,F12-OP1.2]
	[F03,F12-OP3.1]
(3)	[F06-OS1.1]
	[F01,F06-OP3.1]
<b>3.3.6.4. Fire Break</b>	
(1)	[F03-OP3.1]
<b>3.3.6.5. Fuel-fired Vehicles</b>	
(1)	[F82-OP1.4]
<b>3.3.6.6. Open Flame</b>	
(1)	[F01-OP1.1]
<b>3.3.6.8. Fire Department Access Route</b>	
(1)	[F12-OP1.2]
	[F12-OP3.1]
(2)	[F12-OP1.2]
	[F12-OP3.1]

**Table 3.4.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>3.3.6.10. Maintenance</b>	
(1)	[F03,F82-OP1.2]
	[F03,F82-OP3.1]

**Notes to Table 3.4.1.1.:**

(1) See Parts 2 and 3 of Division A.

# **Part 4**

## **Flammable and Combustible Liquids**

<b>4.1.</b>	<b>General</b>	
4.1.1.	Scope .....	4- 1
4.1.2.	Classification .....	4- 1
4.1.3.	Flash Point .....	4- 2
4.1.4.	Electrical Installations .....	4- 2
4.1.5.	Fire Prevention and Protection .....	4- 3
4.1.6.	Spill Control and Drainage Systems .....	4- 4
4.1.7.	Ventilation .....	4- 5
4.1.8.	Handling of Flammable and Combustible Liquids .....	4- 7
<b>4.2.</b>	<b>Container Storage and Handling</b>	
4.2.1.	Scope .....	4- 8
4.2.2.	General .....	4- 9
4.2.3.	Containers and Portable Tanks .....	4- 9
4.2.4.	Assembly and Residential Occupancies .....	4-10
4.2.5.	Mercantile Occupancies .....	4-11
4.2.6.	Business and Personal Services, Educational and Care or Detention Occupancies .....	4-11
4.2.7.	Industrial Occupancies .....	4-12
4.2.8.	Incidental Use .....	4-16
4.2.9.	Rooms for Container Storage and Dispensing .....	4-17
4.2.10.	Cabinets for Container Storage .....	4-18
4.2.11.	Outdoor Container Storage .....	4-18
<b>4.3.</b>	<b>Tank Storage</b>	
4.3.1.	Design, Construction and Use of Storage Tanks .....	4-19
4.3.2.	Installation of Outside Aboveground Storage Tanks .....	4-22
4.3.3.	Supports, Foundations and Anchorage for Aboveground Storage Tanks .....	4-24
4.3.4.	Normal and Emergency Venting for Aboveground Storage Tanks ...	4-25
4.3.5.	Vent Piping for Aboveground Storage Tanks .....	4-25
4.3.6.	Openings Other than Vents in Aboveground Storage Tanks .....	4-25
4.3.7.	Secondary Containment for Aboveground Storage Tanks .....	4-26
4.3.8.	Installation of Underground Storage Tanks .....	4-28
4.3.9.	Corrosion Protection of Underground Steel Storage Tanks .....	4-31

4.3.10.	Vents for Underground Storage Tanks .....	4-31
4.3.11.	Openings Other than Vents in Underground Storage Tanks .....	4-32
4.3.12.	Installation of Storage Tanks inside Buildings .....	4-33
4.3.13.	Rooms for Storage Tanks .....	4-35
4.3.14.	Openings Other than Vents in Storage Tanks in Buildings .....	4-36
4.3.15.	Out of Service .....	4-36
4.3.16.	Removal and Abandonment in Place of Underground Storage Tanks .....	4-37
<b>4.4.</b>	<b>Leak Detection of Storage Tanks and Piping Systems</b>	
4.4.1.	General .....	4-39
4.4.2.	Leak Detection Testing and Monitoring Methods .....	4-42
4.4.3.	Leak Detection Testing of Storage Tanks, Piping Systems and Sumps .....	4-43
4.4.4.	Leak Detection Monitoring of Storage Tanks and Piping Systems .....	4-46
<b>4.5.</b>	<b>Piping and Transfer Systems</b>	
4.5.1.	Scope .....	4-46
4.5.2.	Materials for Piping, Valves and Fittings .....	4-46
4.5.3.	Corrosion Protection of Piping Systems .....	4-47
4.5.4.	Identification of Piping Systems ...	4-47
4.5.5.	Joints in Piping Systems .....	4-48
4.5.6.	Location and Arrangement of Piping .....	4-48
4.5.7.	Valves in Piping Systems .....	4-51
4.5.8.	Heating of Piping Systems .....	4-52
4.5.9.	Methods of Transfer in Piping Systems .....	4-53
4.5.10.	Operating Procedures for Piping Systems .....	4-54
<b>4.6.</b>	<b>Fuel-Dispensing Stations</b>	
4.6.1.	Scope .....	4-55
4.6.2.	Storage and Handling .....	4-55
4.6.3.	Dispensing Systems .....	4-56
4.6.4.	Shut-off Devices .....	4-57
4.6.5.	Delivery Hose and Nozzles .....	4-57
4.6.6.	Remote Pumping Systems .....	4-58
4.6.7.	Spill Control .....	4-59
4.6.8.	Supervision and Dispensing Procedures .....	4-59
4.6.9.	Fire Prevention and Protection .....	4-63
4.6.10.	Inspection and Maintenance .....	4-63
<b>4.7.</b>	<b>Bulk Plants</b>	
4.7.1.	Scope .....	4-64
4.7.2.	Storage .....	4-64
4.7.3.	Dispensing .....	4-64

---

## Division B

4.7.4.	Loading and Unloading Facilities .....	4-65
4.7.5.	Fire Protection .....	4-66
4.7.6.	Spill Control .....	4-66
<b>4.8.</b>	<b>Piers and Wharves</b>	
4.8.1.	Scope .....	4-66
4.8.2.	General .....	4-67
4.8.3.	Storage Tanks .....	4-67
4.8.4.	Piping, Valves and Fittings .....	4-67
4.8.5.	Bonding and Grounding .....	4-68
4.8.6.	Fire Protection .....	4-68
4.8.7.	Bulk Transfer Stations .....	4-69
4.8.8.	Cargo Hose .....	4-69
4.8.9.	Cargo Pumps .....	4-69
4.8.10.	Pump Houses .....	4-70
4.8.11.	Transfer Operations .....	4-70
<b>4.9.</b>	<b>Process Plants</b>	
4.9.1.	Scope .....	4-71
4.9.2.	Outdoor Processing Equipment ...	4-71
4.9.3.	Processing Buildings .....	4-71
4.9.4.	Fire Prevention and Protection ....	4-72
<b>4.10.</b>	<b>Distilleries</b>	
4.10.1.	Scope .....	4-72
4.10.2.	General .....	4-73
4.10.3.	Storage Tanks and Containers ....	4-73
4.10.4.	Storage .....	4-73
4.10.5.	Piping and Pumping Systems .....	4-73
4.10.6.	Ventilation .....	4-74
4.10.7.	Spill Control .....	4-74
4.10.8.	Fire Protection .....	4-74
<b>4.11.</b>	<b>Tank Vehicles</b>	
4.11.1.	Scope .....	4-74
4.11.2.	General .....	4-74
4.11.3.	Loading, Unloading and Dispensing from Tank Vehicles ....	4-75
<b>4.12.</b>	<b>Objectives and Functional Statements</b>	
4.12.1.	Objectives and Functional Statements .....	4-76



# Part 4

## Flammable and Combustible Liquids

### Section 4.1. General

#### 4.1.1. Scope

##### 4.1.1.1. Application

**1)** Except as provided in Sentences (2) and (3), this Part provides for the storage, handling, use and processing of *flammable liquids* and *combustible liquids* in *buildings*, structures and open areas. (See Appendix A.)

**2)** Areas in *process plants*, where conditions must be addressed by design and operational details specific to the hazard, need not conform to this Part, where alternative protection is provided in conformance with Article 1.2.1.1. of Division A. (See Appendix A.)

- 3)** This Part shall not apply to
- a) the transportation of *flammable liquids* or *combustible liquids* under the “Transportation of Dangerous Goods Regulations,”
  - b) *appliances* and their ancillary equipment within the scope of CAN/CSA-B139, “Installation Code for Oil-Burning Equipment” (see Appendix A),
  - c) the storage of *flammable liquids* or *combustible liquids* on farms for individual farm use and on isolated construction projects (see Appendix A),
  - d) the storage of aerosol products covered under Subsection 3.2.5.,
  - e) liquefied petroleum gas-burning *appliances* and equipment within the scope of the gas regulations made pursuant to the Safety Codes Act,
  - f) the production, storage or handling of liquefied natural gas within the scope of the gas regulations made pursuant to the Safety Codes Act,
  - g) liquids such as certain halogenated hydrocarbons and mixtures containing hydrocarbons that do not have *flash points* but that may be flammable under certain conditions, or
  - h) the storage and handling of raw production *flammable liquids* or *combustible liquids* and the incidental storage and handling of hydrocarbon-based chemicals resulting from or used during crude oil or natural gas exploration, production or transmission as mandated under the scope of EUB Guide 55, “Storage Requirements for the Upstream Petroleum Industry.”

**4)** In addition to the requirements in this Part, the storage, handling and use of *flammable liquids* and *combustible liquids* in laboratories shall be in conformance with Section 5.5.

**5)** Unless otherwise specified, this Section shall apply to all areas involved in the storage, handling or use of *flammable liquids* and *combustible liquids* covered in this Part.

#### 4.1.2. Classification

##### 4.1.2.1. Classification

(See Appendix A.)

**1)** For the purposes of this Part, *flammable liquids* and *combustible liquids* shall be classified in conformance with Sentences (2) and (3).

## 4.1.2.2.

- 2) *Flammable liquids* shall be Class I liquids, and shall be subdivided into:
  - a) Class IA liquids, which shall include those having a *flash point* below 22.8°C and a boiling point below 37.8°C,
  - b) Class IB liquids, which shall include those having a *flash point* below 22.8°C and a boiling point at or above 37.8°C, and
  - c) Class IC liquids, which shall include those having a *flash point* at or above 22.8°C and below 37.8°C.
- 3) *Combustible liquids* shall be Class II or Class IIIA liquids, and shall be subdivided into:
  - a) Class II liquids, which shall include those having a *flash point* at or above 37.8°C and below 60°C, and
  - b) Class IIIA liquids, which shall include those having a *flash point* at or above 60°C and below 93.3°C (see Appendix A).

## 4.1.2.2. Heated Liquids

1) When a liquid having a *flash point* at or above 37.8°C is being processed, stored, handled or used at a temperature at or above its *flash point*, it shall be treated as a Class I liquid.

## 4.1.2.3. Used Lubricating Oil

(See Appendix A.)

- 1) Except as provided in Sentence (2), used lubricating oil drained from motor vehicles shall be classified as a Class IIIA liquid.
- 2) When Class I or II liquids are added to the used oils described in Sentence (1), the resulting mixture shall be classified
  - a) through tests conforming to Subsection 4.1.3., or
  - b) in the absence of the tests referred to in Clause (a),
    - i) as a Class IC liquid if Class I liquids are added, or
    - ii) as a Class II liquid if only Class II liquids are added.

## 4.1.3. Flash Point

## 4.1.3.1. Determination of Flash Point

(See Appendix A.)

- 1) Except as provided in Sentences (3) and (4), the *flash point* of liquids having a viscosity less than 6 mm<sup>2</sup>/s at 37.8°C and a *flash point* below 93.3°C shall be determined in conformance with ASTM D 56, "Flash Point by Tag Closed Cup Tester."
- 2) Except as provided in Sentences (3) and (4), the *flash point* of liquids having a viscosity of 6 mm<sup>2</sup>/s or more at 37.8°C or a *flash point* of 93.3°C or higher shall be determined in conformance with ASTM D 93, "Flash Point by Pensky-Martens Closed Cup Tester."
- 3) ASTM D 3828, "Flash Point by Small Scale Closed Cup Tester," is permitted to be used for testing aviation turbine fuels within the scope of this procedure.
- 4) ASTM D 3278, "Flash Point of Liquids by Small Scale Closed-Cup Apparatus," is permitted to be used for paints, enamels, lacquers, varnishes and related products and their components having *flash points* between 0°C and 110°C, and having a viscosity less than 15000 mm<sup>2</sup>/s (150 stokes) at 25°C.

## 4.1.4. Electrical Installations

## 4.1.4.1. Hazardous Locations

1) Electrical equipment in a location where *flammable liquids* or *combustible liquids* are present shall conform to electrical regulations made pursuant to the Safety Codes Act. (See Appendix A.)

- 2) Where refrigerators are used to store Class I liquids, they shall be designed so that
- a) electrical equipment located within the storage compartment, within the outer shell, on the door and on the door frame of the refrigerator conforms to electrical regulations made pursuant to the Safety Codes Act for Class I, Zone 0 or 1 hazardous locations based on the frequency of occurrence and duration of an explosive gaseous atmosphere, and
  - b) electrical equipment mounted on the outside surface of the refrigerator
    - i) conforms to electrical regulations made pursuant to the Safety Codes Act for Class I, Zone 2 hazardous locations, or
    - ii) is located above the top of the storage compartment.

#### 4.1.5. Fire Prevention and Protection

##### 4.1.5.1. Additional Fire Protection Equipment

- 1) Fire protection equipment shall be provided where there are special hazards of operation, dispensing or storage.

##### 4.1.5.2. Ignition Sources

- 1) Unless controlled in a manner that will not create a fire or explosion hazard, a device, operation or activity that produces open flames, sparks or heat shall not be permitted in an area described in Article 4.1.1.1. (See Appendix A.)

##### 4.1.5.3. Smoking

- 1) Except for designated safe smoking areas conforming to Subsection 2.4.2., smoking shall not be permitted in areas described in Article 4.1.1.1.
- 2) Signs conforming to Article 2.4.2.2. shall be prominently posted in areas where smoking is prohibited.

##### 4.1.5.4. Removal of Combustibles

- 1) Areas described in Article 4.1.1.1. shall be kept clean and free of ground vegetation and accumulations of combustible materials not essential to operations.
- 2) Used rags and similar materials contaminated with *flammable liquids* or *combustible liquids* shall be stored in receptacles conforming to Article 2.4.1.3.

##### 4.1.5.5. Emergency Planning

- 1) Except as provided in Sentence (2), emergency planning measures conforming to Section 2.8. shall be provided for all *buildings*, parts of *buildings* and open areas described in Article 4.1.1.1.
- 2) The fire safety plan required as part of the emergency planning measures in Sentence (1) shall be retained on site for reference by the *authority having jurisdiction* and personnel.

##### 4.1.5.6. Access for Firefighting

- 1) Required aisles and other access paths shall be maintained to permit the unobstructed movement of personnel and fire department apparatus so that firefighting operations can be carried out in any part of an area used for the storage, use or handling of *flammable liquids* or *combustible liquids*.

##### 4.1.5.7. Hot Works

- 1) Hot works shall be performed in conformance with Section 5.2.

## 4.1.5.8.

4.1.5.8. **Basement Storage**

(See Appendix A.)

**1)** Except as permitted in Sentence (2) and in *dwelling units* as described in Article 4.2.4.5., and in *mercantile occupancies* as described in Sentence 4.2.5.2.(3), Class I liquids shall not be stored, handled or used in *basements* or pits.

**2)** Not more than 5 L of Class I liquid is permitted to be stored in *basements*, provided it is stored in safety containers conforming to ULC/ORD-C30, "Safety Containers."

4.1.6. **Spill Control and Drainage Systems**4.1.6.1. **Spill Control**

**1)** Except as permitted in Sentence (3), a spill of *flammable liquids* or *combustible liquids* shall be prevented from flowing outside the spill area and from reaching waterways, sewer systems and potable water sources by

- a) constructing a noncombustible barrier capable of containing the spill, or
- b) grading the site or sloping the floor to divert the spill to a drainage system conforming to Article 4.1.6.2.

(See Appendix A.)

**2)** When barriers required in Sentence (1) are provided to contain accidental spillage from aboveground *storage tanks*, they shall conform to the requirements for *secondary containment* in Subsection 4.3.7.

**3)** Water-miscible effluent from spills and firefighting operations is permitted to be directed into a sewer system provided it does not create a fire hazard or any risk to public health or safety.

**4)** The fire safety plan required by Article 4.1.5.5. shall include measures to be taken to direct the overflow of spilled liquids and firefighting water away from

- a) *buildings*,
- b) adjoining properties,
- c) *means of egress*,
- d) air intakes or openings that could permit vapour entry into the *building*,
- e) fire alarm control panels,
- f) fire department access routes,
- g) valves controlling the water supply for firefighting, or fire protection systems,
- h) fire department pumper connections or wall hydrants,
- i) isolation valves controlling processes, and
- j) valves controlling the flow of *flammable liquids* or *combustible liquids*.

**5)** No person shall dump, dispense, discard, or otherwise dispose of *flammable liquids* or *combustible liquids* into a sewer.

4.1.6.2. **Drainage Systems**

**1)** A drainage system referred to in Clause 4.1.6.1.(1)(b) shall

- a) terminate at a location where such spill will not create a fire hazard or any risk to public health or safety, and
- b) direct the spill away from the areas identified in Sentence 4.1.6.1.(4).

**2)** Closed drainage systems shall be equipped with a trap. (See Appendix A.)

4.1.6.3. **Spills and Leaks**

(See Appendix A.)

**1)** Maintenance and operating procedures shall be established to prevent the escape of *flammable liquids* or *combustible liquids* to areas where they could create a fire or explosion hazard.

**2)** Except as provided in Sentence (3), all reasonable steps shall be taken to recover escaped liquid and to remove or treat contaminated soil.

- 3) Spilled or leaked *flammable liquids* or *combustible liquids* shall be
  - a) flushed to a location where they will not create a fire or explosion hazard, or any risk to public health or safety, or
  - b) neutralized or absorbed and cleaned up with the aid of a product that is compatible and non-reactive with the liquid being cleaned up (see Appendix A), and
    - i) deposited in a receptacle conforming to Article 2.4.1.3., or
    - ii) disposed of in a manner that does not create a fire or explosion hazard.

4) *Flammable liquids* and *combustible liquids* that are to be disposed of as waste shall be stored in a *storage tank* or *closed container* conforming to this Part until they are removed from the premises.

#### 4.1.6.4. Notification

(See Appendix A.)

- 1) When a loss of *flammable liquid* or *combustible liquid* occurs due to a spill or leak, or as indicated by any of the leak detection measures in Section 4.4., the *owner* shall ensure that
  - a) appropriate action is taken as required in Sentences 4.1.6.3.(2) and (3), and Sentence 4.4.1.3.(1), and
  - b) if the quantity of liquid spilled or leaked exceeds 50 L in aggregate or is sufficient to cause a sheen on nearby surface water
    - i) the fire department shall be notified immediately, and
    - ii) the *authority having jurisdiction* shall be notified in writing within 24 h.
- 2) A person shall notify the *authority having jurisdiction* and the fire department if they have knowledge about a leak of *flammable liquid* or *combustible liquid* that
  - a) is based on analysis or other evidence of *flammable liquid* or *combustible liquid* in a water well, or
  - b) indicates the presence of free or dissolved *flammable liquid* or *combustible liquid* in soil, groundwater, surface water, sewer lines, utility lines, water supply lines, *basements*, crawl space or on the ground surface.

### 4.1.7. Ventilation

#### 4.1.7.1. Rooms or Enclosed Spaces

1) Where *flammable liquids* and *combustible liquids* are processed, handled, stored, dispensed or used within rooms or enclosed spaces, ventilation shall conform to this Part and the Alberta Building Code 2006. (See Appendix A.)

#### 4.1.7.2. Ventilation Measures

- 1) Except as permitted in Sentence (2), a room or enclosed space referred to in Article 4.1.7.1. shall be provided with one of the following ventilation systems:
  - a) continuous mechanical ventilation where Class I liquids are processed, dispensed or used in a manner that releases flammable vapours into the room or enclosed space,
  - b) either natural or continuous mechanical ventilation where
    - i) Class I liquids are stored, processed, dispensed or used in a manner that does not release flammable vapours into the room or enclosed space, or
    - ii) Class II liquids are processed, dispensed or used.
- 2) Ventilation referred to in Clause (1)(b) need not be provided for the storage of Class I liquids if
  - a) storage consists of only *closed containers*, and
  - b) no dispensing operations are performed.

**3)** Ventilation required in Sentence (1) shall be sufficient to ensure that flammable vapour concentrations outside the zone identified as Class I, Zone 0 or 1 in conformance with Article 4.1.4.1., do not exceed 25% of the *lower explosive limit* of the flammable vapour. (See Appendix A.)

**4)** Where a mechanical ventilation system is installed to meet the conditions of Sentence (3), it shall be capable of exhausting at least 18 m<sup>3</sup>/h per square metre of room area, but not less than 250 m<sup>3</sup>/h.

**5)** Where continuous mechanical ventilation is installed in order to meet the conditions of Sentence (1), it shall

- a) be provided with automatic interlocks so that the activity generating flammable vapours cannot be performed when the ventilation system is not in operation,
- b) sound an audible alarm in an attended area upon shut-down of the ventilation system, and
- c) conform to NFPA 91, "Exhaust Systems for Air Conveying of Vapors, Gases, Mists, and Noncombustible Particulate Solids."

#### 4.1.7.3. Location of Air Inlets and Outlets

**1)** Ventilation air inlets and outlets within a room or enclosed space referred to in Article 4.1.7.1. shall be arranged in conformance with Sentences (2) and (3).

- 2)** Where the flammable vapour being removed is heavier than air,
- a) at least one air inlet shall be located at a point near a wall, and no higher than 300 mm from the floor, and
  - b) at least one air outlet shall be located near the opposite wall, no higher than 300 mm from the floor.

- 3)** Where the flammable vapour being removed is lighter than air,
- a) at least one air inlet shall be located at a point near a wall, and no lower than 300 mm from the ceiling, and
  - b) at least one air outlet shall be located near the opposite wall, no lower than 300 mm from the ceiling.

#### 4.1.7.4. Location of Mechanical Ventilation Exhaust Air Outlets

**1)** Except as provided in Article 4.1.7.6., the exhaust air outlet from a mechanical ventilation system required in Article 4.1.7.2. shall be

- a) located outdoors, not less than 3 m from any *building* opening, and
- b) arranged so that the exhaust air does not discharge toward any unprotected opening within 7.5 m of the discharge point.

#### 4.1.7.5. Make-up Air

**1)** Subject to the provisions in Clause 3.2.8.2.(1)(c), where make-up air for a mechanical ventilation system is taken from within the *building*, the opening into the room or enclosed space shall be provided with a *fire damper*.

**2)** Make-up air for a natural or mechanical ventilation system shall be taken from a point remote from any exhaust air discharge described in Article 4.1.7.4.

**3)** Make-up air for a natural ventilation system shall be taken from a point outside the *building*.

**4.1.7.6. Recirculating Ventilation Systems**

- 1) Where a mechanical ventilation system is installed in conformance with Article 4.1.7.2., and where exhaust air is recirculated, a fail-safe vapour detection and alarm system shall be provided
  - a) to continuously monitor the flammable vapour concentration in the exhaust air, and
  - b) if the vapour concentration in Clause (a) exceeds 25% of the *lower explosive limit* of the vapour, to
    - i) sound an alarm in an attended area,
    - ii) stop the recirculation of air, and
    - iii) redirect the exhaust air to an outdoor location.

**4.1.7.7. Exclusive Use of Ducts**

- 1) Ducts used in a ventilation system conforming to Article 4.1.7.2. shall not be used for any other ventilation or exhaust system.

**4.1.7.8. Maintenance**

- 1) All components of the ventilation system shall be kept free of obstructions that may interfere with its operation.

**4.1.8. Handling of Flammable and Combustible Liquids****4.1.8.1. Containers and Storage Tanks**

- 1) Except as provided in Sentence 4.1.8.4.(1), *flammable liquids* and *combustible liquids* shall be kept in containers conforming to Subsection 4.2.3. or in *storage tanks* conforming to Subsection 4.3.1.
- 2) Containers and *storage tanks* for *flammable liquids* or *combustible liquids* shall be kept closed when not in use.
- 3) Containers and *storage tanks* shall not be filled beyond their safe filling level.

**4.1.8.2. Control of Static Electric Charge**

- 1) When Class I liquids are dispensed from or into a container or a *storage tank*,
  - a) if made of metallic or electrically conducting material, such container or tank shall be electrically connected to the fill stem, or rest on a conductive floor that is electrically connected to the fill stem, or
  - b) if the container or tank is made of non-electrically conducting material, measures shall be taken to minimize the potential for static electric charge to develop (see Appendix A).
- 2) Except as provided in Sentence (3), when Class I liquids are transferred into a *storage tank* through the top of the tank, the fill pipe shall terminate within 150 mm of the bottom of the tank.
- 3) Sentence (2) shall not apply when
  - a) the *storage tank* vapour space cannot exceed 25% of the *lower explosive limit* or is filled with an inert gas that prevents the ignition of the vapour mixture, or
  - b) the liquid being transferred has a minimum conductivity that prevents the accumulation of static electricity (see Appendix A).
- 4) Fill pipes referred to in Sentence (2) shall be installed in such a way as to minimize vibration of the pipe.

**4.1.8.3. Transfer**

- 1) Class I liquids shall be drawn from or transferred into containers or *storage tanks* within a *building*
  - a) through a piping or transfer system conforming to Section 4.5.,

## 4.1.8.4.

- b) by means of a pump designed in conformance with good engineering practice on top of the container or *storage tank*, or
- c) by gravity through a self-closing valve designed in conformance with good engineering practice.

(See Appendix A.)

**2)** Except as provided in Subsection 4.5.9., the transfer of *flammable liquids* or *combustible liquids* by means of pressure applied to a container or *storage tank* shall not be permitted.

**3)** To facilitate non-spill transfer, used lubricating oil *storage tanks* shall be equipped with removable suction tubes with leak-tight couplings. (See Appendix A.)

## 4.1.8.4. Fuel Tanks of Vehicles

**1)** It is permitted to use movable tanks for dispensing *flammable liquids* or *combustible liquids* into the fuel tanks of vehicles or other motorized equipment provided such movable tanks are used in conformance with the requirements of this Part for *storage tanks*. (See Appendix A.)

**2)** Only enclosed pumping equipment designed in conformance with good engineering practice shall be used to transfer Class I liquids to or from the fuel tanks of vehicles inside *buildings*. (See A-4.1.8.3.(1) in Appendix A.)

## Section 4.2. Container Storage and Handling

## 4.2.1. Scope

## 4.2.1.1. Application

**1)** Except as provided in Sentence (2), this Section shall apply to the storage, handling and use of *flammable liquids* or *combustible liquids* that are in

- a) containers conforming to Clauses 4.2.3.1.(1)(a) to (d) having an individual capacity of not more than 230 L,
- b) portable tanks conforming to Clause 4.2.3.1.(1)(e) having an individual capacity of not more than 2 500 L, or
- c) intermodal bulk containers conforming to Clause 4.2.3.1.(1)(e) having an individual capacity of not more than 3 000 L.

- 2)** Except as otherwise stated in this Code, this Section shall not apply to
- a) bulk plants covered in Section 4.7., *refineries* covered in Section 4.9. and *distilleries* covered in Section 4.10.,
  - b) liquids in the fuel tank of motors or engines,
  - c) *distilled beverage alcohol* in *closed containers* when stored in conformance with Part 3,
  - d) food and pharmaceutical products when in *closed containers* having a capacity of not more than 5 L, or
  - e) products containing not more than 50% by volume of water-miscible *flammable liquids* or *combustible liquids* with the remainder of the solution being non-flammable, when in *closed containers* having a capacity of not more than 5 L.

**3)** Portable tanks having a capacity greater than 2500 L shall be installed in conformance with Section 4.3.

**4)** For the purpose of this Section, *unstable liquids* shall meet the requirements for Class IA liquids.

**5)** Except as otherwise stated, requirements for containers in this Part shall also apply to portable tanks described in Sentence (1).

**4.2.2. General****4.2.2.1. Prohibited Locations**

1) *Flammable liquids* or *combustible liquids* shall not be stored in or adjacent to *exits*, elevators or principal routes that provide *access to exits*.

**4.2.2.2. Storage Arrangement**

1) In addition to the provisions of this Section, the method of storage of *flammable liquids* and *combustible liquids* shall be determined to ensure the physical and chemical stability of the stored products.

**4.2.2.3. Separation from Other Dangerous Goods**

1) Except as provided in Sentence (2), *flammable liquids* and *combustible liquids* shall be separated from other *dangerous goods* in conformance with Sections 3.2. and 3.3.

2) For the purposes of applying Table 3.2.7.6., Class IIIA liquids shall be treated as Class 3 *dangerous goods*. (See Appendix A.)

**4.2.3. Containers and Portable Tanks****4.2.3.1. Design and Construction**

1) Except as permitted in Article 4.2.3.3., containers and portable tanks for *flammable liquids* or *combustible liquids* shall be built in conformance with the following:

- a) the "Transportation of Dangerous Goods Regulations,"
- b) CSA B376-M, "Portable Containers for Gasoline and Other Petroleum Fuels,"
- c) CSA B306-M, "Portable Fuel Tanks for Marine Use,"
- d) ULC/ORD-C30, "Safety Containers," or
- e) Section 6 of CSA B620, "Highway Tanks and Portable Tanks for the Transportation of Dangerous Goods."

**4.2.3.2. Markings or Labels**

1) Except as provided in Sentence (2) and Article 4.2.3.1., containers for *flammable liquids* or *combustible liquids* shall be distinctly marked or labelled in easily legible type that is in contrast to any other printed matter on the label with a warning to indicate that

- a) the material in the container is flammable,
- b) it should be kept away from heat, sparks and open flames, and
- c) it should be kept closed when not in use.

2) Markings referred to in Sentence (1) are not required when the container is labelled in conformance with

- a) the "Transportation of Dangerous Goods Act" and its Regulations,
- b) the "Hazardous Products Act" and its Regulations, or
- c) the "Pest Control Products Act" and its Regulations.

**4.2.3.3. Other Types of Containers**

1) The storage, handling and use of *flammable liquids* or *combustible liquids* in a container other than one of those listed in Article 4.2.3.1. shall be permitted only if

- a) the required purity of the liquid would be affected by containers of the types listed in Article 4.2.3.1. or if the liquid would cause the excessive corrosion of those types of containers,
- b) the container not conforming to Article 4.2.3.1. has a capacity of not more than 1 L if used for Class I liquids and not more than 5 L if used for Class II or IIIA liquids, or
- c) the container not conforming to Article 4.2.3.1. is a sample container used for quality control purposes or for testing by regulatory officials.

## 4.2.4.1.

## 4.2.4. Assembly and Residential Occupancies

## 4.2.4.1. Application

1) This Subsection shall apply to the storage and handling of *flammable liquids* and *combustible liquids* in *buildings* classified as *assembly* or *residential occupancies*, except that it shall not apply to nonresidential schools, universities or colleges covered in Subsection 4.2.6.

## 4.2.4.2. Maximum Quantities

1) Except as provided in Sentence (4) and in Articles 4.2.4.5. and 4.2.4.6., the maximum quantity of *flammable liquid* or *combustible liquid* stored in a *building* shall conform to Sentences (2) and (3).

2) When a single class of liquid is stored in a *building*, the total quantity of liquid shall not exceed

- a) 30 L of Class I liquids,
- b) 150 L of Class II liquids, or
- c) 600 L of Class IIIA liquids.

3) When 2 or more classes of liquid are stored in the same *building*, the total quantity permitted for each class of liquid shall be calculated as follows:

$$\frac{q_I}{30} + \frac{q_{II}}{150} + \frac{q_{IIIA}}{600} \leq 1$$

where

- $q_I$  = the actual quantity of Class I liquids present,
- $q_{II}$  = the actual quantity of Class II liquids present,
- $q_{IIIA}$  = the actual quantity of Class IIIA liquids present.

4) Quantities of *flammable liquids* or *combustible liquids* exceeding those permitted in Sentence (1) are permitted, provided they are kept

- a) in storage cabinets conforming to Subsection 4.2.10., except that the total quantity of *flammable liquids* and *combustible liquids* stored in such cabinets shall not exceed the quantity permitted for one cabinet, or
- b) in a storage room conforming to Subsection 4.2.9. and having no openings that communicate directly with the public portions of the *building*.

## 4.2.4.3. Storage Cabinets and Storage Rooms

1) The storage cabinets and storage rooms referred to in Sentence 4.2.4.2.(4) shall not be located above or below the *first storey*.

## 4.2.4.4. Exterior Balconies

1) *Flammable liquids* and *combustible liquids* shall not be stored on exterior balconies.

## 4.2.4.5. Dwelling Units

1) Not more than 15 L of *flammable liquids* and *combustible liquids*, of which not more than 5 L shall be Class I liquids, are permitted to be stored in each *dwelling unit*. (See Sentence 4.1.1.1.(3) for oil-burning *appliances*.)

## 4.2.4.6. Attached Garages and Sheds

1) Not more than 50 L of *flammable liquids* and *combustible liquids*, of which not more than 30 L shall be Class I liquids, are permitted to be stored in a garage or shed attached to a *dwelling unit*.

**4.2.5. Mercantile Occupancies****4.2.5.1. Maximum Quantities**

- 1)** Except as provided in Sentence (5), the quantities of *flammable liquids* and *combustible liquids* stored in *mercantile occupancies* shall not exceed those in Sentences (2) to (4).
- 2)** In *unsprinklered mercantile occupancies*, the maximum quantity of *flammable liquids* and *combustible liquids* permitted to be stored in a single *suite* shall be the lesser of
  - a) 8 L/m<sup>2</sup> of the total area of the *suite*, provided that not more than 2 L/m<sup>2</sup> are Class I liquids, of which not more than 0.3 L/m<sup>2</sup> shall be Class IA, Class IB, or any combination of these 2 classes, or
  - b) 8000 L, provided that not more than 2000 L are Class I liquids, of which not more than 300 L shall be Class IA, Class IB, or any combination of these 2 classes.
- 3)** In *sprinklered mercantile occupancies*, the maximum quantity of *flammable liquids* and *combustible liquids* permitted to be stored in a single *suite* shall be the lesser of
  - a) 24 L/m<sup>2</sup> of the total area of the *suite*, provided that not more than 6 L/m<sup>2</sup> are Class I liquids, of which not more than 1 L/m<sup>2</sup> shall be Class IA, Class IB, or any combination of these 2 classes, or
  - b) 24000 L, provided that not more than 6000 L are Class I liquids, of which not more than 1000 L shall be Class IA, Class IB, or any combination of these 2 classes.
- 4)** For the purposes of calculating permissible quantities in Sentences (2) and (3), *mercantile occupancies* of less than 250 m<sup>2</sup> *floor area* shall be assumed to be 250 m<sup>2</sup> in area.
- 5)** Quantities of *flammable liquids* and *combustible liquids* in excess of those permitted in Sentences (2) to (4) shall be kept in a storage area conforming to Subsection 4.2.7.

**4.2.5.2. Containers**

- 1)** *Flammable liquids* and *combustible liquids* in *mercantile occupancies* shall be kept in *closed containers*.
- 2)** *Closed containers* of Class I and II liquids shall not be stacked more than 1.5 m high on floors, or 1 m high on individual fixed shelves.
- 3)** Class I liquids in *closed containers* are permitted to be stored in *basements* of *mercantile occupancies*.

**4.2.5.3. Transfer**

- 1)** In *mercantile occupancies*, the transfer of *flammable liquids* or *combustible liquids* from or into containers shall only be permitted in a storage room conforming to Subsection 4.2.9. (See Appendix A.)

**4.2.6. Business and Personal Services, Educational and Care or Detention Occupancies****4.2.6.1. Application**

- 1)** This Subsection shall apply to the storage, handling and use of *flammable liquids* and *combustible liquids* in *business and personal services occupancies* and *care or detention occupancies* and shall include nonresidential schools, universities and colleges.

## 4.2.6.2.

## 4.2.6.2. Storage Cabinets and Storage Rooms

- 1) Except as permitted in Article 4.2.6.3., *flammable liquids* and *combustible liquids* shall be kept in *closed containers* and stored
- in cabinets conforming to Subsection 4.2.10., except that the total quantity of *flammable liquids* and *combustible liquids* stored in such cabinets shall not exceed the quantity permitted for one cabinet, or
  - in a room having no openings communicating directly with the public portions of the *building* and conforming to Subsection 4.2.9.

## 4.2.6.3. Maximum Quantities

- 1) Except as provided in Sentence (2), the storage of *flammable liquids* and *combustible liquids* outside of a cabinet or room required in Article 4.2.6.2. is permitted, provided such storage does not exceed
- 10 L, including not more than 5 L of Class I liquids, in a single room, or
  - 250 L, including not more than 60 L of Class II liquids, or 10 L of Class I liquid, in a single *fire compartment* having at least a 45 min *fire separation*.
- 2) In the automotive shops or industrial arts area of an educational facility, storage of up to 75 L of *flammable liquids* and *combustible liquids*, including not more than 25 L of Class I liquid, shall be permitted outside of a cabinet or room as specified in Article 4.2.6.2.

## 4.2.6.4. Containers

- 1) Where individual containers with a capacity of more than 5 L are required for storage of *flammable liquids* or *combustible liquids* in a *building*, safety containers conforming to ULC/ORD-C30, "Safety Containers," and of not more than 25 L capacity, shall be used.

## 4.2.6.5. Separation of Dangerous Goods

- 1) *Flammable liquids* or *combustible liquids* stored in cabinets or rooms shall be separated from other *dangerous goods* in conformance with Article 4.2.2.3.

## 4.2.7. Industrial Occupancies

## 4.2.7.1. Application

- 1) This Subsection applies to the storage of *flammable liquids* and *combustible liquids* in *closed containers* in *industrial occupancies*.

- 2) *Buildings* used primarily for the storage of *flammable liquids* or *combustible liquids* shall conform to the appropriate requirements in the Alberta Building Code 2006.

## 4.2.7.2. Storage Facilities

- 1) In *industrial occupancies*, *flammable liquids* and *combustible liquids* shall be stored
- in conformance with Subsection 4.2.8.,
  - in cabinets conforming to Subsection 4.2.10.,
  - in rooms conforming to Subsection 4.2.9., or
  - in storage areas conforming to Article 4.2.7.5.

## 4.2.7.3. Fire Compartments

- 1) *Fire compartments* regulated by this Subsection shall be separated from the remainder of the *building* by a *fire separation* having a *fire-resistance rating* of at least 2 h.

## 4.2.7.4. Dispensing and Transfer

- 1) Except as permitted in Subsection 4.2.8. and in Sentence (2), the dispensing or transfer of Class I or II liquids shall be conducted in rooms conforming to Subsection 4.2.9.

- 2) It is permitted to dispense or transfer Class I or II liquids in a storage area conforming to Article 4.2.7.5. provided
  - a) the storage area does not exceed 100 m<sup>2</sup>, and
  - b) the dispensing or transfer operations conform to the applicable requirements of Subsection 4.2.9.

**4.2.7.5. Maximum Quantities**

- 1) Except as provided in Sentence (2), the storage of *flammable liquids* and *combustible liquids* in storage areas specified in Clause 4.2.7.2.(1)(d) shall
  - a) conform to Table 4.2.7.5.A.
    - i) where it consists of palletized or solid piled storage, or
    - ii) where stored in *racks* in *buildings* not protected in conformance with Article 4.2.7.6., or
  - b) conform to Table 4.2.7.5.B. where stored in *racks* in *buildings* protected in conformance with Article 4.2.7.6.
- 2) Where a *building* or part of *building* is designed for the storage of *flammable liquids* or *combustible liquids*, there is no limit on the total quantity of storage per *fire compartment* provided the *building* or part of *building* is separated from adjacent *buildings* or parts of *buildings* by
  - a) a *firewall* having a *fire-resistance rating* of at least 4 h, or
  - b) spatial separation in conformance with the Alberta Building Code 2006. (See Appendix A.)
- 3) Where containers for 2 or more liquids having different *flash points* are stored together in a single *individual storage area*, the maximum quantity permitted in the *individual storage area* shall equal that permitted for the liquid with the lowest *flash point*.
- 4) When 2 or more classes of liquids are stored in a single *fire compartment*, the maximum quantity permitted for each class of liquid shall be calculated as follows:

$$\frac{q_{IA}}{Q_{IA}} + \frac{q_{IB}}{Q_{IB}} + \frac{q_{IC}}{Q_{IC}} + \frac{q_{II}}{Q_{II}} + \frac{q_{IIIA}}{Q_{IIIA}} \leq 1$$

where

- $q_{IA, IB \text{ or } IC}$  = the actual quantity of Class IA, IB or IC liquids present,
- $q_{II}$  = the actual quantity of Class II liquids present,
- $q_{IIIA}$  = the actual quantity of Class IIIA liquids present,
- $Q_{IA, IB, IC}$  = the maximum quantity of Class IA, IB or IC liquids permitted in Table 4.2.7.5.A. or Table 4.2.7.5.B. for the arrangement,
- $Q_{II}$  = the maximum quantity of Class II liquids permitted in Table 4.2.7.5.A. or Table 4.2.7.5.B. for the arrangement,
- $Q_{IIIA}$  = the maximum quantity of Class IIIA liquids permitted in Table 4.2.7.5.A. or Table 4.2.7.5.B. for the arrangement.

**Table 4.2.7.5.A.**  
**Indoor Container Storage (Palletized or Solid Piled Storage and Unprotected Rack Storage)**  
 Forming Part of Sentences 4.2.7.5.(1) and (4), 4.2.8.4.(3) and 4.2.9.1.(3)

Class of Liquid	Storage Level	Protected Storage <sup>(1)</sup>			Unprotected Storage		
		Maximum Quantity per ISA <sup>(2)</sup> , L	Maximum Storage Height, m	Maximum Quantity per Fire Compartment, L	Maximum Quantity per ISA <sup>(2)</sup> , L	Maximum Storage Height, m	Maximum Quantity per Fire Compartment, L
Class IA (Flash point below 22.8°C, boiling point below 37.8°C)	<i>First storey</i>	10 000	1.5	50 000	2 500	1.5	2 500
	<i>Storeys above the first storey</i>	7 500	1.5	30 000	2 500	1.5	2 500
	<i>Basement</i>	Not Permitted	Not Permitted	Not Permitted	Not Permitted	Not Permitted	Not Permitted
Class IB or IC (Flash point below 22.8°C, boiling point at or above 37.8°C)	<i>First storey</i>	20 000	2.0	60 000	10 000	1.5	10 000
	<i>Storeys above the first storey</i>	10 000	2.0	50 000	10 000	1.5	10 000
	<i>Basement</i>	Not Permitted	Not Permitted	Not Permitted	Not Permitted	Not Permitted	Not Permitted
Class II (Flash point at or above 37.8°C, and below 60°C)	<i>First storey and storeys above the first storey</i>	40 000	3.0	100 000	15 000	3.0	30 000
	<i>Basement</i>	25 000	1.5	25 000	Not Permitted	Not Permitted	Not Permitted
Class IIIA (Flash point at or above 60°C, and below 93.3°C)	<i>First storey and storeys above the first storey</i>	60 000	6.0	200 000	50 000	4.5	100 000
	<i>Basement</i>	40 000	3.0	100 000	Not Permitted	Not Permitted	Not Permitted

**Notes to Table 4.2.7.5.A.:**

(1) See Article 4.2.7.6.

(2) *Individual storage area.*

**Table 4.2.7.5.B.**  
**Indoor Container Storage (Protected Rack Storage)<sup>(1)</sup>**  
 Forming Part of Sentences 4.2.7.5.(1) and (4)

Class of Liquid	Storage Level	Maximum Height, m	Maximum Quantity per ISA <sup>(2)</sup> and per <i>Fire Compartment</i> , L
Class IA (Flash point below 22.8°C, boiling point below 37.8°C)	<i>First storey</i>	7.5	30 000
	<i>Storeys above first storey</i>	4.5	17 000
	<i>Basement</i>	Not Permitted	Not Permitted
Class IB or IC (Flash point below 22.8°C, boiling point at or above 37.8°C)	<i>First storey</i>	7.5	60 000
	<i>Storeys above first storey</i>	4.5	35 000
	<i>Basement</i>	Not Permitted	Not Permitted
Class II (Flash point at or above 37.8°C, and below 60°C)	<i>First storey</i>	7.5	100 000
	<i>Storeys above first storey</i>	7.5	100 000
	<i>Basement</i>	4.5	35 000
Class IIIA (Flash point at or above 60°C, and below 93.3°C)	<i>First storey</i>	12.0	200 000
	<i>Storeys above first storey</i>	6.0	200 000
	<i>Basement</i>	6.0	100 000

**Notes to Table 4.2.7.5.B.:**

(1) See Article 4.2.7.6.

(2) *Individual storage area.*

**4.2.7.6. Fire Suppression Systems**

**1)** Where protection is required by this Code, storage areas for *flammable liquids* and *combustible liquids* shall be

- a) *sprinklered* in conformance with NFPA 30, “Flammable and Combustible Liquids Code,” or
- b) protected by an automatic fire suppression system.

(See Appendix A.)

**4.2.7.7. Clearances**

**1)** The clearance between the top of storage and the lowest structural members shall not be less than 450 mm.

**2)** The clearance between the top of storage and the ceiling sprinkler deflectors or other overhead fire protection systems shall be in accordance with the standard used for the design of the respective system.

**3)** A clearance of not less than 400 mm shall be maintained between stored *flammable liquids* and *combustible liquids* and walls, except that where the width of storage adjacent to the wall is not more than 1.5 m, such wall clearance is not required. (See Appendix A.)

**4.2.7.8. Aisles**

**1)** Except as provided in Article 4.2.7.9., main aisles, access aisles and aisles defining *individual storage areas* shall be in conformance with Article 3.2.2.2.

**4.2.7.9. Separation from Other Dangerous Goods**

**1)** *Flammable liquids* and *combustible liquids* shall not be stored with other *dangerous goods* unless in conformance with Article 4.2.2.3.

**4.2.7.10.****4.2.7.10. Separation from Combustible Products**

1) Except for Class I commodities, *flammable liquids* and *combustible liquids* shall not be stored in the same *individual storage area* with other products listed in Sentence 3.2.1.1.(1).

**4.2.7.11. Absorbents**

1) Absorbent materials shall be available in the storage area for use in clean-up of spilled *flammable liquids* or *combustible liquids* in conformance with Article 4.1.6.3.

**4.2.8. Incidental Use****4.2.8.1. Application**

1) Except as otherwise noted in this Part, this Subsection applies to *industrial occupancies* where the use, storage and handling of *flammable liquids* or *combustible liquids* is secondary to the principal activity. (See Appendix A.)

**4.2.8.2. Maximum Quantities**

1) Except as provided in Sentences (2) and (3) and in Article 4.2.8.4., the quantity of *flammable liquids* and *combustible liquids* permitted to be located outside of storage rooms conforming to Subsections 4.2.7., 4.2.9. or 4.3.13., or storage cabinets conforming to Subsection 4.2.10., in any one *fire compartment* of a *building*, shall not be more than

- a) 600 L of *flammable liquids* and *combustible liquids* in *closed containers*, of which not more than 100 L shall be Class IA liquids, and
- b) 5000 L of Class IB, IC, II and IIIA liquids in *storage tanks* or portable tanks.

2) Where required for normal plant activity, quantities of *flammable liquids* and *combustible liquids* are permitted to exceed those specified in Sentence (1), but shall not be greater than the supply for one day of normal operation.

3) Where larger quantities than are permitted by Sentence (2) are required, such quantities shall be in *storage tanks* installed in conformance with Sentence 4.3.12.4.(2).

**4.2.8.3. Handling**

1) Areas in which *flammable liquids* or *combustible liquids* are transferred from one container or *storage tank* to another, or where they are used in such a way as to release potentially explosive concentrations of flammable vapours, shall be separated from possible sources of ignition by a spatial separation of not less than 6 m, or by a *fire separation*. (See Appendix A.) (See also A-4.1.5.2.(1) in Appendix A.)

**4.2.8.4. General Storage Areas**

1) In a general storage area covered in Subsection 3.2.3., quantities of *flammable liquids* and *combustible liquids* are permitted to exceed those in Sentence 4.2.8.2.(1) provided the storage area is in conformance with Sentences (2) to (6).

2) The storage area referred to in Sentence (1) shall be *sprinklered* in conformance with Article 3.2.3.3., providing a level of protection not less than that required for Class IV commodities stored up to a height of 6 m.

3) The height of storage of *flammable liquids* and *combustible liquids* shall be not more than that permitted for unprotected storage in Table 4.2.7.5.A.

4) When a single class of liquid is stored, the total quantity in a single *fire compartment* shall be not more than

- a) 2500 L of Class IB and IC liquids,
- b) 5000 L of Class II liquids, or
- c) 10000 L of Class IIIA liquids.

5) When 2 or more classes of liquid are stored in the same *fire compartment*, the total quantity permitted for each class of liquid shall be calculated as follows:

$$\frac{q_I}{2500} + \frac{q_{II}}{5000} + \frac{q_{IIIA}}{10,000} \leq 1$$

where

- q<sub>I</sub> = the actual quantity of Class IB and IC liquids present,
- q<sub>II</sub> = the actual quantity of Class II liquids present,
- q<sub>IIIA</sub> = the actual quantity of Class IIIA liquids present.

6) When 2 or more classes of liquid are stored in the same *individual storage area*, the maximum quantity permitted in the *individual storage area* shall be that permitted for the liquid with the lowest limit listed in Sentence (4).

**4.2.9. Rooms for Container Storage and Dispensing**

**4.2.9.1. Maximum Quantities**

1) Except as provided in Sentences (2) and (3), where *flammable liquids* and *combustible liquids* are stored in a room required in this Part, the storage densities averaged over the total room area and the total quantities of such liquids shall conform to Table 4.2.9.1.

**Table 4.2.9.1.**  
**Rooms for Container Storage and Dispensing**  
 Forming Part of Sentences 4.2.9.1.(1) and (2)

Maximum Quantity, L	Minimum <i>Fire Separation</i> Around Room, h	Maximum Density, L/m <sup>2</sup>
10 000	2	200
1 500	1	100

2) The maximum quantities and densities of *flammable liquids* and *combustible liquids* shown in Table 4.2.9.1. are permitted to be doubled provided the storage room is protected by an automatic fire suppression system conforming to Article 4.2.7.6.

3) The maximum quantities of Class I liquids in an unprotected storage room with a *fire separation* having a *fire-resistance rating* of not less than 2 h shall

- a) not exceed those specified for unprotected storage in Table 4.2.7.5.A., and
- b) comply with Sentences 4.2.7.5.(3) and (4).

**4.2.9.2. Spill Control**

1) Storage rooms referred to in Article 4.2.9.1. shall be liquid-tight where the walls join the floor.

**4.2.9.3. Aisles**

1) The contents of *flammable liquid* and *combustible liquid* storage rooms referred to in Article 4.2.9.1. shall be arranged to provide aisle widths of not less than 1 m.

**4.2.9.4. Dispensing**

1) Dispensing of *flammable liquids* or *combustible liquids* from containers having a capacity of more than 30 L shall be by pumps or through self-closing valves, designed in conformance with good engineering practice. (See A-4.1.8.3.(1) in Appendix A.)

**4.2.9.5.****4.2.9.5. Explosion Venting**

1) Where Class IA or IB liquids are dispensed within a storage room, the room shall be designed to prevent critical structural and mechanical damage from an internal explosion in conformance with good engineering practice such as that described in NFPA 68, "Venting of Deflagrations." (See A-3.2.8.2.(1)(d) in Appendix A.)

**4.2.10. Cabinets for Container Storage****4.2.10.1. Containers**

1) *Flammable liquids* and *combustible liquids* stored in cabinets required in this Part shall be in *closed containers* conforming to Article 4.2.3.1.

**4.2.10.2. Maximum Quantity per Cabinet**

1) The maximum quantity of *flammable liquids* and *combustible liquids* stored in a cabinet shall be 500 L, of which not more than 250 L shall be Class I liquids.

**4.2.10.3. Maximum Quantity per Fire Compartment**

1) Except as provided in Sentences (2) and (3), the total quantity of *flammable liquids* and *combustible liquids* stored in cabinets in a single *fire compartment* shall not exceed the quantity permitted in Article 4.2.10.2. for 3 cabinets.

2) In *industrial occupancies*, quantities of *flammable liquids* and *combustible liquids* greater than those specified in Sentence (1) are permitted in a single *fire compartment* if

- a) the total quantity stored in a group of cabinets is not more than the quantity permitted for 3 cabinets, and
- b) the distance between groups of cabinets described in Clause (a) is not less than 30 m.

3) In *care or detention occupancies*, the total quantity of *flammable liquids* and *combustible liquids* stored in cabinets in a single *fire compartment* shall not exceed the quantity permitted for one cabinet.

**4.2.10.4. Labelling**

1) Cabinets for container storage shall be labelled in conspicuous lettering to indicate that the cabinet contains flammable materials and that open flames must be kept away.

**4.2.10.5. Fire Endurance**

1) Storage cabinets required in this Part shall conform to ULC/ORD-C1275, "Storage Cabinets for Flammable Liquid Containers."

**4.2.10.6. Ventilation**

1) When a storage cabinet required in this Part is provided with ventilation openings,

- a) the ventilation openings shall be sealed with materials providing a fire protection at least equivalent to that required for the construction of the cabinet, or
- b) the cabinet shall be vented outdoors using vent piping providing a fire protection at least equivalent to that required in Clause (a) for seals.

**4.2.11. Outdoor Container Storage****4.2.11.1. Quantities and Clearances**

1) Except as provided in Sentence (2), the quantities and clearances for *flammable liquids* and *combustible liquids* stored in containers in outdoor storage areas shall conform to Table 4.2.11.1.

**Table 4.2.11.1.**  
**Outdoor Container Storage**  
 Forming Part of Sentence 4.2.11.1.(1)

Class of Liquid	Maximum Total Quantity, per Pile, L	Minimum Distance between Piles, m	Minimum Distance to a Property Line or to a <i>Building</i> on the Same Property, m
Class IA (Flash point below 22.8°C, boiling point below 37.8°C)	5 000	1.5	6
Class IB or IC (Flash point below 22.8°C, boiling point at or above 37.8°C)	15 000	1.5	6
Class II (Flash point at or above 37.8°C, and below 60°C)	35 000	1.5	6
Class IIIA (Flash point at or above 60°C, and below 93.3°C)	85 000	1.5	6

**2)** The clearances required in Sentence (1) do not apply where not more than 5000 L of *flammable liquids* or *combustible liquids* are stored adjacent to a *building* on the same property, provided that either

- a) the *building* is limited to 1 *storey* in *building* height and is used primarily for the storage or handling of *flammable liquids* or *combustible liquids*, or
- b) the exposed wall has a *fire-resistance rating* of at least 2 h and has no openings within 3 m of such outdoor storage.

**4.2.11.2. Mixed Storage**

**1)** Where 2 or more liquids with different *flash points* are stored outdoors in containers that form a single pile, the maximum total quantity permitted in the pile shall be equal to that permitted for the liquid with the lowest *flash point*.

**4.2.11.3. Fire Department Access**

**1)** An access route not less than 6 m wide constructed in conformance with Subsection 3.2.5. of Division B of the Alberta Building Code 2006 shall be provided in outdoor storage areas to permit the approach of fire department vehicles to within 60 m of any part of a pile.

**4.2.11.4. Spill Control**

**1)** Outdoor storage areas for *flammable liquids* or *combustible liquids* shall be designed to accommodate possible spillage in conformance with Subsection 4.1.6.

**4.2.11.5. Fencing**

**1)** An outdoor area used for the container storage of *flammable liquids* or *combustible liquids* shall be fenced in conformance with Article 3.3.2.6.

**Section 4.3. Tank Storage**

**4.3.1. Design, Construction and Use of Storage Tanks**

**4.3.1.1. Application**

**1)** This Section applies to *storage tanks* for *flammable liquids* and *combustible liquids*.

## 4.3.1.2.

## 4.3.1.2. Atmospheric Storage Tanks

**1)** Except as permitted in Sentence (3) and in Section 4.10., *atmospheric storage tanks* shall be built in conformance with the following:

- a) API 650, "Welded Steel Tanks for Oil Storage,"
- b) ULC-S601, "Shop Fabricated Steel Aboveground Horizontal Tanks for Flammable and Combustible Liquids,"
- c) CAN/ULC-S602, "Aboveground Steel Tanks for the Storage of Combustible Liquids Intended to be Used as Heating and/or Generator Fuels,"
- d) ULC-S603, "Steel Underground Tanks for Flammable and Combustible Liquids,"
- e) CAN/ULC-S603.1, "External Corrosion Protection Systems for Steel Underground Tanks for Flammable and Combustible Liquids,"
- f) ULC-S615, "Reinforced Plastic Underground Tanks for Flammable and Combustible Liquids,"
- g) ULC-S630, "Shop Fabricated Steel Aboveground Vertical Tanks for Flammable and Combustible Liquids,"
- h) ULC-S643, "Shop Fabricated Steel Aboveground Utility Tanks for Flammable and Combustible Liquids,"
- i) ULC-S652, "Tank Assemblies for Collection of Used Oil,"
- j) ULC-S653, "Aboveground Steel Contained Tank Assemblies for Flammable and Combustible Liquids,"
- k) ULC-S655, "Aboveground Protected Tank Assemblies for Flammable and Combustible Liquids,"
- l) ULC/ORD-C58.10, "Jacketed Steel Underground Tanks for Flammable and Combustible Liquids,"
- m) ULC/ORD-C142.5, "Concrete Encased Steel Aboveground Tank Assemblies for Flammable and Combustible Liquids,"
- n) ULC/ORD-C142.18, "Rectangular Steel Aboveground Tanks for Flammable and Combustible Liquids," or
- o) ULC/ORD-C142.22, "Contained Steel Vertical Aboveground Tank Assemblies for Flammable and Combustible Liquids."

(See Appendix A.)

**2)** Reserved

**3)** When necessitated by possible contamination of the liquid to be stored or possible rapid corrosion of the tank, *storage tanks* need not conform to Sentence (1), provided that they are designed and built in conformance with good engineering practice for the material being used.

**4)** *Atmospheric storage tanks* shall not be used for the storage of *flammable liquids* or *combustible liquids* at temperatures at or above their boiling points.

## 4.3.1.3. Low Pressure Storage Tanks and Pressure Vessels

- 1)** *Low pressure storage tanks* shall be constructed in conformance with
- a) API 620, "Design and Construction of Large, Welded, Low-Pressure Storage Tanks," or
  - b) boiler and *pressure vessel* regulations made pursuant to the Safety Codes Act.

**2)** *Pressure vessels* shall be constructed in conformance with boiler and *pressure vessel* regulations made pursuant to the Safety Codes Act.

**3)** *Low pressure storage tanks* and *pressure vessels* are permitted to be used as *atmospheric storage tanks*.

## 4.3.1.4. Operating Pressure

**1)** The normal operating pressure of a *storage tank* shall not exceed its design pressure.

**4.3.1.5. Corrosion Protection**

1) The exposed surface of every aboveground *storage tank* for *flammable liquids* or *combustible liquids* that is fabricated of any ferrous substance shall be thoroughly coated with a rust-resisting material that is compatible with the tank.

**4.3.1.6. Floating Roofs**

1) Except for perimeter sealing material, floating roof assemblies or internal floating covers installed in *storage tanks* shall be constructed of metal or other materials and designed in conformance with one of the tank construction standards listed in this Subsection.

**4.3.1.7. Identification**

1) Except as required by Sentences (2) and (3), a *storage tank* and its filling and emptying connections shall be identified in conformance with CPPI, "Using the CPPI Colour-Symbol System to Mark Equipment and Vehicles for Product Identification."

2) The contents of every aboveground *storage tank* shall be clearly identified by signs with letters of sufficient size to ensure legibility from not less than 4.5 m or from outside a diked area, whichever is greater.

3) Signs installed in accordance with Sentence (2) shall be located on at least two sides of a *storage tank*.

**4.3.1.8. Overfill Protection**

1) Except as required in Subsection 4.3.8., a *storage tank* shall be prevented from being overfilled by providing

- a) continuous supervision of the filling operations by personnel qualified to supervise such operations, or
- b) an *overflow protection device* conforming to ULC/ORD-C58.15, "Overfill Protection Devices for Flammable Liquid Storage Tanks" (see Appendix A).

**4.3.1.9. Installation and Use**

1) Unless otherwise specified in this Code, a *storage tank* shall be installed and used in conformance with the applicable installation and use provisions of the design document to which the *storage tank* was built as required by this Section.

2) Except for *storage tanks* being withdrawn from service in accordance with Subsections 4.3.15. and 4.3.16. or that are exempt from registration under Article 2.2.5.1. of Division C, no person shall deliver or remove *flammable liquids* or *combustible liquids* to or from a *storage tank*, unless

- a) the *storage tank* is registered under Article 2.2.5.2. of Division C, and
- b) the registration certificate is displayed as required by Sentence 2.2.5.2.(5) of Division C.

3) The *owner* of a *storage tank* shall ensure that documentation is provided that indicates

- a) the location of the *storage tank*,
- b) the product to be stored in the *storage tank*,
- c) the capacity of the *storage tank*,
- d) the material from which the *storage tank* is constructed,
- e) the type of corrosion protection, if any, applied to the *storage tank*, and
- f) the records of any leak tests performed on the *storage tank*.

4) The *owner* shall make the documentation described in Sentence (3) available in conformance with Article 2.2.1.2. of Division C.

**4.3.1.10. Reuse**

(See Appendix A.)

- 1)** Except as permitted by Subsection 4.3.15., a *storage tank* that has been taken out of service shall not be reused for the storage of *flammable liquids* or *combustible liquids* unless it has been
  - a) refurbished so as to conform to one of the standards listed in Sentence 4.3.1.2.(1), or
  - b) refurbished in conformance with Sentence (2) or (3).
- 2)** A *storage tank* is permitted to be refurbished for aboveground use in conformance with one of the following standards:
  - a) ULC-S601(A), "Refurbishing of Steel Aboveground Horizontal Tanks for Flammable and Combustible Liquids,"
  - b) ULC-S630(A), "Refurbishing of Steel Aboveground Vertical Tanks for Flammable and Combustible Liquids."
- 3)** A *storage tank* is permitted to be refurbished for underground use in conformance with one of the following standards:
  - a) ULC-S603(A), "Refurbishing of Steel Underground Tanks for Flammable and Combustible Liquids,"
  - b) ULC-S615(A), "Refurbishing of Reinforced Plastic Underground Tanks for Flammable and Combustible Liquids."
- 4)** A riveted *storage tank* shall not be relocated.

**4.3.2. Installation of Outside Aboveground Storage Tanks**

**4.3.2.1. Location**

- 1)** Every outside aboveground *storage tank* for the storage of *flammable liquids* or *combustible liquids* shall be located in conformance with Sentences (2) to (5) with respect to a property line or a *building* on the same property.
- 2)** Except as provided in Sentences (6) and (7), every aboveground *storage tank* containing stable liquids and having a working pressure of not more than 17 kPa (gauge) shall be separated from a property line or a *building* on the same property by distances
  - a) half those in Table 4.3.2.1., where protection is provided against fire or explosion in the tank in conformance with Sentence 4.3.2.5.(2), or
  - b) equal to those in Table 4.3.2.1., where protection referred to in Clause (a) is not provided.

**Table 4.3.2.1.**  
**Location of Aboveground Storage Tanks**  
 Forming Part of Sentences 4.3.2.1.(2), (3) and (4), and 4.9.2.1.(2) and (3)

Maximum Tank Capacity, L	Minimum Distance to a Property Line or to a <i>Building</i> on the Same Property, m
250 000	3
500 000	4.5
2 500 000	9
5 000 000	12
over 5 000 000	15

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays

- 3)** Every aboveground *storage tank* containing *unstable liquids* and having a working pressure of not more than 17 kPa (gauge) shall be separated from a property line or a *building* on the same property by distances
- equal to those in Table 4.3.2.1., but not less than 7.5 m, where protection is provided against fire or explosion in the tank in conformance with Sentence 4.3.2.5.(2), or
  - 3 times those in Table 4.3.2.1., but not less than 15 m, where protection referred to in Clause (a) is not provided.
- 4)** Every aboveground *storage tank* containing boil-over liquids shall be separated from a property line or a *building* on the same property by distances
- 0.75 times those in Table 4.3.2.1., where protection is provided against fire or explosion in the tank in conformance with Sentence 4.3.2.5.(2), or
  - equal to those in Table 4.3.2.1., where protection referred to in Clause (a) is not provided.

(See Appendix A.)

**5)** Where a *storage tank* containing stable liquids or *unstable liquids* has a working pressure greater than 17 kPa (gauge), the distances from a property line or a *building* on the same property shall be those specified in Sentences (2) and (3) multiplied by 1.5, but shall be not less than 7.5 m.

**6)** The minimum distance required in Sentence (2) from a *storage tank* containing only Class II or IIIA liquids to a *building* on the same property is permitted to be reduced to

- 1.5 m provided the tank capacity is not more than 50000 L,
- 0.5 m provided the tank capacity is not more than 5 000 L, or
- zero provided the tank capacity is not more than 2500 L.

**7)** The minimum distance required in Sentence (2) is permitted to be waived provided the *storage tank*

- is in conformance with ULC-S655, "Aboveground Protected Tank Assemblies for Flammable and Combustible Liquids," and
- has a capacity of not more than 50000 L.

**8)** Where end failure of horizontal *storage tanks* may endanger adjacent property, the tanks shall be placed with the longitudinal axis parallel to such property.

#### 4.3.2.2. Spacing between Storage Tanks

**1)** Except as required in Sentences (2) and (3) and in Article 4.3.2.3., the minimum distance between every combination of 2 aboveground *storage tanks* shall be 0.25 times the sum of their diameters, but shall be not less than 1 m.

**2)** The minimum distance between any 2 *storage tanks*, neither of which has a capacity of more than 250000 L, shall be 1 m.

**3)** Where either of 2 aboveground *storage tanks* contains *unstable liquids*, the distance required in Sentences (1) and (2) shall be doubled.

#### 4.3.2.3. Clearances from Liquefied Petroleum Gas Cylinders and Tanks

**1)** The minimum separation between a *flammable liquid* or *combustible liquid storage tank* and a liquefied petroleum gas cylinder or tank shall be 6 m.

**2)** *Secondary containments* for *flammable liquid* and *combustible liquid storage tanks* shall not contain any liquefied petroleum gas cylinder or tank, and the centre line of the *secondary containment* wall shall be not less than

- 3 m away from a liquefied petroleum gas cylinder, and
- 6 m away from a liquefied petroleum gas tank.

#### 4.3.2.4. Fire Department Access

**1)** Except as provided in Sentences (2) and (3), *storage tanks* for *flammable liquids* or *combustible liquids* shall be spaced so that each *storage tank* is accessible for firefighting purposes.

## 4.3.2.5.

**2)** An access route constructed in conformance with Subsection 3.2.5. of Division B of the Alberta Building Code 2006 shall be provided in outdoor storage areas to permit the approach of fire department vehicles to within 60 m travelling distance of any *storage tank*.

**3)** Where firefighting access to *storage tanks* containing Class I or II liquids is not provided, fire extinguishing measures conforming to Sentence 4.3.2.5.(2) shall be provided.

4.3.2.5. **Fire Protection Systems**

(See Appendix A.)

**1)** Where the diameter of a *storage tank* exceeds 45 m, the *storage tank* shall be provided with protection against fires or explosions in conformance with Sentence (2).

**2)** Protection against fires or explosions required for a *storage tank* shall consist of fixed protection systems designed in conformance with good engineering practice such as that described in

- a) NFPA 11, "Low-, Medium-, and High-Expansion Foam,"
- b) NFPA 15, "Water Spray Fixed Systems for Fire Protection," and
- c) NFPA 69, "Explosion Prevention Systems."

4.3.3. **Supports, Foundations and Anchorage for Aboveground Storage Tanks**4.3.3.1. **Foundations and Supports**

**1)** *Storage tanks* shall rest on the ground or on foundations, supports or piling made of concrete, masonry or steel in conformance with

- a) Appendix B of API 650, "Welded Steel Tanks for Oil Storage," and
- b) Appendices C and D of API 620, "Design and Construction of Large, Welded, Low-Pressure Storage Tanks."

**2)** Tank supports shall be installed on firm foundations designed to minimize uneven settling of the tank and to minimize corrosion of the part of the tank resting on the foundation.

**3)** Except for steel saddles that are less than 300 mm high at their highest point, supports for *storage tanks* shall provide a *fire-resistance rating* of not less than 2 h.

**4)** Every aboveground *storage tank* shall be supported in a manner that will prevent the allowable design stress of the tank from being exceeded.

4.3.3.2. **Earthquake Protection**

**1)** In areas subject to earthquake forces, *storage tanks*, supports and connections shall be designed to resist such forces in conformance with

- a) Part 4 of Division B of the Alberta Building Code 2006, and
- b) Appendix A of ULC-S630, "Shop Fabricated Steel Aboveground Vertical Tanks for Flammable and Combustible Liquids."

4.3.3.3. **Protection against Flooding**

**1)** When aboveground *storage tanks* are located in an area that is subject to flooding, the tanks shall be securely anchored to prevent floating.

4.3.3.4. **Protection Against Mechanical Damage**

**1)** The *authority having jurisdiction* is permitted to require that an aboveground *storage tank* be provided with barriers, if there is potential for mechanical damage to the *storage tank* from vehicles or other sources.

#### 4.3.4. Normal and Emergency Venting for Aboveground Storage Tanks

##### 4.3.4.1. Design and Installation

- 1) *Atmospheric and low pressure storage tanks* shall be provided with normal and emergency venting in conformance with
  - a) API 2000, "Venting Atmospheric and Low-Pressure Storage Tanks: Nonrefrigerated and Refrigerated," or
  - b) the tank design standards listed in Sentence 4.3.1.2.(1).

##### 4.3.4.2. Unstable Liquids

- 1) When *unstable liquids* are stored, the effects of heat or gas resulting from polymerization, decomposition, condensation or self-reactivity shall be allowed for in the determination of the total venting capacity.

#### 4.3.5. Vent Piping for Aboveground Storage Tanks

##### 4.3.5.1. Materials and Construction

- 1) Except at *distilleries* covered in Section 4.10., vent piping materials and construction shall conform to Subsections 4.5.2., 4.5.3. and 4.5.5.

##### 4.3.5.2. Location of Vent Pipe Outlets

- 1) Normal vent pipe outlets for *storage tanks* of Class I liquids
  - a) shall be located outside *buildings* not less than
    - i) 3.5 m above the adjacent ground level, and
    - ii) 1.5 m from any *building* opening, and
  - b) shall discharge so that flammable vapours will not enter the *building* or be trapped near any part of the *building*.
- 2) Normal vent pipe outlets for *storage tanks* of Class II or IIIA liquids shall discharge outside *buildings* not less than
  - a) 2 m above the adjacent ground level, and
  - b) 1.5 m from any *building* opening.
- 3) Emergency vent outlets for *storage tanks* shall discharge outside *buildings* not less than 1.5 m from any *building* opening and from any combustible component of any *building's* exterior wall.

##### 4.3.5.3. Interconnection of Vent Piping

- 1) Except as provided in Sentence (2), 2 or more *storage tanks* are permitted to be connected to a common vent pipe for normal relief venting provided the vent pipe size is designed to vent the combined vapours produced in the connected tanks without exceeding the allowable stresses of the tanks.
- 2) Vent piping for *storage tanks* for Class I liquids shall not be connected to vent piping for *storage tanks* for Class II or IIIA liquids unless an effective arrangement is provided to prevent the vapours from the Class I liquids from entering the other tanks.

#### 4.3.6. Openings Other than Vents in Aboveground Storage Tanks

##### 4.3.6.1. Provision of Valves

- 1) Each connection to an aboveground *storage tank* through which the liquid can normally flow shall be provided with an internal or external shut-off valve located as close as practical to the shell of the tank.
- 2) Each connection to an aboveground *storage tank* that is below the liquid level and through which liquid does not normally flow shall be provided with a liquid-tight closing device.

**4.3.6.2.****4.3.6.2. Materials**

**1)** Valves and their connections to a *storage tank* shall be made of steel, except that when the chemical characteristics of the liquid stored are incompatible with steel, materials other than steel are permitted to be used.

**2)** Materials for valves and their connections to a *storage tank* shall be suitable for the pressures, stresses and temperatures that may be expected, including those of possible fire exposure.

**4.3.6.3. Openings for Liquid Level Measurements**

**1)** Openings for measuring liquid levels in *storage tanks* for Class I liquids shall be equipped with caps or covers which shall be opened only when measuring the liquid level.

**4.3.6.4. Connections for Filling and Emptying**

**1)** Except as provided in Sentence (3), connections used as part of normal operating conditions for filling or emptying *storage tanks* for *flammable liquids* and *combustible liquids* shall be located

- a) outside *buildings*,
- b) at a location free of sources of ignition, and
- c) not less than 1.5 m away from *building* openings.

**2)** Connections for filling or emptying *storage tanks* shall be kept closed to prevent leakage when not in use.

**3)** A filling connection described in Sentence (1) is permitted to be located inside a *building* if

- a) this is made necessary
  - i) by a process or activity located indoors and to which the tank is directly associated, or
  - ii) for the collection of used liquids, and
- b) the fill piping is provided with means to prevent flammable vapours from returning to the *building*.

**4.3.7. Secondary Containment for Aboveground Storage Tanks****4.3.7.1. General**

**1)** The area surrounding a *storage tank* or group of *storage tanks* shall be designed to accommodate accidental spillage in conformance with Subsection 4.1.6.

**2)** Where barriers described in Sentence 4.1.6.1.(1) are provided to contain accidental spillage from aboveground *storage tanks*, they shall conform to the requirements for *secondary containment* in this Subsection.

**3)** A *storage tank* conforming to Sentence 4.3.7.4.(2) shall be considered as conforming to this Subsection provided it is used and maintained in conformance with Articles 4.3.7.8. and 4.3.7.9.

**4.3.7.2. Construction**

**1)** Except as provided in Sentence (2), the base and walls of a *secondary containment* shall be made of noncombustible materials, and shall be designed, constructed and maintained to

- a) withstand full hydrostatic head, and
- b) provide a permeability of not more than  $10^{-6}$  cm/s to the *flammable liquids* or *combustible liquids* contained in the *storage tanks*.

- 2)** Where a membrane provides the level of impermeability required in Sentence (1), it shall
- conform to ULC/ORD-C58.9, "Secondary Containment Liners for Underground and Aboveground Flammable and Combustible Liquid Tanks," and
  - when the membrane is combustible, be covered with a noncombustible material of such nature and thickness that the membrane will not fail when the *secondary containment* is exposed to fire.
- 3)** Except as provided in Sentence (4), openings shall not be permitted in a *secondary containment*.
- 4)** Where piping passes through a *secondary containment*, such passages shall conform to Sentences (1) and (2).

#### 4.3.7.3. Capacity

(See A-4.1.6.1.(1) in Appendix A.)

- 1)** Except as permitted in Sentence (3), a *secondary containment* for a single *storage tank* shall have a volumetric capacity of not less than 110% of the capacity of the tank.
- 2)** Except as permitted in Sentence (3), a *secondary containment* for more than one *storage tank* shall have a volumetric capacity of not less than the sum of
- the capacity of the largest *storage tank* located in the contained space, and
  - 10% of the greater of
    - the capacity specified in Clause (a), or
    - the aggregate capacity of all other *storage tanks* located in the contained space.
- 3)** When the *secondary containment* is designed to prevent the entry of precipitation and water used for firefighting purposes into the contained space, it shall have a volumetric capacity of not less than the capacity of the largest *storage tank* located in the contained space.

#### 4.3.7.4. Clearances

(See Appendix A.)

- 1)** Except as permitted by Sentences (2) and (3), no part of a *secondary containment* wall shall be less than 1.5 m from a *storage tank* shell.
- 2)** It is permitted to waive the distance required in Sentence (1) provided the *storage tank*
- is constructed in accordance with Clauses 4.3.1.2.(1)(j), (k), (m) and (o) incorporating *secondary containment*,
  - has a capacity of not more than 50000 L, and
  - is protected by posts or guardrails where exposed to collision damage.
- 3)** It is permitted to waive the distance required in Sentence (1) provided the *storage tank*
- is constructed in accordance with Clauses 4.3.1.2.(1)(b) and (g), for double-walled *storage tanks*,
  - is equipped with a spill containment device meeting the requirements of ULC/ORD-C142.19, "Spill Containment Devices for Aboveground Flammable and Combustible Liquid Storage Tanks,"
  - is equipped with an *overflow protection device* that is compatible with the intended method of filling and meets the requirements of ULC/ORD-C58.15, "Overflow Protection Devices for Flammable Liquid Storage Tanks,"
  - is provided with a metallic under-dispenser sump meeting the requirements of ULC/ORD-C107.21, "Under-Dispenser Sumps," if the assembly incorporates a fuel dispenser,
  - is provided with a means of detecting leakage within the interstitial space,
  - is inspected every 7 days for any loss if equipped with vacuum gauges that monitor the interstitial space,
  - has a capacity of not more than 50 000 L,
  - has all piping connections made above the normal maximum liquid level,

## 4.3.7.5.

- i) has a means to prevent the release of *flammable liquids* and *combustible liquids* by siphon flow,
- j) has a means for determining the level of *flammable liquids* and *combustible liquids* that is readily accessible to the delivery operator, and
- k) is protected by posts or guardrails where exposed to collision damage.

## 4.3.7.5. Access to Storage Tanks and Ancillary Equipment

- 1) A *secondary containment* shall permit
  - a) access to *storage tanks*, valves and ancillary equipment,
  - b) egress from the contained space, and
  - c) access for firefighting as specified in Article 4.3.2.4.
 (See Appendix A.)

- 2) Where a *storage tank* contains Class I liquids, provisions shall be made for the normal operation of valves and for access to the *storage tank* roof without entering the contained space created by the *secondary containment* when
  - a) the average height of the *secondary containment* exceeds 3.5 m, measured from the ground level of the interior of the contained area, or
  - b) the distance between the tank shell and the top inside edge of the *secondary containment* wall is less than the height of this wall.
 (See Appendix A.)

## 4.3.7.6. Emergency Venting

- 1) Where the *secondary containment* is not open to the atmosphere, emergency venting shall be provided to relieve any buildup of internal pressure in the contained space when exposed to heat or fire.

## 4.3.7.7. Leak Detection

- 1) Where the contained space created by the *secondary containment* is not accessible for visual examination, a monitoring device shall be provided to indicate the presence of liquid in, or the loss of integrity of the *secondary containment*. (See Sentence 4.4.2.1.(7).)

## 4.3.7.8. Drainage

- 1) Liquids, debris and precipitation shall not accumulate in the contained space created by the *secondary containment*.
- 2) Provisions shall be made for removing liquid from the *secondary containment* in conformance with Subsection 4.1.6.
- 3) Controls for the liquid removal system required in Sentence (2) shall be
  - a) normally closed,
  - b) accessible under fire exposure conditions, and
  - c) located so they can be operated from outside the contained space.
- 4) Centrifugal-type pumps shall not be used to transfer water contaminated with *flammable liquids* or *combustible liquids* from diked areas to a collection system.

## 4.3.7.9. Use of Secondary Containment

- 1) The contained space created by a *secondary containment* shall not be used for storage purposes.

## 4.3.8. Installation of Underground Storage Tanks

## 4.3.8.1. Location

- 1) Underground *storage tanks* shall be located so that loads from *building* foundations and supports are not transmitted to the tank.
- 2) Underground *storage tanks* shall be separated by a horizontal distance of not less than
  - a) 600 mm from adjacent underground tanks or structures,

- b) 1 m from a *building* foundation or a *street* line, and
- c) 1.5 m from other property lines.

**3)** The location of each proposed *underground storage tank system* shall be assigned a site sensitivity classification by the *authority having jurisdiction* in accordance with Sentences (4) and (5).

**4)** The site sensitivity classification shall be Class A where the *underground storage tank system* is located within

- a) 500 m of wells or other locations where underground water is being used,
- b) 200 m of a lake, river or other body of water,
- c) 150 m of a major underground structure, or
- d) a municipality that has been deemed to require protection from hydrocarbon spills.

**5)** The site sensitivity classification shall be Class B if the site does not meet the criteria for Class A sites described in Sentence (4).

**6)** No person shall install an *underground storage tank system* at a location that has a site sensitivity classification of Class A as described in Sentence (4), unless

- a) the *underground storage tank system* is constructed and installed in conformance with this Part,
- b) a means of *secondary containment* is provided (see Appendix A),
- c) an *overflow protection device* conforming to ULC/ORD-C58.15, "Overflow Protection Devices for Flammable Liquid Storage Tanks," is installed,
- d) a *spill containment device* conforming to ULC/ORD-C58.19, "Spill Containment Devices for Underground Flammable Liquid Storage Tanks," is installed,
- e) leak detection is installed (see Appendix A),
- f) a line leak detection device is installed on pressurized or suction piping systems (see Appendix A),
- g) all *storage tank* fill pipes are equipped with liquid- and vapour-tight adapters and caps,
- h) a valve is installed on buried suction piping systems in order to isolate piping during leakage testing, and
- i) under dispenser sumps conforming to ULC/ORD-C107.21, "Under Dispenser Sumps," are installed.

**7)** No person shall install an *underground storage tank system* at a location that has a site sensitivity classification of Class B as described in Sentence (5) unless

- a) the *underground storage tank system* is constructed and installed in conformance with this Part,
- b) an *overflow protection device* conforming to Clause (6)(c) is installed,
- c) a *spill containment device* conforming to Clause (6)(d) is installed,
- d) leak detection is installed (see A-4.3.8.1.(6)(e) in Appendix A),
- e) a line leak detection device is installed on pressurized or suction piping systems (See A-4.3.8.1.(6)(f) in Appendix A),
- f) all *storage tank* fill pipes are equipped with liquid- and vapour-tight adapters and caps,
- g) a valve is installed on buried suction piping systems in order to isolate piping during leakage testing, and
- h) under dispenser sumps conforming to ULC/ORD-C107.21, "Under Dispenser Sumps," are installed.

#### 4.3.8.2. Ground Cover

**1)** Except as required in Sentences (2) to (4), *underground storage tanks* shall be installed with not less than 600 mm of ground cover over the tank.

**2)** Except as required in Sentence (3), *storage tanks* subjected to vehicular traffic shall be installed not less than 1 m below finished ground level.

**3)** Either a 150 mm reinforced concrete slab or a 200 mm unreinforced concrete slab over not less than 450 mm of sand is permitted in lieu of the protection described in Sentence (2) provided the slab extends at least 300 mm beyond the *storage tank*.

**4)** Where subsurface conditions make it impracticable to install a *storage tank* totally below adjacent ground level, an underground *storage tank* shall be installed so that at least

- a) 75% of its mass is below adjacent ground level provided there is not less than 600 mm of ground cover over the portion of the tank above adjacent ground level, or
- b) 50% of its mass is below adjacent ground level provided there is not less than 1 m of ground cover over the portion of the tank above adjacent ground level.

#### 4.3.8.3. **Damage Repair**

**1)** Underground *storage tanks* that are in the process of being installed shall be inspected, and any damage to the tank shell, protective coating, fittings or anodes shall be repaired before they are lowered into the excavation.

**2)** An underground *storage tank* that is damaged shall not be repaired on site and used for storage unless

- a) the repair is done by the manufacturer in accordance with ULC refurbishing specifications, and
- b) the manufacturer certifies in writing that the repaired tank meets the applicable manufacturing codes.

(See Appendix A.)

**3)** Damage to *storage tank* shells shall not be repaired on site.

#### 4.3.8.4. **Damage Prevention**

**1)** Underground *storage tanks* shall be lowered into the excavation by the use of lifting lugs and hooks and, where necessary, spreader bars to prevent damage to the tank shell, protective coating, fittings or anodes.

**2)** Any method of handling that might result in damage to the protective coating of the tank shall not be used.

#### 4.3.8.5. **Installation**

**1)** Underground steel *storage tanks* shall be installed in conformance with Appendix B of CAN/ULC-S603.1, "External Corrosion Protection Systems for Steel Underground Tanks for Flammable and Combustible Liquids."

**2)** Underground reinforced plastic *storage tanks* shall be installed in conformance with Appendix A of ULC-S615, "Reinforced Plastic Underground Tanks for Flammable and Combustible Liquids."

**3)** Underground *storage tanks* shall not be placed in direct contact with reinforced concrete slabs but shall be separated by not less than 150 mm of sand or other suitable material to evenly distribute the weight of the tank on the supporting base.

#### 4.3.8.6. **Filling**

**1)** *Flammable liquids* or *combustible liquids* shall not be placed in an underground *storage tank* until

- a) the fill pipe and vent line have been installed in the tank, and
- b) all other openings have been sealed.

#### 4.3.8.7. **Spillage**

**1)** If a spillage occurs, the escaped liquid and all soil contaminated by the spill shall be removed in conformance with Subsection 4.1.6.

#### 4.3.8.8. **Anchorage**

**1)** Underground *storage tanks* shall be protected against hydrostatic forces which can cause the uplift of the tanks once they are empty. (See Appendix A.)

- 2) Where anchors and ground straps are used to resist the uplift forces referred to in Sentence (1), they shall be
  - a) electrically isolated from the tank, and
  - b) installed in such a manner that they do not damage the tank's shell, protective coating, fittings or anodes.

#### 4.3.9. Corrosion Protection of Underground Steel Storage Tanks

##### 4.3.9.1. Corrosion Protection

1) Except as provided in Sentence (2), underground steel *storage tanks* and associated piping and fitting subject to corrosion shall be protected in conformance with CAN/ULC-S603.1, "External Corrosion Protection Systems for Steel Underground Tanks for Flammable and Combustible Liquids."

2) A steel *storage tank* not conforming to Sentence (1) is permitted provided it has corrosion protection conforming to good engineering practice such as that described in PACE Report No. 87-1, "Impressed Current Method of Cathodic Protection of Underground Petroleum Storage Tanks," published by the Canadian Petroleum Products Institute.

##### 4.3.9.2. Testing

1) No person shall backfill a steel underground *storage tank* until the electrical continuity between each anode and the *storage tank* has been tested.

2) All new installations of steel underground *storage tanks* shall be tested for adequate corrosion protection after the backfill is filled to the top of the *storage tank* but before the excavation is closed in and paved over.

3) Measurements shall be taken to ensure that a *cathodic protection* voltage potential of at least 850 millivolt negative to a copper/copper sulphate reference electrode is attained.

4) A certificate shall be provided to the *owner* of the *storage tank* by the person conducting the test referred to in Sentences (2) and (3) indicating that acceptable *cathodic protection* has been achieved.

##### 4.3.9.3. Installation

1) No person shall add a new steel underground *storage tank* to an existing *storage tank system* that is protected by an impressed current *cathodic protection* system unless the tank

- a) conforms to CAN/ULC-S603, "Steel Underground Tanks for Flammable and Combustible Liquids,"
- b) is electrically bonded to the impressed current *cathodic protection* system, and
- c) has anodes to protect it.

(See Appendix A.)

2) No person shall install a *cathodically protected* steel *storage tank* near existing unprotected or sacrificial anode protected tanks or *storage tank systems* unless the new tank is

- a) electrically isolated from the existing system, and
- b) is *cathodically protected* in conformance with this Subsection.

(See Appendix A.)

#### 4.3.10. Vents for Underground Storage Tanks

##### 4.3.10.1. Vent Design

1) Underground *storage tanks* shall be provided with vent openings and piping of sufficient cross-sectional area designed to vent the tanks during the maximum filling or withdrawal rate without causing the allowable stress for the tank to be exceeded.

**4.3.10.2. Materials and Construction**

1) Except at *distilleries* covered in Section 4.10., vent piping materials and construction shall conform to Subsections 4.5.2., 4.5.3. and 4.5.5.

**4.3.10.3. Installation**

- 1) Vent pipe outlets from underground *storage tanks* for Class I liquids
  - a) shall be located outside *buildings* higher than the fill pipe openings but not less than
    - i) 3.5 m above the adjacent ground level,
    - ii) 1.5 m from any *building* opening, and
    - iii) 7.5 m from any dispenser, and
  - b) shall discharge so that flammable vapours will not enter *building* openings or be trapped near any part of the *building*.
- 2) Vent pipe outlets from underground *storage tanks* for Class II or IIIA liquids shall be located outside *buildings* at a height that is above the fill pipe opening but not less than 2 m above finished ground level.
- 3) Vent pipes from underground *storage tanks* for *flammable liquids* or *combustible liquids* shall not be obstructed by any device that may cause excessive back pressure, except that vent pipes from underground *storage tanks* for Class II or IIIA liquids are permitted to be fitted with return bends, coarse screens or other devices to minimize the entry of foreign material.
- 4) Vent piping shall enter the *storage tank* through the top of the tank and shall not extend into the tank more than 25 mm except when the vent is equipped with a vent alarm.
- 5) Vent piping shall be
  - a) installed so that any nominally horizontal run shall slope towards the *storage tank*,
  - b) constructed without traps,
  - c) adequately supported to prevent sagging, and
  - d) where necessary, protected against mechanical damage.

**4.3.10.4. Interconnection of Vent Pipes**

- 1) Except as permitted in Sentence (2), where vent piping connects 2 or more *storage tanks*, pipe sizes shall be designed to vent the combined vapours produced in the connected underground *storage tanks* without exceeding the allowable stresses of the tanks when being filled simultaneously.
- 2) Where it is not possible to fill the connected *storage tanks* referred to in Sentence (1) simultaneously, or where the connected vents have a vapour recovery system, the vent piping shall be sized to accommodate the maximum vapour flow possible in the system.
- 3) Vent piping for an underground *storage tank* containing a Class I liquid shall not be connected to the vent piping for a *storage tank* containing a Class II or IIIA liquid unless an effective method is provided to prevent the vapours from the Class I liquid *storage tank* from entering the other tank.

**4.3.11. Openings Other than Vents in Underground Storage Tanks****4.3.11.1. Connections**

1) Connections for all openings in underground *storage tanks* shall be liquid- and vapour-tight.

**4.3.11.2. Openings for Measuring Liquid Level**

1) Openings for measuring liquid levels in underground *storage tanks* if independent of the fill pipe shall be equipped with a vapour-tight cap or cover which shall be opened only when measuring the liquid level.

**4.3.11.3. Fill Piping and Discharge Piping**

- 1) Fill piping and discharge piping shall enter underground *storage tanks* only through the top of the tank and discharge piping used in suction systems shall be sloped toward the *storage tanks*.
- 2) Remote fill outlets from an underground *storage tank* shall not be located higher than other outlets from the tank.
- 3) Except as provided in Sentence (5), connections used as part of normal operating conditions for filling or emptying *storage tanks* for *flammable liquids* and *combustible liquids* shall be located
  - a) outside *buildings*,
  - b) at a location free of sources of ignition, and
  - c) not less than 1.5 m away from *building* openings.
- 4) Connections for filling or emptying *storage tanks* described in Sentence (3) shall be kept closed to prevent leakage when not in use.
- 5) A filling connection described in Sentence (3) is permitted to be located inside a *building* if
  - a) this is made necessary
    - i) by a process or activity located indoors and to which the tank is directly associated, or
    - ii) for the collection of used liquids, and
  - b) the fill piping is provided with means to prevent flammable vapours from returning to the *building*.

**4.3.12. Installation of Storage Tanks inside Buildings****4.3.12.1. Occupancy**

- 1) Except as provided in Article 4.3.12.2., *storage tanks* inside *buildings* shall
  - a) conform to Subsections 4.3.12. to 4.3.14., and
  - b) be permitted only in *industrial occupancies*.
- 2) Except as permitted by Sentence (3), rooms and *floor areas* used for the storage of *flammable liquids* in *storage tanks* inside *buildings* shall be classified as Group F, Division 1 *occupancies* in conformance with the Alberta Building Code 2006. (See Appendix A.)
- 3) Subject to Subsection 4.1.7. and Articles 4.3.5.2. and 4.3.6.4., *storage tank systems* used for the collection of used lubricating oil are permitted inside *buildings* classified as Group F, Division 2 and Division 3 *major occupancies*.

**4.3.12.2. Stationary Combustion Engines**

- 1) *Storage tank systems* using Class I liquids as fuel supplies for stationary engines inside *buildings* shall conform to this Part when the *storage tank systems* are used to supply *appliances* installed in conformance with NFPA 37, "Installation and Use of Stationary Combustion Engines and Gas Turbines."
- 2) *Storage tank systems* for Class II and IIIA liquids inside *buildings* shall conform to this Part when they are used to supply *appliances* installed in conformance with CAN/CSA-B139, "Installation Code for Oil-Burning Equipment."

**4.3.12.3. Maximum Static Head**

- 1) The static head imposed on a *storage tank* inside a *building* shall not exceed 70 kPa (gauge) at the bottom of the tank when the vent or fill pipe is filled with liquid unless the tank is designed for greater pressures.

**4.3.12.4. Maximum Quantities and Location**

- 1) Except as provided in Subsection 4.2.8. and in Sentence (2), *storage tanks* for *flammable liquids* or *combustible liquids* shall be
  - a) located in dedicated storage rooms conforming to Subsection 4.3.13., and
  - b) located in conformance with Table 4.3.12.4.

2) When quantities greater than are permitted for incidental use in Subsection 4.2.8. are required for special process operations, *storage tanks for flammable liquids or combustible liquids* are permitted to be located outside of a storage room referred to in Sentence (1), provided that

- a) total quantities per *fire compartment* are not more than one-half the quantities permitted in Table 4.3.12.4.,
- b) they are located on the *first storey*, and
- c) the installation conforms to Articles 4.3.12.7. to 4.3.12.10. and Article 4.3.13.4.

**Table 4.3.12.4.**  
**Indoor Tank Storage**  
Forming Part of Sentences 4.3.12.4.(1) and (2), and 4.3.12.6.(1)

Class of Liquid	Storage Level	Maximum Quantity per Storage Room <sup>(1)</sup> , L	
		One or More Tanks	
		Protected Storage <sup>(2)</sup>	Unprotected Storage
Class I (see Sentence 4.1.2.1.(2))	<i>First storey</i>	40 000	25 000
	<i>Storeys above the first storey</i>	7 500	Not Permitted
	<i>Basement</i>	Not Permitted	Not Permitted
Class II (Flash point at or above 37.8°C, and below 60°C) and IIIA (Flash point at or above 60°C and below 93.3°C)	<i>First storey</i>	200 000	100 000
	<i>Storeys above the first storey</i>	20 000	Not Permitted
	<i>Basement</i>	20 000	Not Permitted

**Notes to Table 4.3.12.4.:**

(1) See Subsection 4.3.13.

(2) See Article 4.2.7.6.

**4.3.12.5. Fire Compartments**

1) *Fire compartments* regulated by this Subsection shall be separated from the remainder of the *building* by a *fire separation* having a *fire-resistance rating* of not less than 2 h.

**4.3.12.6. Mixed Storage**

1) When 2 or more classes of liquids are stored in a single storage room referred to in Sentence 4.3.12.4.(1), the total quantity permitted for each class of liquid shall be calculated as follows:

$$\frac{q_I}{Q_I} + \frac{q_{II+III A}}{Q_{II+III A}} \leq 1$$

where

$q_I$  = the actual quantity of Class I liquids present,

$q_{II+III A}$  = the actual quantity of Class II and IIIA liquids present,

$Q_I$  = the maximum quantity of Class I liquids permitted in Table 4.3.12.4.,

$Q_{II+III A}$  = the maximum quantity of Class II and IIIA liquids permitted in Table 4.3.12.4.

**4.3.12.7. Storage Tanks outside Storage Rooms**

1) Where *storage tanks* for *flammable liquids* or *combustible liquids* are located outside of storage rooms conforming to Subsection 4.3.13.,

- a) provision shall be made to contain 100% of the volume of the largest *storage tank*, or to drain away spilled *flammable liquids* or *combustible liquids*, and
- b) the area in which the *storage tanks* are located shall be ventilated (see Appendix A).

**4.3.12.8. Vents**

1) Except as provided in Sentence (2), normal and emergency vents for *storage tanks* in *buildings* shall be provided in conformance with Subsections 4.3.4. and 4.3.5. (See Appendix A.)

2) The use of weak roof-to-side shell seams, designed to rupture before the allowable design stress of the *storage tank* is reached, shall not be permitted as a means of emergency venting of *storage tanks* inside *buildings*.

**4.3.12.9. Supports, Foundations and Anchorage**

1) Except as provided in Sentence (2), where *storage tanks* for *flammable liquids* or *combustible liquids* are installed inside *buildings*, the supports, foundations and anchorage for such *storage tanks* shall be in conformance with Subsection 4.3.3.

2) Where a *storage tank* is suspended, rather than supported on a foundation, supports shall be designed and installed in conformance with good engineering practice. (See Appendix A.)

**4.3.12.10. Bonding and Grounding**

1) Where *storage tanks* for *flammable liquids* or *combustible liquids* are installed inside *buildings*, tanks, piping and discharge equipment shall be bonded and grounded.

**4.3.13. Rooms for Storage Tanks****4.3.13.1. Design and Construction**

1) Rooms for *storage tanks* inside *buildings* shall be designed and constructed in accordance with the Alberta Building Code 2006.

2) Rooms described in Sentence (1) shall be used for no other purposes than the storage and handling of *flammable liquids* or *combustible liquids*.

**4.3.13.2. Clearances**

1) A minimum clear space of 550 mm shall be maintained between the walls of a room described in Article 4.3.13.1. and the sides of any *storage tanks* within the room.

**4.3.13.3. Explosion Venting**

1) Where Class IA or IB liquids are dispensed within a storage room, the room shall be designed to prevent critical structural and mechanical damage from an internal explosion in conformance with good engineering practice such as that described in NFPA 68, "Venting of Deflagrations." (See A-3.2.8.2.(1)(d) in Appendix A.)

**4.3.13.4. Hose Stations and Portable Extinguishers**

1) In *buildings* not required to be equipped with a standpipe and hose system by the Alberta Building Code 2006, hose stations shall be provided in the vicinity of the storage room, such that all parts of the room are within reach of a hose stream. (See Appendix A.)

2) Portable extinguishers for *Class B fires* shall be provided.

**4.3.13.5.****4.3.13.5. Placards**

1) Placards conforming to Article 3.2.7.14., identifying the liquids stored as *flammable liquids* or *combustible liquids* and the capacities of the *storage tanks*, shall be posted in a conspicuous location outside of the room, and that information shall be included in the fire safety plan required in Article 4.1.5.5.

**4.3.14. Openings Other than Vents in Storage Tanks in Buildings****4.3.14.1. Connections**

1) Connections for all openings in *storage tanks* in *buildings* shall be liquid- and vapour-tight.

2) Connections to *storage tanks* through which liquid can flow shall be provided with valves located as close as practicable to the tank.

**4.3.14.2. Openings for Liquid Level Measurement**

1) Openings that are independent of the fill pipe and are used for measuring the liquid level in *storage tanks* containing Class I or II liquids shall be equipped with a vapour-tight cap which shall be opened only when measuring the liquid level.

2) Openings referred to in Sentence (1) shall be protected against overflow and vapour pressure by means of a spring-loaded check valve.

**4.3.15. Out of Service****4.3.15.1. Underground Storage Tanks**

1) When underground *storage tanks* will be out of service for a period not exceeding 180 days

- a) the liquid level in the *storage tank* shall be measured at intervals not greater than one month and a record of the measurements shall be retained in conformance with Article 2.2.1.2. of Division C,
- b) fill pipe covers and covers over openings to measure liquid levels, dispensers and power controls shall be kept locked when not in use, and
- c) vent piping shall be kept open.

2) Except as provided in Sentence (3), when underground *storage tanks* will be out of service for a period exceeding 180 days

- a) the *authority having jurisdiction* shall be notified, in writing, as soon as practicable,
- b) the *storage tanks*, connected piping and dispensers shall be emptied of Class I liquid,
- c) the *storage tanks*, piping and dispensers shall be refilled with a Class II or IIIA liquid, or not less than 1 kg of dry ice for each 500 L of tank capacity shall be added to the *storage tank*,
- d) measurements of the liquid level of each *storage tank* containing a Class II or IIIA liquid shall be made at intervals not greater than one month, and a record of the measurements shall be retained in conformance with Article 2.2.1.2. of Division C, and
- e) fill pipe covers and covers over openings to measure liquid levels, dispensers and power controls shall be locked.

- 3) Where underground *storage tank* facilities are operated on a seasonal basis,
  - a) at the close of each season of operation,
    - i) the liquid level of each *storage tank* shall be measured,
    - ii) a record of the measurements shall be retained in conformance with Article 2.2.1.2. of Division C, and
    - iii) all fill pipe covers and covers over openings for measuring liquid levels, dispensers and power controls shall be locked, and
  - b) before the start of an operating season,
    - i) the liquid level in each *storage tank* shall be measured,
    - ii) the measurements shall be compared with those recorded at the close of the previous season, and
    - iii) when a loss of liquid or water intrusion is apparent, immediate action shall be taken to determine and correct the condition.

4) When an underground *storage tank* is to be reused for the storage of *flammable liquids* or *combustible liquids*, the *authority having jurisdiction* shall be notified.

5) If an underground *storage tank* has been out of service for more than 12 months, the *storage tank* and piping shall be tested for leakage in conformance with Section 4.4.

#### 4.3.15.2. Aboveground Storage Tanks

1) When an aboveground *storage tank* will be out of service or unsupervised for a period not exceeding 180 days, the piping from the *storage tank* shall be capped or the valves that are necessary to achieve similar isolation of the *storage tank* shall be closed and securely locked.

2) When an out-of-service *storage tank* referred to in Sentence (1) contains *flammable liquids* or *combustible liquids*, the liquid level in the *storage tank* shall be measured and the readings compared at intervals not greater than one month.

3) If an aboveground *storage tank* will be out of service for a period exceeding 180 days,

- a) all liquid and vapours shall be removed from the *storage tank* and its connected piping, and
- b) the *storage tank* markings shall clearly indicate that the *storage tank* is empty.

4) Aboveground *storage tanks* that have been out of service for a period of more than 180 days and are to be returned to service shall, where possible, be internally inspected and the *authority having jurisdiction* shall be advised of the inspection results and the intention to return the *storage tanks* to service.

#### 4.3.15.3. Disposal

1) Where *storage tanks* are to be permanently disposed of, sufficient openings shall be cut in the *storage tank* to render it unfit for further use. (See Appendix A.)

#### 4.3.15.4. Corrosion Protection

1) Corrosion protection systems shall be maintained in operating condition when a *storage tank* is temporarily out of service and during seasonal shutdowns.

### 4.3.16. Removal and Abandonment in Place of Underground Storage Tanks

#### 4.3.16.1. Removal

1) Except as permitted in Article 4.3.16.2., when an *underground storage tank system* has no further use or has been out of service for 2 years

- a) the *owner* shall notify the *authority having jurisdiction* in writing at least 30 days before the removal of an *underground storage tank system*,
- b) *storage tanks* shall have all *flammable liquids* and *combustible liquids* removed from them,

- c) *storage tanks* shall be purged of vapours and removed from the ground (see Appendix A), and
- d) the associated piping shall be
  - i) purged of vapours and the ends permanently sealed by capping or plugging, or
  - ii) removed from the ground.

- 2)** If soil surrounding the *storage tanks* described in Sentence (1) is found to be contaminated, the *owner* shall
- a) notify the *authority having jurisdiction*,
  - b) when requested, provide a report showing the extent of the site soil contamination, and
  - c) remove, treat or replace the contaminated soil in a manner acceptable to the *authority having jurisdiction*. (See A-4.1.6.3. in Appendix A.)

#### 4.3.16.2. Abandonment in Place

- 1)** If it is impracticable to remove an underground *storage tank*, the *owner* shall apply to the *authority having jurisdiction* for permission to abandon the *storage tank* in place.

- 2)** An *owner* who makes application for permission to abandon a *storage tank* in place in accordance with Sentence (1) shall
- a) describe in the application, the reasons why it is impracticable to remove the *storage tank* and provide other information that supports the application,
  - b) satisfy the *authority having jurisdiction* that the soil under and around the *storage tank* has not been contaminated with petroleum product, and
  - c) provide confirmation that the *owner* of the property is aware of the application and agrees with the plan to abandon the *storage tank* in place.

- 3)** The *owner* may be granted permission to abandon the *storage tank* in place if the *authority having jurisdiction* is satisfied that the *storage tank* is
- a) located in whole or in part beneath a permanent *building* or other facility making excavation impracticable,
  - b) of a size or type of construction that makes excavation impracticable,
  - c) inaccessible to the heavy equipment necessary for removal of the *storage tank*, or
  - d) situated so that removal of the *storage tank* would endanger the structural integrity of nearby *buildings* or other facilities.

- 4)** If the *authority having jurisdiction* grants permission to abandon a *storage tank* in place in accordance with Sentence (3), the *owner* shall be notified in writing.

- 5)** If the *authority having jurisdiction* grants permission to abandon a *storage tank* in place in accordance with Sentence (3), the *owner* shall
- a) purge the *storage tank* of vapours to less than 10% of the lower explosive limit,
  - b) check for the presence of vapours using combustible gas detection equipment,
  - c) arrange for a certified person to enter the *storage tank* and conduct an internal inspection of the *storage tank* for perforations,
  - d) notify the *authority having jurisdiction* if the *storage tank* is perforated,
  - e) conduct additional investigations or take remedial actions in accordance with directions issued by the *authority having jurisdiction*,
  - f) remove sludge from the *storage tank* and dispose of it in a manner acceptable to the *authority having jurisdiction*,
  - g) make holes along the top of the *storage tank* large enough to permit filling the *storage tank* with inert material,
  - h) fill the *storage tank* with sand, gravel, concrete or other inert material acceptable to the *authority having jurisdiction*, and
  - i) remove associated piping from service in conformance with Clause 4.3.16.1.(1)(d).

6) If it is considered impracticable to carry out the internal inspection required by Clause (5)(c), the *owner* shall conduct precision leak tests if so directed by the *authority having jurisdiction*. (See Section 4.4.)

## Section 4.4. Leak Detection of Storage Tanks and Piping Systems

### 4.4.1. General

#### 4.4.1.1. Application

1) Except as provided in Sentence (2) and except as otherwise specified in this Code, this Section provides the minimum requirements regarding the detection of leaks in aboveground and underground *storage tanks*, piping systems and sumps.

2) This Section shall not apply to *storage tanks* that have been taken out of service in compliance with the applicable provisions of Subsections 4.3.15. and 4.3.16.

#### 4.4.1.2. Frequency and Methods of Leak Detection Testing and Monitoring

1) Every *storage tank*, piping system and sump, including those at *fuel-dispensing stations*, shall be tested and monitored for leaks in conformance with Tables 4.4.1.2.A. to 4.4.1.2.E., which establish the minimum requirements regarding the frequency and methods to be used for

- a) commissioning testing,
- b) subsequent in-service monitoring, and
- c) testing when a leak is suspected.

2) The methods referred to in Sentence (1) shall conform to Subsections 4.4.2. to 4.4.4.

3) The commissioning testing referred to in Sentence (1) shall be performed at the time of installation

- a) once backfill and surfacing have been completed but before being put into service, in the case of an underground *storage tank* or underground piping system,
- b) before being put into service, in the case of an aboveground *storage tank* or exposed piping system, and
- c) once the final surface materials have been installed but before being put into service, in the case of a sump.

4) The frequency of the in-service monitoring referred to in Sentence (1) shall be calculated from the date of the commissioning test.

5) Immediate action shall be taken when a leak is suspected and the leak detection testing referred to in Sentence (1) shall be performed if

- a) a loss of liquid or a gain of water is indicated by any of the leak detection measures described in this Section, or
- b) the level of water at the bottom of an underground *storage tank* exceeds 50 mm.

6) The minimum requirements referred to in Sentence (1) shall not preclude the appropriate use of alternative solutions, innovative new technologies, or methods capable of achieving the same objectives. (See Appendix A.)

**Table 4.4.1.2.A.**  
**Leak Detection Testing and Monitoring of Underground Storage Tanks**  
 Forming Part of Sentence 4.4.1.2.(1)

Type of Containment	Commissioning Test	In-Service Monitoring		Leak Suspected
		Continuous	Periodic	
Single-walled <sup>(1)</sup>	Precision Leak Detection Test	Inventory Reconciliation	Precision Leak Detection Test every 2 years	Precision Leak Detection Test
		Inventory Reconciliation and Monitoring Wells	Precision Leak Detection Test every 5 years	
		Statistical Inventory Reconciliation (SIR)		
		Automatic Tank Gauge	None required	
Continuous In-Tank Leak Detection				
Double-walled <sup>(2)</sup>	Precision Leak Detection Test or Secondary Containment Test <sup>(3)</sup>	Secondary Containment Monitoring	None required	Precision Leak Detection Test or Secondary Containment Test <sup>(3)</sup>

**Notes to Table 4.4.1.2.A.:**

- (1) Applies to single-walled tanks of typical construction, including *storage tanks* that do not meet the requirements for double-walled tanks.  
 (2) Applies to double-walled tanks, which have an interstitial space that allows for monitoring using high- or low-tech methods.  
 (3) The Secondary Containment Test is capable of detecting leaks in the interstitial space of the tank. Risers, connections and vents are also susceptible to leakage and must therefore also be tested.

**Table 4.4.1.2.B.**  
**Leak Detection Testing and Monitoring of Aboveground Storage Tanks**  
 Forming Part of Sentence 4.4.1.2.(1)

Type of Containment <sup>(1)</sup>	Commissioning Test	In-Service Monitoring		Leak Suspected
		Continuous	Periodic	
Contained open <sup>(2)</sup> vertical tank	Visual inspection <sup>(3)</sup> during Liquid Media Test	Inventory Reconciliation and Secondary Containment Monitoring	API 653 or Tank floor inspection every 10 years	API 653 or Tank floor inspection
Contained open <sup>(2)</sup> horizontal tank	Visual inspection <sup>(3)</sup> during Liquid Media Test		None required	Visual inspection <sup>(3)</sup>
Double-walled <sup>(4)</sup>	Visual inspection <sup>(3)</sup>	Secondary Containment Monitoring	None required	Secondary Containment Monitoring

**Notes to Table 4.4.1.2.B.:**

- (1) See Subsection 4.3.7.  
 (2) Applies to tanks contained in an open arrangement that do not meet the requirements for double-walled tanks and do not conform to Subsection 4.3.7.  
 (3) Visual leak detection may apply to single- or double-walled *storage tanks* and piping. See Sentence 4.4.2.1.(8).  
 (4) Applies to double-walled tanks, which have an interstitial space that allows for monitoring using high- or low-tech methods.

**Table 4.4.1.2.C.**  
**Leak Detection Testing and Monitoring of Underground Piping Systems**  
 Forming Part of Sentence 4.4.1.2.(1)

Type of Containment	Commissioning Test	In-Service Monitoring		Leak Suspected
		Continuous	Periodic	
Single-walled <sup>(1)</sup>	Pipe Leak Detection Test	Inventory Reconciliation	Pipe Leak Detection Test every 2 years	Pipe Leak Detection Test
		Inventory Reconciliation and Monitoring Wells	Pipe Leak Detection Test every 5 years	
		SIR		
		Single Vertical Check Valve <sup>(2)</sup>	None required	
		Automatic Tank Gauge		
Continuous In-Tank Leak Detection				
Single-walled, buried mechanical threaded connections <sup>(3)</sup>	Pipe Leak Detection Test	Pipe Leak Detection and Inventory Reconciliation	None required	Pipe Leak Detection Test
		Single Vertical Check Valve <sup>(2)</sup>	Pipe Leak Detection Test every 12 months	
Double-walled <sup>(4)</sup>	Pipe Leak Detection Test or Secondary Containment Test <sup>(5)</sup>	Secondary Containment Monitoring or Pipe Leak Detection <sup>(6)</sup>	None required	Pipe Leak Detection Test or Secondary Containment Test <sup>(5)</sup>

**Notes to Table 4.4.1.2.C.:**

- (1) Applies to single-walled piping systems of typical construction, including piping systems that do not meet the requirements for double-walled piping systems.
- (2) Applies to suction line only.
- (3) See Article 4.5.5.6.
- (4) Applies to double-walled piping systems, which have an interstitial space that allows for monitoring using high- or low-tech methods. Monitoring in a sump can be done in accordance with Table 4.4.1.2.E.
- (5) The Secondary Containment Test is capable of detecting leaks in the interstitial space of pipes. Risers, connections and vents are also susceptible to leakage and must therefore also be tested.
- (6) Applies to pressure line only.

**Table 4.4.1.2.D.**  
**Leak Detection Testing and Monitoring of Exposed Piping Systems**  
 Forming Part of Sentence 4.4.1.2.(1)

Type of Containment	Commissioning Test	In-Service Monitoring		Leak Suspected
		Continuous	Periodic	
Single-walled <sup>(1)</sup>	Pipe Leak Detection Test	Visual inspection	None required	Identify and repair
Flexible hose lines over water			Pipe Leak Detection Test every 12 months	
Double-walled <sup>(2)</sup>	Pipe Leak Detection Test	Secondary Containment Monitoring	None required	Pipe Leak Detection Test
Contained open <sup>(3)</sup>		Visual inspection	None required	Identify and repair

**Notes to Table 4.4.1.2.D.:**

- (1) Applies to single-walled piping systems of typical construction, including piping systems that do not meet the requirements for double-walled or contained open piping systems.

Table 4.4.1.2.D. (Continued)

- (2) Applies to double-walled piping systems with an interstitial space contiguous to the primary containment that can be monitored using high- or low-tech methods.
- (3) Applies to piping systems contained in an open arrangement that do not meet the requirements for double-walled piping systems and do not conform to Subsection 4.3.7.

**Table 4.4.1.2.E.**  
**Leak Detection Testing and Monitoring of Turbine, Transition, Pump and Dispenser Sumps**  
 Forming Part of Sentence 4.4.1.2.(1)

Commissioning Test	Periodic In-Service Monitoring	Leak Suspected
Static Liquid Media Leak Detection Test <sup>(1)</sup>	Visual inspection every 12 months	Identify and repair

**Notes to Table 4.4.1.2.E.:**

- (1) See Article 4.4.3.6.

**4.4.1.3. Remedial Action**

- 1)** When a leak detection test required by this Section detects a leak in a *storage tank*, piping system or sump,
- a) the leaking components or system shall be
    - i) repaired and tested,
    - ii) replaced, or
    - iii) removed, and
  - b) the escaped liquid shall be removed in conformance with Subsection 4.1.6.

**4.4.1.4. Retention of Records**

- 1)** Records of the tests referred to in this Section shall be retained in conformance with Article 2.2.1.2. of Division C.

**4.4.2. Leak Detection Testing and Monitoring Methods****4.4.2.1. Definition and Performance of Leak Detection Testing and Monitoring Methods**

- 1)** This Subsection applies to the leak detection testing and monitoring methods referred to in this Section.
- 2)** Inventory reconciliation referred to in this Section
- a) shall follow the procedures established in the United States Environmental Protection Agency (EPA) pamphlet, EPA 510-B-93-004, "Doing Inventory Control Right for Underground Storage Tanks," which also allows calculations for the inventory reconciliation procedure to be completed using an electronic methodology referred to as automatic tank gauging, and
  - b) shall conform to Article 4.4.4.1.
- 3)** The use of monitoring wells shall follow the procedures established in the CCME document, "Environmental Code of Practice for Aboveground and Underground Storage Tank Systems Containing Petroleum Products and Allied Petroleum Products." (See Appendix A.)
- 4)** Statistical inventory reconciliation (SIR) methodology shall follow the procedures established in the EPA documents, EPA 530/UST-90/007, "Evaluating Leak Detection Methods: Statistical Inventory Reconciliation Methods (SIR)," and EPA 510-B-95-009, "Introduction to Statistical Inventory Reconciliation: For Underground Storage Tanks." (See A-4.4.4.1. in Appendix A.)

- 5) Where inventory reconciliation is performed using automatic tank gauging referred to in Clause (2)(a), the equipment shall conform to
- ULC/ORD-C58.12, "Leak Detection Devices (Volumetric Type) for Underground Flammable Liquid Storage Tanks," or
  - ULC/ORD-C58.14, "Non-Volumetric Leak Detection Devices for Underground Flammable Liquid Storage Tanks."
- 6) A continuous in-tank leak detection system shall conform to good engineering practice and meet the requirements of a precision leak detection test. (See Appendix A.)
- 7) High-tech *secondary containment* monitoring referred to in this Section shall include the use of an automatic device that
- conforms to Clause (5)(a) or (b), and
  - continuously monitors the interstitial space between the inner tank or inner piping and the *secondary containment*.
- (See Sentence 4.3.7.7.(1).) (See Appendix A for low-tech method.)
- 8) Visual inspection referred to in this Section shall,
- in the case of an exposed piping system, conform to Article 4.5.10.5., and
  - in the case of an aboveground *storage tank*, consist of
    - a visual examination of the tank shell, or
    - if the bottom of the tank is not amenable to a visual examination, testing the bottom of the tank (see Appendix A).
- 9) A static liquid media leak detection test shall conform to Article 4.4.3.6.
- 10) The precision leak detection test for underground *storage tanks* that is referred to in this Section shall
- be capable of detecting a tank leak rate as small as 0.38 L/h within 24 h with a probability of detection of 0.95 or greater and a probability of false alarm of 0.05 or less,
  - conform to the performance requirements of
    - ULC/ORD-C58.12, "Leak Detection Devices (Volumetric Type) for Underground Flammable Liquid Storage Tanks," or
    - ULC/ORD-C58.14, "Non-Volumetric Leak Detection Devices for Underground Flammable Liquid Storage Tanks" (see Appendix A), and
  - be conducted by an individual who has been trained in the proper care and use of the test equipment and the operating procedures.
- (See Appendix A and also Sentences 4.4.3.1.(2) and (3).)
- 11) Pipe leak detection referred to in this Section shall conform to ULC/ORD-C107.12, "Line Leak Detection Devices for Flammable Liquid Piping." (See also Articles 4.4.3.4. and 4.4.3.5.)
- 12) A single vertical check valve referred to in this Section shall
- consist of a vertical check valve located immediately under the pump,
  - be installed with no other check valve between the suction pump and the *storage tank*, and
  - be part of an installation where lines must be sufficiently sloped so that any liquid in the line will drain back into the *storage tank* should a leak occur in the piping system.
- (See Appendix A.)

### 4.4.3. Leak Detection Testing of Storage Tanks, Piping Systems and Sumps

#### 4.4.3.1. Leak Detection Tests

- 1) Where field test methods are included in the tank construction standards referred to in Articles 4.3.1.2. and 4.3.1.3., such tests shall be permitted for *storage tanks* conforming to those standards.

2) If a precision leak detection test referred to in Sentence 4.4.2.1.(10) detects a leak rate exceeding 0.38 L/h on an underground *storage tank*, the tank shall be considered to be leaking.

3) During a leak detection test on a *storage tank*, the pressure at the bottom of the tank shall not exceed the tank manufacturer's specifications.

#### 4.4.3.2. Pneumatic Leak Detection Tests

1) Pneumatic leak detection tests using compressed air shall not be performed on *storage tanks* and piping systems having once contained *flammable liquids* or *combustible liquids*.

2) Except as provided in Sentence (1), pneumatic leak detection tests using compressed air or an inert gas shall include the application of soap and water to the tank and piping surface, fittings, joints and connections to help in the detection of leaks.

3) In the case of underground *storage tanks* or piping, the test referred to in Sentence (2) shall be conducted prior to covering the tank or piping system.

4) Pneumatic leak detection tests shall not be performed on field-erected aboveground *storage tanks*.

#### 4.4.3.3. Protocols for Pneumatic Leak Detection Testing of Storage Tanks

1) Where a pneumatic leak detection test is performed on a *storage tank*, the tank shall be considered to be leaking if the test indicates a pressure drop within 2 h of establishing steady temperature conditions and removing the source of pressure.

2) Pressure applied to underground *storage tanks* during a pneumatic leak detection test shall be measured by an instrument calibrated in increments of not more than 1 kPa.

3) Where a pneumatic leak detection test is conducted before an underground *storage tank* is backfilled, in the case of a new tank, or after the tank is uncovered, in the case of a previously installed tank, the test pressure shall be in conformance with the production testing requirements of

- a) ULC-S603, "Steel Underground Tanks for Flammable and Combustible Liquids," or
- b) ULC-S615, "Reinforced Plastic Underground Tanks for Flammable and Combustible Liquids."

4) Where a pneumatic leak detection test is performed on a completely buried *storage tank*, the test pressure shall not be less than 35 kPa (gauge) and shall not exceed the tank manufacturer's specifications.

5) Measures shall be taken to guard against the hazards associated with pneumatic leak detection testing in areas where explosive mixtures of *flammable liquid* or *combustible liquid* vapours and air may be present in the vicinity of a *storage tank* that has been in use.

#### 4.4.3.4. Protocols for Pneumatic Leak Detection Testing of Piping Systems

1) A pressure decline test using an inert gas is permitted to be used as a leak detection test for piping systems that

- a) are new or in use, and
- b) convey a volume of less than 1 000 L.

2) A pressure decline test performed on a piping system shall conform to Sentences (3) to (9).

3) The design and installation of the piping system permitting, the piping system's contents shall be drained prior to conducting the pressure decline test procedure.

4) Pumps, dispensers and other auxiliary equipment that are connected to the piping system and cannot withstand the pressure of the test shall be isolated from the test procedure to prevent damage to the equipment.

5) A stabilization period of up to 30 min is required after pressurization.

- 6) Pipe volumes of 500 L or less shall be pressurized for at least 60 min after stabilization.
- 7) Pipe volumes greater than 500 L but less than 1 000 L shall be pressurized for at least 2 h after stabilization.
- 8) Test pressures shall
  - a) be the greater of 350 kPa (gauge) or 1.5 times the maximum operating pressure, and
  - b) not exceed the piping manufacturer's test specifications.
- 9) The piping system shall be considered to be leaking if any pressure decline is detected within the time periods stated.

#### 4.4.3.5. Protocols for Liquid Media Leak Detection Testing of Piping Systems

- 1) Liquid media leak detection testing of piping systems shall conform to Sentences (2) to (9).
- 2) Test devices and methods shall conform to the performance requirements of ULC/ORD-C107.12, "Line Leak Detection Devices for Flammable Liquid Piping."
- 3) Tests shall be conducted by an individual who has been trained in the proper use of the test device and the operating procedures.
- 4) A sufficient amount of time shall be allocated to stabilize the temperature of the liquid throughout the volume of the piping during the test.
- 5) Except as provided in Sentences (6) and (7), test pressure shall
  - a) be the greater of 350 kPa (gauge) or 1.5 times the maximum operating pressure, and
  - b) not exceed the piping manufacturer's test specifications.
- 6) Test pressures exceeding 700 kPa (gauge) shall not be permitted unless the piping system is designed for such pressures.
- 7) Where test pressures exceed the design pressures for pumps or similar components connected to the piping system being tested, such pumps or components shall be isolated from the test procedure.
- 8) Class I liquids shall not be used for pressure testing piping systems, except that pressure piping normally containing Class I liquids is permitted to be tested with such liquids at pressures not exceeding their maximum operating pressures.
- 9) The pipe shall be considered to be leaking if the leak rate exceeds 0.38 L/h.

#### 4.4.3.6. Protocols for Leak Detection Testing of Sumps

- 1) Static liquid media leak detection testing of turbine, transition, dispenser and pump sumps shall conform to Sentences (2) to (4).
- 2) The liquid used for the test shall
  - a) exceed the elevation of the piping and other points of entry into the sump, and
  - b) not be a *flammable liquid* or a *combustible liquid*.
- 3) The minimum duration of the test shall be 1 h.
- 4) The sumps referred to in Sentence (1) shall be considered to be leaking if the loss of liquid in the sump is measurable.

## 4.4.4.1.

**4.4.4. Leak Detection Monitoring of Storage Tanks and Piping Systems****4.4.4.1. Inventory Reconciliation**

(See Appendix A.)

**1)** Where inventory reconciliation is required by this Section, the liquid level in any *storage tank* shall be measured at intervals not greater than 7 days in conformance with Sentences (2) to (4), except that at *fuel-dispensing stations* the measurements shall be taken each day the station is in operation.

**2)** The level of water at the bottom of an underground *storage tank* shall be measured at intervals not greater than 7 days, except that at *fuel-dispensing stations* the measurements shall be taken each day the station is in operation.

**3)** A comparison of the measurements described in Sentences (1) and (2) with meter readings and a computation of any gain or loss of liquid shall be done each time a required measurement is taken.

**4)** A record of the measurements for each *storage tank* and of the computations described in Sentence (3) shall be retained, in conformance with Article 2.2.1.2. of Division C.

**5)** When required by the *authority having jurisdiction* the record referred to in Sentence (4) shall be the subject of an audit performed in a manner acceptable to the *authority having jurisdiction*.

**4.4.4.2. Leakage Detection**

**1)** Where continuous leak detection is provided on an underground piping system, it shall conform to ULC/ORD-C107.12, "Line Leak Detection Devices for Flammable Liquid Piping."

**Section 4.5. Piping and Transfer Systems****4.5.1. Scope****4.5.1.1. Application**

**1)** This Section applies to piping and transfer systems for *flammable liquids* and *combustible liquids*.

**2)** Except where otherwise stated in this Part, this Section shall not apply to the following:

- a) tubing or casings and piping for oil or gas wells,
- b) transmission pipelines,
- c) piping for vehicles, aircraft, watercraft and portable or stationary engines,
- d) piping systems in *fuel-dispensing stations* and *distilleries*, and
- e) piping that falls within the scope of boiler and *pressure vessel* regulations made pursuant to the Safety Codes Act.

**4.5.2. Materials for Piping, Valves and Fittings****4.5.2.1. Materials**

**1)** Materials for piping systems containing *flammable liquids* or *combustible liquids* shall be suitable for the maximum anticipated working pressures and operating temperatures and for the chemical properties of the contained liquid.

2) Except as provided in Sentence (3), the use of the following materials for piping systems referred to in Sentence (1) shall not be permitted:

- a) materials that are subject to failure from internal stress or rupture by mechanical damage, or
- b) combustible or low-melting-point materials that are subject to failure even in moderate fires.

3) Non-metallic piping systems are permitted to be used for underground installations provided they conform to ULC/ORD-C971, "Nonmetallic Underground Piping for Flammable and Combustible Liquids."

4) Except as provided in Sentence (5), where steel piping is used, it shall conform to

- a) API 5L, "Line Pipe,"
- b) ASTM A 53/A 53M, "Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless," or
- c) CSA Z245.1, "Steel Pipe."

5) Where service pressures exceeding 875 kPa (gauge) may occur, piping and fittings shall be designed in conformance with ANSI/ASME B31.3, "Process Piping."

6) Underground piping systems shall include piping in tank sumps, transition sumps and dispenser sumps.

#### 4.5.2.2. Special Materials

1) Where problems of corrosion, contamination, or sanitation or standards of purity require special materials, it is permitted to use non-metallic materials for piping, valves and fittings in conformance with Clause 1.2.1.1.(1)(b) of Division A.

### 4.5.3. Corrosion Protection of Piping Systems

#### 4.5.3.1. Corrosion Protection

1) Except as provided in Sentence (2), all exposed or underground piping, valves, couplings, flanges and bolts that are fabricated of any ferrous substance shall be thoroughly coated with a rust-resistant compatible material.

2) Underground steel piping, valves and fittings that are in contact with the soil or groundwater shall be protected against corrosion in conformance with

- a) CAN/ULC-S603.1, "External Corrosion Protection Systems for Steel Underground Tanks for Flammable and Combustible Liquids," or
- b) good engineering practice, such as described in PACE Report No. 87-1, "Impressed Current Method of Cathodic Protection of Underground Petroleum Storage Tanks," published by the Canadian Petroleum Products Institute.

### 4.5.4. Identification of Piping Systems

#### 4.5.4.1. Identification

1) Pipelines for *flammable liquids* or *combustible liquids* shall be marked with the contents of the line, and these markings shall be maintained in a clearly legible form.

2) Piping for *flammable liquids* or *combustible liquids* shall not be painted red.

3) Transfer points in piping systems for *flammable liquids* and *combustible liquids* shall be identified in conformance with CPPI, "Using the CPPI Colour-Symbol System to Mark Equipment and Vehicles for Product Identification."

#### 4.5.4.2. Documentation

1) Documentation on the piping systems for *flammable liquids* or *combustible liquids*, including the tank and pumping arrangements, shall be made available to the fire department upon request.

## 4.5.5.1.

2) Documents referred to in Sentence (1) shall be kept at 2 separate locations so that one copy remains readily available in the event the other is inaccessible due to fire.

## 4.5.5. Joints in Piping Systems

## 4.5.5.1. Threaded Joints

1) Threaded joints in piping systems for *flammable liquids* or *combustible liquids* shall be made using joint compound or polytetrafluoroethylene tape conforming to CAN/ULC-S642-M, "Compounds and Tapes for Threaded Pipe Joints."

## 4.5.5.2. Welded Piping

1) Welding of piping for *flammable liquids* or *combustible liquids* shall conform to Section 5.2. and the appropriate requirements of

- a) the Occupational Health and Safety Act and its Regulations, and
- b) API 1104, "Welding of Pipelines and Related Facilities."

2) Flanged joints for piping shall be provided in welded systems at intervals that will facilitate dismantling and avoid subsequent in-place cutting and welding operations.

## 4.5.5.3. Flanged Joints

1) Except as permitted in Sentence (2), flanged joints for piping shall be made with forged or cast steel flanges designed, constructed and installed in conformance with ANSI/ASME B16.5, "Pipe Flanges and Flanged Fittings NPS 1/2 Through NPS 24."

2) Bronze flanges for 50 mm diameter or smaller size piping referred to in Article 4.5.5.2. are permitted to be used where copper and brass piping is permitted.

## 4.5.5.4. Bolting Materials

1) Bolting materials for flanged connections in steel piping systems for *flammable liquids* or *combustible liquids* shall be of alloy steel equivalent to ASTM A 193/A 193M, "Alloy-Steel and Stainless Steel Bolting Materials for High-Temperature Service," Grade B-7.

## 4.5.5.5. Gaskets

1) Gaskets in flanged connections shall be of a material resistant to the liquid being carried and capable of withstanding temperatures of 650°C and above without damage.

## 4.5.5.6. Mechanical Connections

1) Where underground piping systems have no *secondary containment*, mechanical connections shall

- a) be readily accessible for inspection and maintenance, and
- b) not be in direct contact with the soil.

## 4.5.6. Location and Arrangement of Piping

## 4.5.6.1. Location

1) Piping shall be installed outdoors whenever possible and located so it will not create a hazard to *buildings* or equipment.

2) Where piping for *flammable liquids* or *combustible liquids* is installed within a *building*, the length of piping shall be as direct and as short as practicable.

3) It is not permitted to use any portion of a piping system in a manner that could damage it or for any purpose other than the transfer of product.

4) Vent piping and connections for filling and emptying *storage tanks* shall be located in conformance with Section 4.3.

**4.5.6.2. Supports for Aboveground Outdoor Piping**

- 1) Aboveground outdoor piping shall be supported and arranged to prevent excessive vibration and stress on equipment connected to it.
- 2) Where vehicular, watercraft or aircraft impact or physical damage is possible, protective guarding devices shall be provided for aboveground outdoor piping.
- 3) Aboveground piping systems shall be supported such that they are not in direct contact with the surface of the ground.

**4.5.6.3. Arrangement of Aboveground Outdoor Piping**

- 1) Aboveground outdoor piping shall not be located
  - a) on the exterior of walls except on those of *noncombustible construction*, or
  - b) above windows.
- 2) Aboveground outdoor piping shall not be located above roofs except above roofs of impermeable and *noncombustible construction*, with provision for accidental spillage provided in conformance with Subsection 4.1.6.
- 3) Where aboveground piping crosses roadways or railway sidings, ample overhead clearance and warning signs indicating the clearance height shall be provided.
- 4) Piping passing through the *secondary containment* walls of an aboveground *storage tank* shall be designed to prevent excessive stress resulting from settlement or fire exposure.

**4.5.6.4. Underground Piping**

- 1) Underground piping shall be located so it will not be damaged as a result of vibrations or settling of an adjacent *building* or structure.
- 2) Underground piping shall be located not less than 300 mm away from the foundations of any *building* or structure, except where such piping enters the *building* as permitted in Article 4.5.6.7.
- 3) Piping passing under railway tracks shall be installed in conformance with "Standards Respecting Pipeline Crossings Under Railways," published by Transport Canada.
- 4) Piping adjacent to railway tracks shall be installed in conformance with General Order No. O-32, "Flammable Liquids Bulk Storage Regulations," published by Transport Canada.

**4.5.6.5. Installation of Underground Piping**

- 1) Underground piping shall be
  - a) supported on
    - i) undisturbed or compacted soil, or
    - ii) not less than 150 mm of clean sand, pea gravel or clean crushed stone, and
  - b) backfilled on the top and sides with not less than
    - i) 300 mm of pea gravel or clean crushed stone, or
    - ii) 300 mm of clean sand, free of cinders and stones, and compacted in layers not more than 300 mm thick.
- 2) The location of underground piping shall be assigned a site sensitivity classification in accordance with Sentences (3) and (4) by the *authority having jurisdiction*.
- 3) The site sensitivity classification shall be Class A where the underground piping is located within
  - a) 500 m of wells or other locations where underground water is being used,
  - b) 200 m of a lake, river or other body of water,
  - c) 150 m of a major underground structure, or
  - d) a municipality that has been deemed to require protection from hydrocarbon spills.

## 4.5.6.6.

- 4) The site sensitivity classification shall be Class B if the site does not meet the criteria for Class A sites described in Sentence (3).
- 5) Underground piping installed at a location that has a site sensitivity classification of Class A shall have
  - a) a means of *secondary containment* provided (see A-4.3.8.1.(6)(b) in Appendix A), and
  - b) a line leak detection device installed on pressurized or suction piping systems (see A-4.3.8.1.(6)(f) in Appendix A).
- 6) Underground piping installed at a location that has a site sensitivity classification of Class B shall have a line leak detection device installed on pressurized or suction piping systems. (See A-4.3.8.1.(6)(f) in Appendix A.)

## 4.5.6.6. Piping in Service Tunnels

- 1) Piping for *flammable liquids* or *combustible liquids* shall not be located in service tunnels that are used for pedestrian traffic other than maintenance personnel.

## 4.5.6.7. Piping at Entrances to Buildings

- 1) Piping for *flammable liquids* or *combustible liquids* shall be located aboveground where the piping enters a *building*.
- 2) Piping referred to in Sentence (1) shall be provided with inside and outside shut-off valves.
- 3) Where piping referred to in Sentence (1) passes through a wall that would restrict the expansion or contraction of the piping, pipe sleeves shall be provided at the wall penetration to facilitate such movement.

## 4.5.6.8. Indoor Piping

- 1) Indoor piping for *flammable liquids* or *combustible liquids* shall either be supported overhead or be located in trenches conforming to Article 4.5.6.9.
- 2) Piping referred to in Sentence (1) shall not be installed under combustible flooring.

## 4.5.6.9. Piping in Trenches

- 1) Where indoor piping for *flammable liquids* or *combustible liquids* is installed in trenches, a trapped drainage system shall be provided.
- 2) When piping referred to in Sentence (1) contains Class I liquids, the trench shall be
  - a) provided with positive ventilation to the outdoors, or
  - b) designed to prevent the accumulation of flammable vapours.

## 4.5.6.10. Overhead Piping

- 1) Overhead piping for *flammable liquids* or *combustible liquids* shall be installed close to the ceiling or beams or along walls not less than 1.8 m above the floor to protect it against mechanical damage.
- 2) Where practicable, overhead piping referred to in Sentence (1) shall be supported from *building* framing members.
- 3) In *buildings* of steel frame construction, piping referred to in Sentence (1) shall be fastened to steel beams or columns by pipe hangers attached to the flanges.
- 4) Piping under concrete ceilings shall be suspended with the use of through bolts or expansion shields.

## 4.5.6.11. Supports for Overhead Piping

- 1) Piping shall be supported on pipe hangers or other supports so that allowable stresses in the pipe are not exceeded. (See Appendix A.)

2) Anchors of the expansion shield type used to suspend piping shall not be used to suspend piping from unsound or lightweight concrete or from gypsum assemblies.

#### 4.5.6.12. Protection of Pipe Risers

- 1) Exposed pipe risers shall be protected against mechanical damage by
  - a) installing such risers
    - i) adjacent to walls or pilasters,
    - ii) between flanges of steel columns, or
    - iii) within securely anchored larger perforated pipe, and
  - b) providing mechanical guards where the risers are exposed to mobile equipment.

#### 4.5.6.13. Provision for Expansion and Contraction

1) In the design of piping systems for *flammable liquids* or *combustible liquids*, provision shall be made for the expansion and contraction of the piping system and of the product it conveys.

- 2) To prevent excessive stresses resulting from vibration, settling or temperature changes
- a) flexible non-metallic hose connectors conforming to CAN/ULC-S633, "Flexible Underground Hose Connectors for Flammable and Combustible Liquids," are permitted to be used where necessary in underground piping systems carrying *flammable liquids* or *combustible liquids*,
  - b) flexible non-metallic pipe and fittings conforming to ULC/ORD-C971, "Nonmetallic Underground Piping for Flammable and Combustible Liquids," are permitted to be used where necessary in underground piping systems carrying *flammable liquids* or *combustible liquids*, or
  - c) flexible metallic hose connectors conforming to ULC/ORD-C536, "Flexible Metallic Hose," are permitted to be used where necessary in aboveground and underground piping systems carrying *flammable liquids* or *combustible liquids*.

### 4.5.7. Valves in Piping Systems

#### 4.5.7.1. Design

1) Except as provided in Sentences (2) and (3), valves in piping systems for *flammable liquids* or *combustible liquids* shall be designed to accommodate the temperatures and pressures of those systems and shall conform to ULC/ORD-C842, "Valves for Flammable and Combustible Liquids."

2) Every hose nozzle valve shall conform to CAN/ULC-S620, "Hose Nozzle Valves for Flammable and Combustible Liquids."

3) Every emergency valve shall conform to ULC-S651, "Emergency Valves for Flammable and Combustible Liquids."

#### 4.5.7.2. Shut-off Valves

1) Shut-off valves shall be provided in all *flammable liquid* or *combustible liquid* piping and pumping systems.

2) Where practicable, valves referred to in Sentence (1) shall be located outdoors or be immediately accessible from outdoors.

- 3) Except as permitted in Sentence (4), steel shut-off valves shall be provided
- a) at connections to all aboveground *storage tanks*,
  - b) on supply piping where it enters *buildings* or structures,
  - c) on branch lines from the main supply line,
  - d) on supply lines at dispensing locations,
  - e) to isolate one part of a piping system from another, and
  - f) to isolate meters and air eliminators.

**4.5.7.3.**

4) Stainless steel, monel metal or lined steel bodied valves are permitted to be used when special conditions warrant their use.

**4.5.7.3. Diaphragm Valves**

1) Diaphragm valves shall have no direct connections between the liquid and air sections that might permit leakage of the liquid past the packing into the air lines.

**4.5.7.4. Globe Valves**

1) Globe valves shall be arranged so that the packing is on the low pressure side.

**4.5.7.5. Indicating Valves**

1) Rising stem or other indicating valves shall be used where necessary to determine whether the valves are open or shut.

**4.5.7.6. Identification**

1) All valves shall be identified in conformance with CPPI, "Using the CPPI Colour-Symbol System to Mark Equipment and Vehicles for Product Identification."

2) Every identification tag shall be kept clean so that its colour and inscription are easily recognizable.

**4.5.8. Heating of Piping Systems****4.5.8.1. Design**

1) Heating equipment for piping systems containing *flammable liquids* or *combustible liquids* shall be designed not to overheat or create an ignition source for the liquids being heated.

**4.5.8.2. Steam Heating**

1) *Flammable liquid* and *combustible liquid* piping is permitted to be heated by steam lines provided the minimum steam temperature and pressure to make the liquid fluid are used and Sentences (2) and (3) are complied with.

2) A pressure regulator shall be provided in the steam line with a relief valve on the downstream side of the regulator.

3) Piping and steam lines shall be enclosed in insulation conforming to the Alberta Building Code 2006.

**4.5.8.3. Electrical Heating Cables**

1) Electrical heating cables including electrical induction heating shall conform to Subsection 4.1.4.

**4.5.8.4. Thermal Electrical Conduction Heating**

1) Thermal electrical conduction heating conforming to Sentence (2) is permitted to be used by passing a low-voltage alternating current through the pipe.

2) Systems permitted in Sentence (1) shall be installed and tested as complete units and shall conform to the following:

- a) unheated sections of piping shall be isolated from heated sections by means of nonconductive fittings,
- b) thermostatic controls, high temperature limit controls and fuses shall have the lowest practical rating to ensure satisfactory operation,
- c) all parts of the piping and fittings shall be enclosed by insulating coverings of a type that will prevent accidental grounding of the systems, and
- d) switches, transformers, contactors and other spark-producing equipment shall be located in an area not subject to flammable vapours.

3) Upon completion of installation, systems permitted in Sentence (1) shall be tested to ensure that all components are functioning as intended.

**4.5.8.5. Open Flames**

1) The use of open flames as a heat source shall not be permitted for heating piping for *flammable liquids* or *combustible liquids*.

**4.5.9. Methods of Transfer in Piping Systems****4.5.9.1. Location of Outdoor Pumps**

1) Pumps for *flammable liquid* or *combustible liquid* piping systems installed aboveground and outside of *buildings* shall be located not less than

- a) 3 m from the property line, and
- b) 1.5 m from *building* openings.

**4.5.9.2. Pump Houses and Pump Rooms**

1) Pumps located indoors shall be in rooms built in conformance with Subsection 4.2.9. (See Appendix A.)

2) Pump houses and pump rooms shall not be used for any purpose other than to serve the pumping equipment.

**4.5.9.3. Pits**

1) Pits for subsurface pumps for piping systems or for piping connected to submersible pumps shall be designed to withstand the forces to which they may be subjected without causing damage to the system.

2) Pits provided in conformance with Sentence (1) shall not be larger than necessary for inspection and maintenance and shall be provided with a cover.

**4.5.9.4. Control Switches**

1) Pumps for piping systems shall be provided with duplicate control switches to shut down the pumps in case of emergency, with one located in the operating area and the other at a remote location.

**4.5.9.5. Hydraulic Transfer Systems**

1) Where *flammable liquids* or *combustible liquids* are transferred by water pressure as a result of displacement, such system shall not be used for liquids that are miscible in water.

2) All *pressure vessels* for hydraulic transfer systems referred to in Sentence (1) shall be constructed, installed and tested in conformance with boiler and *pressure vessel* regulations made pursuant to the Safety Codes Act.

3) Hydraulic transfer systems referred to in Sentence (1) shall be designed to prevent water pressure in excess of the design pressure of the tank or piping.

4) Operating pressures shall be controlled by a constant-level float valve or a pressure-regulating valve on the water supply side of the hydraulic transfer system referred to in Sentence (1).

5) Hydraulic transfer systems referred to in Sentence (1) shall be arranged so that there is no water pressure on the system except when liquid is being discharged.

6) Check valves shall be provided for both water and *flammable liquid* or *combustible liquid* piping to prevent backflow in hydraulic transfer systems referred to in Sentence (1).

**4.5.9.6. Inert Gas Transfer Systems**

1) Where *flammable liquids* or *combustible liquids* are transferred as a result of displacement by the expansion of nitrogen, carbon dioxide or other inert gases, all *pressure vessels* involved shall be constructed, installed and tested in conformance with boiler and *pressure vessel* regulations made pursuant to the Safety Codes Act.

## 4.5.9.7.

2) Pressure regulators for inert gas transfer systems referred to in Sentence (1) shall be provided in the gas line to control the pressure of the gas at the minimum pressure required to force the liquid through the piping system at the required rate.

3) A relief valve with a slightly higher setting than the pressure required in Sentence (2) shall be provided on the downstream side of the regulator or on the tank.

4) Means of automatically shutting off the gas supply and bleeding the gas pressure in the event of fire shall be provided on all inert gas transfer systems referred to in Sentence (1).

4.5.9.7. **Non-Inert Gas Transfer**

1) Except as permitted in Sentence (2), the transfer of *flammable liquids* or *combustible liquids* in a closed piping system by means of compressed air or other non-inert gas pressure shall not be permitted.

2) A non-inert gas pressure is permitted to be used in a closed piping system referred to in Sentence (1) provided

- a) it is the vapour or gas of the *flammable liquid* or *combustible liquid* being transferred, or
- b) it is a vapour or gas that will not support combustion reaction and is non-reactive with the *flammable liquid* or *combustible liquid* being transferred.

4.5.10. **Operating Procedures for Piping Systems**4.5.10.1. **Procedures**

1) Standard procedures for normal operation and for emergencies shall be given in printed form to all employees engaged in the operation of equipment for the transfer of *flammable liquids* or *combustible liquids* and shall be posted for convenient reference.

4.5.10.2. **Training**

1) All employees concerned with transfer operations involving *flammable liquids* or *combustible liquids* shall be trained in

- a) the procedures referred to in Article 4.5.10.1.,
- b) the importance of constant attendance during all loading or unloading operations,
- c) extinguishing procedures for fires involving *flammable liquids* and *combustible liquids*, and
- d) the *flammable liquid* and *combustible liquid* colour coding and identification system required in Article 4.5.7.6.

2) Employees engaged in the operation of equipment for the transfer of *flammable liquids* or *combustible liquids* shall be trained in the location, function and operation of valves used for the operation of fire protection equipment and manual emergency shut-off valves.

4.5.10.3. **Emergency Valves**

1) Signs indicating the location of valves used for the operation of fire protection equipment and manual emergency shut-off valves shall be posted in conspicuous locations.

4.5.10.4. **Portable Extinguishers**

1) At least one portable extinguisher having a rating of 80-B:C shall be provided in the vicinity of pumps and ancillary equipment used for the transfer of *flammable liquids* or *combustible liquids*.

4.5.10.5. **Visual Inspections**

1) A visual inspection routine for the prompt detection of obviously abnormal conditions shall be established and shall be performed at least once each shift.

2) A visual inspection shall be made at least once during each day of operation of all aboveground piping systems, pumps and other ancillary equipment, to detect leakage, and any leakage shall be repaired as quickly as practicable.

3) Where necessary, flammable vapour indicators shall be used to detect leakage.

4) Open flames and spark-producing devices shall not be used for leakage detection referred to in Sentence (2).

#### 4.5.10.6. Operational Tests

1) To ensure proper operation, monthly inspections and tests shall be made of all safety shut-off valves and other fire safety devices, with particular attention directed to normally open, fusible-link-operated valves, float valves and automatic controls.

2) Records of inspections and tests of equipment referred to in Sentence (1) shall be retained in conformance with Article 2.2.1.2. of Division C.

#### 4.5.10.7. Maintenance

1) Except as provided in Sentence (6), maintenance shall not be carried out on piping systems while they are under pressure.

2) If connections or piping are to be opened, the system shall be drained of *flammable liquids* and *combustible liquids*.

3) Where equipment for handling *flammable liquids* or *combustible liquids* has to be repaired, it shall be removed and taken to maintenance areas when possible.

4) Tags shall be attached to all valves on piping systems that are shut off for maintenance purposes to indicate that such valves are not to be opened.

5) Piping that has been used for the transfer of *flammable liquids* or *combustible liquids* shall be removed or capped when it is no longer intended to be used.

6) Connections to pressurized piping systems shall be made in conformance with good practice such as that described in

- a) API 1104, "Welding of Pipelines and Related Facilities,"
- b) API 2200, "Repairs to Crude Oil, Liquefied Petroleum Gas and Products Pipelines," or
- c) API 2201, "Welding or Hot Tapping on Equipment in Service."

## Section 4.6. Fuel-Dispensing Stations

### 4.6.1. Scope

#### 4.6.1.1. Application

(See Appendix A.)

1) This Section applies to the storage, handling and use of *flammable liquids*, *combustible liquids* and Class 2.1 gases at *fuel-dispensing stations*.

2) Except as provided in this Section, the storage and dispensing of Class 2.1 flammable gases at *fuel-dispensing stations* shall conform to gas regulations made pursuant to the Safety Codes Act. (See Appendix A.)

3) Requirements of this Section that pertain to the location of dispensers, *storage tanks*, pumps, piping and their ancillary equipment inside *buildings* shall not apply to a canopy that is open on not less than 75% of its perimeter.

### 4.6.2. Storage and Handling

#### 4.6.2.1. Outside Aboveground Storage Tanks

1) Except as provided in Sentences (2), (3), and (4), the installation of outside aboveground *storage tanks* at *fuel-dispensing stations* shall be in conformance with Subsection 4.3.2.

## 4.6.2.2.

2) Except as permitted by Sentence (3), outside aboveground *storage tanks* at *fuel-dispensing stations* shall have an individual capacity of not more than 50000 L, and their aggregate capacity shall not exceed 150000 L. (See Appendix A.)

3) Outside aboveground *storage tanks* for Class II and IIIA liquids used exclusively at fleet vehicle *fuel-dispensing stations* or *cardlock installations* shall have an individual capacity of not more than 75 000 L, and their aggregate capacity shall not exceed 225 000 L. (See Appendix A.)

4) Outside aboveground *storage tanks* at *fuel-dispensing stations* shall be provided with

- a) physical protection against collision damage,
- b) measures to prevent unauthorized access to the *storage tank* and its ancillary equipment, and
- c) measures to contain accidental spillage in conformance with Subsection 4.3.7.

## 4.6.2.2. Containers

1) All packaged *flammable liquid* and *combustible liquid* products stored or sold at a *fuel-dispensing station* shall be in *closed containers* conforming to Article 4.2.3.1., distinctly marked with the generic name of the liquid they contain.

## 4.6.2.3. Piping

1) All piping for *flammable liquids* or *combustible liquids* at a *fuel-dispensing station* shall be in conformance with Article 4.5.2.1.

## 4.6.2.4. Corrosion Protection for Piping

1) All piping, valves and fittings at a *fuel-dispensing station* shall be protected against corrosion in conformance with Article 4.5.3.1.

## 4.6.2.5. Piping Supports and Guards

1) Piping shall be firmly supported and protected by installing guards when necessary to prevent vehicular, watercraft or aircraft impact damage, or other physical damage.

## 4.6.2.6. Pits

1) Pits for subsurface pumps or for piping connected to submersed pumps shall conform to Article 4.5.9.3.

## 4.6.3. Dispensing Systems

## 4.6.3.1. Dispensers

1) Fixed dispensers for *flammable liquids* or *combustible liquids* shall conform to CSA B346-M, "Power-Operated Dispensing Devices for Flammable Liquids."

## 4.6.3.2. Sumps

1) Sumps shall be installed in conformance with ULC/ORD-C107.21, "Under-Dispenser Sumps."

## 4.6.3.3. Location

1) Fixed dispensers for Class I liquids shall be installed outside *buildings* and not less than

- a) 3 m from any right-of-way and any property line,
- b) 3 m from any propane gas dispenser,
- c) 1.5 m from any natural gas dispenser,
- d) 6 m horizontally from any fixed source of ignition,
- e) 6 m horizontally from any liquefied petroleum gas cylinder or tank,

- f) 3 m from any *building* openings, other than those that serve as shelter for operating personnel and in which electrical installations conform to Article 4.1.4.1., and
- g) 6 m from any manhole or sewer opening (see Appendix A).

**2)** Fixed dispensers for Class II or IIIA liquids are permitted to be installed inside a *building* when

- a) the *building* is not open to the public,
- b) the dispensers are located on the *first storey*,
- c) drainage is provided, and
- d) ventilation is provided in conformance with Subsection 4.1.7. and with the requirements for *storage garages* in Part 6 of Division B of the Alberta Building Code 2006.

**3)** The location of dispensers of Class I liquids within a *building* shall conform to Subsection 3.3.5. of Division B of the Alberta Building Code 2006.

#### 4.6.3.4. Protection against Collision Damage

- 1)** Fixed dispensers shall be protected against collision damage by
- a) a concrete island not less than 100 mm high, or
  - b) posts or guardrails.

#### 4.6.3.5. Marine Fuel-Dispensing Stations

**1)** Dispensers at *marine fuel-dispensing stations* shall be in a location that will prevent watercraft or aircraft impact, or other physical damage.

### 4.6.4. Shut-off Devices

#### 4.6.4.1. Location and Identification

**1)** A device to shut off power to all dispensers and pumps shall be provided at a remote location on the site of the *fuel-dispensing station* and shielded from any fire that might occur in the dispensing area.

**2)** The device required in Sentence (1) shall be clearly identified and readily accessible to attendants and emergency responders.

#### 4.6.4.2. Self-service Outlets

**1)** Except as required by Sentence (2) and Sentences 4.6.8.2.(6) to (9) and in addition to the device required by Sentence 4.6.4.1.(1), an emergency shut-off switch to simultaneously stop the flow of liquid at all dispensers at *self-service outlets* shall be located at the central control console described in Sentence 4.6.8.2.(2) so that it is readily accessible to the attendant.

**2)** At card- or key-activated *self-service outlets*, the emergency shut-off switch required in Sentence (1) shall be in a readily accessible location acceptable to the *authority having jurisdiction*.

**3)** Reset capability for emergency shut-off switches required by Sentence (1) shall be restricted to manual operation.

#### 4.6.4.3. Marine Fuel-Dispensing Stations

**1)** At *marine fuel-dispensing stations*, a readily accessible valve shall be provided in each pipeline at or within 7.5 m of the pier to shut off the supply from shore.

### 4.6.5. Delivery Hose and Nozzles

#### 4.6.5.1. Delivery Hose

**1)** Delivery hose shall conform to CAN/ULC-S612, "Hose for Flammable and Combustible Liquids."

2) Except as permitted in Sentences (3) and (4), hose through which *flammable liquids* or *combustible liquids* are dispensed at a *fuel-dispensing station* shall be restricted to a maximum extended length of 4.5 m.

3) Where a retracting mechanism is used, a maximum extended length of 6 m shall be permitted.

4) At *marine fuel-dispensing stations* or at card- or key-activated dispensers, the length of extended hose is permitted to exceed the values in Sentences (2) and (3).

#### 4.6.5.2. Hose Nozzle Valves

1) Every hose nozzle valve through which a Class I or II liquid is dispensed by a motorized dispenser into a vehicle tank shall

- a) be automatic closing as required in Sentence (2), and
- b) conform to CAN/ULC-S620, "Hose Nozzle Valves for Flammable and Combustible Liquids."

2) Except as provided in Sentences (3) to (5), a hose nozzle valve shall be constructed so that the valve

- a) can be kept open only by the continuous application of manual pressure, or
- b) is equipped with a hold-open device that is an integral part of the nozzle and that will
  - i) allow automatic dispensing,
  - ii) automatically shut off when the vehicle tank is filled, and
  - iii) shut off if the nozzle is dropped or falls from the fill pipe.

3) A hose nozzle valve at a *marine fuel-dispensing station* shall be of the type without a hold-open device, in conformance with Clause (2)(a).

4) When a hose nozzle valve with a hold-open device is used at a *fuel-dispensing station*, a break-away coupling conforming to ULC-S644, "Emergency Breakaway Fittings for Flammable and Combustible Liquids," shall be provided.

5) When the flow of liquid can be stopped other than by the hose nozzle valve, a hose nozzle valve with a hold-open device is permitted to be used only if it is provided with a device that will automatically close the hose nozzle valve upon a drop of pressure in the dispensing hose.

#### 4.6.6. Remote Pumping Systems

##### 4.6.6.1. Application

1) This Subsection shall apply to systems for dispensing *flammable liquids* or *combustible liquids* where such liquids are transferred from bulk storage to individual or multiple dispensers by pumps located elsewhere than at the dispensers.

##### 4.6.6.2. Pumps and Control Equipment

1) Pumps, including associated control equipment, shall be designed so that the system will not be subject to pressures above the design working pressure.

2) Pumps shall be securely anchored and protected against damage from vehicles.

##### 4.6.6.3. Emergency Valves

1) An emergency valve conforming to ULC-S651, "Emergency Valves for Flammable and Combustible Liquids," shall be installed in the supply line so that the shear point of the valve is at a level not higher than the base of the dispenser nor more than 25 mm below it.

2) The emergency valve required in Sentence (1) shall be maintained in operating condition and serviced at intervals not greater than 12 months.

**4.6.6.4. Pump Location**

- 1) Pumps installed aboveground and outside *buildings* shall be located not less than
  - a) 3 m from any property line, and
  - b) 1.5 m from any *building* opening.
- 2) When an outside pump location is impractical, pumps are permitted to be installed inside *buildings* or in pits as provided in Article 4.6.2.6.

**4.6.6.5. Marine Fuel-Dispensing Stations**

- 1) Except as permitted in Sentence (2), tanks and pumps not integral with the dispenser at *marine fuel-dispensing stations* shall be located on the shore or on a pier of the solid-fill type.
- 2) Where shore locations would result in excessively long supply lines to the dispenser, *storage tanks* are permitted to be installed on a pier provided that
  - a) the applicable portions of Subsection 4.3.7. relating to spacing, *secondary containment* and piping are complied with, and
  - b) the quantity stored does not exceed 5000 L aggregate capacity.
- 3) No *storage tank* at a *marine fuel-dispensing station* shall be located closer than 4.5 m horizontally from the normal annual high-water mark.
- 4) *Storage tanks* located on shore and supplying *marine fuel-dispensing stations* are permitted to be located aboveground where rock or a high water table make underground tanks impracticable.
- 5) Where *storage tanks* at a *marine fuel-dispensing station* are elevated above the dispenser, an automatically operated valve that is designed to open only when the dispenser is being operated, so as to prevent gravity draining of the tank in the event of a rupture of the supply line to the dispenser, shall be provided at the *storage tank* outlet, positioned adjacent to and outside the valve specified in Article 4.3.6.1.
- 6) Piping between *storage tanks* located on shore and dispensers at a *marine fuel-dispensing station* shall conform to Section 4.5., except that where dispensing is from a floating structure, it is permitted to use suitable lengths of flexible hose designed in conformance with good engineering practice between the piping on shore and the piping on the floating structure. (See A-4.8.8.1.(1)(a) in Appendix A.)

**4.6.7. Spill Control****4.6.7.1. Spill Control**

- 1) Areas where *flammable liquids* or *combustible liquids* are dispensed shall be designed to
  - a) be able to handle accidental spillage in conformance with Subsection 4.1.6., and
  - b) control a spill of not less than 1 000 L.
- 2) Contaminated absorbent materials used during the cleanup of *flammable liquid* and *combustible liquid* spills shall be stored in a *storage tank* or *closed container* conforming to this Part until they are removed from the premises.

**4.6.8. Supervision and Dispensing Procedures****4.6.8.1. Attendants**

- 1) Except as permitted by Sentence (2) and Sentences 4.6.8.2.(6) to (9) for unattended *self-service outlets*, every *fuel-dispensing station* shall have at least one attendant referred to in Article 4.6.8.5. on duty when the station is open for business.
- 2) *Fuel-dispensing stations* that do not serve the general public do not require an attendant.

**3)** Except as permitted at *self-service outlets*, a qualified attendant shall be in constant control of the dispensing of Class I and II liquids into the fuel tanks of motor vehicles, watercraft or aircraft, or into containers.

**4)** Duties of attendants and fuel-dispensing procedures, as stated in Articles 4.6.8.5. and 4.6.8.6., shall be posted at every *fuel-dispensing station*.

#### 4.6.8.2. Self-service Outlets

**1)** Instructions for the operation of dispensers in *self-service outlets* shall be posted in a conspicuous location.

**2)** A control console shall be provided at *self-service outlets* within 25 m of all dispensers so that the attendant has an unobstructed view of all units at the same time.

**3)** The control console referred to in Sentence (2) shall be equipped to regulate the operation of each dispenser.

**4)** A 2-way communication system between the control console and each pump island shall be provided at *self-service outlets*.

**5)** At *fuel-dispensing stations* that provide both attended service and self-service, the attendant required in Sentence 4.6.8.1.(1) is permitted to dispense *flammable liquids* or *combustible liquids* at the attended service island, provided that

- a) each island has an emergency shut-off switch as described in Article 4.6.4.2., and
- b) the attendant is never more than 25 m from the self-service island or control console.

**6)** *Self-service outlets* are permitted to operate as unattended *self-service outlets* in conformance with all relevant Sections of this Part and Sentences (7), (8) and (9).

**7)** An unattended *self-service outlet* shall be provided with the following safety features:

- a) a video recording surveillance system connected to a monitoring facility (see Appendix A),
- b) a manually actuated emergency shut-off switch that
  - i) shuts off power to the individual dispensing unit, and
  - ii) can be actuated from both sides of the dispensing unit,
- c) a readily accessible, manually actuated, master emergency shut-off switch that
  - i) is located more than 6 m but less than 10 m from the dispensing island, and
  - ii) shuts off power to all dispensing units at the station,
- d) dispensing devices that can only be reset by trained personnel in attendance at the site in the event an emergency shut-off switch has been actuated,
- e) a public pay telephone or other means of direct communication with the fire department provided in a location acceptable to the *authority having jurisdiction*,
- f) an audible alarm actuated by the emergency shut-off switches that can be heard throughout the site,
- g) a strobe light actuated by the emergency shut-off switch in Clause (b) or Clause (c) in a visible location,
- h) dispensing pump cabinets and panels monitored with intrusion alarm devices connected to a monitoring facility,
  - i) pump control and accessory *buildings* that are protected with intrusion alarm devices and smoke and heat detection devices connected to the monitoring facility in Clause (a), and
  - j) electronic *storage tank* monitoring for inventory control.

**8)** Dispensing units at an unattended *self-service outlet* shall be such that the maximum quantity of *flammable liquids* and *combustible liquids* that can be dispensed at one time is 100 L, after which

- a) the dispensing unit automatically shuts down, and
- b) further dispensing cannot occur until the dispensing unit has been reset and the customer has initiated the starting sequence.

- 9) In addition to the requirements of Articles 4.6.8.6. to 4.6.8.8., an unattended *self-service outlet* shall have weather-resistant signs acceptable to the *authority having jurisdiction* conspicuously posted in the dispensing area indicating
- a) the location and use of the dispenser emergency shut-off switch,
  - b) the location and use of the master emergency shut-off switch,
  - c) the user must stay outside their vehicle in view of the fuelling nozzle during dispensing,
  - d) emergency instructions in the event of an accident or spill, and
  - e) telephone numbers for the fire department.

#### 4.6.8.3. Special Dispensers

1) Except as provided in Article 4.6.8.4. for card- or key-activated equipment and Sentences 4.6.8.2.(6) to (9) for unattended *self-service outlets*, special dispensers including coin-operated, card-operated and preset units, shall not be permitted at *self-service outlets* unless there is at least one qualified attendant on duty for each 12 hoses that can be operated simultaneously while the outlet is open to the public.

#### 4.6.8.4. Card- or Key-Activated Dispensers

1) Card- or key-activated dispensers are permitted at unattended *self-service outlets* and *fuel-dispensing stations* that are not open to the general public, in conformance with Sentences (2) to (6). (See Appendix A.)

2) Except as provided in Sentences (3) to (6), the installation of card- or key-activated dispensers shall conform to the requirements for *self-service outlets* and *fuel-dispensing stations* in this Section.

3) Operation of card- or key-activated dispensers shall be restricted to persons authorized by the supply agent to possess a card or key to operate the dispensers.

4) Clearly legible operating instructions, visible at all times, shall be posted at every dispenser island.

5) A telephone or other clearly identified means to notify the fire department shall be provided in a location readily accessible to the user.

6) Emergency instructions, including the telephone number of the local fire department, shall be conspicuously posted to advise the user, in the event of a spill or accident,

- a) to use the emergency shut-off switch required in Article 4.6.4.2., and
- b) to call the fire department.

#### 4.6.8.5. Duties of Attendants

- 1) Attendants on duty at *fuel-dispensing stations* shall
- a) supervise the dispensing of *flammable liquids* and *combustible liquids*,
  - b) activate the controls to permit the dispensing of fuel at an individual dispenser only after the customer at the unit is ready to activate the nozzle,
  - c) prevent the dispensing of *flammable liquids* and *combustible liquids* into containers that
    - i) do not conform to Article 4.2.3.1., or
    - ii) are in a vehicle,
  - d) take appropriate measures to prevent sources of ignition from creating a hazard at the dispensers,
  - e) take appropriate action in the event of a spill to reduce the risk of fire,
  - f) shut off the power to all dispensers in the event of a spill or fire, and
  - g) notify the fire department forthwith in accordance with Sentence 4.1.6.4.(1), when a spill or accident occurs that involves *flammable liquids* or *combustible liquids*.

- 2)** In addition to the requirements in Sentence (1), attendants on duty at *marine fuel-dispensing stations* shall
- activate the controls to permit the dispensing of fuel at an individual dispenser only after all ports and hatches on the watercraft have been closed, and
  - ensure that containers for *flammable liquids* and *combustible liquids*,
    - are not filled beyond their safe filling level, and
    - are filled only after they have been removed from the watercraft or aircraft.
- 3)** Attendants shall be trained on how to conduct their duties including but not limited to,
- inventory reconciliation practices,
  - proper and safe product transfer procedures, and
  - responsibilities identified in this Code.

#### 4.6.8.6. Fuel-Dispensing Procedures

- 1)** Except as provided in Sentence (2), *flammable liquids* and *combustible liquids* shall not be dispensed into the fuel tank of a motor vehicle, watercraft or aircraft while the engine is running.
- 2)** It is permitted to dispense a Class II or IIIA liquid into the fuel tank of a motor vehicle while its engine is running provided it is dispensed not less than 6 m away from any Class I liquid dispenser. (See Appendix A.)
- 3)** Class I and II liquids shall not be dispensed at a *fuel-dispensing station* into the fuel tank of a motor vehicle while any part of the motor vehicle or any vehicle attached to it is on a *street*.
- 4)** Every person dispensing *flammable liquids* and *combustible liquids* shall
- take precautions to prevent overflow or spillage of the liquid being dispensed,
  - not knowingly overfill the fuel system,
  - except as otherwise stated in Article 4.6.8.5., in the event of spillage, immediately apply an absorbent material to soak up the spillage in conformance with Article 4.1.6.3.,
  - not dispense Class I or II liquids in proximity to open sources of ignition,
  - not use any object or device that is not an integral part of the hose nozzle valve assembly to maintain the flow of fuel,
  - not dispense the liquids into containers that are in a vehicle, watercraft or aircraft, and
  - be at least 16 years of age.

#### 4.6.8.7. Sources of Ignition

- 1)** Smoking and non-fixed sources of ignition shall not be permitted within 7.5 m of a dispenser at a *fuel-dispensing station*.

#### 4.6.8.8. Signs

- 1)** At least one weather-resistant sign conforming to Sentences (2) to (4) shall be provided for each dispenser in a location visible to every driver approaching the dispenser.
- 2)** The sign required in Sentence (1) shall indicate that smoking is not permitted in the vicinity of the dispenser and that the ignition must be turned off while the vehicle is being refuelled. (See Appendix A.)
- 3)** The sign required in Sentence (1) shall
- have a minimum dimension of 200 mm, and
  - except as permitted in Sentence (4), have letters not less than 25 mm high.
- 4)** The sign required in Sentence (1) is permitted to display the international “No Smoking – Ignition Off” symbol not less than 100 mm in diameter.

**4.6.9. Fire Prevention and Protection****4.6.9.1. Portable Extinguishers**

1) At least 2 portable extinguishers, each having a rating of not less than 40-B:C, shall be provided at every *fuel-dispensing station*.

2) Individual extinguishers required by Sentence (1) shall weigh not more than 4.6 kg.

**4.6.9.2. Absorbent Materials**

1) Absorbent material to soak up liquid spillage shall be provided for use by attendants at *fuel-dispensing stations* in conformance with Article 4.1.6.3.

**4.6.10. Inspection and Maintenance****4.6.10.1. Inspection**

1) Operators of *self-service outlets, fuel-dispensing stations* and *marine fuel-dispensing stations* shall ensure that a weekly inspection is conducted of

- a) dispensing unit hoses and nozzles to ensure safe operation,
- b) dispensing unit pumps and fittings to determine if there are any leaks,
- c) fill boxes and fill pipe areas for product spillage, and
- d) *storage tank* vents to ensure piping or openings are not blocked or damaged.

2) Operators of *self-service outlets, fuel-dispensing stations* and *marine fuel-dispensing stations* shall ensure that electronic liquid measuring or leak detection equipment is inspected each business day to confirm that the equipment is functioning as intended.

**4.6.10.2. Maintenance**

1) Operators of *self-service outlets, fuel-dispensing stations* and *marine fuel-dispensing stations* shall inspect and maintain the *cathodic protection* systems on underground *storage tanks* and piping in conformance with

- a) CAN/ULC-S603.1, "Galvanic Corrosion Protection Systems for Steel Underground Tanks for Flammable and Combustible Liquids," for sacrificial anode systems, or
- b) PACE Report 87-1, "Impressed Current Method of Cathodic Protection of Underground Storage Tanks," Clause 5.5(c) and Part 6.0 for impressed current systems.

2) Impressed current *cathodic protection* systems shall be supplied with electrical power on a continuous basis and the power supply shall be inspected at least weekly.

**4.6.10.3. Corrective Action**

1) The operator of a *self-service outlet, a fuel-dispensing station* or a *marine fuel-dispensing station* shall ensure that immediate corrective action is taken when a condition is identified that contravenes Articles 4.6.10.1. and 4.6.10.2.

**4.6.10.4. Records**

1) Records acceptable to the *authority having jurisdiction* of maintenance and inspections required by Articles 4.6.10.1. and 4.6.10.2. shall be retained in conformance with Article 2.2.1.2. of Division C.

## Section 4.7. Bulk Plants

### 4.7.1. Scope

#### 4.7.1.1. Application

1) This Section shall apply to that portion of a property where *flammable liquids* or *combustible liquids* are received in bulk quantities and are stored or handled for the purpose of being distributed.

### 4.7.2. Storage

#### 4.7.2.1. Storage

- 1) *Flammable liquids* and *combustible liquids* shall be stored in
  - a) *closed containers*, in conformance with Article 4.7.2.4., or
  - b) *storage tanks*, in conformance with Section 4.3.

#### 4.7.2.2. Storage Tanks

1) At bulk plant rail loading and unloading facilities, the minimum distance from a *storage tank* to a railway line shall be in conformance with General Order No. O-32, "Flammable Liquids Bulk Storage Regulations," published by Transport Canada.

#### 4.7.2.3. Hydraulic Pressure Shock

1) Bulk *storage tanks*, piping, pumps, valves and associated components shall be designed, installed and maintained to accommodate hydraulic pressure shock on the system.

#### 4.7.2.4. Container Storage

- 1) Containers for *flammable liquids* or *combustible liquids* stored indoors shall be stored in conformance with Subsection 4.2.7.
- 2) Containers for *flammable liquids* or *combustible liquids* stored outdoors shall be stored in conformance with Subsection 4.2.11., except that the distance between the piles and property lines and the distance between piles need not apply when the containers are stored in an area that does not present a hazard to neighbouring property.

#### 4.7.2.5. Spill Control

1) An outdoor storage area shall be designed to accommodate accidental spillage in conformance with Subsection 4.1.6.

#### 4.7.2.6. Fencing

1) The outdoor area occupied by aboveground *storage tanks*, container storage, ancillary equipment and unloading facilities shall be fenced in conformance with Article 3.3.2.6.

### 4.7.3. Dispensing

#### 4.7.3.1. Interconnection

1) Dispensing systems for Class I liquids shall not be interconnected with dispensing systems for Class II and IIIA liquids.

#### 4.7.3.2. Dispensing into Vehicles

1) Dispensers used by the general public to dispense *flammable liquids* or *combustible liquids* into the fuel tanks of vehicles, portable tanks, and containers shall not be located at a bulk plant unless separated by a fence or equivalent barrier from the area in which the bulk storage operations are conducted.

**2)** Where a dispenser referred to in Sentence (1) is supplied from an aboveground *storage tank*

- a) an automatically operated valve that is designed to open only when the dispenser is being operated shall be provided at the tank outlet, and
- b) an emergency valve shall be provided for the dispenser in conformance with Sentence 4.6.6.3.(1).

**3)** Dispensing of *flammable liquids* and *combustible liquids* at bulk plants shall be in conformance with Subsection 4.6.8.

#### **4.7.3.3. Dispensing into Metal Containers or Tanks**

**1)** Class I liquids shall not be dispensed into a metal container or *storage tank* unless it is electrically connected in conformance with Article 4.1.8.2.

### **4.7.4. Loading and Unloading Facilities**

(See Appendix A.)

#### **4.7.4.1. Clearances**

**1)** At a loading or unloading facility for *tank vehicles* or tank cars, the horizontal distance from the fill stem to an aboveground *storage tank*, a *building* or a property line shall be not less than

- a) 7.5 m for Class I liquids, and
- b) 4.5 m for Class II and IIIA liquids.

**2)** At bulk plant rail loading and unloading facilities, the minimum distance from a loading structure to a railway line shall be in conformance with General Order No. O-32, "Flammable Liquids Bulk Storage Regulations," published by Transport Canada.

**3)** *Buildings* for the shelter of personnel or pumps shall be considered a part of the loading or unloading facility.

#### **4.7.4.2. Multi-purpose Facilities**

**1)** When piping and pumping systems have been used for the transfer of either *flammable liquids* or *combustible liquids* at loading or unloading facilities, the system shall be cleaned of vapours before the other class of liquid is introduced.

#### **4.7.4.3. Check Valves**

**1)** Systems through which tank cars or *tank vehicles* discharge into aboveground *storage tanks* by means of pumps shall be provided with check valves to prevent backflow and the inadvertent mixing of liquids.

**2)** Systems referred to in Sentence (1) shall be designed, installed and maintained to prevent leakage or spillage.

#### **4.7.4.4. Control Valves**

**1)** Valves installed to control the filling of *tank vehicles* or tank cars shall be of the self-closing type.

**2)** Control valves referred to in Sentence (1) shall be held open manually, except where automatic devices are provided for shutting off the flow in order to prevent the overfilling of *tank vehicle* or tank car compartments. (See Appendix A.)

#### **4.7.4.5. Bonding and Grounding**

(See Appendix A.)

**1)** Bonding, grounding and isolation components for protection against static charges during the loading or unloading of *tank vehicles* or tank cars shall be provided when transferring *flammable liquids* or *combustible liquids*.

**4.7.4.6.**

**2)** Where *flammable liquids* or *combustible liquids* are transferred from or into railway tank cars, the railway tracks shall be bonded throughout their length and permanently grounded in conformance with CTC 1982-8 RAIL, "Railway Prevention of Electric Sparks Regulations," published by Transport Canada.

**3)** Bonding required in Sentence (1) shall consist of a metallic bond wire connected to the fill stem or to some part of the loading or unloading structure that is in electrical contact with the fill stem in conformance with Subsection 4.1.4.

**4)** Bonding wires for *tank vehicles* shall be provided with a pull-off connector attached so as to be in electrical contact with the cargo tank of the *tank vehicle*.

**5)** The bonding connection required in Sentence (1) shall be fixed to the *tank vehicle* or *storage tank* before dome covers are raised and shall remain in place until filling is completed and all dome covers have been closed and secured.

**4.7.4.6. Downspouts**

**1)** Except as provided in Sentence 4.1.8.2.(3), when *tank vehicles* or tank cars are filled with Class I or II liquids through the top of the tank, the fill pipe shall terminate within 150 mm of the bottom of the tank.

**4.7.4.7. Identification**

**1)** Areas used for the transfer of *flammable liquids* or *combustible liquids* shall be clearly designated as such by posted placards conforming to the "Transportation of Dangerous Goods Act" and its Regulations.

**4.7.5. Fire Protection****4.7.5.1. Portable Extinguishers**

**1)** At least 2 portable extinguishers, each having a rating of not less than 40-B:C, shall be provided at hazardous locations in bulk storage plants for *flammable liquids* and *combustible liquids*, except that such portable extinguishers are permitted to be provided from the *tank vehicles* operated as part of a bulk plant that is not fenced. (See Appendix A.)

**4.7.6. Spill Control****4.7.6.1. Spill Control**

**1)** Facilities to control possible spills of *flammable liquids* or *combustible liquids* shall be provided at loading and unloading points, in conformance with Subsection 4.1.6.

**Section 4.8. Piers and Wharves****4.8.1. Scope****4.8.1.1. Application**

**1)** This Section applies to *flammable liquid* and *combustible liquid* installations on piers and wharves, but does not include *marine fuel-dispensing stations*.

**4.8.2. General****4.8.2.1. Clearances**

1) Piers and wharves where cargos of *flammable liquids* or *combustible liquids* are transferred in bulk quantities to or from tanks of marine vessels shall be not less than 30 m from

- a) any bridge over a navigable waterway, and
- b) an entrance to a superstructure of any vehicular or railroad tunnel under a waterway.

2) The termination of fixed piping for loading and unloading *flammable liquids* or *combustible liquids* shall be not less than 60 m from a bridge or from an entrance to a tunnel.

**4.8.2.2. Construction**

1) The substructure and deck of a pier or wharf shall be designed for its intended use and shall be constructed of heavy timber or material that will provide adequate flexibility, resistance to shock, durability, strength and fire resistance.

**4.8.3. Storage Tanks****4.8.3.1. Installation**

1) Except as permitted in Sentences (2) and (3), *storage tanks* shall be installed on shore in conformance with Subsections 4.3.2. to 4.3.7.

2) *Storage tanks* are permitted to be located in *buildings* on piers and wharves of solid-fill or *noncombustible construction* provided they conform to Subsections 4.3.12. to 4.3.14.

3) *Storage tanks* are permitted to be buried in piers and wharves of the solid-fill type provided they conform to Subsections 4.3.8. to 4.3.11.

**4.8.4. Piping, Valves and Fittings****4.8.4.1. Installation and Materials**

1) The method of installation and materials used for piping, valves and fittings shall conform to Section 4.5.

**4.8.4.2. Pipe Supports**

1) Piping shall be properly supported and arranged to prevent excessive vibration or strain on equipment connected to it.

- 2) Piping supports shall consist of
- a) wood having no dimension less than 150 mm,
  - b) steel, or
  - c) concrete.

3) Where pipe is supported more than 1.2 m above the pier deck, piping supports shall have a minimum *fire-resistance rating* of 2 h.

**4.8.4.3. Guards**

1) In areas where general cargo is handled or where piping might be subject to physical damage from vehicles, watercraft or aircraft, the piping shall be protected by means of guarding devices.

**4.8.4.4. Flexible Connections**

1) Piping between the shore and piers or wharves shall be provided with swing joints or flexible connections designed in conformance with good engineering practice to permit the independent movement of the pier or wharf and shore piping without strain on the pipe.

**4.8.4.5.****4.8.4.5. Shut-off Valves**

1) A readily accessible valve to shut off the supply from shore shall be provided in each pipeline within 7.5 m of piers and wharves.

**4.8.4.6. Access Openings for Inspection**

1) Access openings for inspection purposes below deck shall be provided for valves required in Article 4.8.4.5. and for connections to pipelines, and suitable signs shall be posted indicating their locations.

2) No freight or materials shall be placed on piers and wharves in such a manner as to obstruct the access openings required in Sentence (1).

**4.8.4.7. Identification**

1) Identification tags or labels of metal or other material impervious to water and to the *flammable liquids* or *combustible liquids* being transferred shall be attached to and maintained on all pipelines and control valves to designate their use.

**4.8.4.8. Leakage Testing**

1) Piping systems shall be tested for leakage in conformance with Section 4.4. before being put into service and before reactivation when used on a seasonal basis.

2) Underground piping systems referred to in Sentence (1) shall be tested at intervals no greater than 12 months.

**4.8.5. Bonding and Grounding****4.8.5.1. Bonding and Grounding**

1) Railway tracks on piers and wharves shall be bonded throughout their length and permanently grounded in conformance with CTC 1982-8 RAIL, "Railway Prevention of Electric Sparks Regulations," published by Transport Canada.

2) Insulating joints shall be placed in all rails where entering upon the pier or wharf.

**4.8.6. Fire Protection****4.8.6.1. Portable Extinguishers**

1) Portable extinguishers having a rating of 40-B:C shall be provided in the vicinity of Class I liquid pumps and fuel dispensers.

2) Portable extinguishers shall be kept in the pump house or other suitable location where they will be accessible in the event of an emergency, but not accessible to the public.

3) Where marine vessels are loading or unloading *flammable liquids* or *combustible liquids* or are being refuelled, portable extinguishers with a rating of not less than 40-B:C shall be placed on the pier or wharf in the vicinity of loading or unloading operations so that they are accessible in the event of a fire emergency.

4) Portable extinguishers provided in conformance with Sentence (3) shall be in addition to those provided on board the marine vessels.

**4.8.6.2. Training**

1) Operating personnel shall be trained on how to summon the nearest fire department in the event of fire.

**4.8.7. Bulk Transfer Stations****4.8.7.1. Location**

1) Except as permitted in Sentence (2), the bulk transfer of *flammable liquids* or *combustible liquids* shall be permitted only on piers and wharves used exclusively for that purpose.

2) Where it is not practicable to locate bulk transfer stations on separate piers and wharves, such stations are permitted to be located on general purpose piers and wharves provided that guards or fences are installed around valves or pumping equipment to prevent entry of unauthorized personnel.

**4.8.7.2. Leakage and Spill Control**

1) Measures to accommodate possible leakage or spillage from hose couplings shall be provided in conformance with Subsection 4.1.6.

2) Provision shall be made to prevent spillage resulting from the disconnection of hoses.

**4.8.7.3. Hose Connections**

1) Except as provided in Sentence (2), hose connections on piping shall be of the bolted flange type, and all such connections shall be provided with shut-off valves.

2) The use of cam-locking connections up to 100 mm in size shall be permitted.

3) Hose connections shall not project beyond the face of piers and wharves.

**4.8.8. Cargo Hose****4.8.8.1. Cargo Hose**

1) The transfer of *flammable liquids* or *combustible liquids* between tanks of marine vessels and piers or wharves shall be through

- a) flexible cargo hose designed in conformance with good engineering practice (see Appendix A), or
- b) jointed tubing or piping
  - i) suitable for the cargo to be transferred, and
  - ii) designed to withstand the maximum design working pressure.

**4.8.8.2. Maintenance and Testing**

1) Cargo hose shall be maintained in satisfactory operating condition and be pressure tested, at intervals not greater than 12 months, to 1.5 times the maximum working pressure but not less than 350 kPa (gauge).

**4.8.8.3. Supports**

1) Cargo hose shall be supported where it is not run on a solid foundation.

**4.8.9. Cargo Pumps****4.8.9.1. Pressure Relief**

1) Cargo pumps capable of producing pressures in excess of the safe working pressure of the cargo hose shall be provided with pressure relief devices such as return lines or relief valves.

**4.8.9.2. Location**

1) Except as permitted in Sentence (2), cargo pumps shall be located

- a) on shore or on piers and wharves either of *noncombustible construction* or of the solid-fill type, and
- b) not less than 3 m from other *buildings* or structures.

**4.8.10.1.**

- 2) Where it is not practicable to install cargo pumps as required in Sentence (1), they are permitted to be installed on piers and wharves of *combustible construction* if located in pump houses
  - a) conforming to Subsection 4.8.10., and
  - b) located not less than 3 m from other *buildings*.

**4.8.10. Pump Houses****4.8.10.1. Construction**

- 1) Pump houses shall be of *noncombustible construction* with floors that are chemically resistant to the liquid being handled, liquid-tight and equipped with curbs or flashings around the base of the wall not less than 100 mm in height to contain any spilled liquid.

**4.8.11. Transfer Operations****4.8.11.1. Supervision**

- 1) Transfer operations shall be carried out only under the continuous supervision of a person qualified to supervise such operations.
- 2) Cargo shall not be transferred to or from the tank of a marine vessel unless sufficient personnel are on board to control the operation.
- 3) The person responsible for directing the operations shall
  - a) prior to the transfer of cargo, ascertain that no unauthorized repair work is being carried out on the pier or wharf and that there are no open flames in the vicinity,
  - b) during the transfer of cargo, monitor the progress of the loading and unloading to prevent overflow, and
  - c) inspect the hose and connections for leakage and, if leakage occurs, stop the operations.

**4.8.11.2. Bonding and Grounding**

- 1) Tanks of marine vessels shall be electrically connected to the shore piping prior to the connection of cargo hose, except when *cathodic protection* facilities are operating.
- 2) Electrical connections to tanks of marine vessels shall be maintained until the cargo hose has been disconnected and any spillage has been removed.

**4.8.11.3. Equipment**

- 1) Cargo hose shall be of adequate length to allow for movement of the marine vessel.
- 2) Gaskets shall be used in all hose joints and pipe couplings to prevent leakage.
- 3) Flanged joints shall be tightly bolted to prevent leakage.
- 4) Drip pans shall be placed under hose connections on piers and wharves, except where a sump pit or settling basin is provided.

**4.8.11.4. Spill Control**

- 1) When transfer operations are completed,
  - a) the valves on the hose connections shall be closed, and
  - b) the cargo hose shall be drained into appropriate containers that shall be emptied in conformance with Subsection 4.1.6.
- 2) Care shall be taken that no liquid is discharged on a pier or wharf or overboard during draining and emptying operations.

## Section 4.9. Process Plants

### 4.9.1. Scope

#### 4.9.1.1. Application

1) Except as provided in Sentence (2), this Section applies to *process plants*, including *refineries*, that contain industrial processes involving *flammable liquids* or *combustible liquids*.

2) This Section does not apply to *distilleries* covered in Section 4.10.

### 4.9.2. Outdoor Processing Equipment

#### 4.9.2.1. Location

1) The location of outdoor processing equipment in *process plants* shall be based on its *flammable liquid* or *combustible liquid* capacity as described in Sentences (2) to (4).

2) Except as provided in Sentence (4), outdoor processing equipment having emergency relief venting and a working pressure of not more than 17 kPa (gauge) shall be separated from property lines and *buildings* on the same property by distances

- a) equal to those in Table 4.3.2.1. for *stable liquids*, and
- b) 2.5 times those in Table 4.3.2.1. for *unstable liquids*.

3) Except as provided in Sentence (4), outdoor processing equipment having emergency relief venting and a working pressure more than 17 kPa (gauge) shall be separated from property lines and *buildings* on the same property by distances

- a) 1.5 times those in Table 4.3.2.1. for *stable liquids*, and
- b) 4 times those in Table 4.3.2.1. for *unstable liquids*.

4) Where protection is not provided against fires or explosions in processing equipment, the distances in Sentences (2) and (3) shall be doubled. (See Sentence 4.3.2.5.(2).)

### 4.9.3. Processing Buildings

#### 4.9.3.1. Explosion Venting

1) Except as provided in Article 4.9.4.2., where Class IA liquids or *unstable liquids* are processed within a room or a *building*, the room or *building* shall be designed to prevent critical structural and mechanical damage from an internal explosion in conformance with good engineering practice such as that described in NFPA 68, "Venting of Deflagrations." (See A-3.2.8.2.(1)(d) in Appendix A.)

#### 4.9.3.2. Fire Separations

1) Areas where *unstable liquids* are handled or where small scale unit chemical processes are carried on shall be separated from the remainder of the *building* by a *fire separation* having a *fire-resistance rating* of not less than 2 h.

#### 4.9.3.3. Basements and Pits

1) *Buildings* where Class I and II liquids are handled in chemical processes shall not have *basements* or covered pits.

#### 4.9.3.4. Ventilation

1) Equipment used in a *building* and the ventilation of the *building* shall be designed so as to limit flammable vapour-air mixtures under normal operating conditions to the interior of equipment, and to not more than 1.5 m from such equipment. (See Appendix A.)

**4.9.3.5.****4.9.3.5. Construction**

1) *Buildings* containing processing equipment involving *flammable liquids* or *combustible liquids* shall be constructed in conformance with the Alberta Building Code 2006.

**4.9.4. Fire Prevention and Protection****4.9.4.1. Spill and Vapour Control**

- 1) Processing equipment shall be designed and arranged to
  - a) prevent the unintentional escape of liquids and vapours, and
  - b) minimize the quantity escaping in the event of accidental release.

**4.9.4.2. Explosion Protection**

- 1) Processing equipment where an explosion hazard is present shall be
  - a) designed to withstand the explosion pressure without damage to the equipment,
  - b) provided with explosion venting in conformance with NFPA 68, "Venting of Deflagrations," or
  - c) provided with an explosion prevention system in conformance with NFPA 69, "Explosion Prevention Systems."

**4.9.4.3. Fire Protection**

- 1) Where the process warrants such protection, industrial *process plants* shall be supplied with
  - a) water supplies of adequate pressure and quantity to meet the probable fire demands,
  - b) hydrants,
  - c) hoses connected to a permanent water supply and located so that all equipment containing *flammable liquids* or *combustible liquids*, including pumps, can be reached with at least one hose stream,
  - d) nozzles capable of discharging a water spray, and
  - e) automatic fire suppression systems.

**4.9.4.4. Emergency Procedures**

1) Emergency procedures conforming to Article 4.1.5.5. shall be established for *refineries* and *process plants*.

**Section 4.10. Distilleries****4.10.1. Scope****4.10.1.1. Application**

1) This Section applies only to those areas or *buildings* in *distilleries* where *distilled beverage alcohols* are concentrated, blended, mixed, stored or packaged. (See Appendix A.)

2) The storage, handling and use of *flammable liquids* or *combustible liquids* other than *distilled beverage alcohols* in a *distillery* shall conform to Part 4.

3) Where there is a conflict between the requirements of this Section and other requirements in Part 4, this Section shall govern.

**4.10.2. General****4.10.2.1. Building Classification**

**1)** Except as provided in Sentence (2), *buildings* or parts of *buildings* in which *distilled beverage alcohol* is distilled, processed or stored in bulk shall be classified as *high-hazard industrial occupancies*.

**2)** *Buildings* or parts of *buildings* used for the storage of *closed containers* of *distilled beverage alcohols* shall be classified as *medium-hazard industrial occupancies*.

**4.10.3. Storage Tanks and Containers****4.10.3.1. Design, Fabrication and Testing**

**1)** *Storage tanks*, wooden vats, barrels, drums or containers used for the storage or processing of *distilled beverage alcohols* shall be designed, fabricated and tested for the anticipated maximum working pressure, operating temperature, internal corrosion conditions and structural stresses to which they could be subjected.

**4.10.3.2. Supports, Foundations and Anchorage**

(See Appendix A.)

**1)** Supports, foundations and anchorage of *storage tanks* shall comply with Subsection 4.3.3., except that timber supports shall be permitted.

**2)** *Storage tank* supports having less than a 2 h *fire-resistance rating* shall be protected by an automatic fire suppression system.

**3)** The area underneath any *storage tank* greater than 1.2 m in diameter shall be protected by an automatic fire suppression system.

**4.10.3.3. Storage Tank Vents**

**1)** Normal and emergency vents shall be provided on *storage tanks* in conformance with good engineering practice. (See Appendix A.)

**4.10.4. Storage****4.10.4.1. Storage Tanks, Drums and Barrels**

**1)** Where more than 25000 L of *distilled beverage alcohol* in *storage tanks*, drums or barrels are stored inside *buildings*, such *buildings* shall be *sprinklered*.

**4.10.4.2. Closed Containers and Storage Aids**

**1)** Storage of *closed containers* of *distilled beverage alcohols*, packaging materials and empty bottles, drums, barrels and pallets shall be in conformance with Part 3.

**4.10.5. Piping and Pumping Systems****4.10.5.1. Design and Installation**

**1)** The design, fabrication, assembly and inspection of piping and pumping systems containing *distilled beverage alcohols* shall be suitable for the anticipated maximum working pressures, operating temperatures, internal corrosion conditions and structural stresses to which they could be subjected. (See Appendix A.)

**4.10.6.1.****4.10.6. Ventilation****4.10.6.1. Ventilation**

1) Natural or mechanical ventilation shall be provided for all areas where alcohol vapours are released from *storage tanks* or process equipment under normal operating conditions, to prevent the concentration of vapours from exceeding 25% of the *lower explosive limit*, measured 1.5 m from any equipment or from any opening subject to vapour release.

**4.10.7. Spill Control****4.10.7.1. Spill Control**

1) Emergency drainage systems shall be provided to direct any spilled or leaked *distilled beverage alcohol* to a safe location.

**4.10.8. Fire Protection****4.10.8.1. Portable Extinguishers**

1) Except as permitted in Sentence (2), in maturing warehouses, at least one portable extinguisher having a rating of 4-A:30-B:C shall be located adjacent to each *exit*.

2) Hose stations are permitted to be installed in lieu of portable extinguishers at locations required in Sentence (1), and spaced so that the travel distance to the nearest hose is not greater than 25 m.

3) At least one portable extinguisher having a rating of 30-B:C shall be located on each industrial lift truck.

**4.10.8.2. Standpipe and Hose Systems**

1) Except as provided in Sentence (2), standpipe and hose systems shall be provided and installed in *distilleries* in conformance with Article 2.1.3.1.

2) Where a *building* is *sprinklered* in conformance with Article 2.1.3.6., small hose (38 mm) stations are permitted to be supplied from interior sprinkler piping.

**Section 4.11. Tank Vehicles****4.11.1. Scope****4.11.1.1. Application**

1) This Section applies to *tank vehicles* when located on a property covered in this Code.

**4.11.2. General****4.11.2.1. Portable Extinguishers**

1) Except as required or permitted by Sentence 4.7.5.1.(1) a *tank vehicle* shall be provided with at least one portable extinguisher having a minimum rating of 40-B:C.

2) Portable extinguishers on a *tank vehicle* shall be readily accessible.

**4.11.2.2. Hot Works**

1) Hot works performed on or in close proximity to a *tank vehicle* shall conform to Section 5.2. and Article 4.11.2.6.

2) No person shall smoke or use an open flame within 7.5 m of a *tank vehicle* that is being loaded, unloaded or repaired.

**4.11.2.3. Parking inside Buildings**

1) A *tank vehicle* shall not be parked inside a *building* unless the *building* is specifically designed for that purpose or the cargo tank has been purged in accordance with this Section.

2) If a *tank vehicle* is to be parked inside a *building*, provisions shall be made to ensure that there is sufficient space in the tank to compensate for thermal expansion of the *flammable liquid* or *combustible liquid*.

3) Before parking a *tank vehicle* inside a *building*, the vehicle shall be inspected to ensure that there are no leaks in the tank, piping or valves.

**4.11.2.4. Parking outside Buildings**

1) Except as provided in Sentence (2), a *tank vehicle* is permitted to be left unattended by the vehicle operator outside a *building* for not more than 1 h.

2) A *tank vehicle* is permitted to be left unattended by the vehicle operator outside a *building* for more than 1 h, but only in a parking space

- a) that is located not less than 15 m from a *building*, and
- b) where the *tank vehicle* is not exposed to undue hazard from accident or collision.

**4.11.2.5. Damaged or Leaking Containers**

1) Containers or tanks that leak or that have become damaged shall not be used to transport *flammable liquids* or *combustible liquids*.

**4.11.2.6. Repair and Servicing**

1) No person shall repair or service the cargo tank of a *tank vehicle* in a *building* unless

- a) all *flammable liquids* and *combustible liquids* have been removed from the cargo tank and stored in a *storage tank* or container constructed and installed in accordance with this Part,
- b) the cargo tank has been purged with steam of flammable vapours or combustible vapours, outside the *building* or in a well-ventilated area, to less than 10% of the *lower explosive limit*, and
- c) while the cargo tank is being repaired it is monitored for the presence of flammable vapours and combustible vapours using combustible gas detection equipment.

2) No person shall repair, service or store a *tank vehicle* in a *building* other than for repairs conducted in conformance with Article 4.11.2.2. and Sentence (1), unless

- a) the *building* is acceptable to the *authority having jurisdiction*, or
- b) all *flammable liquids* and *combustible liquids* have been removed from the cargo tank and the tank has been purged of flammable vapours or combustible vapours, outside the *building* or in a well-ventilated area, to less than 10% of the lower explosive limit.

**4.11.3. Loading, Unloading and Dispensing from Tank Vehicles****4.11.3.1. Loading and Unloading**

1) Unless otherwise stated in this Subsection, the loading and unloading of *tank vehicles* shall be conducted in conformance with the applicable provisions in Subsection 4.7.4.

**4.11.3.2. Ignition Sources**

1) During loading and unloading operations, a *tank vehicle* and its delivery equipment shall be separated from ignition sources by distances conforming to the requirements for dispensers in Articles 4.6.3.3. and 4.6.8.7.

**4.11.3.3.****4.11.3.3. Static Electric Charges**

1) During loading and unloading of a *tank vehicle*, measures shall be taken against static electric charges in conformance with Articles 4.1.8.2. and 4.7.4.5.

**4.11.3.4. Supervision**

1) During loading and unloading of a *tank vehicle*, trained personnel shall be in a position to shut off the flow of liquid in an emergency.

**4.11.3.5. Multi-use Compartments**

1) When a compartment of a *tank vehicle* has been used to carry a Class I liquid, the compartment, piping and accessory delivery equipment shall be drained of liquid before a Class II or IIIA liquid is loaded.

**4.11.3.6. Engine**

1) When the loading or unloading of Class I liquids is done without the use of the engine of the *tank vehicle*, the engine ignition shall be shut off during the transfer operations.

**4.11.3.7. Unloading**

1) Before a *tank vehicle* is unloaded, the volume of liquid in the receiving tank shall be measured to ensure that the tank can accept the volume to be unloaded.

2) If the vents of the receiving or delivery tank are obstructed, the transfer of liquid shall be stopped.

3) A *tank vehicle* shall not be parked on a *street*, shoulder or sidewalk while unloading at a *fuel-dispensing station*.

**4.11.3.8. Dispensing into Vehicles**

1) Dispensing Class I liquids into the fuel tank of vehicles directly from a *tank vehicle* shall not be permitted.

2) Dispensing Class II or IIIA liquids into the fuel tank of vehicles directly from a *tank vehicle* having a capacity greater than 3 000 L shall be permitted only if

- a) the vehicles are located outdoors on a property where they are
  - i) not less than 6 m away from any *building*, and
  - ii) not exposed to undue hazard from accident or collision,
- b) at least 2 portable extinguishers having a minimum rating of 80-B:C are provided on the *tank vehicle*,
- c) the delivery hoses and automatically closing hose nozzle valves used for the fuel-dispensing operations conform to Subsection 4.6.5.,
- d) the *tank vehicle* operator is given training and equipment for controlling any spillage that may occur during the fuel-dispensing operations, and
- e) in cases where fuel-dispensing operations are carried out at a site not conforming to Subsection 4.1.6., measures are in place to control a spill of not less than 1 000 L.

**Section 4.12. Objectives and Functional Statements****4.12.1. Objectives and Functional Statements****4.12.1.1. Attribution to Acceptable Solutions**

1) For the purposes of compliance with this Code as required in Clause 1.2.1.1.(1)(b) of Division A, the objectives and functional statements attributed to the acceptable solutions in this Part shall be the objectives and functional statements listed in Table 4.12.1.1. (See A-1.1.2.1.(1) in Appendix A.)

**Table 4.12.1.1.**  
**Objectives and Functional Statements Attributed to the Acceptable Solutions in Part 4**  
 Forming Part of Sentence 4.12.1.1.(1)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.1.3.1. Determination of Flash Point</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
(3)	[F01–OS1.1]
(4)	[F01–OS1.1]
<b>4.1.4.1. Hazardous Locations</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
<b>4.1.5.1. Additional Fire Protection Equipment</b>	
(1)	[F02,F03–OP1.2]
	[F02,F03–OS1.2]
<b>4.1.5.2. Ignition Sources</b>	
(1)	[F01–OS1.1] Applies to portion of Code text: "... a device, operation or activity that produces open flames, sparks or heat shall not be permitted in an area described in Article 4.1.1.1."
	[F01–OS1.1] Applies to portion of Code text: "Unless controlled in a manner that will not create a fire or explosion hazard ..."
<b>4.1.5.3. Smoking</b>	
(1)	[F01–OS1.1]
<b>4.1.5.4. Removal of Combustibles</b>	
(1)	[F01–OS1.1]
<b>4.1.5.5. Emergency Planning</b>	
(2)	[F12–OS1.2]
<b>4.1.5.6. Access for Firefighting</b>	
(1)	[F12–OP1.2]
	[F12–OP3.1]
	[F12–OS1.2]
<b>4.1.5.8. Basement Storage</b>	
(1)	[F43,F01–OS1.1]
(2)	[F02,F43–OS1.1]
<b>4.1.6.1. Spill Control</b>	
(1)	[F44–OH5]
	[F44–OP1.1,OP1.2] Applies to preventing spills from flowing outside the spill area.
	[F44–OS1.1,OS1.2] Applies to preventing spills from flowing outside the spill area.
(3)	[F44–OH5]
	[F44–OS1.1,OS1.2]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(4)	[F44–OH5]
	[F44–OP1.1,OP1.2]
	[F44–OS1.1,OS1.2]
(5)	[F01,F44–OP3.1]
<b>4.1.6.2. Drainage Systems</b>	
(1)	(a),(b) [F44–OP1.1,OP1.2]
	(a),(b) [F44–OS1.1,OS1.2,OS1.4]
	(a) [F44–OH5] Applies to the termination of the drainage system where it will not create a risk to public health.
(2)	[F03–OS1.2]
<b>4.1.6.3. Spills and Leaks</b>	
(1)	[F82,F44–OP1.1,OP1.2]
	[F82,F44–OP1.1,OP1.2]
	[F82,F44–OS1.1,OS1.2]
	[F82,F44–OS1.1,OS1.2]
(2)	[F44–OH5]
	[F44–OP1.1,OP1.2]
	[F44–OS1.1,OS1.2]
(3)	(a) [F01,F02–OS1.1] (b) [F02–OS1.1,OS1.2]
	(a) [F44–OP1.1,OP1.2] (b) [F02–OP1.1,OP1.2]
(4)	[F01–OS1.1]
	[F43–OS3.4]
<b>4.1.7.1. Rooms or Enclosed Spaces</b>	
(1)	[F01–OS1.1] Applies to portion of Code text: "... shall conform ... to this Part, and the Alberta Building Code 2006."
<b>4.1.7.2. Ventilation Measures</b>	
(1)	[F01–OS1.1]
(2)	[F43–OS1.1]
(3)	[F01–OS1.1]
(4)	[F01–OS1.1]
(5)	(c) [F01,F02–OS1.1,OS1.2]
	(c) [F02–OP1.2]
	(a) [F01–OS1.1]
	(b) [F11–OS1.1]
<b>4.1.7.3. Location of Air Inlets and Outlets</b>	
(2)	[F01–OS1.1]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F01-OS1.1]
<b>4.1.7.4. Location of Mechanical Ventilation Exhaust Air Outlets</b>	
(1)	(a) [F01-OS1.1]
	(b) [F01-OS1.1] [F03-OS1.2]
	(b) [F03-OP1.2]
	(b) [F03-OP3.1]
<b>4.1.7.5. Make-up Air</b>	
(1)	[F03-OP1.2]
	[F03-OS1.2]
(2)	[F01-OS1.1]
(3)	[F01,F44-OS1.2]
<b>4.1.7.6. Recirculating Ventilation Systems</b>	
(1)	[F01-OS1.1]
	(a),(b)(i) [F11,F01-OS1.1]
<b>4.1.7.7. Exclusive Use of Ducts</b>	
(1)	[F01,F44-OP1.1,OP1.2] [F03-OP1.2]
	[F01,F44-OS1.1,OS1.2] [F03-OS1.2]
<b>4.1.7.8. Maintenance</b>	
(1)	[F82-OS1.1]
<b>4.1.8.1. Containers and Storage Tanks</b>	
(2)	[F43-OS1.1]
(3)	[F43-OS1.1]
<b>4.1.8.2. Control of Static Electric Charge</b>	
(1)	[F01-OS1.1]
	(b) [F01-OS1.1]
(2)	[F01-OS1.1]
(4)	[F22-OS1.1]
<b>4.1.8.3. Transfer</b>	
(1)	(b) [F43-OS1.1]
	(c) [F43-OS1.1]
(2)	[F20,F81,F01-OS1.1]
(3)	[F43-OH5]
<b>4.1.8.4. Fuel Tanks of Vehicles</b>	
(1)	[F01,F43,F81-OS1.1]
(2)	[F43-OS1.1]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.2.2.1. Prohibited Locations</b>	
(1)	[F03–OS1.2] Applies to storage near elevators.
	[F10,F12,F05,F06–OS1.5] Applies to storage in or adjacent to <i>exits</i> or principal routes that provide <i>access to exits</i> .
<b>4.2.2.2. Storage Arrangement</b>	
(1)	[F04–OP1.2]
	[F20–OH5]
	[F20–OS1.1,OS1.2] [F04–OS1.2,OS1.5]
<b>4.2.3.1. Design and Construction</b>	
(1)	[F20,F43,F80,F81–OH5]
	[F20,F43,F80,F81,F01–OS1.1]
	(d) [F01,F43,F04–OS1.1]
<b>4.2.3.2. Markings or Labels</b>	
(1)	[F81–OS1.1] [F12–OS1.1,OS1.2]
(2)	[F81–OS1.1] [F12–OS1.1,OS1.2]
<b>4.2.4.2. Maximum Quantities</b>	
(2)	[F02–OP1.2]
	[F02–OS1.2]
(3)	[F02–OP1.2]
	[F02–OS1.2]
(4)	[F02,F03–OP1.2]
	[F02,F03–OS1.2]
	(a) [F02–OP1.2] Applies to storage in cabinets not exceeding the quantity permitted for one cabinet.
	(a) [F02–OS1.2]
	(b) [F03–OS1.2]
<b>4.2.4.3. Storage Cabinets and Storage Rooms</b>	
(1)	[F12–OP1.2] [F01–OP1.1]
	[F12–OS1.2] [F01–OS1.1]
<b>4.2.4.4. Exterior Balconies</b>	
(1)	[F03–OP1.2]
	[F03–OS1.2]
<b>4.2.4.5. Dwelling Units</b>	
(1)	[F02–OP1.2]
	[F02–OS1.2]
(2)	[F02–OP1.2]
	[F02–OS1.2]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F02–OP1.2]
	[F02–OS1.2]
<b>4.2.4.6. Attached Garages and Sheds</b>	
(1)	[F02–OP1.2]
	[F02–OS1.2]
<b>4.2.5.1. Maximum Quantities</b>	
(2)	[F02–OP1.2]
	[F02–OS1.2]
(3)	[F02–OP1.2]
	[F02–OS1.2]
(5)	[F02,F03–OP1.2]
	[F02,F03–OS1.2]
<b>4.2.5.2. Containers</b>	
(1)	[F01,F43–OS1.1]
(2)	[F04–OP1.2]
	[F20–OH5]
	[F20–OS1.1,OS1.2] [F04–OS1.5]
(3)	[F01,F43–OS1.2]
<b>4.2.5.3. Transfer</b>	
(1)	[F01,F43–OS1.1]
<b>4.2.6.2. Storage Cabinets and Storage Rooms</b>	
(1)	[F02,F03–OP1.2]
	[F02,F03–OS1.2]
	(a) [F02–OP1.2] Applies to storage in cabinets not exceeding the quantity permitted for one cabinet.
	(a) [F02–OS1.2] Applies to storage in cabinets not exceeding the quantity permitted for one cabinet.
	[F01,F43–OS1.1] Applies to portion of Code text: “Except as permitted in Article 4.2.6.3., <i>flammable liquids</i> and <i>combustible liquids</i> shall be kept in closed containers ...”
	(b) [F03–OS1.2]
<b>4.2.6.3. Maximum Quantities</b>	
(1)	[F02,F03–OP1.2]
	[F02,F03–OS1.2]
(2)	[F02–OP1.2]
	[F02–OS1.2]
<b>4.2.6.4. Containers</b>	
(1)	[F04,F43,F01–OS1.1] [F02–OS1.2]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.2.6.5. Separation of Dangerous Goods</b>	
(1)	[F03–OS1.2]
<b>4.2.7.2. Storage Facilities</b>	
(1)	[F02,F03–OP1.2]
	[F02,F03–OS1.2]
<b>4.2.7.3. Fire Compartments</b>	
(1)	[F03–OP1.2]
	[F03–OS1.2]
<b>4.2.7.4. Dispensing and Transfer</b>	
(1)	[F01,F02,F03–OP1.2]
	[F01,F02,F03–OS1.2]
(2)	[F01,F02–OP1.1,OP1.2]
	[F02,F01–OS1.2,OS1.1]
<b>4.2.7.5. Maximum Quantities</b>	
(1)	[F03,F02–OP1.2]
	[F03,F02–OS1.2]
	[F04–OP1.2]
	[F20–OH5]
	[F20–OS1.1,OS1.2] [F04–OS1.2,OS1.5]
	[F43,F01–OS1.1]
(2)	[F03–OP1.2]
	[F03–OS1.2]
<b>4.2.7.6. Fire Suppression Systems</b>	
(1)	[F02–OP1.1]
	[F02–OS1.2]
<b>4.2.7.7. Clearances</b>	
(1)	[F04–OP1.3]
	[F04–OS1.3]
(2)	[F02–OP1.2]
	[F02–OS1.2]
(3)	[F81,F82–OS1.1] [F10–OS1.5]
<b>4.2.7.10. Separation from Combustible Products</b>	
(1)	[F03–OS1.2]
<b>4.2.8.2. Maximum Quantities</b>	
(1)	[F02–OP1.2]
	[F02–OS1.2]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(2)	[F02–OP1.2]
	[F02–OS1.2]
(3)	[F02–OP1.2]
	[F02–OS1.2]
<b>4.2.8.3. Handling</b>	
(1)	(a) [F01–OS1.1]
<b>4.2.8.4. General Storage Areas</b>	
(1)	[F02,F03–OP1.2]
	[F02,F03–OS1.2]
(4)	[F02–OP1.2]
	[F02–OS1.2]
<b>4.2.9.1. Maximum Quantities</b>	
(1)	[F02–OP1.2] Applies to storage densities averaged over the total room area.
	[F02–OP1.2] Applies to the total quantities of <i>flammable liquids</i> and <i>combustible liquids</i> .
	[F02–OS1.2] Applies to storage densities averaged over the total room area.
	[F02–OS1.2] Applies to the total quantities of <i>flammable liquids</i> and <i>combustible liquids</i> .
	[F03–OP1.2] Applies to the <i>fire-resistance ratings</i> of <i>fire separations</i> .
	[F03–OS1.2] Applies to the <i>fire-resistance ratings</i> of <i>fire separations</i> .
(2)	[F02–OP1.2]
	[F02–OS1.2]
<b>4.2.9.2. Spill Control</b>	
(1)	[F44–OH5]
	[F44–OP1.2]
	[F44–OS1.1,OS1.2]
<b>4.2.9.3. Aisles</b>	
(1)	[F12–OP1.2]
	[F81,F82–OS1.1,OS1.2] [F12–OS1.2] [F10–OS1.5]
<b>4.2.9.4. Dispensing</b>	
(1)	[F43,F01–OS1.1]
<b>4.2.9.5. Explosion Venting</b>	
(1)	[F02–OP1.3]
	[F02–OS1.3]
<b>4.2.10.1. Containers</b>	
(1)	[F43,F01–OS1.1] Applies to storage in <i>closed containers</i> .

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.2.10.2. Maximum Quantity per Cabinet</b>	
(1)	[F02–OP1.2]
	[F02–OS1.2]
<b>4.2.10.3. Maximum Quantity per Fire Compartment</b>	
(1)	[F02–OP1.2]
	[F02–OS1.2]
(2)	[F02–OP1.2]
	[F02–OS1.2]
(3)	[F02–OP1.2]
	[F02–OS1.2]
<b>4.2.10.4. Labelling</b>	
(1)	[F01–OS1.1]
<b>4.2.10.5. Fire Endurance</b>	
(1)	[F01–OS1.1]
	[F03–OP1.2]
	[F03–OS1.2]
	[F44–OH5]
	[F44–OP1.1]
	[F44–OS1.1]
<b>4.2.10.6. Ventilation</b>	
(1)	(a) [F01–OS1.1,OS1.2] Applies to materials providing equivalent fire protection. (b) [F01–OS1.1,OS1.2] Applies to the vent piping providing equivalent fire protection.
	(a) [F01–OS1.1] Applies to portion of Code text: "... the ventilation openings shall be sealed ..." (b) [F01–OS1.1] Applies to portion of Code text: "... the cabinet shall be vented outdoors ..."
<b>4.2.11.1. Quantities and Clearances</b>	
(1)	[F03,F02–OP3.1]
	[F03,F02–OS1.2]
(2)	(a),(b) [F03,F02–OP3.1]
	(a),(b) [F03,F02–OS1.2]
<b>4.2.11.3. Fire Department Access</b>	
(1)	[F12–OP3.1]
<b>4.3.1.2. Atmospheric Storage Tanks</b>	
(1)	[F20,F80,F43,F81–OH5]
	[F20,F80,F43,F81,F01–OS1.1]
(4)	[F01,F20,F81–OS1.1]
	[F20,F81–OH5]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.3.1.3. Low Pressure Storage Tanks and Pressure Vessels</b>	
(1)	[F43,F80,F81,F20–OH5]
	[F43,F80,F81,F20,F01–OS1.1]
(2)	[F43,F81,F80,F20–OH5]
	[F81,F80,F43,F01,F20–OS1.1]
<b>4.3.1.4. Operating Pressure</b>	
(1)	[F81,F20–OH5]
	[F81,F20–OS1.1]
<b>4.3.1.5. Corrosion Protection</b>	
(1)	[F80–OH5]
	[F80–OS1.1]
<b>4.3.1.6. Floating Roofs</b>	
(1)	[F04–OS1.1]
<b>4.3.1.7. Identification</b>	
(1)	[F12–OP1.2]
	[F81–OS1.1] [F12–OS1.2]
(2)	[F12–OP1.2]
	[F12–OS1.2]
(3)	[F12–OP1.2]
	[F12–OS1.2]
<b>4.3.1.8. Overfill Protection</b>	
(1)	[F43–OH5]
	[F43–OS1.1]
<b>4.3.1.9. Installation and Use</b>	
(1)	[F81,F80,F43,F01,F20–OH5]
	[F81,F80,F43,F01,F20–OS1.1]
<b>4.3.1.10. Reuse</b>	
(2)	[F20,F43–OH5]
	[F20,F43,F01–OS1.1]
(3)	[F20,F43–OH5]
	[F20,F43,F01–OS1.1]
(4)	[F81–OH5]
	[F81–OS1.1]
<b>4.3.2.1. Location</b>	
(2)	[F03–OP3.1]
	[F03–OS1.2]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F03–OP3.1]
	[F03–OS1.2]
(4)	[F03–OP3.1]
	[F03–OS1.2]
(5)	[F03–OP3.1]
	[F03–OS1.2]
(6)	(a) [F03–OP3.1]
	(a) [F03–OS1.2]
	(b) [F01,F02–OP3.1]
	(b) [F01,F02–OS1.2]
(7)	[F04,F02–OP3.1]
	(a) [F04,F02–OS1.2]
(8)	[F02–OP3.1]
<b>4.3.2.2. Spacing between Storage Tanks</b>	
(1)	[F03,F12–OP1.2] Applies to the minimum distance being 0.25 times the sum of the tanks' diameters.
	[F82–OH5] Applies to the minimum distance of 1 m between the <i>storage tanks</i> .
	[F82–OP1.2] Applies to the minimum distance of 1 m between the <i>storage tanks</i> .
	[F82–OS1.1] Applies to the minimum distance of 1 m between the <i>storage tanks</i> .
(2)	[F03–OP1.2]
(3)	[F03–OP1.2]
<b>4.3.2.3. Clearances from Liquefied Petroleum Gas Cylinders and Tanks</b>	
(1)	[F03–OP1.2]
(2)	[F02,F03–OP1.2]
<b>4.3.2.4. Fire Department Access</b>	
(1)	[F12–OP1.2]
(2)	[F12–OP1.2]
(3)	[F02,F03–OP1.2]
<b>4.3.2.5. Fire Protection Systems</b>	
(2)	[F02–OS1.2]
	[F02,F03–OP1.2]
<b>4.3.3.1. Foundations and Supports</b>	
(1)	[F22,F81,F20–OH5]
	[F22,F81,F20–OS1.1]
	[F02–OS1.2] Applies to the requirement that <i>storage tanks</i> rest on the ground or on foundations, supports or piling made of concrete, masonry or steel.

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(2)	[F22–OH5] Applies to the installation of tank supports on firm foundations designed to minimize uneven settling of the tank.
	[F22–OS1.1] Applies to the installation of tank supports on firm foundations designed to minimize uneven settling of the tank.
	[F80–OH5] Applies to the installation of tank supports on firm foundations designed to minimize corrosion of the part of the tank resting on the foundation.
	[F80–OS1.1] Applies to the minimizing of corrosion of the part of the tank resting on the foundation.
(3)	[F04–OS1.2] Applies to portion of Code text: "... supports for <i>storage tanks</i> shall provide a <i>fire-resistance rating</i> of not less than 2 h."
	[F04–OS1.2] Applies to the use of steel saddles that are less than 300 mm high at their highest point.
(4)	[F20,F81–OH5]
	[F20,F81–OS1.1]
<b>4.3.3.2. Earthquake Protection</b>	
(1)	[F22–OH5]
	[F22–OS1.1]
<b>4.3.3.3. Protection Against Flooding</b>	
(1)	[F22–OH5]
	[F22–OS1.1]
<b>4.3.3.4. Protection Against Mechanical Damage</b>	
(1)	[F22–OS1.1]
	[F22–OH5]
<b>4.3.4.1. Design and Installation</b>	
(1)	[F04,F81–OS1.1] Applies to the requirement for emergency venting.
	[F20,F81–OH5] Applies to the requirement for normal venting.
	[F20,F81–OS1.1] Applies to the requirement for normal venting.
<b>4.3.4.2. Unstable Liquids</b>	
(1)	[F20,F81,F04–OH5]
	[F20,F81,F04–OS1.1]
<b>4.3.5.2. Location of Vent Pipe Outlets</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
(3)	[F01–OS1.1]
<b>4.3.5.3. Interconnection of Vent Piping</b>	
(1)	[F20,F81–OH5]
	[F20,F81–OS1.1]
(2)	[F01–OS1.1]

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.3.6.1. Provision of Valves</b>	
(1)	[F44–OH5]
	[F44–OP1.1]
	[F44–OS1.1]
(2)	[F44–OH5]
	[F44–OP1.1]
	[F44–OS1.1]
<b>4.3.6.2. Materials</b>	
(1)	[F04,F20–OH5] Applies to portion of Code text: “Valves and their connections to a <i>storage tank</i> shall be made of steel ...”
	[F04,F20–OS1.1] Applies to portion of Code text: “Valves and their connections to a <i>storage tank</i> shall be made of steel ...”
(2)	[F20,F04–OS1.1]
	[F20,F04–OH5] Applies to the materials for valves and their connections to a <i>storage tank</i> being suitable for the pressures, stresses and temperatures.
<b>4.3.6.3. Openings for Liquid Level Measurements</b>	
(1)	[F43,F01,F81,F34–OS1.1]
	[F43,F81,F34–OH5]
<b>4.3.6.4. Connections for Filling and Emptying</b>	
(1)	(a),(b) [F01–OS1.1]
	(a),(c) [F01–OS1.1]
(2)	[F43,F01,F81,F34–OS1.1]
	[F43,F81,F34–OH5]
(3)	[F01–OS1.1]
<b>4.3.7.2. Construction</b>	
(1)	(a) [F20–OH5] Applies to the base and walls of secondary containments being designed, constructed and maintained to withstand full hydrostatic head.
	(a) [F20–OP1.1] Applies to the base and walls of secondary containments being designed, constructed and maintained to withstand full hydrostatic head.
	(a) [F20–OS1.1] Applies to the base and walls of secondary containments being designed, constructed and maintained to withstand full hydrostatic head.
	(b) [F44–OH5] Applies to the base and walls of secondary containments being designed, constructed and maintained to provide the stated permeability.
	(b) [F44–OP1.1] Applies to the base and walls of secondary containments being designed, constructed and maintained to provide the stated permeability.
	(b) [F44–OS1.1] Applies to the base and walls of secondary containments being designed, constructed and maintained to provide the stated permeability.
	[F04–OP1.1] Applies to the construction of the base and walls of secondary containments with noncombustible materials.
	[F04–OS1.1] Applies to the construction of the base and walls of secondary containments with noncombustible materials.

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(2)	[F44–OP1.1]
	[F44–OS1.1]
(3)	[F44–OH5]
	[F44–OP1.1]
	[F44–OS1.1]
<b>4.3.7.3. Capacity</b>	
(1)	[F44–OH5]
	[F44–OP1.1]
	[F44–OS1.1]
(2)	[F44–OH5]
	[F44–OP1.1]
	[F44–OS1.1]
(3)	[F44–OH5]
	[F44–OP1.1]
	[F44–OS1.1]
<b>4.3.7.4. Clearances</b>	
(1)	[F01,F82–OP1.1] [F12–OP1.2]
	[F01,F82–OS1.1] [F12–OS1.2]
	[F82–OH5]
(2)	[F44,F81–OH5]
	[F44,F81–OP1.1]
	[F44,F81–OS1.1]
(3)	[F44,F81–OH5]
	[F44,F81–OP1.1]
	[F44,F81–OS1.1]
<b>4.3.7.5. Access to Storage Tanks and Ancillary Equipment</b>	
(1)	(a) [F82–OP1.1] [F12–OP1.2]
	(a) [F82–OS1.1] [F12–OS1.2]
	(a) [F82,F12–OH5]
	(b) [F10–OS1.5]
	(b) [F10–OS3.4]
	(c) [F12–OP1.2]
	(c) [F12–OS1.2]
(2)	[F12–OH5]
	[F12–OP1.1]
	[F12–OS1.1]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.3.7.6. Emergency Venting</b>	
(1)	[F04–OP1.1]
	[F04–OS1.1]
<b>4.3.7.7. Leak Detection</b>	
(1)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
<b>4.3.7.8. Drainage</b>	
(1)	[F81,F44–OH5]
	[F81,F44–OP1.1] [F12–OP1.2]
	[F81,F44–OS1.1] [F12–OS1.2]
	[F01,F02–OS1.1] Applies to the accumulation of liquids and debris.
(3)	(a) [F44–OH5]
	(a) [F44–OP1.1]
	(a) [F44–OS1.1]
	(b),(c) [F12–OP1.1]
	(b),(c) [F12–OS1.1]
(4)	[F40–OH5]
<b>4.3.7.9. Use of Secondary Containment</b>	
(1)	[F81,F44,F01,F02–OP1.1] [F12–OP1.2]
	[F81,F44,F01,F02–OS1.1] [F12–OS1.2]
	[F81,F44,F01,F02,F12–OH5]
<b>4.3.8.1. Location</b>	
(1)	[F81,F20–OH5]
	[F81,F20–OS1.1]
(2)	(a) [F20,F21–OH5] (b) [F20,F21–OH5] Applies to the distance from a <i>building</i> foundation.
	(a) [F20,F21–OS1.1] (b) [F20,F21–OS1.1] Applies to the distance from a <i>building</i> foundation.
	(b) [F01–OP3.1] Applies to the distance from a <i>building</i> foundation.
	(b) [F01–OS1.1] Applies to the distance from a <i>building</i> foundation.
	(b) [F81–OH5] Applies to the distance from <i>street</i> lines. (c) [F81–OH5]
	(b) [F81–OS1.1] Applies to the distance from <i>street</i> lines. (c) [F81–OS1.1]
	(6)
(7)	[F43,F44,F81–OH5]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.3.8.2. Ground Cover</b>	
(1)	[F20,F81–OH5]
	[F20,F81–OS1.1]
(2)	[F20,F81–OH5]
	[F20,F81–OS1.1]
(3)	[F20,F81–OH5]
	[F20,F81–OS1.1]
(4)	[F81,F04,F20–OH5]
	[F81,F04,F20–OS1.1]
<b>4.3.8.3. Damage Repair</b>	
(1)	[F82–OH5]
	[F82–OS1.1]
(2)	[F81,F82–OH5]
	[F81,F82–OS1.1]
<b>4.3.8.4. Damage Prevention</b>	
(1)	[F81–OH5]
	[F81–OS1.1]
(2)	[F81–OH5]
	[F81–OS1.1]
<b>4.3.8.5. Installation</b>	
(1)	[F81–OH5]
	[F81–OS1.1]
(2)	[F81–OH5]
	[F81–OS1.1]
(3)	[F20–OH5]
	[F20–OS1.1]
<b>4.3.8.6. Filling</b>	
(1)	[F43–OH5]
	[F43–OS1.1]
<b>4.3.8.8. Anchorage</b>	
(1)	[F22–OH5]
	[F22–OS1.1]
(2)	[F81–OH5]
	[F81–OS1.1]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.3.9.1. Corrosion Protection</b>	
(1)	[F80–OH5]
	[F80–OS1.1]
(2)	[F80–OH5]
	[F80–OS1.1]
<b>4.3.9.2. Testing</b>	
(1)	[F80–OH5]
<b>4.3.9.3. Installation</b>	
(1)	[F80,F81–OH5]
(2)	[F80,F81–OH5]
<b>4.3.10.1. Vent Design</b>	
(1)	[F20,F81–OH5]
	[F20,F81–OS1.1]
<b>4.3.10.3. Installation</b>	
(1)	(a) [F43–OH5] Applies to the vent pipe outlets being higher than the fill pipe openings.
	(a) [F43–OS1.1] Applies to the vent pipe outlets being higher than the fill pipe openings.
	(a)(i),(b) [F01–OS1.1]
	(a)(ii),(b) [F01–OS1.1]
	(a)(iii) [F01–OS1.1]
(2)	[F01–OS1.1] Applies to portion of Code text: “Vent pipe outlets from underground <i>storage tanks</i> for Class II or IIIA liquids shall be located outside <i>buildings</i> ...”
	[F01–OS1.1] Applies to the requirement for vent pipe outlets to be located outside <i>buildings</i> at not less than 2 m above finished ground level.
	[F43–OH5] Applies to the requirement for the vent pipe outlets to be located outside <i>buildings</i> at a height that is above the fill pipe opening.
	[F43–OS1.1] Applies to the requirement for vent pipe outlets to be located outside <i>buildings</i> at a height that is above the fill pipe opening.
(3)	[F20,F81–OH5] Applies to the requirement for vent pipes to not be obstructed by any device that may cause excessive back pressure.
	[F20,F81–OS1.1] Applies to the requirement for vent pipes to not be obstructed by any device that may cause excessive back pressure.
(4)	[F11–OH5] Applies to portion of Code text: “... except when the vent is equipped with a vent alarm.”
	[F11–OS1.1] Applies to portion of Code text: “... except when the vent is equipped with a vent alarm.”
	[F20,F81–OH5] Applies to portion of Code text: “Vent piping shall enter the <i>storage tank</i> through the top of the tank and shall not extend into the tank more than 25 mm ...”
	[F20,F81–OS1.1] Applies to portion of Code text: “Vent piping shall enter the <i>storage tank</i> through the top of the tank and shall not extend into the tank more than 25 mm ...”

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(5)	(a),(b),(c) [F81,F20–OH5]
	(a),(b),(c) [F81,F20–OS1.1]
	(d) [F81–OH5]
	(d) [F81–OS1.1]
<b>4.3.10.4. Interconnection of Vent Pipes</b>	
(1)	[F20,F81–OH5]
	[F20,F81–OS1.1]
(2)	[F20–OH5]
	[F20–OS1.1]
(3)	[F01–OS1.1]
<b>4.3.11.1. Connections</b>	
(1)	[F43–OH5]
	[F43,F01–OS1.1]
<b>4.3.11.2. Openings for Measuring Liquid Level</b>	
(1)	[F43,F01,F81,F34–OS1.1]
	[F43,F81,F34–OH5]
<b>4.3.11.3. Fill Piping and Discharge Piping</b>	
(1)	[F43–OH5] Applies to portion of Code text: "... discharge piping used in suction systems shall be sloped toward the <i>storage tanks</i> ."
	[F43–OH5] Applies to portion of Code text: "Fill piping and discharge piping shall enter underground <i>storage tanks</i> only through the top of the tank ..."
	[F43–OS1.1] Applies to portion of Code text: "... discharge piping used in suction systems shall be sloped toward the <i>storage tanks</i> ."
	[F43–OS1.1] Applies to portion of Code text: "Fill piping and discharge piping shall enter underground <i>storage tanks</i> only through the top of the tank ..."
(2)	[F43–OH5]
	[F43–OS1.1]
(3)	(a),(b) [F01–OS1.1]
	(a),(c) [F01–OS1.1]
(4)	[F43–OH5]
	[F43,F01–OS1.1]
(5)	[F01–OS1.1]
<b>4.3.12.1. Occupancy</b>	
(1)	[F01,F02–OS1.1]
<b>4.3.12.2. Stationary Combustion Engines</b>	
(1)	[F01,F02,F03,F04,F43,F81–OS1.1,OS1.2]
(2)	[F01,F02,F03,F04,F43,F81–OS1.1,OS1.2]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.3.12.3. Maximum Static Head</b>	
(1)	[F20–OH5]
	[F20–OS1.1]
<b>4.3.12.4. Maximum Quantities and Location</b>	
(1)	(b) [F01–OP1.1] [F02–OP1.2]
	(b) [F01–OS1.1] [F02–OS1.2]
<b>4.3.12.5. Fire Compartments</b>	
(1)	[F03–OP1.2]
	[F03–OS1.2]
<b>4.3.12.6. Mixed Storage</b>	
(1)	[F01–OP1.1] [F02–OP1.2]
	[F01–OS1.1] [F02–OS1.2]
<b>4.3.12.7. Storage Tanks outside Storage Rooms</b>	
(1)	[F01–OS1.1]
	(a) [F44–OH5]
	(a) [F44–OP1.1]
	(a) [F44–OS1.1]
<b>4.3.12.8. Vents</b>	
(2)	[F01–OS1.1]
<b>4.3.12.9. Supports, Foundations and Anchorage</b>	
(2)	[F22,F81,F04,F80,F20–OH5]
	[F22,F81,F20,F80,F04–OS1.1]
<b>4.3.12.10. Bonding and Grounding</b>	
(1)	[F01–OS1.1]
<b>4.3.13.1. Design and Construction</b>	
(1)	[F81–OS1.1,OS1.2]
	[F81–OP1.1,OP1.2]
<b>4.3.13.2. Clearances</b>	
(1)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
<b>4.3.13.3. Explosion Venting</b>	
(1)	[F02–OP1.3]
	[F02–OS1.3]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.3.13.4. Hose Stations and Portable Extinguishers</b>	
(1)	[F44–OP1.1]
	[F44–OS1.1]
	[F44–OH5] Applies to portion of Code text: "... shall be provided in the vicinity of the storage room, such that all parts of the room are within reach of a hose stream."
<b>4.3.13.5. Placards</b>	
(1)	[F12–OP1.2] Applies to the posting of placards in a conspicuous location outside of the room.
	[F12–OS1.2] Applies to the posting of placards in a conspicuous location outside of the room.
	[F81–OP1.1] [F12–OP1.2] Applies to the information being included in the fire safety plan required in Article 4.1.5.6.
	[F81–OS1.1] [F12–OS1.2] Applies to the information to be included in the fire safety plan required by Article 4.1.5.6.
<b>4.3.14.1. Connections</b>	
(1)	[F43–OH5]
	[F43,F01–OS1.1]
(2)	[F44–OH5]
	[F44–OP1.1]
	[F44–OS1.1]
<b>4.3.14.2. Openings for Liquid Level Measurement</b>	
(1)	[F43,F01,F81,F34–OS1.1]
	[F43,F81–OH5]
(2)	[F20,F81–OH5]
	[F20,F81–OS1.1]
<b>4.3.15.1. Underground Storage Tanks</b>	
(1)	[F34,F80–OH5]
(2)	[F34,F80–OH5]
(3)	[F34,F80–OH5]
<b>4.3.15.2. Aboveground Storage Tanks</b>	
(1)	[F34–OH5]
	[F34–OS1.1]
(2)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
(3)	[F43–OH5]
	[F43,F01–OS1.1]
(4)	[F43,F80–OH5]

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.3.15.3. Disposal</b>	
(1)	[F81–OH5]
	[F81–OS1.1]
<b>4.3.15.4. Corrosion Protection</b>	
(1)	[F43,F80,F82–OH5]
<b>4.3.16.1. Removal</b>	
(1)	[F01–OS1.1]
	[F40–OH5]
(2)	[F40–OH5]
<b>4.3.16.2. Abandonment in Place</b>	
(5)	[F01–OS1.1]
	[F40–OH5]
(6)	[F40–OH5]
<b>4.4.1.2. Frequency and Methods of Leak Detection Testing and Monitoring</b>	
(1)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
(3)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
<b>4.4.1.3. Remedial Action</b>	
(1)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
<b>4.4.2.1. Definition and Performance of Leak Detection Testing and Monitoring Methods</b>	
(2)	[F82,F01–OP1.1]
	[F82,F01–OS1.1]
	[F82,F43–OH5]
(3)	[F01,F82–OP1.1]
	[F01,F82–OS1.1]
	[F43,F82–OH5]
(4)	[F82,F01–OP1.1]
	[F82,F01–OS1.1]
	[F82,F43–OH5]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(5)	[F01,F82-OP1.1]
	[F01,F82-OS1.1]
	[F43,F82-OH5]
(6)	[F01,F82-OP1.1]
	[F01,F82-OS1.1]
	[F43,F82-OH5]
(7)	[F01,F82-OP1.1]
	[F01,F82-OS1.1]
	[F43,F82-OH5]
(8)	[F43,F82-OH5]
	[F82-OP1.1]
	[F82,F81-OS1.1]
(10)	[F01,F82-OS1.1]
	[F82-OH5]
(11)	[F01,F82-OP1.1]
	[F01,F82-OS1.1]
	[F82-OH5]
(12)	[F82-OH5]
	[F82-OP1.1]
	[F82-OS1.1]
<b>4.4.3.1. Leak Detection Tests</b>	
(1)	[F01,F82-OP1.1]
	[F01,F82-OS1.1]
	[F43,F82-OH5]
(3)	[F20,F81-OS1.1]
<b>4.4.3.2. Pneumatic Leak Detection Tests</b>	
(1)	[F01-OS1.1]
(2)	[F81-OH5]
	[F81-OP1.1]
	[F81-OS1.1]
(4)	[F20,F81-OS1.1]
	[F20,F81-OS3.4]
<b>4.4.3.3. Protocols for Pneumatic Leak Detection Testing of Storage Tanks</b>	
(3)	[F20,F81-OS1.1]
	[F20,F81-OS3.4]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(4)	[F20,F81-OS1.1]
	[F20,F81-OS3.4]
(5)	[F01-OS1.1]
<b>4.4.3.4. Protocols for Pneumatic Leak Detection Testing of Piping Systems</b>	
(3)	[F43-OH5]
	[F43-OS1.1]
(4)	[F43-OH5]
	[F43-OS1.1]
(5)	[F82-OH5]
	[F82-OP1.1]
	[F82-OS1.1]
(6)	[F82-OH5]
	[F82-OP1.1]
	[F82-OS1.1]
(7)	[F82-OH5]
	[F82-OP1.1]
	[F82-OS1.1]
<b>4.4.3.5. Protocols for Liquid Media Leak Detection Testing of Piping Systems</b>	
(2)	[F01,F82-OP1.1]
	[F01,F82-OS1.1]
(3)	[F01,F82-OP1.1]
	[F01,F82-OS1.1]
	[F43,F82-OH5]
(4)	[F82-OH5]
	[F82-OP1.1]
	[F82-OS1.1]
(5)	[F20,F81-OS1.1]
(7)	[F81-OH5]
	[F81-OP1.1]
	[F81-OS1.1]
(8)	[F43-OS1.1]
<b>4.4.3.6. Protocols for Leak Detection Testing of Sumps</b>	
(2)	[F82-OH5]
	[F82-OP1.1]
	[F82-OS1.1]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F82–OH5]
	[F82–OS1.1]
<b>4.4.4.1. Inventory Reconciliation</b>	
(1)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
(2)	[F82–OH5]
	[F82–OS1.1]
(3)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
<b>4.4.4.2. Leakage Detection</b>	
(1)	[F81,F82–OH5]
	[F81,F82–OS1.1]
<b>4.5.2.1. Materials</b>	
(1)	[F20–OH5] This applies to the suitability of materials for the maximum anticipated working pressures and operating temperatures.
	[F20–OP1.1] This applies to the suitability of materials for the maximum anticipated working pressures and operating temperatures.
	[F20–OS1.1] This applies to the suitability of materials for the maximum anticipated working pressures and operating temperatures.
	[F80–OH5] Applies to the suitability of materials for the chemical properties of the contained liquid.
	[F80–OP1.1] Applies to the suitability of materials for the chemical properties of the contained liquid.
	[F80–OS1.1] Applies to the suitability of materials for the chemical properties of the contained liquid.
(2)	(a) [F20–OH5]
	(a) [F20–OP1.1]
	(a) [F20–OS1.1]
	(b) [F04–OH5]
	(b) [F04–OP1.1]
	(b) [F04–OS1.1]
(3)	[F04,F81,F20–OH5]
	[F04,F81,F20–OP1.1]
	[F81,F04,F20–OS1.1]
(4)	[F80,F81,F20–OH5]
	[F80,F81,F20–OP1.1]
	[F80,F81,F20–OS1.1]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(5)	[F80,F81,F20-OH5]
	[F80,F81,F20-OP1.1]
	[F80,F81,F20-OS1.1]
<b>4.5.2.2. Special Materials</b>	
(1)	[F80,F81,F20-OH5]
	[F80,F81,F20-OP1.1]
	[F80,F81,F20-OS1.1]
<b>4.5.3.1. Corrosion Protection</b>	
(1)	[F80-OH5]
	[F80-OP1.1]
	[F80-OS1.1]
(2)	[F80-OH5]
	[F80-OP1.1]
	[F80-OS1.1]
<b>4.5.4.1. Identification</b>	
(1)	[F81-OS1.1] [F12-OS1.2]
(2)	[F81-OH5]
	[F81-OS1.1]
(3)	[F12-OP1.2]
	[F81-OS1.1] [F12-OS1.2]
<b>4.5.4.2. Documentation</b>	
(1)	[F12-OH5]
	[F12-OP1.2]
	[F12-OS1.2]
(2)	[F12-OH5]
	[F12-OP1.2]
	[F12-OS1.2]
<b>4.5.5.1. Threaded Joints</b>	
(1)	[F43-OH5]
	[F43-OP1.1]
	[F43-OS1.1]
<b>4.5.5.2. Welded Piping</b>	
(1)	[F20-OH5]
	[F20-OP1.1]
	[F20-OS1.1]
(2)	[F01-OS1.1]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.5.5.3. Flanged Joints</b>	
(1)	[F20–OH5]
	[F20–OP1.1]
	[F20–OS1.1]
<b>4.5.5.4. Bolting Materials</b>	
(1)	[F04–OH5]
	[F04–OP1.1]
	[F04–OS1.1]
<b>4.5.5.5. Gaskets</b>	
(1)	[F04,F20–OS1.1]
	[F20,F04–OP1.1]
	[F04,F20–OH5] Applies to portion of Code text: “Gaskets in flanged connections shall be of a material resistant to the liquid being carried ...”
<b>4.5.5.6. Mechanical Connections</b>	
(1)	(a) [F82–OH5] (b) [F80–OH5]
	(a) [F82–OP1.1] (b) [F80–OP1.1]
	(a) [F82–OS1.1] (b) [F80–OS1.1]
<b>4.5.6.1. Location</b>	
(1)	[F43–OP1.1]
	[F43–OS1.1]
(2)	[F43–OH5]
	[F43–OP1.1]
	[F43–OS1.1]
(3)	[F81–OH5]
	[F81–OP1.1]
	[F81–OS1.1]
<b>4.5.6.2. Supports for Aboveground Outdoor Piping</b>	
(1)	[F20,F22–OH5]
	[F20,F22–OP1.1]
	[F20,F22–OS1.1]
(2)	[F80–OH5]
	[F80–OP1.1]
	[F80–OS1.1]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F80,F82–OH5]
	[F80,F82–OP1.1]
	[F80,F82–OS1.1]
<b>4.5.6.3. Arrangement of Aboveground Outdoor Piping</b>	
(1)	(a) [F01–OP1.1,OP1.2]
	(a) [F01–OS1.1,OS1.2]
	(b) [F01,F04–OP1.1]
	(b) [F01,F04–OS1.1]
(2)	[F02–OP1.2] Applies to the requirement for <i>noncombustible construction</i> .
	[F02–OS1.2] Applies to the requirement for <i>noncombustible construction</i> .
	[F44–OP1.1] Applies to the requirement for impermeable construction.
	[F44–OS1.1] Applies to the requirement for impermeable construction.
(3)	[F81–OH5]
	[F81–OP1.1]
	[F81–OS1.1]
(4)	[F04,F21–OP1.1]
	[F21,F04–OS1.1]
	[F04,F21–OH5] Applies to designing to prevent excessive stress resulting from settlement.
<b>4.5.6.4. Underground Piping</b>	
(1)	[F81,F21–OH5]
	[F81,F21–OP1.1]
	[F81,F21–OS1.1]
(2)	[F81,F20–OH5]
	[F81,F20–OP1.1]
	[F81,F20–OS1.1]
(3)	[F81,F21–OH5]
	[F81,F21–OP1.1]
	[F81,F21–OS1.1]
(4)	[F81,F21–OH5]
	[F81,F21–OP1.1]
	[F81,F21–OS1.1]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.5.6.5. Installation of Underground Piping</b>	
(1)	(a) [F20,F22–OH5]
	(a) [F20,F22–OP1.1]
	(a) [F20,F22–OS1.1]
	(b) [F21,F81,F20–OH5]
	(b) [F21,F81,F20–OP1.1]
	(b) [F21,F81,F20–OS1.1]
(5)	[F43,F44,F81–OH5]
(6)	[F43,F44,F81–OH5]
<b>4.5.6.6. Piping in Service Tunnels</b>	
(1)	[F43–OS1.1]
<b>4.5.6.7. Piping at Entrances to Buildings</b>	
(1)	[F82,F21–OH5]
	[F82,F21–OP1.1]
	[F82,F21–OS1.1]
(2)	[F44–OH5]
	[F44–OP1.1]
	[F44–OS1.1]
(3)	[F21–OH5]
	[F21–OP1.1]
	[F21–OS1.1]
<b>4.5.6.8. Indoor Piping</b>	
(1)	[F81–OP1.1] Applies to the requirement for indoor piping to be supported overhead or located in trenches.
	[F81–OS1.1] Applies to indoor piping being supported overhead or being located in trenches.
(2)	[F02–OP1.2] [F04–OP1.1]
	[F02–OS1.2] [F04–OS1.1]
<b>4.5.6.9. Piping in Trenches</b>	
(2)	[F01–OP1.1]
	[F01–OS1.1]
<b>4.5.6.10. Overhead Piping</b>	
(1)	[F81–OP1.1]
	[F81–OS1.1]
(2)	[F20–OP1.1]
	[F20–OS1.1]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F20–OP1.1]
	[F20–OS1.1]
(4)	[F20–OP1.1]
	[F20–OS1.1]
<b>4.5.6.11. Supports for Overhead Piping</b>	
(1)	[F20–OP1.1]
	[F20–OS1.1]
(2)	[F20–OP1.1]
	[F20–OS1.1]
<b>4.5.6.12. Protection of Pipe Risers</b>	
(1)	[F81–OP1.1]
	[F81–OS1.1]
<b>4.5.6.13. Provision for Expansion and Contraction</b>	
(1)	[F21–OH5]
	[F21–OP1.1]
	[F21–OS1.1]
(2)	[F20,F21,F81–OH5]
	[F20,F21,F81–OP1.1]
	[F20,F21,F81–OS1.1]
<b>4.5.7.1. Design</b>	
(1)	[F20,F81–OH5]
	[F20,F81–OS1.1]
	[F81,F20–OP1.1]
(2)	[F81,F20–OH5]
	[F81,F20–OP1.1]
	[F81,F20–OS1.1]
(3)	[F81,F20–OH5]
	[F81,F20–OP1.3]
	[F81,F20–OS1.1]
<b>4.5.7.2. Shut-off Valves</b>	
(1)	[F44–OH5]
	[F44–OP1.1]
	[F44–OS1.1]
(2)	[F44,F12–OH5]
	[F44,F12–OP1.1]
	[F44,F12–OS1.1]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	(a),(b),(c),(d),(e) [F12,F44–OH5] Applies to the requirement for shut-off valves.
	(a),(b),(c),(d),(e) [F12,F44–OP1.1] Applies to the requirement for shut-off valves.
	(a),(b),(c),(d),(e) [F12,F44–OS1.1] Applies to the requirement for shut-off valves.
	[F04,F20–OH5] Applies to the requirement for steel shut-off valves.
	[F04,F20–OP1.1] Applies to the requirement for steel shut-off valves.
	[F04,F20–OS1.1] Applies to the requirement for steel shut-off valves.
(4)	[F81,F04,F20–OP1.1]
	[F81,F04,F20–OS1.1]
	[F81,F20–OH5]
<b>4.5.7.3. Diaphragm Valves</b>	
(1)	[F43–OP1.1]
	[F43–OS1.1]
<b>4.5.7.4. Globe Valves</b>	
(1)	[F20–OH5]
	[F20–OP1.1]
	[F20–OS1.1]
<b>4.5.7.5. Indicating Valves</b>	
(1)	[F12–OH5]
	[F12–OP1.1]
	[F12–OS1.1]
<b>4.5.7.6. Identification</b>	
(1)	[F12–OH5]
	[F12,F81–OP1.1]
	[F12,F81–OS1.1]
(2)	[F12–OH5]
	[F12,F81–OP1.1]
	[F12,F81–OS1.1]
<b>4.5.8.1. Design</b>	
(1)	[F01,F81,F20–OS1.1]
<b>4.5.8.2. Steam Heating</b>	
(1)	[F20,F81–OH5] Applies to the minimum steam pressure needed to make the liquid being used fluid.
	[F20,F81–OP1.1] Applies to the minimum steam pressure needed to make the liquid being used fluid.
	[F20,F81–OP1.1] Applies to the minimum steam temperature needed to make the liquid being used fluid.
	[F20,F81–OS1.1] Applies to the minimum steam pressure needed to make the liquid being used fluid.
	[F20,F81–OS1.1] Applies to the minimum steam temperature needed to make the liquid being used fluid.

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(2)	[F81,F20-OH5]
	[F81,F20-OP1.1]
	[F81,F20-OS1.1]
(3)	[F01,F81-OP1.1]
	[F01,F81-OS1.1]
<b>4.5.8.4. Thermal Electrical Conduction Heating</b>	
(2)	(a),(b),(c) [F01-OS1.1]
	(b) [F81,F20-OP1.1]
	(b) [F81,F20-OS1.1]
	(d) [F01-OS1.1]
(3)	[F82,F01,F20-OS1.1]
	[F82,F20-OP1.1]
<b>4.5.8.5. Open Flames</b>	
(1)	[F01-OS1.1]
<b>4.5.9.1. Location of Outdoor Pumps</b>	
(1)	(a) [F01-OP3.1]
	(a) [F01-OS1.1]
	(b) [F01-OP3.1]
	(b) [F01-OS1.1]
<b>4.5.9.2. Pump Houses and Pump Rooms</b>	
(2)	[F01-OP1.1] [F02-OP1.2]
	[F01-OS1.1] [F02-OS1.2]
<b>4.5.9.3. Pits</b>	
(1)	[F20,F81-OH5]
	[F20,F81-OS1.1]
(2)	[F01-OP1.1] [F02-OP1.2] Applies to the size of pits not being larger than required for inspection and maintenance.
	[F01-OS1.1] [F02-OS1.2] Applies to the size of pits not being larger than required for inspection and maintenance.
	[F81-OS1.1] Applies to the requirement for the pits to be provided with a cover.

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.5.9.4. Control Switches</b>	
(1)	[F12–OH5] Applies to the requirement to locate one of the 2 control switches in the operating area and the other at a remote location.
	[F12–OP1.1] Applies to the requirement to locate one of the 2 control switches in the operating area and the other at a remote location.
	[F12–OS1.1] Applies to the requirement to locate one of the 2 control switches in the operating area and the other at a remote location.
	[F44–OH5] Applies to the requirement to have control switches to shut down the pumps in case of emergency.
	[F44–OP1.1] Applies to the requirement to have control switches to shut down the pumps in case of emergency.
	[F44–OS1.1] Applies to the requirement to have control switches to shut down the pumps in case of emergency.
<b>4.5.9.5. Hydraulic Transfer Systems</b>	
(1)	[F81–OH5]
	[F81–OP1.1]
	[F81–OS1.1]
(2)	[F81,F20,F82–OH5]
	[F81,F20,F82–OS1.1]
	[F81,F82,F20–OP1.1]
(3)	[F81,F20–OH5]
	[F81,F20–OP1.1]
	[F81,F20–OS1.1]
(4)	[F81,F20–OH5]
	[F81,F20–OP1.1]
	[F81,F20–OS1.1]
(5)	[F81,F20–OH5]
	[F81,F20–OP1.1]
	[F81,F20–OS1.1]
(6)	[F81–OH5]
	[F81–OP1.1]
	[F81–OS1.1]
<b>4.5.9.6. Inert Gas Transfer Systems</b>	
(1)	[F81,F82,F20–OH5]
	[F81,F82,F20–OP1.1]
	[F81,F82,F20–OS1.1]
(2)	[F81,F20–OH5]
	[F81,F20–OP1.1]
	[F81,F20–OS1.1]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F81,F20–OH5]
	[F81,F20–OP1.1]
	[F81,F20–OS1.1]
(4)	[F81,F04–OH5]
	[F81,F04–OP1.1]
	[F81,F04–OS1.1]
<b>4.5.9.7. Non-Inert Gas Transfer</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
<b>4.5.10.1. Procedures</b>	
(1)	[F12–OH5]
	[F12–OP1.1]
	[F12–OS1.1]
<b>4.5.10.2. Training</b>	
(1)	(a) [F12–OH5]
	(a) [F12–OP1.1]
	(a) [F12–OS1.1]
	(b) [F12–OH5]
	(b) [F12–OP1.1]
	(b) [F12–OS1.1]
	(c) [F12–OP1.2]
	(c) [F12–OS1.2]
	(d) [F12–OH5]
	(d) [F12,F81–OP1.1]
	(d) [F12,F81–OS1.1]
(2)	[F12–OH5] Applies to the training of employees in the location, function and operation of valves used for the operation of the manual emergency shut-off valves.
	[F12–OP1.1] Applies to the training of employees in the location, function and operation of valves used for the operation of the manual emergency shut-off valves.
	[F12–OP1.2] Applies to the training of employees in the location, function and operation of valves used for the operation of fire protection equipment.
	[F12–OS1.1] Applies to the training of employees in the location, function and operation of valves used for the operation of manual emergency shut-off valves.
	[F12–OS1.2] Applies to the training of employees in the location, function and operation of valves used for the operation of fire protection equipment.

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.5.10.3. Emergency Valves</b>	
(1)	[F12–OP1.2,OP1.1]
	[F12–OS1.2,OS1.1]
	[F12–OH5] Applies to the requirement for signs indicating the location of valves used for the operation of manual emergency shut-off valves.
<b>4.5.10.4. Portable Extinguishers</b>	
(1)	[F12,F02–OP1.2]
	[F12,F02–OS1.2]
<b>4.5.10.5. Visual Inspections</b>	
(1)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
(2)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
(3)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
(4)	[F01–OS1.1]
<b>4.5.10.6. Operational Tests</b>	
(1)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
<b>4.5.10.7. Maintenance</b>	
(1)	[F01,F43–OS1.1]
	[F43–OH5]
(2)	[F43–OH5]
	[F43–OS1.1]
(3)	[F01–OS1.1]
(4)	[F81–OH5]
	[F81–OS1.1]
(5)	[F43–OH5]
	[F43–OS1.1]
(6)	[F43–OH5]
	[F43,F01–OS1.1]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.6.1.1. Application</b>	
(2)	[F01,F02,F03,F81–OS1.1]
<b>4.6.2.1. Outside Aboveground Storage Tanks</b>	
(2)	[F02–OP1.2]
	[F02–OS1.2]
(3)	[F02–OP1.2]
	[F02–OS1.2]
(4)	(a) [F81–OH5]
	(a) [F81–OS1.1]
	(b) [F34–OH5]
	(b) [F34–OS1.1]
<b>4.6.2.2. Containers</b>	
(1)	[F81,F12–OS1.1] [F12–OS1.2] Applies to the requirement for products stored or sold at <i>fuel-dispensing stations</i> to be in <i>closed containers</i> distinctly marked with the generic name of the liquid they contain.
<b>4.6.2.5. Piping Supports and Guards</b>	
(1)	[F81,F22–OH5]
	[F81,F22–OP1.1]
	[F81,F22–OS1.1]
<b>4.6.3.1. Dispensers</b>	
(1)	[F01,F43–OS1.1]
	[F43–OH5]
<b>4.6.3.2. Sumps</b>	
(1)	[F20,F43,F80,F81–OS1.1]
<b>4.6.3.3. Location</b>	
(1)	(f) [F01–OS1.1] Applies to location with respect to openings in <i>buildings</i> for the shelter of operating personnel and in which there are electrical installations.
	(f) [F01–OS1.1] Applies to the minimum distance from any <i>building</i> opening.
	(a) [F01–OP3.1]
	(b),(c) [F01,F81–OS1.1]
	(d) [F01–OS1.1]
	(f) [F43,F01–OS1.1]
	(g) [F44–OH5]
(2)	(d) [F01–OS1.1] Applies to portion of Code text: "... ventilation is provided in conformance ... with the requirements for <i>storage garages</i> in Part 6 of Division B of the Alberta Building Code 2006."
	(d) [F40–OS3.4] Applies to portion of Code text: "... ventilation is provided in conformance ... with the requirements for <i>storage garages</i> in Part 6 of Division B of the Alberta Building Code 2006."
	(a) [F34–OS1.1]
	(b) [F12,F01–OS1.1]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F01,F43-OS1.1]
<b>4.6.3.4. Protection against Collision Damage</b>	
(1)	[F81-OH5]
	[F81-OS1.1]
<b>4.6.3.5. Marine Fuel-Dispensing Stations</b>	
(1)	[F81-OH5]
	[F81-OS1.1]
<b>4.6.4.1. Location and Identification</b>	
(1)	[F44-OH5] Applies to the requirement to provide shut-off devices to all dispensers and pumps. [F06-OH5] Applies to the location and shielding of the shut-off devices.
	[F44-OP1.1] Applies to the requirement to provide shut-off devices to all dispensers and pumps. [F06-OP1.1] Applies to the location and shielding of the shut-off devices.
	[F44-OS1.1] Applies to the requirement to provide shut-off devices to all dispensers and pumps. [F06-OS1.1] Applies to the location and shielding of the shut-off devices.
(2)	[F12-OH5]
	[F12-OP1.1,OP1.2]
	[F12-OS1.1,OS1.2]
<b>4.6.4.2. Self-service Outlets</b>	
(1)	[F12,F44-OH5]
	[F12,F44-OP1.1,OP1.2]
	[F12,F44-OS1.1,OS1.2]
(2)	[F12-OH5]
	[F12-OP1.1,OP1.2]
	[F12-OS1.1,OS1.1]
<b>4.6.4.3. Marine Fuel-Dispensing Stations</b>	
(1)	[F12-OH5]
	[F12-OP1.1]
	[F12-OS1.1]
<b>4.6.5.1. Delivery Hose</b>	
(1)	[F81,F20,F43-OH5]
	[F81,F20,F43-OP1.1]
	[F81,F20,F43,F01-OS1.1]
(2)	[F43-OH5]
	[F43-OP1.1]
	[F43-OS1.1]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F43–OH5]
	[F43–OP1.1]
	[F43–OS1.1]
<b>4.6.5.2. Hose Nozzle Valves</b>	
(1)	(b) [F81,F43,F01,F20–OS1.1]
	(b) [F81,F43,F20–OH5]
	(b) [F81,F43,F20–OP1.1]
(2)	(a) [F43–OH5]
	(a) [F43–OP1.1]
	(a) [F43–OS1.1]
	(b) [F43–OH5]
	(b) [F43–OP1.1]
	(b) [F43–OS1.1]
(3)	[F43–OH5]
	[F43–OP1.1]
	[F43–OS1.1]
(4)	[F81–OH5]
	[F81–OP1.1]
	[F81–OS1.1]
(5)	[F43–OH5]
	[F43–OP1.1]
	[F43–OS1.1]
<b>4.6.6.2. Pumps and Control Equipment</b>	
(1)	[F20,F81–OH5]
	[F20,F81–OP1.1]
	[F20,F81–OS1.1]
(2)	[F81,F20,F22–OH5]
	[F81,F20,F22–OP1.1]
	[F81,F20,F22–OS1.1]
<b>4.6.6.3. Emergency Valves</b>	
(1)	[F81,F04,F43–OP1.1]
	[F81,F04,F43–OS1.1]
	[F81,F43–OH5]
(2)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.6.6.4. Pump Location</b>	
(1)	(a) [F01–OP3.1]
	(a) [F01–OS1.1]
	(b) [F01–OP3.1]
	(b) [F01–OS1.1]
<b>4.6.6.5. Marine Fuel-Dispensing Stations</b>	
(1)	[F81,F12,F20,F22–OH5]
	[F81,F12,F20,F22–OP1.1]
	[F81,F12,F20,F22–OS1.1]
(2)	[F44–OH5]
	[F44,F02–OP1.1]
	[F44,F02–OS1.1]
(3)	[F22–OH5]
	[F22–OP1.1]
	[F22–OS1.1]
(5)	[F81,F43–OH5]
	[F81,F43–OP1.1]
	[F81,F43–OS1.1]
(6)	[F43–OH5] Applies where dispensing is from a floating structure.
	[F43,F01–OP1.1] Applies where dispensing is from a floating structure.
	[F43,F01–OS1.1] Applies where dispensing is from a floating structure.
<b>4.6.7.1. Spill Control</b>	
(1)	(b) [F44–OH5]
	(b) [F44–OP1.1,OP1.2]
	(b) [F44–OS1.1,OS1.2]
(2)	[F01–OS1.1]
	[F43–OH5]
<b>4.6.8.1. Attendants</b>	
(1)	[F43,F01,F44–OS1.1]
	[F43,F44–OH5]
	[F43,F44,F01–OP1.1]
(2)	[F43,F01,F34–OP1.1]
	[F43,F01,F34–OS1.1]
	[F43,F34–OH5]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	[F43–OH5]
	[F43,F01–OP1.1]
	[F43,F01–OS1.1]
(4)	[F81–OH5]
	[F81–OP1.1]
	[F81–OS1.1]
<b>4.6.8.2. Self-service Outlets</b>	
(1)	[F81–OH5]
	[F81–OP1.1]
	[F81–OS1.1]
(2)	[F43,F44,F12,F01–OH5]
	[F43,F44,F12,F01–OP1.1]
	[F43,F44,F12,F01–OS1.1]
(3)	[F44–OH5]
	[F44–OP1.1,OP1.2]
	[F44–OS1.1,OS1.2]
(4)	[F43,F44–OH5]
	[F43,F44,F01–OP1.1]
	[F43,F44,F01–OS1.1]
(5)	[F43,F44,F12–OH5]
	[F43,F44,F12,F01–OP1.1]
	[F43,F44,F12,F01–OS1.1]

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(7)	(a) [F81–OS3.4]
	(b) [F06,F44–OH5] Applies to a device to shut off power to all dispensers and pumps at a remote location and shielded from fire that may occur at the pumps.
	(b) [F06,F44–OP1.1] Applies to a device to shut off power to all dispensers and pumps at a remote location and shielded from fire that may occur at the pumps.
	(b) [F06,F44–OS1.1] Applies to a device to shut off power to all dispensers and pumps at a remote location and shielded from fire that may occur at the pumps.
	(c) [F06,F44–OH5]
	(c) [F06,F44–OP1.1]
	(c) [F06,F44–OS1.1]
	(d) [F81–OS3.4]
	(e) [F13–OH5]
	(e) [F13–OP1.1,OP1.2]
	(e) [F13–OS1.1,OS1.2]
	(f) [F11–OS3.7]
	(g) [F11–OS3.7]
(h) [F34–OS3.4]	
(i) [F34–OS3.4]	
(j) [F43–OS3.4]	
(8)	[F43–OH5]
	[F02–OS3.4]
(9)	[F11,F12,F13–OS1.1]
<b>4.6.8.3. Special Dispensers</b>	
(1)	[F12,F44–OH5]
	[F12,F44,F01–OP1.1]
	[F12,F44,F01–OS1.1]
<b>4.6.8.4. Card- or Key-Activated Dispensers</b>	
(3)	[F34–OH5]
	[F34–OP1.1]
	[F34–OS1.1]
(4)	[F81–OH5]
	[F81–OP1.1]
	[F81–OS1.1]
(5)	[F13–OH5]
	[F13–OP1.1,OP1.2]
	[F13–OS1.1,OS1.2]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(6)	(a) [F12–OH5] Applies to the requirement that the emergency instructions be conspicuously posted to advise the user, in the event of a spill or accident.
	(a) [F12–OP1.1,OP1.2] Applies to the requirement that the emergency instructions be conspicuously posted to advise the user, in the event of a spill or accident.
	(a) [F12–OS1.1,OS1.2] Applies to the requirement that the emergency instructions be conspicuously posted to advise the user, in the event of a spill or accident.
	(b) [F13–OH5]
	(b) [F13–OP1.1,OP1.2]
	(b) [F13–OS1.1,OS1.2]
<b>4.6.8.5. Duties of Attendants</b>	
(1)	(c) [F01,F44–OS1.1] Applies to containers that are located in a vehicle.
	(a),(b),(c) [F44–OH5]
	(a),(b),(c) [F44–OP1.1,OP1.2]
	(a),(b),(c) [F44–OS1.1,OS1.2]
	(d) [F01–OS1.1]
	(e) [F01–OP1.1]
	(e) [F01–OS1.1]
	(f) [F44–OH5]
	(f) [F44–OP1.1,OP1.2]
	(f) [F44–OS1.1,OS1.2]
(2)	(a) [F44,F01–OS1.1] (b) [F44,F01–OS1.1] Applies to containers being filled only after having been removed from the aircraft or watercraft.
	(b) [F43–OH5] Applies to containers not being filled beyond their safe filling level.
	(b) [F43–OS1.1] Applies to containers not being filled beyond their safe filling level.
	(b) [F44–OS1.1] Applies to the removal of containers from watercraft or aircraft.
(3)	[F12–OS1.1,OS1.2]
<b>4.6.8.6. Fuel-Dispensing Procedures</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
(3)	[F01,F43,F44,F81–OS1.1]
(4)	(c) [F44–OH5] Applies to the requirement to immediately apply an absorbent material.
	(c) [F44–OP1.1] Applies to the requirement to immediately apply an absorbent material.
	(c) [F44–OS1.1] Applies to the requirement to immediately apply an absorbent material.
	(f) [F01,F44–OS1.1]
	(a),(b),(e) [F43–OH5]
	(a),(b),(e) [F43–OS1.1]
	(d) [F01–OS1.1]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.6.8.7. Sources of Ignition</b>	
(1)	[F01–OS1.1]
<b>4.6.8.8. Signs</b>	
(1)	[F01–OS1.1] Applies to portion of Code text: “At least one ... sign ... shall be provided for each dispenser in a location visible to every driver approaching the dispenser.”
	[F80–OS1.1] Applies to the portion of Code text: “At least one weather-resistant sign ...”
(2)	[F01–OS1.1]
(3)	[F01–OS1.1]
(4)	[F01–OS1.1]
<b>4.6.9.1. Portable Extinguishers</b>	
(1)	[F12,F02–OP1.2]
	[F12,F02–OS1.2]
<b>4.6.10.1. Inspection</b>	
(1)	[F01,F43,F82–OH5]
	[F01,F43,F82–OP1.1]
	[F01,F43,F82–OS1.1]
(2)	[F43,F82–OH5]
<b>4.6.10.2. Maintenance</b>	
(1)	[F43,F81,F82–OH5]
(2)	[F43,F81,F82–OH5]
<b>4.6.10.3. Corrective Action</b>	
(1)	[F01,F43,F82–OS1.1]
	[F01,F43,F82–OP1.1]
	[F01,F43,F81,F82–OH5]
<b>4.7.2.1. Storage</b>	
(1)	[F43–OS1.1]
<b>4.7.2.2. Storage Tanks</b>	
(1)	[F03–OP1.2]
	[F03–OP3.1]
	[F22,F21,F81–OH5]
	[F22,F21,F81–OS1.1] [F03–OS1.2]
<b>4.7.2.3. Hydraulic Pressure Shock</b>	
(1)	[F20,F82–OH5]
	[F20,F82–OP1.1]
	[F20,F82–OS1.1]

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.7.3.1. Interconnection</b>	
(1)	[F01–OS1.1]
<b>4.7.3.2. Dispensing into Vehicles</b>	
(1)	[F34–OH5]
	[F34–OS1.1]
(2)	(a) [F81,F43–OH5]
	(a) [F81,F43–OP1.1]
	(a) [F81,F43–OS1.1]
<b>4.7.4.1. Clearances</b>	
(1)	[F01–OS1.1] [F03–OS1.2]
	[F01,F03–OP3.1]
	[F03–OP1.2]
(2)	[F03–OP1.2]
	[F03–OP3.1]
	[F21,F22,F81–OH5]
	[F22,F21,F81–OS1.1] [F03–OS1.2]
<b>4.7.4.2. Multi-purpose Facilities</b>	
(1)	[F01–OS1.1]
<b>4.7.4.3. Check Valves</b>	
(1)	[F43–OH5]
	[F43–OS1.1]
(2)	[F43,F82–OH5]
	[F43,F82–OS1.1]
<b>4.7.4.4. Control Valves</b>	
(1)	[F43–OH5]
	[F43–OS1.1]
(2)	[F43,F81–OH5]
	[F43,F81–OS1.1]
<b>4.7.4.5. Bonding and Grounding</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
(3)	[F01–OS1.1]
(4)	[F01–OS1.1]
(5)	[F01–OS1.1]
<b>4.7.4.6. Downspouts</b>	
(1)	[F01–OS1.1]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.7.4.7. Identification</b>	
(1)	[F12–OS1.1,OS1.2] [F81–OS1.1]
	[F12,F81–OS3.4]
<b>4.7.5.1. Portable Extinguishers</b>	
(1)	[F02,F12–OP1.2]
	[F02,F12–OS1.2]
<b>4.8.2.1. Clearances</b>	
(1)	[F03–OP3.1]
	[F03–OS1.2]
(2)	[F03–OP3.1]
	[F03–OS1.2]
<b>4.8.2.2. Construction</b>	
(1)	[F20,F04,F80–OH5]
	[F20,F04,F80–OP1.1]
	[F20,F04,F80–OS1.1]
<b>4.8.3.1. Installation</b>	
(1)	[F04,F20–OH5] Applies to portion of Code text: “Except as permitted in Sentences (2) and (3), <i>storage tanks</i> shall be installed on shore ...”
	[F04,F20–OS1.1] Applies to portion of Code text: “Except as permitted in Sentences (2) and (3), <i>storage tanks</i> shall be installed on shore ...”
(2)	[F04,F20,F43–OH5]
	[F04,F43,F20–OS1.1]
(3)	[F20,F43,F04–OH5]
	[F20,F43,F04–OS1.1]
<b>4.8.4.2. Pipe Supports</b>	
(1)	[F20,F22–OH5]
	[F20,F22–OP1.1]
	[F20,F22–OS1.1]
(2)	[F02–OH5]
	[F02–OP1.2]
	[F02–OS1.2]
(3)	[F04–OH5]
	[F04–OP1.2]
	[F04–OS1.2]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.8.4.3. Guards</b>	
(1)	[F81–OH5]
	[F81–OP1.1]
	[F81–OS1.1]
<b>4.8.4.4. Flexible Connections</b>	
(1)	[F21–OH5]
	[F21–OP1.1]
	[F21–OS1.1]
<b>4.8.4.5. Shut-off Valves</b>	
(1)	[F12,F44–OH5]
	[F12,F44–OP1.1,OP1.2]
	[F12,F44–OS1.1,OS1.2]
<b>4.8.4.6. Access Openings for Inspection</b>	
(1)	[F12–OP1.1,OP1.2] [F82–OP1.1]
	[F12–OS1.2,OS1.1] [F82–OS1.1]
	[F12,F82–OH5]
(2)	[F12–OP1.1,OP1.2] [F82–OP1.1]
	[F12–OS1.1,OS1.2] [F82–OS1.1]
	[F12,F82–OH5]
<b>4.8.4.7. Identification</b>	
(1)	[F12–OH5]
	[F81–OP1.1] [F12–OP1.1,OP1.2]
	[F81–OS1.1] [F12–OS1.2,OS1.1]
<b>4.8.4.8. Leakage Testing</b>	
(2)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
<b>4.8.5.1. Bonding and Grounding</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
<b>4.8.6.1. Portable Extinguishers</b>	
(1)	[F12,F02–OP1.2] Applies to the requirement for portable extinguishers with a rated capacity.
	[F12,F02–OS1.2] Applies to the requirement for portable extinguishers with a rated capacity.

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(2)	[F12–OP1.2] Applies to the placement and accessibility of portable extinguishers.
	[F12–OS1.2] Applies to the placement and accessibility of portable extinguishers.
	[F34–OP1.2] Applies to the placement of portable extinguishers so they are not accessible to the public.
	[F34–OS1.2] Applies to the placement of portable extinguishers so they are not accessible to the public.
(3)	[F12,F02–OP1.2]
	[F12,F02–OS1.2]
<b>4.8.6.2. Training</b>	
(1)	[F12,F13–OP1.2]
	[F12,F13–OS1.2]
<b>4.8.7.1. Location</b>	
(1)	[F01,F81–OH5]
	[F01,F81–OP1.1]
	[F01,F81–OS1.1]
(2)	[F34–OH5]
	[F34–OP1.1]
	[F34–OS1.1]
<b>4.8.7.2. Leakage and Spill Control</b>	
(2)	[F43–OH5]
	[F43–OS1.1]
<b>4.8.7.3. Hose Connections</b>	
(1)	[F22,F43–OH5] Applies to portion of Code text: “Except as provided in Sentence (2), hose connections on piping shall be of the bolted flange type ...”
	[F22,F43–OP1.1] Applies to portion of Code text: “Except as provided in Sentence (2), hose connections on piping shall be of the bolted flange type ...”
	[F22,F43–OS1.1] Applies to portion of Code text: “Except as provided in Sentence (2), hose connections on piping shall be of the bolted flange type ...”
	[F44–OH5] Applies to the requirement for shut-off valves.
	[F44–OP1.1,OP1.2] Applies to the requirement for shut-off valves.
	[F44–OS1.1,OS1.2] Applies to the requirement for shut-off valves.
(2)	[F22,F43–OH5]
	[F22,F43–OP1.1]
	[F22,F43–OS1.1]
(3)	[F81–OH5]
	[F81–OP1.1]
	[F81–OS1.1]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.8.8.1. Cargo Hose</b>	
(1)	[F81,F20,F22–OH5]
	[F81,F20,F22–OP1.1]
	[F81,F20,F22–OS1.1]
<b>4.8.8.2. Maintenance and Testing</b>	
(1)	[F82–OH5]
	[F82–OP1.1]
	[F82–OS1.1]
<b>4.8.8.3. Supports</b>	
(1)	[F20,F22–OH5]
	[F20,F22–OP1.1]
	[F20,F22–OS1.1]
<b>4.8.9.1. Pressure Relief</b>	
(1)	[F20,F81–OH5]
	[F20,F81–OP1.1]
	[F20,F81–OS1.1]
<b>4.8.9.2. Location</b>	
(1)	(a) [F02–OP1.2]
	(a) [F02–OS1.2]
	(b) [F01,F03–OS1.1,OS1.2]
	(b) [F03,F01–OP3.1]
(2)	[F44,F02,F03–OP3.1]
	[F44,F02,F03,F01–OS1.1,OS1.2]
<b>4.8.10.1. Construction</b>	
(1)	[F02–OP3.1] Applies to portion of Code text: "Pump houses shall be of <i>noncombustible construction</i> ..."
	[F02–OS1.2] Applies to portion of Code text: "Pump houses shall be of <i>noncombustible construction</i> ..."
	[F44–OH5] Applies to the construction of the floors.
	[F44–OP3.1] Applies to the construction of the floors.
	[F44–OS1.1] Applies to the construction of the floors.
<b>4.8.11.1. Supervision</b>	
(1)	[F44,F12–OP1.1,OP1.2]
	[F44,F12,F43,F01–OS1.1,OS1.2]
	[F44,F43,F12–OH5]
(2)	[F43,F44,F12–OH5]
	[F43,F44,F12–OP1.1]
	[F43,F44,F12–OS1.1]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(3)	(b) [F43–OH5]
	(c) [F43–OH5] Applies to portion of Code text: “... inspect the hose and connections for leakage ...”
	(b) [F43–OS1.1]
	(c) [F43–OS1.1] Applies to portion of Code text: “... inspect the hose and connections for leakage ...”
	(c) [F44–OH5] Applies to portion of Code text: “... if leakage occurs, stop the operations.”
	(c) [F44–OP1.1] Applies to portion of Code text: “... if leakage occurs, stop the operations.”
(3)	(c) [F44–OS1.1] Applies to portion of Code text: “... if leakage occurs, stop the operations.”
(a)	[F01–OS1.1]
<b>4.8.11.2. Bonding and Grounding</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
<b>4.8.11.3. Equipment</b>	
(1)	[F21–OH5]
	[F21–OP1.1]
	[F21–OS1.1]
(2)	[F43–OH5]
	[F43–OP1.1]
	[F43–OS1.1]
(3)	[F43–OH5]
	[F43–OP1.1]
	[F43–OS1.1]
(4)	[F44–OH5]
	[F44–OP1.1]
	[F44–OS1.1]
<b>4.8.11.4. Spill Control</b>	
(1)	[F43–OH5]
	[F43–OS1.1]
(2)	[F43–OH5]
	[F43–OS1.1]
<b>4.9.2.1. Location</b>	
(2)	[F03–OP3.1]
	[F03–OS1.2]
(3)	[F03–OP3.1]
	[F03–OS1.2]
(4)	[F03–OP3.1]
	[F03–OS1.2]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.9.3.1. Explosion Venting</b>	
(1)	[F02–OP1.3]
	[F02–OS1.3]
<b>4.9.3.2. Fire Separations</b>	
(1)	[F03–OP1.2]
	[F03–OS1.2]
<b>4.9.3.3. Basements and Pits</b>	
(1)	[F01–OS1.1]
<b>4.9.3.4. Ventilation</b>	
(1)	[F01–OS1.1]
<b>4.9.3.5. Construction</b>	
(1)	[F81–OS1.1,OS1.2]
	[F81–OP1.1,OP1.2]
<b>4.9.4.1. Spill and Vapour Control</b>	
(1)	(a) [F43–OH5]
	(a) [F43,F01–OS1.1]
	(b) [F44–OH5]
	(b) [F44–OP1.1]
	(b) [F44–OS1.1]
<b>4.9.4.2. Explosion Protection</b>	
(1)	[F01–OS1.1] [F02–OS1.3]
	[F02–OP1.3]
	(a),(b) [F02–OP1.3]
	(a),(b) [F02–OS1.2]
	(c) [F01–OS1.1]
<b>4.9.4.3. Fire Protection</b>	
(1)	[F03,F12–OP1.2]
	[F03,F12–OS1.2]
<b>4.10.3.1. Design, Fabrication and Testing</b>	
(1)	[F20,F80,F43–OH5]
	[F20,F80,F43,F01–OS1.1]
<b>4.10.3.2. Supports, Foundations and Anchorage</b>	
(1)	[F02,F04–OS1.2] Applies to the use of timber supports.
(2)	[F02–OS1.2] Applies to supports having less than a 2 h <i>fire-resistance rating</i> being protected by an automatic fire suppression system.
(3)	[F02–OS1.2] Applies to the protection of the area underneath any <i>storage tank</i> that is greater than 1.2 m in diameter.

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.10.3.3. Storage Tank Vents</b>	
(1)	[F81,F20,F04–OH5]
	[F81,F20,F04,F01–OS1.1]
<b>4.10.4.1. Storage Tanks, Drums and Barrels</b>	
(1)	[F02–OP1.2]
	[F02–OS1.2]
<b>4.10.5.1. Design and Installation</b>	
(1)	[F20,F80–OH5]
	[F20,F80–OP1.1]
	[F20,F80–OS1.1]
<b>4.10.6.1. Ventilation</b>	
(1)	[F01–OS1.1]
<b>4.10.7.1. Spill Control</b>	
(1)	[F44–OH5]
	[F44–OS1.1,OS1.2]
<b>4.10.8.1. Portable Extinguishers</b>	
(1)	[F12,F02–OP1.2]
	[F12,F02–OS1.2]
(2)	[F12,F02–OP1.2]
	[F12,F02–OS1.2]
(3)	[F12,F02–OP1.2]
	[F12,F02–OS1.2]
<b>4.10.8.2. Standpipe and Hose Systems</b>	
(1)	[F12,F02–OP1.2]
	[F12,F02–OS1.2]
(2)	[F02–OP1.2]
	[F02–OS1.2]
<b>4.11.2.1. Portable Extinguishers</b>	
(1)	[F02,F12–OP1.2]
	[F02,F12–OS1.1]
(2)	[F12–OP1.2]
	[F12–OS1.2]
<b>4.11.2.2. Hot Works</b>	
(2)	[F01–OS1.1]
	[F01–OP1.1]

Table 4.12.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.11.2.3. Parking inside Buildings</b>	
(1)	[F01,F44-OP1.1] [F02,F03-OP1.2]
	[F01,F44-OS1.1] [F02,F03-OS1.2]
	[F44-OH5]
(2)	[F43,F01-OS1.1]
	[F01,F43-OP1.1]
(3)	[F43,F01-OS1.1]
	[F01,F43-OP1.1]
<b>4.11.2.4. Parking outside Buildings</b>	
(1)	[F02-OP3.1]
	[F81,F34-OS1.1] [F02-OS1.2]
(2)	[F81-OS1.1] [F03-OS1.2]
	[F81,F03-OP3.1]
<b>4.11.2.5. Damaged or Leaking Containers</b>	
(1)	[F01,F43,F82-OS1.1]
	[F01,F43,F82-OP1.1]
	[F43-OH5]
<b>4.11.2.6. Repair and Servicing</b>	
(1)	[F01,F02,F43-OS1.1,OS1.2]
	[F01,F02,F43-OP1.1,OP1.2]
(2)	[F01,F02,F43-OP1.1,OP1.2]
	[F01,F02,F43-OS1.1,OS1.2]
<b>4.11.3.2. Ignition Sources</b>	
(1)	[F01-OS1.1]
	[F20,F81-OS1.1]
<b>4.11.3.3. Static Electric Charges</b>	
(1)	[F01-OS1.1]
<b>4.11.3.4. Supervision</b>	
(1)	[F44-OH5]
	[F44-OP1.1,OP1.2]
	[F44-OS1.1,OS1.2]
<b>4.11.3.5. Multi-use Compartments</b>	
(1)	[F01-OS1.1]
<b>4.11.3.6. Engine</b>	
(1)	[F01-OS1.1]

**Table 4.12.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>4.11.3.7. Unloading</b>	
(1)	[F43–OH5]
	[F43–OS1.1]
(2)	[F81,F20,F43–OH5]
	[F81,F20,F43–OS1.1]
(3)	[F81,F01,F02–OS1.1]
<b>4.11.3.8. Dispensing into Vehicles</b>	
(1)	[F01,F43–OS1.1]
	[F43–OH5]
	[F43,F01–OP1.1]
(2)	(a) [F01–OS1.1] (a) [F03–OS1.2]
	(a) [F01,F03–OP3.1]
	(b) [F02,F12–OS1.2]
	(d) [F43,F44–OS1.1]
	(e) [F44–OH5]
	(e) [F44–OS1.1]

**Notes to Table 4.12.1.1.:**

<sup>(1)</sup> See Parts 2 and 3 of Division A.



# **Part 5**

## **Hazardous Processes and Operations**

<b>5.1.</b>	<b>General</b>	
5.1.1.	Scope .....	5- 1
5.1.2.	Electrical Installations .....	5- 1
5.1.3.	Ventilation .....	5- 1
5.1.4.	Flash Point .....	5- 1
5.1.5.	Fire Safety Plan .....	5- 1
<b>5.2.</b>	<b>Hot Works</b>	
5.2.1.	General .....	5- 2
5.2.2.	Hot Work Equipment .....	5- 2
5.2.3.	Prevention of Fires .....	5- 3
<b>5.3.</b>	<b>Dust-Producing Processes</b>	
5.3.1.	General .....	5- 4
5.3.2.	Woodworking Operations .....	5- 6
5.3.3.	Grain Handling and Storage Facilities .....	5- 6
<b>5.4.</b>	<b>Special Processes Involving Flammable and Combustible Liquids and Materials</b>	
5.4.1.	Baking and Drying Processes .....	5- 7
5.4.2.	Dry Cleaning Plants .....	5- 7
5.4.3.	Fumigation and Thermal Insecticidal Fogging .....	5- 7
5.4.4.	Floor Finishing .....	5- 8
5.4.5.	Spray Coating Processes .....	5- 8
5.4.6.	Dipping and Coating Processes ...	5- 9
<b>5.5.</b>	<b>Laboratories</b>	
5.5.1.	Scope .....	5- 9
5.5.2.	Construction .....	5- 9
5.5.3.	Fire Prevention and Protection .....	5- 9
5.5.4.	Ventilation .....	5-11
5.5.5.	Dangerous Goods .....	5-12
<b>5.6.</b>	<b>Construction and Demolition Sites</b>	
5.6.1.	General .....	5-13
5.6.2.	Excavation .....	5-17
<b>5.7.</b>	<b>Fireworks</b>	
5.7.1.	Fireworks .....	5-17
<b>5.8.</b>	<b>Objectives and Functional Statements</b>	
5.8.1.	Objectives and Functional Statements .....	5-20



# **Part 5**

## **Hazardous Processes and Operations**

### **Section 5.1. General**

#### **5.1.1. Scope**

##### **5.1.1.1. Application**

1) This Part applies to processes and operations that involve a risk from explosion, high flammability or related conditions that create a hazard to life safety.

##### **5.1.1.2. Explosives**

1) Except as required by Section 5.7. for *fireworks*, the manufacturing, handling, transportation, sale and use of Class 1 *dangerous goods* shall be in conformance with the “Explosives Act” and its Regulations, published by Natural Resources Canada.

#### **5.1.2. Electrical Installations**

##### **5.1.2.1. Hazardous Locations**

1) Where wiring or electrical equipment is located in areas in which flammable gases or vapours, *combustible dusts* or *combustible fibres* are present in quantities sufficient to create a hazard, such wiring and electrical equipment shall conform to electrical regulations made pursuant to the Safety Codes Act. (See Appendix A.)

##### **5.1.2.2. General**

1) Electrical installations shall conform to electrical regulations made pursuant to the Safety Codes Act.

#### **5.1.3. Ventilation**

##### **5.1.3.1. Ventilation**

1) Ventilation shall be provided for hazardous locations and processes in conformance with the Alberta Building Code 2006 and with this Part.

#### **5.1.4. Flash Point**

##### **5.1.4.1. Flash Point**

1) The *flash points* of *flammable liquids* and *combustible liquids* shall be determined in conformance with Subsection 4.1.3.

#### **5.1.5. Fire Safety Plan**

##### **5.1.5.1. Fire Safety Plan**

1) Except as provided in Sentences (2) and (3), a fire safety plan conforming to Section 2.8. shall be prepared for areas where processes and operations described in Article 5.1.1.1. take place.

**2)** In addition to the information required in Section 2.8., the fire safety plan shall include

- a) the location and identification of storage and use areas for specific products, in conformance with Article 3.2.2.5., and
- b) the names, addresses and telephone numbers of persons to be contacted in case of fire during non-operating hours.

**3)** In addition to the information required in Sentence (2), where Class 7 radioactive materials are used or handled, the fire safety plan shall include the information specified in Subsection 3.1.2.

**4)** Personnel shall be instructed in the fire emergency procedures described in the fire safety plan in Sentences (1), (2) and (3) before they are given any responsibility for fire safety.

**5)** The fire safety plan shall be acceptable to the *authority having jurisdiction* and maintained for fire department inspection and for reference by on-site personnel. (See Appendix A.)

## Section 5.2. Hot Works

### 5.2.1. General

#### 5.2.1.1. Application

**1)** This Section shall apply to hot works involving open flames or producing heat or sparks, including, without being limited to, cutting, welding, soldering, brazing, grinding, adhesive bonding, thermal spraying and thawing pipes.

**2)** Except as provided in this Section, hot works described in Sentence (1) shall conform to CAN/CSA-W117.2, "Safety in Welding, Cutting and Allied Processes."

#### 5.2.1.2. Training

**1)** Hot works shall be performed only by personnel trained in the safe use of equipment in conformance with this Section.

### 5.2.2. Hot Work Equipment

#### 5.2.2.1. Maintenance

**1)** Hot work equipment shall be maintained in good operating condition.

#### 5.2.2.2. Inspection

- 1)** Hot work equipment shall be examined for leakage or defects prior to each use.
- 2)** Leaks or defects found in hot work equipment shall be repaired prior to use.

#### 5.2.2.3. Equipment Not in Use

**1)** All valves shall be closed and gas lines bled when Class 2 gas hot work equipment is not in use.

**2)** Electric hot work equipment shall be de-energized when not in use.

#### 5.2.2.4. Compressed Gas Equipment

**1)** The design and installation of oxygen-fuel gas equipment shall conform to NFPA 51, "Design and Installation of Oxygen-Fuel Gas Systems for Welding, Cutting and Allied Processes."

- 2)** Unalloyed copper piping shall not be used for acetylene gas.
- 3)** Oil or grease shall not be used with equipment for oxygen.
- 4)** Cylinders of Class 2 gases shall conform to Part 3.

**5.2.3. Prevention of Fires****5.2.3.1. Location of Operations**

- 1)** Except as provided in Sentence (2), hot work shall be carried out in an area free of combustible and flammable contents, with walls, ceilings and floors of *noncombustible construction* or lined with noncombustible materials.
- 2)** When it is not practicable to undertake hot work in an area described in Sentence (1),
  - a) combustible and flammable materials within a 15 m distance from the hot work shall be protected against ignition in conformance with Article 5.2.3.2.,
  - b) a fire watch shall be provided during the hot work and for a period of not less than 60 min after its completion in conformance with Article 5.2.3.3., and
  - c) a final inspection of the hot work area shall be conducted 4 h after completion of work.
- 3)** When there is a possibility of sparks leaking onto combustible materials in areas adjacent to the area where hot work is carried out,
  - a) openings in walls, floors or ceilings shall be covered or closed to prevent the passage of sparks to such adjacent areas, or
  - b) Sentence (2) shall apply to such adjacent areas.

**5.2.3.2. Protection of Combustible and Flammable Materials**

- 1)** Any combustible and flammable material, dust or residue shall be
  - a) removed from the area where hot work is carried out, or
  - b) protected against ignition by the use of noncombustible materials.
- 2)** Combustible materials or *building* surfaces that cannot be removed or protected against ignition as required in Sentence (1) shall be thoroughly wetted where hot work is carried out.
- 3)** Any process or activity that produces flammable gases or vapours, *combustible dusts* or *combustible fibres* in quantities sufficient to create a fire or explosion hazard shall be interrupted and the hazardous conditions shall be removed before any hot work is carried out.

**5.2.3.3. Fire Watch**

- 1)** The exposed areas described in Sentences 5.2.3.1.(2) and (3) shall be examined for ignition of combustible materials by personnel equipped with and trained in the use of fire extinguishing equipment.

**5.2.3.4. Work on Containers, Equipment or Piping**

- 1)** Hot work shall not be performed on containers, equipment, or piping containing *flammable liquids*, *combustible liquids* or Class 2.1 flammable gases unless
  - a) they have been cleaned and tested with a gas detector to ascertain that they are free of explosive vapours, or
  - b) safety measures are taken in conformance with good engineering practice (see Appendix A).
- 2)** Hot work shall not be performed on a totally enclosed container.
- 3)** Hot work shall not be performed on metal objects that are in contact with combustible materials unless safety precautions are taken to prevent their ignition by conduction.

**5.2.3.5. Work Adjacent to Piping**

- 1)** When hot work is to be carried out near piping containing a Class 2.1 flammable gas, the piping shall
  - a) conform to Sentence 5.2.3.4.(1), or
  - b) be protected by a thermal barrier against the passage of heat.

**5.2.3.6. Fire Extinguishing Equipment**

- 1) At least one portable fire extinguisher shall be provided in the hot work area.

**5.2.3.7. Fire Safety Plan**

- 1) In *buildings* or areas described in Article 2.8.1.1., the required fire safety plan shall include the safety measures described in this Subsection for the safe conducting of hot works.

**Section 5.3. Dust-Producing Processes****5.3.1. General****5.3.1.1. Application**

- 1) This Section shall apply to *buildings* or parts of *buildings* where *combustible dusts* are produced in quantities or concentrations that create an explosion or fire hazard.

**5.3.1.2. Dust Removal**

- 1) *Building* and machinery surfaces shall be kept clean of accumulations of *combustible dusts* using cleaning equipment that
  - a) is made of materials that will not create electrostatic charges or sparks,
  - b) is electrically conductive and bonded to ground, and
  - c) except as permitted in Sentence (3), removes the dust to a safe location by vacuum.
- 2) When used in an atmosphere containing *combustible dusts*, the cleaning equipment required in Sentence (1) shall conform to electrical regulations made pursuant to the Safety Codes Act.
- 3) Where it is not possible to effectively remove the dust by vacuum, it is permitted to use compressed air or other means that will cause the dust to become suspended in the air during removal if, in the dust removal area,
  - a) all sources of ignition are eliminated, and
  - b) all machinery and equipment is de-energized, unless such equipment is suitable for use in atmospheres containing *combustible dusts*, in conformance with electrical regulations made pursuant to the Safety Codes Act.

**5.3.1.3. Dust-Collecting Systems**

- 1) Dust-collecting systems shall be provided to prevent the accumulation of dust and keep suspended dusts at a safe concentration inside a *building*.
- 2) A dust-collecting system required in Sentence (1) shall be designed in conformance with good engineering practice such as that described in NFPA 664, "Prevention of Fires and Explosions in Wood Processing and Woodworking Facilities," and the NFPA standards on dust explosion hazards, and shall
  - a) be made of noncombustible materials, and
  - b) not create sparks upon physical contact in the fan assembly.
 (See Appendix A.)

**5.3.1.4. Dust Collectors**

- 1) Except as provided in Sentence (2), a dust collector having a capacity greater than 0.5 m<sup>3</sup>/s shall
  - a) be located outside of a *building*, and
  - b) be equipped with explosion venting to the outdoors of not less than 0.1 m<sup>2</sup> of vent area for each cubic metre of dust collector enclosure volume.
- 2) A dust collector described in Sentence (1) is permitted to be located inside a *building* if it is
  - a) provided with explosion venting to the outdoors as specified in Clause (1)(b),

- b) equipped with an automatic explosion prevention system, or
- c) located in a room with *fire separations* having a *fire-resistance rating* of not less than 1 h and provided with explosion venting to the outdoors.

**3)** When air exhausted by a dust collector described in this Article is returned to a *building*, the dust-collecting system shall be designed so that

- a) returned air will not create an explosion hazard inside the *building*, and
- b) the exhaust fan and ancillary equipment are automatically shut down in the event of a fire or an explosion inside the dust collector.

#### 5.3.1.5. Bonding and Grounding

**1)** Electrically conducting parts of conveying systems, dust collectors, dust-producing machines and any equipment capable of accumulating static electricity located in an atmosphere containing *combustible dusts* shall be electrically bonded and grounded.

**2)** Static electricity shall be prevented from accumulating on machines or equipment subject to static electricity buildup by appropriate bonding, grounding and static eliminating devices.

#### 5.3.1.6. Explosion Venting

**1)** Except as provided in Article 5.3.1.7., an activity that creates an atmosphere containing significant concentrations of *combustible dusts* shall be located only in a *building* provided with explosion venting to the outdoors.

**2)** When explosion venting is required in this Section, it shall be designed to prevent critical structural and mechanical damage to the *building* in conformance with good engineering practice such as that described in NFPA 68, "Venting of Deflagrations." (See A-3.2.8.2.(1)(d) in Appendix A.)

#### 5.3.1.7. Explosion Prevention Systems

**1)** In processes where an explosion hazard is present and conditions exist that prevent adequate explosion venting as required in this Section, an explosion prevention system shall be provided.

**2)** When an explosion prevention system is required in this Section, it shall be designed in conformance with good engineering practice such as that described in NFPA 69, "Explosion Prevention Systems."

#### 5.3.1.8. Electrical Interlocks

**1)** Equipment required to have a dust-collecting system shall be interlocked to prevent it from operating if the dust-collecting system is not in operation.

#### 5.3.1.9. Separators

**1)** Separators shall be provided to prevent the entrance of foreign materials that may cause sparks in conveying equipment, dust collectors, dust-producing machines and any equipment located in an atmosphere containing *combustible dusts*.

#### 5.3.1.10. Ignition Sources

**1)** Unless controlled in a manner that will not create a fire or explosion hazard, a device, operation or activity that produces open flames, sparks or heat shall not be permitted. (See A-4.1.5.2.(1) in Appendix A.)

**2)** Portable electrical equipment used in atmospheres containing *combustible dusts* shall conform to electrical regulations made pursuant to the Safety Codes Act.

**3)** Smoking shall not be permitted in atmospheres containing *combustible dusts*.

**5.3.2.1.****5.3.2. Woodworking Operations****5.3.2.1. Exhaust Systems**

**1)** Every machine that produces wood dust, particles or shavings shall be provided with a blower and exhaust system installed in conformance with NFPA 664, "Prevention of Fires and Explosions in Wood Processing and Woodworking Facilities."

**2)** Operations or machines that generate sparks or combustible vapours shall not be served by exhaust systems connected to woodworking machines referred to in Sentence (1).

**5.3.2.2. Shavings and Sawdust Collection**

**1)** Loose shavings and sawdust shall be collected at frequent intervals and deposited in receptacles described in Article 2.4.1.3.

**5.3.2.3. Fire Extinguishers**

**1)** A portable extinguisher shall be provided within 7.5 m of any machine producing wood dust, particles or shavings.

**5.3.3. Grain Handling and Storage Facilities****5.3.3.1. Storage Bins and Silos**

**1)** A product subject to spontaneous heating shall be permitted to be stored in silos or bins only if measures are taken to

- a) monitor the temperature of the stored product, and
- b) prevent overheating of the stored product from creating a fire or explosion hazard.

**2)** Permanently open vent stacks are permitted to be used for the ventilation of storage bins where mechanical dust-collecting systems are not practical provided that the vent stacks

- a) have a cross-sectional area not less than twice that of all spouts discharging into the bin,
- b) are installed not more than 30° from the vertical,
- c) extend from the top of the bin to a point not less than 1.2 m above the roof, and
- d) are designed to prevent the entry of snow and rain.

**5.3.3.2. Conveying Equipment**

**1)** Belt conveyors and bucket elevator legs shall be equipped with safety devices to

- a) detect excessive misalignment, blockage, slipping or slow-down of the conveying equipment, and
- b) prevent conditions described in Clause (a) from creating a fire or explosion hazard by
  - i) alerting personnel trained in taking appropriate actions, or
  - ii) automatically stopping the conveying equipment.

**2)** Conveying equipment belts shall be made of static conductive materials to prevent buildup of static charges. (See Appendix A.)

- 3)** Conveying equipment bearings shall be
- a) accessible for inspection and maintenance,
  - b) lubricated to prevent overheating, and
  - c) kept free of accumulation of *combustible dusts*.

**4)** Belt conveyor galleries and tunnels and bucket elevator leg enclosures shall be provided with explosion venting to the outdoors in conformance with Sentence 5.3.1.6.(2).

**5.3.3.3. Separators**

1) Separators shall be provided at grain receiving points ahead of the conveying equipment. (See Article 5.3.1.9.)

**5.3.3.4. Fire Protection**

1) Where a standpipe and hose system is provided, fog and fine spray nozzles shall be used to prevent *combustible dust* from being raised into suspension upon application of a solid stream water discharge.

## Section 5.4. Special Processes Involving Flammable and Combustible Liquids and Materials

**5.4.1. Baking and Drying Processes****5.4.1.1. Application**

1) This Subsection applies to baking and drying processes during which flammable vapours are given off by the products being baked or dried.

**5.4.1.2. Design, Operation and Maintenance**

1) The design, operation and maintenance requirements relating to baking and drying processes shall conform to NFPA 86, "Ovens and Furnaces."

**5.4.2. Dry Cleaning Plants****5.4.2.1. Dry Cleaning Plants**

1) Dry cleaning plants shall conform to NFPA 32, "Drycleaning Plants."

**5.4.3. Fumigation and Thermal Insecticidal Fogging****5.4.3.1. Application**

1) This Subsection applies to the fumigation or thermal insecticidal fogging of *buildings*, including the fumigation of equipment or commodities within structures, tanks or bins or under tarpaulins.

**5.4.3.2. Notification**

1) The fire department shall be notified before any operation described in Article 5.4.3.1. is conducted.

2) The occupants of any premises adjacent to that in which fumigation or thermal insecticidal fogging is to take place shall be given prior notice.

**5.4.3.3. Ignition Sources**

1) All flames and other sources of ignition shall be eliminated in any part of a *building* undergoing fumigation or thermal insecticidal fogging.

**5.4.3.4. Electric Power**

1) Electric power supply shall be shut off to the premises undergoing fumigation or thermal insecticidal fogging.

**5.4.3.5. Air Temperature**

1) The air temperature in the part of a *building* undergoing fumigation or thermal insecticidal fogging shall be kept sufficiently low to prevent the actuation of any sprinkler or fire alarm system.

**5.4.3.6.****5.4.3.6. Access to Premises**

- 1) No unauthorized person shall be permitted to enter a premise undergoing fumigation or thermal insecticidal fogging until the premise has been ventilated and is safe.
- 2) Warning signs shall be posted in a conspicuous location near every entrance to the premises being fumigated.
- 3) One person shall be on duty at each entrance to the premises undergoing fumigation or thermal insecticidal fogging to prevent any unauthorized person from entering until such premises have been ventilated.

**5.4.4. Floor Finishing****5.4.4.1. Application**

- 1) Floor finishing operations involving the use of *flammable liquids* or *combustible liquids* shall conform to Part 4 and this Subsection.

**5.4.4.2. Public Access**

- 1) Any part of a *building* where floor finishing operations are done shall not be open to the public.

**5.4.4.3. Ventilation**

- 1) Ventilation shall be provided in areas where floor finishing operations are done to prevent the accumulation of flammable vapours.
- 2) Ventilation required in Sentence (1) is permitted to be provided by mechanical systems if their use does not constitute a source of ignition.

**5.4.4.4. Sources of Ignition**

- 1) All mechanical systems, electric motors and other equipment that might be a source of ignition shall be shut down, and smoking and the use of open flames shall be prohibited during the application of Class I liquids and for at least 1 h after such application.

**5.4.4.5. Waste Receptacles**

- 1) A receptacle conforming to Article 2.4.1.3. shall be provided for all waste rags and materials used in operations involving *flammable liquids* or *combustible liquids*, and the contents shall be removed daily and disposed of in a manner that will not create a fire hazard.

**5.4.5. Spray Coating Processes****5.4.5.1. Application**

- 1) This Subsection applies to spray coating processes involving the use of combustible dry powders, *flammable liquids* or *combustible liquids*.

**5.4.5.2. Design, Operation and Maintenance**

- 1) The design, operation and maintenance requirements relating to spray coating processes shall conform to NFPA 33, "Spray Application Using Flammable or Combustible Materials."

**5.4.6. Dipping and Coating Processes****5.4.6.1. Application**

- 1) This Subsection applies to
  - a) processes in which products or materials are immersed in a dip tank containing *flammable liquids* or *combustible liquids*, and
  - b) the unatomized application of *flammable liquids* or *combustible liquids*, such as by flow coating or roll coating processes.

**5.4.6.2. Design, Operation and Maintenance**

- 1) The design, operation and maintenance requirements relating to dipping and coating processes shall conform to NFPA 34, "Dipping and Coating Processes Using Flammable or Combustible Liquids."

**Section 5.5. Laboratories****5.5.1. Scope****5.5.1.1. Application**

- 1) This Section applies to laboratories where *dangerous goods*, including *flammable liquids* and *combustible liquids*, are used. (See Appendix A.)
- 2) Except as otherwise specified in this Section, the use, handling and storage of *dangerous goods*, including *flammable liquids* and *combustible liquids*, shall conform to Parts 3, 4 and 5.

**5.5.2. Construction****5.5.2.1. Interior Finish Materials**

- 1) Interior finish materials, floors, fixed furniture and equipment shall be chemically resistant to *dangerous goods* being used in a laboratory to minimize their deterioration, in conformance with Articles 3.2.7.7. and 3.2.7.8.

**5.5.2.2. Separation**

- 1) A laboratory shall be separated from other parts of the *building* by *fire separations* conforming to this Code and the Alberta Building Code 2006, but having a *fire-resistance rating* of not less than 1 h.

**5.5.3. Fire Prevention and Protection****5.5.3.1. Emergency Planning**

- 1) Except as provided in Sentences (2) to (6), a laboratory shall conform to the requirements for emergency planning in Section 2.8. and for a fire safety plan in Subsection 5.1.5.
- 2) Fire drills required in Subsection 2.8.3. shall be held at intervals not greater than 3 months in a laboratory.
- 3) Personnel working in a laboratory shall be trained in the safe handling and use of *dangerous goods*, in conformance with Article 3.2.7.15.
- 4) *Dangerous goods* shall be identified in conformance with Article 3.2.7.13.
- 5) The laboratory shall be clearly designated as an area containing *dangerous goods* in conformance with Article 3.2.7.14.
- 6) Measures shall be taken to prevent access to the laboratory by unauthorized persons.

**5.5.3.2.****5.5.3.2. Combustible Materials**

- 1) Where combustible materials, such as packaging materials, are used in a laboratory, their quantity shall not be greater than the supply for one day of normal operation.
- 2) Combustible materials in excess of those permitted in Sentence (1) shall be stored outside of the laboratory in conformance with Section 3.2.

**5.5.3.3. Spill Control**

- 1) Absorbent and neutralizing materials shall be provided in the laboratory and in the *dangerous goods* storage areas in conformance with Sentence 3.2.7.11.(2).

**5.5.3.4. Electrical Equipment**

- 1) Except as provided in Sentence 5.5.3.5.(3), electrical equipment located in areas where the concentration of flammable vapours is sufficient to create a hazard shall conform to electrical regulations made pursuant to the Safety Codes Act for Class I, Division 1, for the hazardous locations.
- 2) Electrical equipment located inside a power-ventilated enclosure required in Article 5.5.4.2. and its exhaust duct system shall
  - a) conform to Sentence (1), and
  - b) be designed and maintained to prevent the accumulation of combustible or reactive deposits.

**5.5.3.5. Ignition Sources**

- 1) Smoking shall not be permitted in a laboratory and signs shall be posted in conformance with Article 2.4.2.2.
- 2) Where overheating of unattended equipment using heat can cause a fire or an explosion, such equipment shall be equipped with a high temperature limit switch fitted to
  - a) sound an alarm, and
  - b) shut off the heat.
- 3) An ignition source that is an integral part of an operation involving flammable vapours shall be permitted provided
  - a) the supply of *flammable liquids* or *combustible liquids* for this operation is controlled and kept to a strict minimum,
  - b) flammable vapours and combustion fumes are exhausted in conformance with Article 5.5.4.2.,
  - c) there is no other source of ignition capable of igniting the flammable vapours in an uncontrolled manner, and
  - d) there is no combustible material in the immediate vicinity of this operation.

**5.5.3.6. Inspection and Maintenance**

- 1) Electrical equipment, mechanical systems, piping, valves, and automatic and manual control and safety devices shall be inspected, tested and maintained in good operating condition at all times.
- 2) The ventilation systems serving a laboratory shall be inspected and cleaned to prevent the accumulation of combustible or reactive deposits, and the intervals between inspections shall be not greater than
  - a) 12 months for the ventilation systems of the laboratory and *dangerous goods* storage areas, and
  - b) 6 months for the ventilation system of a power-ventilated enclosure required in Article 5.5.4.2.

**5.5.4. Ventilation****5.5.4.1. General Ventilation**

- 1)** A laboratory shall be provided with continuous mechanical ventilation designed and maintained to ensure that *dangerous goods* vapours and particles
  - a) do not accumulate in the laboratory,
  - b) are prevented from migrating to other parts of the *building*,
  - c) do not accumulate in the ventilation system,
  - d) are exhausted to the outdoors, and
  - e) are not returned to the *building*.
- 2)** A ventilation system required in this Section shall be provided with monitoring devices to
  - a) indicate that the ventilation system is in operation, and
  - b) sound an alarm if the ventilation system is malfunctioning.

**5.5.4.2. Power-Ventilated Enclosure**

- 1)** The use of *dangerous goods* in a laboratory shall be confined inside a power-ventilated enclosure conforming to Articles 5.5.4.3. and 5.5.4.4. when
  - a) their use releases flammable vapours or causes runaway or potentially explosive reactions,
  - b) liquids are heated to a temperature equal to or greater than their *flash point*, or
  - c) Class I liquids or *unstable liquids* are used.
- 2)** A power-ventilated enclosure required in Sentence (1) shall not be used for the storage of *dangerous goods*, and any quantity in excess of the supply necessary for normal operations shall conform to Subsection 5.5.5.

**5.5.4.3. Enclosure Exhaust Ventilation**

- 1)** The ventilation system for a power-ventilated enclosure required in Article 5.5.4.2. shall
  - a) conform to NFPA 91, "Exhaust Systems for Air Conveying of Vapors, Gases, Mists, and Noncombustible Particulate Solids,"
  - b) provide continuous exhaust ventilation at an air velocity sufficient to prevent the accumulation of combustible or reactive deposits in the power-ventilated enclosure and its exhaust duct system,
  - c) confine *dangerous goods* vapours and particles to the area where they are generated and exhaust them to the outdoors,
  - d) not return the exhausted air to the *building*, and
  - e) be provided with well identified control switches that are
    - i) located outside of the power-ventilated enclosure, and
    - ii) readily accessible in case of an emergency.
- 2)** Where the deposits referred to in Clause (1)(b) can accumulate in the power-ventilated enclosure and its exhaust duct system and create a fire or explosion hazard,
  - a) provisions shall be made to remove such deposits so they do not create a fire or explosion hazard, or
  - b) an automatic fire suppression system shall be provided.

**5.5.4.4. Enclosure Construction**

- 1)** The power-ventilated enclosure required in Article 5.5.4.2. and its exhaust duct system shall
  - a) except as provided in Sentences (2) and (3), be constructed of noncombustible materials compatible with and chemically resistant to the *dangerous goods* vapours and particles being exhausted,
  - b) be provided with access doors to permit inspection and maintenance of the fan assembly and exhaust ducts,

## 5.5.5.1.

- c) be provided with instructions for its use and the operation of the ventilation system, and
  - d) be provided with means to control accidental spillage.
- 2)** Combustible materials are permitted in systems described in Clause (1)(a) if
- a) such materials are required by the corrosive or reactive properties of the *dangerous goods* being used, and
  - b) their *flame-spread rating* is not more than 25.
- 3)** The *flame-spread rating* required in Sentence (2) is permitted to be greater than 25 if an automatic fire suppression system is provided inside the power-ventilated enclosure and its exhaust duct system.

## 5.5.5. Dangerous Goods

## 5.5.5.1. Maximum Quantities

- 1)** The quantity of *dangerous goods* kept in a laboratory shall be minimized and shall not exceed the lesser of
- a) the supply necessary for normal operation, or
  - b) when located in
    - i) a Group A, Division 2 educational or a Group D *major occupancy*, 300 L of *flammable liquids* and *combustible liquids*, of which not more than 50 L shall be Class I liquids, or
    - ii) a Group B *major occupancy*, the quantities of *flammable liquids* and *combustible liquids* permitted in Sentence 4.2.6.3.(1).
- (See Appendix A.)
- 2)** Quantities of *flammable liquids* and *combustible liquids* in excess of those permitted in Sentence (1) shall be stored in
- a) cabinets conforming to Subsection 4.2.10. except that, in laboratories described in Clause (1)(b), the total quantity of *flammable liquids* and *combustible liquids* stored in such cabinets shall not exceed the quantity permitted for one cabinet, or
  - b) a room conforming to Subsection 4.2.9.
- 3)** Quantities of *dangerous goods* other than *flammable liquids* and *combustible liquids* in excess of those permitted in Sentence (1) shall be stored outside of the laboratory in conformance with Part 3.

## 5.5.5.2. Containers for Flammable and Combustible Liquids

- 1)** Except as provided in Sentences (2) and (3), *flammable liquids* or *combustible liquids* in a laboratory shall be kept in containers conforming to Subsection 4.2.3.
- 2)** Where Class I liquids are required to be kept in individual containers having a capacity greater than 5 L in a laboratory, such containers shall
- a) be safety containers conforming to ULC/ORD-C30, "Safety Containers," and
  - b) have a capacity of not more than 25 L.
- 3)** Containers of *flammable liquids* or *combustible liquids* shall be kept closed when not in use.

## 5.5.5.3. Compressed Gases

- 1)** Storage cylinders and piping systems for Class 2 gases used in a laboratory shall be firmly secured and protected against mechanical damage.
- 2)** Each point of supply and each point of use of cylinders or piping systems for Class 2 gases shall be provided with
- a) labels identifying the gas being supplied, and
  - b) a manual shut-off valve.
- 3)** A Class 2 gas cylinder valve shall be closed when not in use.

**5.5.5.4. Refrigerated Storage**

1) Refrigerators described in Sentence 4.1.4.1.(2) shall be identified in conformance with Article 3.2.7.14.

2) Class I liquids that are stored in refrigerators shall be kept in *closed containers* .

**5.5.5.5. Highly Unstable Substances**

(See Appendix A.)

1) Where unstable substances, such as perchloric acid, are heated above normal ambient temperature, it shall be done in a separate power-ventilated enclosure

- a) conforming to Articles 5.5.4.3. and 5.5.4.4., and
- b) displaying conspicuously posted instructions specifying that the enclosure is to be used for this application only.

2) The power-ventilated enclosure required by Sentence (1) as well as its exhaust duct system shall be washed after each use to prevent the accumulation of highly unstable deposits. (See Appendix A.)

3) Unstable substances, such as perchloric acid, shall not be heated with an open flame or in a hot oil bath.

**5.5.5.6. Chemical Wastes**

- 1) Wastes from *dangerous goods* shall be
  - a) identified to prevent accidental mixing of incompatible chemicals, and
  - b) included in the quantities specified in Article 5.5.5.1.

## Section 5.6. Construction and Demolition Sites

**5.6.1. General****5.6.1.1. Application**

(See Appendix A.)

1) This Section applies to fire safety for *buildings*, parts of *buildings*, facilities, adjacent *buildings* or facilities and associated areas undergoing construction, alteration or demolition operations.

**5.6.1.2. Protection of Adjacent Building**

1) Protection shall be provided for exposed adjacent *buildings* or facilities from fire originating from *buildings*, parts of *buildings*, facilities and associated areas undergoing construction, alteration or demolition operations. (See Appendix A.)

**5.6.1.3. Fire Safety Plan**

1) Except as required in Sentence (2), prior to the commencement of construction, alteration or demolition operations, a fire safety plan shall be prepared for the site and shall include

- a) the designation and organization of site personnel to carry out fire safety duties, including a fire watch service if applicable,
- b) the emergency procedures to be followed in the event of a fire, including
  - i) initiating a fire warning,
  - ii) notifying the fire department,
  - iii) instructing site personnel on the procedures to be followed once the warning has been initiated, and
  - iv) confining, controlling and extinguishing the fire,
- c) measures for controlling fire hazards in and around the *building* (see Appendix A), and
- d) a maintenance procedure for firefighting measures required in Section 5.6.

**2)** Where construction, alteration or demolition operations occur in an existing *building* that is required to have a fire safety plan conforming to Section 2.8., the fire safety plan shall take into account the changes occurring to the *building*.

#### 5.6.1.4. Access for Firefighting

**1)** Unobstructed access to fire hydrants, portable extinguishers and to fire department connections for standpipe and sprinkler systems shall be maintained.

**2)** A means shall be provided for firefighters to allow for firefighting on all levels of the *building*.

**3)** Provision shall be made for the use of existing elevators, hoists or lifts to assist such personnel in reaching all levels of the *building*.

**4)** Access routes for fire department vehicles shall be provided and maintained to construction and demolition sites.

**5)** Where a construction or demolition site is fenced so as to prevent general entry, provision shall be made for access by fire department equipment and personnel.

#### 5.6.1.5. Portable Extinguishers

**1)** In addition to the other requirements of this Code, portable extinguishers shall be provided in unobstructed and easily accessible locations

- a) where hot work operations are carried out,
- b) where combustibles are stored,
- c) near internal combustion engines,
- d) where *combustible liquids, flammable liquids* or gases are stored or handled, and
- e) where temporary fuel-fired equipment is used.

**2)** The extinguishers required by Sentence (1) shall have a minimum rating of

- a) 2-A:10-B:C on moveable equipment, and
- b) 4-A:40-B:C in all other locations.

#### 5.6.1.6. Standpipe Systems

(See Appendix A.)

**1)** Where a standpipe system is to be installed in a *building* under construction or alteration, the system shall be installed progressively in conformance with Subsection 3.2.5. of Division B of the Alberta Building Code 2006 in areas permitted to be occupied.

**2)** Where a standpipe is to be installed in portions of a *building* under construction or alteration that is not occupied

- a) a permanent or temporary standpipe system is permitted in accordance with Clauses (b) and (c),
- b) the standpipe system shall be provided with conspicuously marked and readily accessible fire department connections on the outside of the *building* at the *street* level and shall have at least one hose outlet at each floor,
- c) the pipe size, hose valves and water supply shall be in accordance with Subsection 3.2.5. of Division B of the Alberta Building Code 2006,
- d) the standpipes system shall, as a minimum, be securely supported and restrained at each alternate floor,
- e) at least one hose valve for attaching fire department hose shall be provided at each intermediate landing or floor level in the *exit* stairway,
- f) hose valves shall be kept closed at all times and guarded against mechanical damage,
- g) the standpipe shall be not more than one floor below the highest forms, staging, and similar combustibles at all times, and
- h) temporary standpipe systems shall remain in service until permanent standpipe installation is complete.

3) Where a *building* being demolished floor by floor is equipped with a standpipe system, the system, together with fire department connections and valves, shall be maintained in operable condition on all *storeys* below the one being demolished, except for the *storey* immediately below it.

#### 5.6.1.7. Hot Surface Applications and Hot Works

1) Any activity that involves heat sources and hot processes shall be considered hot works and shall conform to the requirements in Sentences (2) and (3) and Section 5.2.

2) Bitumen kettles shall

- a) not be located on roofs,
- b) be provided with adequate metal covers that are close-fitting and constructed of steel having a thickness of not less than No. 14 standard gauge,
- c) be under constant supervision when in operation, and
- d) be maintained free of excessive residue.

3) Mops that have been used for spreading bitumen shall be kept outside the *building* in a safe location when not in use.

#### 5.6.1.8. Provision for Egress

1) In areas of a *building* where construction, alteration or demolition operations are taking place, at least one *exit* shall be accessible and usable at all times.

2) In *buildings* being demolished, at least one stairway shall be maintained in usable condition at all times.

#### 5.6.1.9. Fire Warning

1) A means shall be provided to alert site personnel of a fire and such a means shall be capable of being heard throughout the *building* or facility.

#### 5.6.1.10. Building Services at Demolition Sites

1) Except as required in Sentence (2) and except for water supplies for firefighting, *building* services shall be terminated at a point located outside the *building* or part thereof being demolished. (See Appendix A.)

2) The service company whose service connections will be affected shall be notified before any action described in Sentence (1) is taken and, if it is necessary to maintain any service, it shall be

- a) relocated as necessary, and
- b) protected from damage.

3) Temporary service installations shall be installed in conformance with regulations made pursuant to the Safety Codes Act.

#### 5.6.1.11. Ignition Sources

1) Devices capable of producing ignition, internal combustion engines, temporary heating equipment and associated devices shall be kept at a safe distance from combustible material so as not to cause ignition. (See Appendix A.)

2) The clearance between combustible materials and temporary heating equipment, including *flues*, shall be in conformance with Part 6 of Division B of the Alberta Building Code 2006 or in conformance with the minimum clearances shown on certified heating equipment.

#### 5.6.1.12. Fuel Supply Installation

1) Fuel supplies for heating equipment and internal combustion engines shall conform to

- a) CAN/CSA-B139, "Installation Code for Oil-Burning Equipment," or
- b) gas regulations made pursuant to the Safety Codes Act.

## 5.6.1.13.

**5.6.1.13. Tank, Piping and Machinery Reservoir Safety at Demolition Sites**

1) Tanks, piping and machinery reservoirs at a demolition site shall be taken out of service in conformance with Subsection 4.3.15.

2) Tanks, piping and machinery reservoirs at a demolition site that contain *combustible liquids* or *flammable liquids* or that are likely to contain flammable vapours shall be drained and, except as permitted by Sentence (3), removed prior to the demolition of the *building*.

3) Where it is impracticable to remove tanks, piping or machinery reservoirs from the *building* prior to demolition, such equipment shall be conspicuously identified and removed as soon as conditions permit.

4) Tanks, piping and machinery reservoirs referred to in Sentences (1), (2) and (3) that once contained *combustible liquids*, *flammable liquids* or flammable vapours shall be purged with inert materials prior to demolition to prevent an explosion. (See Appendix A.)

**5.6.1.14. Fire Separations in Partly Occupied Buildings**

1) Where part of a *building* continues to be occupied, the occupied part shall be separated from the part being demolished or constructed by a *fire separation* having a *fire-resistance rating* of not less than 1 h.

**5.6.1.15. Watch**

1) A watch, with tours at intervals of not more than 1 h, shall be provided throughout demolition sites when there are occupants in the portion of the *building* not being demolished.

2) Except where a *building* is provided with a fire alarm system or similar equipment, a watch, with tours at intervals of not more than 1 h, shall be provided when a portion of the *building* is occupied while construction operations are taking place.

3) Facilities shall be provided to enable the watcher referred to in Sentences (1) and (2) to

- a) ensure a fire warning is sounded to notify occupants, and
- b) communicate with the fire department.

**5.6.1.16. Smoking Restrictions**

1) Smoking shall be permitted only if Subsection 2.4.2. is complied with.

**5.6.1.17. Dangerous Goods Storage and Use**

1) *Combustible liquids* and *flammable liquids* shall be stored and used in conformance with Part 4.

2) *Dangerous goods* shall be stored in conformance with Part 3.

3) *Dangerous goods* shall be used in conformance with Part 5.

**5.6.1.18. Temporary Enclosures**

1) Fabrics and films used to temporarily enclose *buildings* shall be securely fastened to prevent them from being blown against heaters or other ignition sources.

**5.6.1.19. Disposal of Combustible Refuse**

1) Combustible refuse in sufficient quantities to constitute a fire hazard shall be moved to a safe location. (See also Subsection 8.2.5. of Division B of the Alberta Building Code 2006.)

**5.6.1.20. Protection during Shutdown**

**1)** Except as permitted in Sentence (2), where a fire protection system is provided, it shall remain operational throughout the construction, alteration or demolition area where reasonably practical.

**2)** When any portion of a fire protection system is temporarily shut down during construction, alteration or demolition operations, protection during shutdown shall comply with Article 6.1.1.4.

**5.6.1.21. Occupied Buildings**

**1)** When a *building* is occupied prior to its completion or during extensive alterations to it, fire safety measures in the occupied portions of the *building* shall be maintained or alternate provisions made.

**2)** Measures shall be taken to cordon off and control access to the work areas.

**3)** Required *exits* from the occupied area shall be maintained or alternate *means of egress* shall be provided. (See Appendix A.)

**5.6.2. Excavation****5.6.2.1. Services Shut-off**

**1)** Except as provided in Article 5.6.2.2., before excavation begins, *building* services shall be shut off, terminated and labelled so as to permit them to be easily identified outside the limits of the excavation. (See also Sentence 5.6.1.10.(1).)

**2)** The service company whose service connections will be affected shall be notified before any action described in Sentence (1) is taken and, if it is necessary to maintain any service, it shall be

- a) relocated as necessary, and
- b) protected from damage.

**5.6.2.2. Maintaining Existing Services**

**1)** Existing gas, electrical, water, steam and other services are permitted to be left within the area of the excavation provided that

- a) before work begins, the service company concerned has approved the proposed method of operation,
- b) the location of the services is determined before excavation commences,
- c) a suitable method of excavation is adopted that will ensure that the services are not damaged, and
- d) the services are provided with suitable temporary supports.

**Section 5.7. Fireworks****5.7.1. Fireworks**

(See Appendix A.)

**5.7.1.1. Application**

**1)** Except as permitted by Sentence (2), this Section shall apply to the sale and discharge of *fireworks* and pyrotechnic devices.

**2)** This Section shall not apply to a person who possesses or discharges *fireworks* commonly used as distress flares.

**5.7.1.2. Manufacture, Importation, and Transportation**

**1)** The manufacture and importation of *fireworks* shall be in conformance with the "Explosives Act" and its Regulations, published by Natural Resources Canada.

**2)** The transportation of *fireworks* shall be in conformance with the "Transportation of Dangerous Goods Act" and its Regulations.

**5.7.1.3. Discharge**

- 1)** Except as permitted in Clause 5.7.1.7.(1)(b), no person shall discharge, fire or set off *fireworks* from, on or over
- a) public land as defined in the Public Lands Act, or
  - b) a forest protection area designated under the Forest and Prairie Protection Act.

**5.7.1.4. Prohibited**

- 1)** No person shall have in their possession, sell, offer for sale, give away or otherwise distribute, discharge, fire or set off *firecrackers*.
- 2)** No person shall purchase, store, use or supervise the use of a pyrotechnic device unless,
- a) the pyrotechnic device conforms to the requirements of the “Explosives Act” and its Regulations, published by Natural Resources Canada, and
  - b) the person is certified in accordance with the “Explosives Act” and its Regulations, published by Natural Resources Canada.

**5.7.1.5. Activities**

- 1)** No person shall discharge, fire or set off *fireworks*
- a) in a place or in a manner that creates a danger or constitutes a nuisance to any person or property,
  - b) on a highway, road allowance, public beach or park unless they first obtain written permission from the fire department,
  - c) on privately owned land unless they
    - i) first obtain the written consent of the *owner* or occupant of that land and the *owner* or occupant of neighbouring land on which debris might reasonably be expected to fall, and
    - ii) provide a copy of the consent required in Subclause (c)(i) to the fire department,
  - d) in a *building* or place, unless
    - i) the *fireworks* are specifically designed and clearly marked by the manufacturer for such use, and
    - ii) the *building* or place is acceptable to the fire department,
  - e) within 10 m of any *building*, tent, trailer, canvas shelter or motor vehicle,
  - f) within 200 m of any place where explosives or *flammable liquids* or *combustible liquids* or substances are manufactured or stored,
  - g) within 250 m of a correctional institution as defined in the Corrections Act, a facility as defined in the Mental Health Act, a nursing home within the meaning of the Nursing Homes Act, a social care facility as defined in the Social Care Facilities Licensing Act, a hospital as defined in the Hospitals Act, an educational institution or a church, unless acceptable to the fire department, or
  - h) when the wind velocity exceeds 45 km/h or when, in the opinion of the fire department, weather conditions create an undue fire hazard.
- 2)** The fire department is permitted to require a person to cease the discharging, firing or setting off of *fireworks* when considered necessary to do so for reasons of safety.

**5.7.1.6. Authority**

- 1)** The fire department, or *forest officer* in the forest protection area, is permitted to seize, take, remove or cause to be seized, taken or removed any *fireworks* offered or exposed for sale or being held or used contrary to this Section.
- 2)** Where *fireworks* are seized in accordance with Sentence (1), the fire department, or *forest officer* in the forest protection area, shall dispose of them in a safe manner.

**5.7.1.7. Written Permission**

(See Appendix A.)

- 1)** No person shall
  - a) purchase, possess, handle, discharge, fire or set off *fireworks* unless written permission issued by the fire department for that purpose has been obtained, or
  - b) discharge, fire or set off *fireworks* in a forest protection area unless written permission issued by a *forest officer* for that purpose has been obtained.
- 2)** Written permission issued under Sentence (1)
  - a) shall specify the date, time and location on which the *fireworks* are to be discharged, and
  - b) is permitted to contain any other terms and conditions the fire department or *forest officer* considers necessary to ensure the safe use of the *fireworks*.
- 3)** Permission shall not be granted under this Section in respect to *high-hazard fireworks* unless the applicant possesses a *fireworks* supervisor card issued pursuant to the "Explosives Act" and its Regulations, published by Natural Resources Canada.

**5.7.1.8. Fireworks Sales**

- 1)** No person shall sell, offer for sale or store for the purpose of sale, *fireworks* unless
  - a) permission is obtained from the fire department for the sale and storage, and
  - b) the *building* or place used for the sale or storage conforms to Part 3.
- 2)** A request for permission under Sentence (1) shall be accompanied by a copy of the applicant's current business licence issued by the municipality in which the applicant carries on business.
- 3)** A person who sells *fireworks* or offers them for sale shall ensure that
  - a) the manufacturer's instructions on the safe use of *fireworks* are provided with each sale,
  - b) notices acceptable to the fire department are posted at the sales outlet outlining the instructions referred to in Clause (a),
  - c) a record of each sale is kept on the premises where the sale occurs for a period of not less than two years following the date of the sale, and
  - d) a record referred to in Clause (c) shows
    - i) the date of the sale,
    - ii) the name, address and phone number of the purchaser,
    - iii) a description of the *fireworks* sold,
    - iv) the date and time the *fireworks* will be discharged, and
    - v) the location and a description of the site where the *fireworks* will be discharged.
- 4)** A person who sells *fireworks* or offers them for sale shall make available the record referred to in Clause (3)(c) in conformance with Article 2.2.1.2. of Division C.

**5.7.1.9. Age Requirement**

- 1)** No person who is under 18 years of age shall purchase, possess, handle, discharge, fire or set off *fireworks*.

**5.7.1.10. Discharging**

- 1)** *Fireworks* from which a projectile is discharged shall be set up in such a manner so that when ignited the projectile will go into the air in a vertical direction not more than 15° off the perpendicular.
- 2)** Where ground level *fireworks* are discharged
  - a) they shall be positioned out of the firing range of aerial *fireworks* and in a location where there is no dry grass or combustible material on the ground beneath them, and
  - b) the area shall be thoroughly wet down immediately before the *fireworks* are discharged.

3) A portable extinguisher having a rating of not less than 2-A shall be provided and kept in the immediate discharge area.

#### 5.7.1.11. High-Hazard Display

- 1) Where *high-hazard fireworks* are discharged, the person responsible for discharging the *fireworks* shall ensure that
- a) they have at least 2 assistants who are competent persons over 18 years of age and have been trained in the proper handling of *fireworks*,
  - b) the *fireworks* are set up in conformance with the "Display Fireworks Manual," published by Natural Resources Canada,
  - c) at least 2 portable extinguishers each having a rating not less than 2-A shall be not more than 45 m from the location at which the *fireworks* are discharged,
  - d) the potential landing area is cleared of spectators, vehicles, dry grass and other combustible material immediately prior to the beginning of the display and during the display,
  - e) nothing other than a flashlight or electrical lighting is used for artificial illumination,
  - f) no person, other than persons responsible for discharging the *fireworks*, is closer than 45 m from the location at which the *fireworks* are being discharged,
  - g) the location at which the *fireworks* are discharged is at least
    - i) 60 m from any highway or other similar means of travel used by the public, and
    - ii) 15 m from the nearest overhead obstruction,
  - h) a complete search is conducted of the display area for any duds within 12 hours of the conclusion of the display, and
    - i) any unused *fireworks* or duds remaining are disposed of in a safe manner within 12 hours of the conclusion of the display.

## Section 5.8. Objectives and Functional Statements

### 5.8.1. Objectives and Functional Statements

#### 5.8.1.1. Attribution to Acceptable Solutions

1) For the purposes of compliance with this Code as required in Clause 1.2.1.1.(1)(b) of Division A, the objectives and functional statements attributed to the acceptable solutions in this Part shall be the objectives and functional statements listed in Table 5.8.1.1. (See A-1.1.2.1.(1) in Appendix A.)

**Table 5.8.1.1.**  
**Objectives and Functional Statements Attributed to the Acceptable Solutions in Part 5**  
 Forming Part of Sentence 5.8.1.1.(1)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>5.1.1.2. Explosives</b>	
(1)	[F01,F02-OS1.1]
<b>5.1.5.1. Fire Safety Plan</b>	
(2)	(b) [F12-OS1.2]
<b>5.2.1.1. Application</b>	
(2)	[F01-OS1.1] Applies to portion of Code text: "... hot works described in Sentence (1) shall conform to CAN/CSA-W117.2, 'Safety in Welding, Cutting and Allied Processes.'"

**Table 5.8.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>5.2.1.2. Training</b>	
(1)	[F81–OS1.1]
<b>5.2.2.1. Maintenance</b>	
(1)	[F82–OS1.1]
<b>5.2.2.2. Inspection</b>	
(1)	[F82–OS1.1]
(2)	[F82–OS1.1]
<b>5.2.2.3. Equipment Not in Use</b>	
(1)	[F43,F01–OS1.1]
(2)	[F01–OS1.1]
<b>5.2.2.4. Compressed Gas Equipment</b>	
(1)	[F81,F01–OS1.1]
(2)	[F01–OS1.1]
(3)	[F01–OS1.1]
<b>5.2.3.1. Location of Operations</b>	
(1)	[F01–OS1.1]
(2)	(c) [F01–OP1.1] [F02–OP1.2]
	(c) [F01–OS1.1] [F02–OS1.2]
(3)	(a) [F01–OS1.1]
<b>5.2.3.2. Protection of Combustible and Flammable Materials</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
(3)	[F01–OS1.1]
<b>5.2.3.3. Fire Watch</b>	
(1)	[F01–OP1.1] [F02–OP1.2]
	[F01–OS1.1] [F02–OS1.2]
<b>5.2.3.4. Work on Containers, Equipment or Piping</b>	
(1)	[F01–OS1.1] Applies to the restriction of hot works.
(2)	[F81,F20–OS3.1]
(3)	[F01–OS1.1] Applies to portion of Code text: “Hot work shall not be performed on metal objects that are in contact with combustible materials unless ...”
<b>5.2.3.5. Work Adjacent to Piping</b>	
(1)	(b) [F81–OS1.1]
<b>5.2.3.6. Fire Extinguishing Equipment</b>	
(1)	[F02–OS1.2]

Table 5.8.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>5.2.3.7. Fire Safety Plan</b>	
(1)	[F01–OS1.1]
<b>5.3.1.2. Dust Removal</b>	
(2)	[F01–OS1.1]
(3)	[F01–OS1.1]
<b>5.3.1.3. Dust-Collecting Systems</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1] Applies to the design of dust-collecting systems according to good engineering practice such as the NFPA standards.
	(a) [F02–OP1.2]
	(a) [F02–OS1.2]
	(b) [F01–OS1.1]
<b>5.3.1.4. Dust Collectors</b>	
(1)	[F02–OP1.2]
	[F02–OS1.2]
(2)	[F02,F03–OP1.2] [F01–OP1.1]
	[F02,F03–OS1.2] [F01–OS1.1]
(3)	[F01–OS1.1]
	[F01–OS1.1]
	(b) [F03–OP1.2]
	(b) [F03–OS1.2]
<b>5.3.1.5. Bonding and Grounding</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
<b>5.3.1.6. Explosion Venting</b>	
(1)	[F02–OP1.3]
	[F02–OS1.3]
(2)	[F02–OP1.3]
	[F02–OS1.3]
<b>5.3.1.7. Explosion Prevention Systems</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
<b>5.3.1.8. Electrical Interlocks</b>	
(1)	[F01–OS1.1]
<b>5.3.1.9. Separators</b>	
(1)	[F01–OS1.1]

**Table 5.8.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>5.3.1.10. Ignition Sources</b>	
(1)	[F01-OS1.1]
(2)	[F01-OS1.1]
(3)	[F01-OS1.1]
<b>5.3.2.1. Exhaust Systems</b>	
(1)	[F01-OS1.1] [F02-OS1.2]
	[F02-OP1.2]
(2)	[F01-OS1.1]
<b>5.3.2.2. Shavings and Sawdust Collection</b>	
(1)	[F01-OS1.1] Applies to portion of Code text: "Loose shavings and sawdust shall be collected at frequent intervals ..."
<b>5.3.2.3. Fire Extinguishers</b>	
(1)	[F12-OS1.2]
<b>5.3.3.1. Storage Bins and Silos</b>	
(1)	[F01-OS1.1]
<b>5.3.3.2. Conveying Equipment</b>	
(1)	[F81,F11,F01-OS1.1]
(2)	[F01-OS1.1]
(3)	[F01,F82-OS1.1]
<b>5.3.3.3. Separators</b>	
(1)	[F01-OS1.1]
<b>5.3.3.4. Fire Protection</b>	
(1)	[F01-OS1.1]
<b>5.4.1.2. Design, Operation and Maintenance</b>	
(1)	[F01,F82-OS1.1] [F02,F03,F82-OS1.2]
<b>5.4.2.1. Dry Cleaning Plants</b>	
(1)	[F01,F81-OS1.1] [F02,F03,F81-OS1.2]
<b>5.4.3.2. Notification</b>	
(1)	[F13-OS1.1]
	[F13-OS3.4]
(2)	[F11-OS1.1]
	[F11-OS3.4]
<b>5.4.3.3. Ignition Sources</b>	
(1)	[F01-OS1.1]
<b>5.4.3.4. Electric Power</b>	
(1)	[F01-OS1.1]

Table 5.8.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>5.4.3.5. Air Temperature</b>	
(1)	[F81–OP1.2]
	[F81–OS1.2]
<b>5.4.3.6. Access to Premises</b>	
(1)	[F34–OS1.1]
	[F34–OS3.4]
(2)	[F34–OS1.1]
	[F34–OS3.4]
(3)	[F34–OS1.1]
	[F34–OS3.4]
<b>5.4.4.2. Public Access</b>	
(1)	[F34–OS1.1]
	[F34–OS3.4]
<b>5.4.4.3. Ventilation</b>	
(1)	[F01–OS1.1]
(2)	[F01–OS1.1]
<b>5.4.4.4. Sources of Ignition</b>	
(1)	[F01–OS1.1]
<b>5.4.4.5. Waste Receptacles</b>	
(1)	[F01–OS1.1] Applies to the disposal of contents in a manner that will not create a fire hazard.
	[F02–OP1.2] Applies to the daily removal of contents.
	[F02–OS1.2] Applies to the daily removal of contents.
<b>5.4.5.2. Design, Operation and Maintenance</b>	
(1)	[F01,F82–OS1.1] [F02,F03,F82–OS1.2]
<b>5.4.6.2. Design, Operation and Maintenance</b>	
(1)	[F01,F82–OS1.1] [F02,F03,F82–OS1.2]
<b>5.5.2.2. Separation</b>	
(1)	[F03–OP1.2]
	[F03–OS1.2]
<b>5.5.3.1. Emergency Planning</b>	
(2)	[F12–OS1.5]
(6)	[F34–OH5]
	[F34–OS1.1]
	[F34–OS3.4]

**Table 5.8.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>5.5.3.2. Combustible Materials</b>	
(1)	[F02–OP1.2] [F02–OS1.2]
(2)	[F02–OP1.2] Applies to storing outside the laboratory. [F02–OS1.2] Applies to storing outside the laboratory.
<b>5.5.3.3. Spill Control</b>	
(1)	[F01–OP1.1] [F02–OP1.2] Applies to portion of Code text: “Absorbent and neutralizing materials shall be provided in the laboratory and in the <i>dangerous goods</i> storage areas ...” [F01–OS1.1] [F02–OS1.2] Applies to portion of Code text: “Absorbent and neutralizing materials shall be provided in the laboratory and in the <i>dangerous goods</i> storage areas ...”
<b>5.5.3.4. Electrical Equipment</b>	
(2)	(b) [F02–OP1.2] [F82–OP1.1] (b) [F02–OS1.2] [F82–OS1.1]
<b>5.5.3.5. Ignition Sources</b>	
(1)	[F01–OS1.1] Applies to portion of Code text: “Smoking shall not be permitted in a laboratory ...”
(2)	(a) [F11–OP1.1] (a) [F11–OS1.1] (b) [F01–OS1.1]
(3)	[F01,F02–OS1.1,OS1.2]
<b>5.5.3.6. Inspection and Maintenance</b>	
(1)	[F82–OH5] [F82–OP1.1] [F82–OS1.1] [F82–OS3.4]
(2)	[F02–OP1.2] [F02–OS1.2] [F82–OS1.1]
<b>5.5.4.1. General Ventilation</b>	
(1)	(a),(b),(d),(e) [F01–OS1.1] (c) [F02–OP1.2] (c) [F02–OS1.2] [F81,F82–OS1.1]
(2)	[F81,F11–OS1.1]
<b>5.5.4.2. Power-Ventilated Enclosure</b>	
(2)	[F02–OP1.2] Applies to portion of Code text: “A power-ventilated enclosure required in Sentence (1) shall not be used for the storage of <i>dangerous goods</i> ...” [F02–OS1.2] Applies to portion of Code text: “A power-ventilated enclosure required in Sentence (1) shall not be used for the storage of <i>dangerous goods</i> ...”

Table 5.8.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>5.5.4.3. Enclosure Exhaust Ventilation</b>	
(1)	(a) [F01–OS1.1]
	(a) [F02–OP1.2]
	(a) [F02–OS1.2]
	(a),(c),(d) [F01–OS1.1]
	(b) [F02–OP1.2]
	(b) [F02–OS1.2] [F81–OS1.1]
	(e) [F12–OP1.1,OP1.2]
	(e) [F12–OS1.2,OS1.1]
(2)	(a) [F02–OP1.2] [F82–OP1.1]
	(a) [F02–OS1.2] [F82–OS1.1]
<b>5.5.4.4. Enclosure Construction</b>	
(1)	(a) [F01–OS1.1] Applies to portion of Code text: "... be constructed of ... materials compatible with ... the <i>dangerous goods</i> vapours and particles being exhausted ..."
	(a) [F02–OP1.2] Applies to portion of Code text: "... be constructed of noncombustible materials ..."
	(a) [F02–OS1.2] Applies to portion of Code text: "... be constructed of noncombustible materials ..."
	(a) [F80–OS1.1] Applies to portion of Code text: "... be constructed of ... materials ... chemically resistant to the <i>dangerous goods</i> vapours and particles being exhausted ..."
	(a) [F80–OS3.4] Applies to portion of Code text: "... be constructed of ... materials ... chemically resistant to the <i>dangerous goods</i> vapours and particles being exhausted ..."
	(b) [F02–OP1.2]
	(b) [F02–OS1.2] [F82–OS1.1]
(3)	[F02–OP1.2]
	[F02–OS1.2]
<b>5.5.5.1. Maximum Quantities</b>	
(1)	[F02–OP1.2]
	[F02–OS1.2]
	(a) [F02–OP1.2]
	(a) [F02–OS1.2]
(3)	[F02–OP1.2] Applies to storing outside the laboratory.
	[F02–OS1.2] Applies to storing outside the laboratory.
<b>5.5.5.2. Containers for Flammable and Combustible Liquids</b>	
(2)	[F02,F04–OS1.2] [F43,F01–OS1.1]
(3)	[F43,F01–OS1.1]

**Table 5.8.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>5.5.5.3. Compressed Gases</b>	
(1)	[F81–OS1.1]
	[F81–OS3.4]
(2)	(a) [F12–OP1.2]
	(a) [F81–OS1.1] [F12–OS1.1,OS1.2]
	(a) [F81,F12–OS3.4]
	(b) [F12–OP1.2]
	(b) [F12–OS1.1,OS1.2]
	(b) [F12–OS3.4]
(3)	[F43–OS1.1]
	[F43–OS3.4]
<b>5.5.5.4. Refrigerated Storage</b>	
(2)	[F01,F43–OS1.1]
<b>5.5.5.5. Highly Unstable Substances</b>	
(1)	(b) [F81–OS1.1]
(2)	[F01–OP1.1] [F02–OP1.2]
	[F01–OS1.1] [F02–OS1.2]
(3)	[F01–OS1.1]
<b>5.5.5.6. Chemical Wastes</b>	
(1)	(a) [F81–OS1.1]
<b>5.6.1.2. Protection of Adjacent Building</b>	
(1)	[F11,F13,F12–OS1.2,OS1.5] [F01,F82–OS1.1] [F02,F82–OS1.2]
<b>5.6.1.3. Fire Safety Plan</b>	
(1)	[F11,F13,F12–OS1.2,OS1.5] [F01,F82–OS1.1] [F02,F82–OS1.2]
	[F13,F12–OP1.2] [F01,F82–OP1.1] [F02,F82–OP1.2]
<b>5.6.1.4. Access for Firefighting</b>	
(1)	[F12–OS1.2,OS1.5]
(2)	[F12–OP1.2]
	[F12–OS1.2,OS1.5]
(3)	[F12–OP1.2]
	[F12–OS1.2,OS1.5]
(4)	[F12–OS1.2,OS1.5]
	[F12–OP1.2]
(5)	[F12–OS1.2,OS1.5]
	[F12–OP1.2]

Table 5.8.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>5.6.1.5. Portable Extinguishers</b>	
(1)	[F12–OP1.2]
	[F12–OS1.2]
(2)	[F02–OP1.2]
	[F02–OS1.2]
<b>5.6.1.6. Standpipe Systems</b>	
(1)	[F02,F12–OS1.2]
	[F02,F12–OP1.2]
(2)	[F02,F12–OS1.2]
	[F02,F12–OP1.2]
(3)	[F12,F82–OP1.2]
	[F12,F82–OS1.2]
<b>5.6.1.7. Hot Surface Applications and Hot Works</b>	
(1)	[F01–OS1.1]
	[F01–OP1.1]
(2)	[F01–OS1.1]
	[F01–OP1.1]
(3)	[F01–OS1.2]
	[F01–OP1.2]
<b>5.6.1.8. Provision for Egress</b>	
(1)	[F10,F82–OS3.7]
(2)	[F10,F82–OS3.7]
<b>5.6.1.9. Fire Warning</b>	
(1)	[F11–OS1.5]
<b>5.6.1.10. Building Services at Demolition Sites</b>	
(1)	[F01,F43–OS1.1]
	[F01,F43–OP1.1]
	[F32–OS3.3]
(2)	[F81–OS1.1,OS1.2]
	[F81–OP1.1,OP1.2]
(3)	[F32–OS3.4]
	[F01–OS1.1,OS1.2]
<b>5.6.1.11. Ignition Sources</b>	
(1)	[F01–OS1.1]
	[F01–OP1.1]

**Table 5.8.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(2)	[F01-OS1.1,OS1.2] [F01-OP1.1]
<b>5.6.1.13. Tank, Piping and Machinery Reservoir Safety at Demolition Sites</b>	
(2)	[F01,F43-OS1.1] [F01-OS1.1]
(3)	[F01,F81-OS1.1]
(4)	[F01,F43-OS1.1]
<b>5.6.1.14. Fire Separations in Partly Occupied Buildings</b>	
(1)	[F03-OP1.2] [F03-OS1.2]
<b>5.6.1.15. Watch</b>	
(1)	[F02-OS1.2,OS1.5]
(2)	[F02-OS1.5,OS1.2]
(3)	[F13-OS1.5,OS1.2]
<b>5.6.1.16. Smoking Restrictions</b>	
(1)	[F01-OS1.1]
<b>5.6.1.18. Temporary Enclosures</b>	
(1)	[F01-OS1.1,OS1.2]
<b>5.6.1.19. Disposal of Combustible Refuse</b>	
(1)	[F02-OP1.2]
<b>5.6.1.20. Protection during Shutdown</b>	
(1)	[F12,F82-OS1.2] [F12,F82-OP1.2] [F02-OP3.1]
	[F02-OP1.2] [F02-OP3.1] [F02-OS1.2,OS1.5]
<b>5.6.1.21. Occupied Buildings</b>	
(1)	[F10,F11,F12,F13,F82-OS1.5] [F01-OS1.1] [F02,F11,F13,F82-OS1.2] [F02,F11,F12,F13,F82-OP1.2] [F01,F82-OP1.1]
	[F34-OS1.1] [F34-OS3.4]
(3)	[F10-OS1.5]
<b>5.6.2.1. Services Shut-off</b>	
(1)	[F01,F43,F81-OS1.1,OS1.2] [F01,F43,F81-OP1.1,OP1.2] [F32,OS3.3]

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays

Table 5.8.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(2)	[F81-OS1.1,OS1.2]
	[F81-OP1.1,OP1.2]
<b>5.6.2.2. Maintaining Existing Services</b>	
(1)	[F81-OS1.1,OS1.2]
<b>5.7.1.3. Discharge</b>	
(1)	[F01-OP1.1,OP1.2]
	[F01-OP3.1]
<b>5.7.1.4. Prohibited</b>	
(1)	[F43-OS3.4]
(2)	[F81-OS3.4]
<b>5.7.1.5. Activities</b>	
(1)	[F02,F44,F81-OS1.1,OS1.2]
	[F02,F44,F81-OP1.1,OP1.2]
	[F02,F44,F81-OP3.1]
<b>5.7.1.10. Discharging</b>	
(1)	[F43,F44-OH5]
	[F02,F44-OP1.2]
	[F02,F44-OP3.1]
(2)	[F01,F03-OS1.1,OS1.2]
	[F01,F03-OP1.1]
	[F01,F03-OP3.1]
(3)	[F02,F12-OS1.2]
	[F02,F12-OP1.2]
<b>5.7.1.11. High-Hazard Display</b>	
(1)	(c) [F02,F12-OS1.2]
	(c) [F02,F12-OP1.2]
	(d) [F01,F03-OP1.2]
	(d) [F01,F03-OP3.1]
	(d) [F01,F03-OS1.1,OS1.2]
	(e) [F01-OS1.1]
	(e) [F01-OP1.1]
	(g) [F03-OP3.1]
	(g) [F01-OS1.2]

**Notes to Table 5.8.1.1.:**

(1) See Parts 2 and 3 of Division A.

# **Part 6**

## **Fire Protection Equipment**

<b>6.1.</b>	<b>General</b>	
6.1.1.	General .....	6- 1
<b>6.2.</b>	<b>Portable Extinguishers</b>	
6.2.1.	General .....	6- 2
<b>6.3.</b>	<b>Fire Alarm and Voice Communication Systems</b>	
6.3.1.	General .....	6- 2
<b>6.4.</b>	<b>Water-Based Fire Protection Systems</b>	
6.4.1.	General .....	6- 3
<b>6.5.</b>	<b>Emergency Power Systems and Unit Equipment for Emergency Lighting</b>	
6.5.1.	General .....	6- 3
<b>6.6.</b>	<b>Special Fire Suppression Systems</b>	
6.6.1.	General .....	6- 4
<b>6.7.</b>	<b>Smoke Alarms and Carbon Monoxide Detectors</b>	
6.7.1.	General .....	6- 5
<b>6.8.</b>	<b>Hose for Firefighting</b>	
6.8.1.	General .....	6- 5
<b>6.9.</b>	<b>Lightning Protection Systems</b>	
6.9.1.	General .....	6- 5
<b>6.10.</b>	<b>Objectives and Functional Statements</b>	
6.10.1.	Objectives and Functional Statements .....	6- 6



# **Part 6**

## **Fire Protection Equipment**

### **Section 6.1. General**

#### **6.1.1. General**

##### **6.1.1.1. Application**

**1)** This Part includes requirements for the inspection, testing, and maintenance of portable extinguishers, fire alarm and voice communication systems, water-based fire protection systems, emergency power systems, emergency lighting, special fire suppression systems, smoke alarms, and carbon monoxide detectors, and specifications for hose for firefighting and maintenance requirements for lightning protection systems.

##### **6.1.1.2. Maintenance**

**1)** Fire protection installations shall be maintained in operating condition. (See Appendix A.)

**2)** Specialized fire protection installations not specifically regulated by this Code shall be inspected, tested, maintained and operated in accordance with standards acceptable to the *authority having jurisdiction*.

##### **6.1.1.3. Notification**

**1)** Before repairs or alterations are made to fire protection installations, including but not limited to fire extinguishing systems and fire alarm and detection systems, a procedure of notification acceptable to the fire department shall be established, and the procedure may include the notification of the fire department and the *building* occupants. (See Appendix A.)

**2)** If a person who carries out the maintenance of fire protection installations, including but not limited to portable fire extinguishers, fire extinguishing systems, fire alarm systems or fire alarm devices, discovers that a device or system is inoperative or defective and the *owner* or their authorized agent is unwilling or unable to correct the defect, the person carrying out the maintenance shall forthwith notify, in writing, the fire department and the *owner* or their authorized agent of that notification.

**3)** A person involved in alterations, repairs, shutdown or impairment that affect the operation of a hydrant shall ensure that

- a) the fire department is notified,
- b) the fire department approves the alterations, repairs, shutdown or impairment, and
- c) the affected hydrant is identified in a manner acceptable to the fire department.

(See Appendix A.)

**4)** Sentence (1) does not apply to industrial or manufacturing facilities maintaining their own *fire brigades*.

##### **6.1.1.4. Protection during Shutdown**

**1)** When any portion of a fire protection system is temporarily shut down, alternative measures shall be taken to ensure that protection is maintained. (See Appendix A.)

**6.1.1.5. Records**

- 1)** Unless otherwise stated in this Part, records indicating inspection, testing and maintenance of fire protection equipment shall be on appropriate forms in conformance with this Article and be retained in conformance with Article 2.2.1.2. of Division C.
- 2)** Appropriate forms required by Sentence (1) are included in
  - a) NFPA, "Fire Protection Systems, Inspection, Test and Maintenance Manual, 3<sup>rd</sup> Edition,"
  - b) CAN/ULC-S536, "Inspection and Testing of Fire Alarm Systems," and
  - c) CAN/ULC-S537, "Verification of Fire Alarm Systems."
- 3)** Except as permitted by Sentence (4), each portable extinguisher shall have a tag securely attached to it showing
  - a) the type of extinguisher,
  - b) the size of extinguisher,
  - c) the serial number of extinguisher,
  - d) the date of last annual maintenance,
  - e) the date of last recharge,
  - f) a five-year monthly inspection and annual maintenance record,
  - g) the name of the *owner* of the extinguisher,
  - h) the name, address and telephone number of the service agency,
  - i) the certification number of the recognized testing agency, and
  - j) the printed name and signature of the service person.
- 4)** Bar coding and other technologies acceptable to the *authority having jurisdiction* are permitted to be used as a means of record keeping on portable extinguishers provided
  - a) an information record in accordance with Sentence (3) is available at the premise where the portable extinguisher is located, and
  - b) the tag on the portable extinguisher contains information indicating
    - i) a five-year monthly inspection record for use by the *owner*,
    - ii) the name of the *owner* of the extinguisher,
    - iii) the name, address and telephone number of the service agency,
    - iv) the certification number of a recognized testing agency, and
    - v) the printed name and signature of the service person.
- 5)** Service information that is required to be placed monthly or annually on the portable extinguisher tag referred to in Sentences (3) and (4) shall be handwritten.

**Section 6.2. Portable Extinguishers****6.2.1. General****6.2.1.1. Inspection, Testing and Maintenance**

- 1)** Portable extinguishers shall be inspected, tested and maintained in conformance with NFPA 10, "Portable Fire Extinguishers."

**Section 6.3. Fire Alarm and Voice Communication Systems****6.3.1. General****6.3.1.1. Maintenance**

- 1)** Fire alarm and voice communication systems shall be maintained in operable condition at all times.

**6.3.1.2. Inspection and Testing**

- 1) Fire alarm systems shall be inspected and tested in conformance with CAN/ULC-S536, "Inspection and Testing of Fire Alarm Systems."
- 2) Fire alarm and detection system components shall be accessible for purposes of inspection or maintenance.

**6.3.1.3. Central Stations and Their Fire Protection Signalling Systems**

- 1) Central stations, including their fire protection signalling systems, shall be maintained in conformance with CAN/ULC-S561, "Installation and Services for Fire Signal Receiving Centres and Systems." (See Appendix A.)
- 2) Central stations and proprietary signalling systems conforming to National Fire Protection Association standards shall be maintained in conformance with NFPA 72®, "National Fire Alarm Code®."(2)

**6.3.1.4. Voice Communication Systems**

- 1) Voice communication systems that are integrated with a required fire alarm system shall be tested in conformance with Article 6.3.1.2.
- 2) Voice communication or public address systems that are part of the *building* evacuation plan and are not electrically supervised shall be tested at intervals not greater than one month in conformance with Sentences (3) and (4). (See Appendix A.)
- 3) Loudspeakers operated from the central alarm and control facility shall be tested to ensure they can be heard in all parts of the *building*.
- 4) The 2-way communication system from each *floor area* to the central alarm and control facility shall be tested to ensure proper operation.

**6.3.1.5. Signal Transmission**

- 1) If a fire alarm or sprinkler system is required to transmit a signal to the fire department in conformance with the Alberta Building Code 2006, the connection shall be operational at all times.

## Section 6.4. Water-Based Fire Protection Systems

**6.4.1. General****6.4.1.1. Inspection, Testing and Maintenance**

- 1) Water-based fire protection systems shall be inspected, tested and maintained in conformance with NFPA 25, "Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems." (See Appendix A.)

## Section 6.5. Emergency Power Systems and Unit Equipment for Emergency Lighting

**6.5.1. General****6.5.1.1. Inspection, Testing and Maintenance**

- 1) Except as provided in Articles 6.5.1.2. to 6.5.1.5., emergency power systems shall be inspected, tested and maintained in conformance with CAN/CSA-C282, "Emergency Electrical Power Supply for Buildings."

(2) NFPA 72® and National Fire Alarm Code® are registered trademarks of the National Fire Protection Association, Inc., Quincy, MA 02169-7471.

**6.5.1.2.**

**2)** An emergency electrical power supply system for emergency equipment for health care facilities shall be inspected, tested and maintained in conformance with CAN/CSA-Z32, "Electrical Safety and Essential Electrical Systems in Health Care Facilities." (See Appendix A.)

**6.5.1.2. Notification**

**1)** When an emergency power system or any part thereof is shut down, the *supervisory staff* shall be notified in conformance with Section 2.8.

**6.5.1.3. Instructions**

**1)** Where an emergency power system is installed, instructions shall be provided for switching on essential loads and for starting the generator when this is not done automatically.

**6.5.1.4. Records**

**1)** Written records shall be maintained as required in CAN/CSA-C282, "Emergency Electrical Power Supply for Buildings."

**6.5.1.5. Supply of Fresh Fuel**

**1)** Liquid fuel *storage tanks* shall be drained and refilled with fresh fuel at intervals not greater than 12 months. (See Appendix A.)

**6.5.1.6. Inspection of Unit Equipment**

**1)** Self-contained emergency lighting unit equipment shall be inspected at intervals not greater than one month to ensure that

- a) pilot lights are functioning and not obviously damaged or obstructed,
- b) the terminal connections are clean, free of corrosion and lubricated when necessary,
- c) the terminal clamps are clean and tight as per manufacturer's specifications,
- d) the battery surface is kept clean and dry, and
- e) the lighthoods are aligned in an acceptable manner.

**2)** Self-contained emergency lighting unit equipment shall be tested

- a) at intervals not greater than one month to ensure that the emergency lights will function upon failure of the primary power supply, and
- b) at intervals not greater than 12 months to ensure that the unit will provide emergency lighting for a duration equal to the design criterion under simulated power failure conditions.

**3)** After completion of the test required in Clause (2)(b), the charging conditions for voltage and current and the recovery period shall be tested to ensure that the charging system is functioning in accordance with the manufacturer's specifications.

**6.5.1.7. Inspection of Emergency Lights**

**1)** Except as provided in Article 6.5.1.6., emergency lights shall be inspected at intervals not greater than 12 months to ensure that they are functional.

**Section 6.6. Special Fire Suppression Systems****6.6.1. General****6.6.1.1. Testing, Inspection and Maintenance**

**1)** A special fire suppression system that meets the description given in any one of the standards referenced in Article 2.1.3.5. shall be tested, inspected and maintained in conformance with the appropriate requirements of that standard.

## Section 6.7. Smoke Alarms and Carbon Monoxide Detectors

### 6.7.1. General

#### 6.7.1.1. Inspection, Testing and Maintenance

- 1) Except as required by Sentences (2) and (3), *smoke alarms* shall be inspected, tested and maintained in conformance with CAN/ULC-S552, "Maintenance and Testing of Smoke Alarms."
- 2) The *owner* of a leased *dwelling unit* shall
  - a) ensure *smoke alarms* within the *dwelling unit* are tested and cleaned prior to occupancy, and
  - b) provide tenants with information concerning ongoing *smoke alarm* inspection, testing and maintenance.
- 3) *Smoke alarms* in *suites* of hotels and motels are to be inspected, tested and cleaned every month.
- 4) A record shall be kept of all testing of *smoke alarms* installed in hotels and motels and shall be retained in conformance with Article 2.2.1.2. of Division C.
- 5) Carbon monoxide detectors shall be inspected, tested and maintained in conformance with the manufacturer's instructions.

## Section 6.8. Hose for Firefighting

### 6.8.1. General

#### 6.8.1.1. General

- 1) No person shall sell, offer for sale, purchase, lease or otherwise distribute 65 mm or 38 mm hose couplings or fittings intended for use on firefighting hose or fire hydrants by a municipal fire department or *fire brigade* unless the couplings and fittings comply with this Section.
- 2) Threaded firefighting hose couplings and fittings shall have threads that are
  - a) 38 mm Straight Iron Pipe Thread (S.I.P.T.) on 38 mm couplings, or
  - b) 3.15 threads per cm with a major thread diameter between 75.95 mm and 75.69 mm for male threads and 76.45 mm for female threads on 65 mm hose couplings and hydrant connections.
- 3) All firefighting hose couplings shall meet the test requirements of ULC-S513, "Threaded Couplings for 1 1/2 inch and 2 1/2 inch Fire Hose," for pull, compression, hardness, and corrosion resistance.
- 4) All firefighting hose with internal lug quick-connect couplings shall be in conformance with CAN4-S543-M, "Internal Lug Quick-connect Couplings for Fire Hose."

## Section 6.9. Lightning Protection Systems

### 6.9.1. General

#### 6.9.1.1. Maintenance

- 1) A lightning protection system shall be maintained in accordance with CAN/CSA-B72, "Installation Code for Lightning Protection Systems."

## Section 6.10. Objectives and Functional Statements

### 6.10.1. Objectives and Functional Statements

#### 6.10.1.1. Attribution to Acceptable Solutions

1) For the purposes of compliance with this Code as required in Clause 1.2.1.1.(1)(b) of Division A, the objectives and functional statements attributed to the acceptable solutions in this Part shall be the objectives and functional statements listed in Table 6.10.1.1. (See A-1.1.2.1.(1) in Appendix A.)

**Table 6.10.1.1.**  
**Objectives and Functional Statements Attributed to the Acceptable Solutions in Part 6**  
 Forming Part of Sentence 6.10.1.1.(1)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>6.1.1.2. Maintenance</b>	
(1)	[F82-OP1.2]
	[F82-OP3.1]
	[F82-OS1.2,OS1.5]
(2)	[F82-OP1.2]
	[F82-OP3.1]
	[F82-OS1.2,OS1.5]
<b>6.1.1.3. Notification</b>	
(1)	[F11,F13-OP1.2]
	[F11,F13-OP3.1]
	[F11,F13-OS1.2,OS1.5]
(2)	[F82-OS1.4]
	[F82-OP1.4]
(3)	[F12,F13-OS1.4]
	[F12,F13-OP1.4]
<b>6.1.1.4. Protection during Shutdown</b>	
(1)	[F02-OP1.2]
	[F02-OP3.1]
	[F02-OS1.2,OS1.5]
<b>6.2.1.1. Inspection, Testing and Maintenance</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2]
	[F82-OS3.1,OS3.2,OS3.3,OS3.4]
<b>6.3.1.1. Maintenance</b>	
(1)	[F02,F12-OS1.5,OS1.2]
<b>6.3.1.2. Inspection and Testing</b>	
(1)	[F82-OS1.5,OS1.2]

**Table 6.10.1.1. (Continued)**

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
(2)	[F82-OS1.5,OS1.2]
<b>6.3.1.3. Central Stations and Their Fire Protection Signalling Systems</b>	
(1)	[F82-OS1.2,OS1.5]
(2)	[F82-OS1.2,OS1.5]
<b>6.3.1.4. Voice Communication Systems</b>	
(2)	[F82-OS1.2,OS1.5]
(3)	[F82-OS1.2,OS1.5]
(4)	[F82-OS1.2,OS1.5]
<b>6.3.1.5. Signal Transmission</b>	
(1)	[F13,F82-OS1.4]
	[F13,F82-OP1.4]
<b>6.4.1.1. Inspection, Testing and Maintenance</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2]
	[F82-OS3.1,OS3.2,OS3.3,OS3.4.]
<b>6.5.1.1. Inspection, Testing and Maintenance</b>	
(1)	[F82-OP1.2]
	[F82-OP3.1]
	[F82-OS1.2,OS1.5]
	[F82-OS3.1,OS3.7]
(2)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
<b>6.5.1.3. Instructions</b>	
(1)	[F12-OP1.2]
	[F12-OP3.1]
	[F12-OS1.2,OS1.5]
	[F12-OS3.1,OS3.7]
<b>6.5.1.5. Supply of Fresh Fuel</b>	
(1)	[F82-OP1.2]
	[F82-OP3.1]
	[F82-OS1.2,OS1.5]
	[F82-OS3.1,OS3.7]
<b>6.5.1.6. Inspection of Unit Equipment</b>	
(1)	[F82-OS3.1,OS3.7]
(2)	[F82-OS3.1,OS3.7]
(3)	[F82-OS3.1,OS3.7]

Table 6.10.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>6.5.1.7. Inspection of Emergency Lights</b>	
(1)	[F82-OS3.1,OS3.7]
<b>6.6.1.1. Testing, Inspection and Maintenance</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2]
<b>6.7.1.1. Inspection, Testing and Maintenance</b>	
(1)	[F82-OS1.5,OS1.2]
(2)	[F82-OS1.5,OS1.2]
(3)	[F82-OS1.5,OS1.2]
(5)	[F82-OS1.5,OS1.2]
<b>6.8.1.1. General</b>	
(2)	[F12,F81-OS1.2,OS1.4]
	[F12,F81-OP1.2,OP1.4]
	[F12,F81-OP3.1]
(3)	[F12,F81-OS1.2,OS1.4]
	[F12,F81-OP1.2,OP1.4]
	[F12,F81-OP3.1]
(4)	[F12,F81-OS1.2,OS1.4]
	[F12,F81-OP1.2,OP1.4]
	[F12,F81-OP3.1]
<b>6.9.1.1. Maintenance</b>	
(1)	[F82-OS1.4]
	[F82-OP1.4]

**Notes to Table 6.10.1.1.:**

(1) See Parts 2 and 3 of Division A.

# **Part 7**

## **Fire Emergency Systems in High Buildings**

<b>7.1.</b>	<b>General</b>	
7.1.1.	General .....	7- 1
<b>7.2.</b>	<b>Inspection, Testing and Maintenance</b>	
7.2.1.	Intervals between Tests .....	7- 2
7.2.2.	Elevators .....	7- 2
7.2.3.	Venting to Aid Firefighting .....	7- 3
7.2.4.	Central Alarm and Control Facility .....	7- 3
<b>7.3.</b>	<b>Inspections and Test Procedures for Smoke Control Systems</b>	
7.3.1.	General .....	7- 3
7.3.2.	Smoke Control Equipment .....	7- 4
<b>7.4.</b>	<b>Objectives and Functional Statements</b>	
7.4.1.	Objectives and Functional Statements .....	7- 4



# **Part 7**

## **Fire Emergency Systems in High Buildings**

### **Section 7.1. General**

#### **7.1.1. General**

##### **7.1.1.1. Application**

**1)** This Part provides for the inspection, testing and maintenance of the fire emergency systems installed in high *buildings* as defined in Subsection 3.2.6. of Division B of the Alberta Building Code 2006.

##### **7.1.1.2. Testing Fire Emergency Systems**

**1)** Except as provided in Sentence (2), fire emergency systems required to be installed in *buildings* in conformance with Subsection 3.2.6. of Division B of the Alberta Building Code 2006 shall be tested in conformance with Sections 7.2. and 7.3.

**2)** Any fire emergency system required by Subsection 3.2.6. of Division B of the Alberta Building Code 2006 that does not conform to a specific measure outlined in Commentary C of the User's Guide – NBC 1995 (Part 3) shall be tested to ensure that it operates as intended.

**3)** Deficiencies noted during the testing described in Sentences (1) and (2) shall be corrected.

##### **7.1.1.3. Records**

**1)** A written record shall be kept of all tests and corrective measures required by Article 7.1.1.2., and such record shall be retained for examination by the *authority having jurisdiction*, in conformance with Article 2.2.1.2. of Division C.

##### **7.1.1.4. Maintenance of Fire Emergency Systems**

**1)** In addition to the requirements of Part 6, components of fire emergency systems shall be maintained in conformance with Sentences (2) to (6).

**2)** The keys required to recall elevators and to permit independent operation of each elevator shall be kept in the locations required by Sentence 2.5.1.3.(1).

**3)** Access to windows and panels required to vent *floor areas* and vents to vestibules permitted to be manually openable shall be kept free of obstruction.

**4)** Windows and panels provided for venting *floor areas* shall be maintained so as to be openable without the use of keys.

**5)** Vents to vestibules permitted to be manually openable shall be maintained in an operable condition.

**6)** Where firefighters' elevator identification has been provided as required by elevator regulations made pursuant to the Safety Codes Act, it shall be maintained in a condition acceptable to the fire department.

## Section 7.2. Inspection, Testing and Maintenance

### 7.2.1. Intervals between Tests

#### 7.2.1.1. Intervals between Tests

1) Except as specifically prescribed in this Part, all tests specified in this Section and Section 7.3. shall be carried out at intervals not greater than 3 months, except that longer intervals between tests are permitted in conformance with Clause 1.2.1.1.(1)(b) of Division A. (See Appendix A.)

### 7.2.2. Elevators

#### 7.2.2.1. Testing Elevators

1) Elevator door-opening devices operated by means of photo-electric cells shall be tested to ensure that the devices become inoperative after the door has been held open for more than 20 s with the photo-electric cell covered.

2) Key-operated switches located outside an elevator hoistway and intended for firefighter use shall be identified in a manner acceptable to the fire department and tested to ensure that

- a) in the "Off" position, the elevators will operate normally, even if the fire alarm is actuated,
- b) in the "Auto" position, actuation of the fire alarm system will
  - i) render any security or service lock-out features and the emergency stop switch inoperative as soon as the doors are closed and the car starts to move,
  - ii) cancel all other calls, and
  - iii) cause the cars to proceed non-stop to the recall level where the car doors will open and remain open,
- c) in the "On" position, the elevator will respond as specified in Clause (2)(b) without the fire alarm being actuated,
- d) neither the "Auto" or "On" position will override the elevator inspection mode, and
- e) the key can be removed from the key slot in any position.

3) Key-operated switches located in each elevator car and intended for firefighter use shall be identified in a manner acceptable to the fire department and tested to ensure that when in the "On" position

- a) the key can be removed from the key slot,
- b) the power-operated doors will only open or close when the appropriate button is continuously depressed,
- c) premature release of the button referred to in Clause (b) will cause the doors to automatically return to their previous position, and
- d) the elevator will travel to the selected floor and will remain on that floor with its doors closed until the open button is pushed or another floor is chosen.

4) Key- or push-button-operated switches located outside the elevator cars and used to select an elevator or group of elevators to operate on emergency power shall be identified in a manner acceptable to the fire department and tested to ensure that, during a power failure,

- a) the pre-selected elevator or group of elevators will operate normally, and
- b) operation of the switches will transfer power to another elevator or group of elevators as indicated by the labelled switch position.

5) At intervals not greater than 12 months, the *building* emergency power systems shall be operated and each elevator capable of operating under emergency power shall be tested with no other source of electrical power.

#### 7.2.2.2. Tests

1) The tests specified in this Subsection shall be carried out at intervals of not more than 12 months.

**7.2.3. Venting to Aid Firefighting****7.2.3.1. Closures**

- 1) The *closures* in vent openings into smoke shafts from each *floor area* shall be tested at intervals in conformance with Article 7.2.1.1. to ensure that
  - a) they can be operated from a remote location such as a stairshaft, the *storey* immediately below or the central alarm and control facility, and
  - b) they will not open automatically on any *storey* other than the fire floor when smoke or hot gas passes through the shaft.
- 2) Sentence (1) does not require all *closures* in vent openings into smoke shafts to be tested on each test occasion, but a representative number may be tested at any one time provided the test, the number of closures and sequence is acceptable to the *authority having jurisdiction*.

**7.2.3.2. Elevator Recall**

- 1) In addition to the procedures described in Article 7.2.3.1., all elevators in an elevator hoistway that is designed for use as a smoke shaft shall be tested to ensure that on activation of the fire alarm system they will return to the *street* floor level and remain inoperative.

**7.2.3.3. Air-Handling System Controls**

- 1) Controls for air-handling systems used for venting in the event of a fire shall be tested to ensure that
  - a) the system can maintain an exhaust to the outdoors at a rate of six air changes per hour from any *floor area*, and
  - b) emergency power to the fans required by Clause (a) is provided as described in Article 3.2.7.9. of Division B of the Alberta Building Code 2006.

**7.2.3.4. Records**

(See Appendix A.)

- 1) A written record shall be kept of all tests and corrective measures required by this Subsection and it shall be retained in conformance with Article 2.2.1.2. of Division C.

**7.2.4. Central Alarm and Control Facility****7.2.4.1. Fan Controls**

- 1) Air moving fans in a system serving more than 2 *storeys* shall be tested to ensure that they will stop on activation of a switch at the central alarm and control facility.

**7.2.4.2. Hold-Open Devices**

- 1) Doors to vestibules that are normally held open by a hold-open device connected to the *building* fire alarm system shall be tested to ensure that they will close on a signal from the central alarm and control facility.

**Section 7.3. Inspections and Test Procedures for Smoke Control Systems****7.3.1. General****7.3.1.1. Application**

- 1) The test procedures described in Subsection 7.3.2., as appropriate to the fire safety system being used, shall be carried out in addition to those required by Sections 7.1. and 7.2., unless other arrangements acceptable to the *authority having jurisdiction* are included in the fire safety plan. (See Appendix A.)

**7.3.1.2.****7.3.1.2. Doors in Means of Egress**

1) Where vestibules or stairshafts are pressurized as a means of smoke control, all doors in the path of *exit* travel shall be tested to ensure that they can be operated as required in Article 2.7.2.1. when the entire smoke control system is being tested.

**7.3.1.3. Records**

1) A written record shall be kept of all tests and corrective measures required by Subsection 7.3.2., and such record shall be retained in conformance with Article 2.2.1.2. of Division C.

**7.3.2. Smoke Control Equipment****7.3.2.1. Central Alarm and Control Facility**

1) If applicable, switches at the central alarm and control facility shall be tested at intervals conforming to Article 7.2.1.1. to ensure that

- a) *closures* to vent openings in vertical service spaces, elevator hoistways, smoke shafts, stairshafts and outdoors in vestibules and below-grade *floor areas* will operate as designed,
- b) pressurization, exhaust, and supply air fans for vestibules, elevator hoistways, stairshafts, and *floor areas*, including refuge areas, will operate as designed,
- c) dampers in air-handling systems that serve more than 2 storeys will close automatically and remain closed,
- d) dampers in return air and exhaust ducts will operate as designed,
- e) *closures* in openings in the walls and roofs of the central core will close automatically and remain closed, and
- f) doors to vestibules, if normally held open, will close automatically and remain closed.

2) A light or other indicator at the control panel will be deemed sufficient indication that the equipment functioned as intended except that at least once in every three year period, all equipment shall be confirmed by actual observation. (See Appendix A.)

**7.3.2.2. Pressurization**

1) Pressurized vestibules, elevator hoistways and stairshafts, core areas, and areas of refuge shall be tested using pressure sensors or by tracer smoke

- a) at not more than 2 year intervals, and
- b) after any alterations to the *building* that may affect pressurization or air movement contrary to the original design element.

**Section 7.4. Objectives and Functional Statements****7.4.1. Objectives and Functional Statements****7.4.1.1. Attribution to Acceptable Solutions**

1) For the purposes of compliance with this Code as required in Clause 1.2.1.1.(1)(b) of Division A, the objectives and functional statements attributed to the acceptable solutions in this Part shall be the objectives and functional statements listed in Table 7.4.1.1. (See A-1.1.2.1.(1) in Appendix A.)

**Table 7.4.1.1.**  
**Objectives and Functional Statements Attributed to the Acceptable Solutions in Part 7**  
 Forming Part of Sentence 7.4.1.1.(1)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>7.1.1.2. Testing Fire Emergency Systems</b>	
(2)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
(3)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
<b>7.1.1.4. Maintenance of Fire Emergency Systems</b>	
(2)	[F12-OP1.2]
	[F12-OS1.2,OS1.5]
(3)	[F12-OP1.2]
	[F12-OS1.2]
(4)	[F12-OP1.2]
	[F12-OS1.2]
(5)	[F82-OP1.2]
	[F82-OP3.1]
	[F82-OS1.2,OS1.5]
(6)	[F12-OS1.2]
	[F12-OP1.2]
<b>7.2.1.1. Intervals between Tests</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
<b>7.2.2.1. Testing Elevators</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
(2)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
(3)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
(4)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
(5)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
<b>7.2.3.1. Closures</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]

Copyright © NRC 1941 - 2019 World Rights Reserved © CNRC 1941-2019 Droits réservés pour tous pays

Table 7.4.1.1. (Continued)

Acceptable Solutions	Objectives and Functional Statements <sup>(1)</sup>
<b>7.2.3.2. Elevator Recall</b>	
(1)	[F82-OS1.2]
<b>7.2.3.3. Air-Handling System Controls</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
<b>7.2.4.1. Fan Controls</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
<b>7.2.4.2. Hold-Open Devices</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
<b>7.3.1.2. Doors in Means of Egress</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
<b>7.3.1.3. Records</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
<b>7.3.2.1. Central Alarm and Control Facility</b>	
(1)	[F82-OP1.2]
	[F82-OS1.2,OS1.5]
<b>7.3.2.2. Pressurization</b>	
(1)	[F82-OS1.2,OS1.5]

**Notes to Table 7.4.1.1.:**

(1) See Parts 2 and 3 of Division A.

# Appendix A

## Explanatory Material

### **A-1.1.2.1.(1) Objectives and Functional Statements Attributed to Acceptable**

**Solutions.** The objectives and functional statements attributed to each Code provision are shown in tables at the end of each Part in Division B.

Many provisions in Division B serve as modifiers of or pointers to other provisions or serve other clarification or explanatory purposes. In most cases, no objectives and functional statements have been attributed to such provisions, which therefore do not appear in the above-mentioned tables.

For provisions that serve as modifiers of or pointers to other referenced provisions and that do not have any objectives and functional statements attributed to them, the objectives and functional statements that should be used are those attributed to the provisions they reference.

**A-1.3.1.2.(1)** Where documents are referenced in the Appendices of this Code, they shall be the editions designated in Table A-1.3.1.2.(1).

**Table A-1.3.1.2.(1)**  
**Documents Referenced in the Appendices of the Alberta Fire Code 2006**

Issuing Agency	Document Number	Title of Document	Code Reference
ACGIH	25th Edition	Industrial Ventilation: A Manual of Recommended Practice	A-3.2.7.3.(1)(b)
API	2000-1998	Venting Atmospheric and Low-Pressure Storage Tanks: Nonrefrigerated and Refrigerated	A-4.3.12.8.(1)
API	RP 2003-1998	Protection Against Ignitions Arising out of Static, Lightning and Stray Currents	A-4.7.4.5.
API	2009-2002	Safe Welding and Cutting Practices in Refineries, Gasoline Plants and Petrochemical Plants	A-5.2.3.4.(1)(b)
API	2015-2001	Safe Entry and Cleaning of Petroleum Storage Tanks	A-4.3.15.3.(1) A-5.2.3.4.(1)(b)
API	2201-2003	Welding or Hot Tapping on Equipment in Service	A-5.2.3.4.(1)(b)
API	2207-1998	Preparing Tank Bottoms for Hot Work	A-5.2.3.4.(1)(b)
ASTM	D 5-05	Penetration of Bituminous Materials	A-4.1.3.1.
ASTM	D 3278-96e1	Flash Point of Liquids by Small Scale Closed-Cup Apparatus	A-4.1.3.1.
CGA	CAN/CGA-B149.5	Installation Code for Propane Fuel Systems and Tanks on Highway Vehicles	A-2.4.4.5.(1)
CGA	CGA P-1 (2000)	Safe Handling of Compressed Gases in Containers	A-3.1.1.4.(1)(a)
CSA	CAN/CSA-B139-04	Installation Code for Oil-Burning Equipment	A-4.1.1.1.(3)(b)
CSA	CAN/CSA-C282-05	Emergency Electrical Power Supply for Buildings	A-6.5.1.1.(2)
CSA	CAN/CSA-Z32-04	Electrical Safety and Essential Electrical Systems in Health Care Facilities	A-6.5.1.1.(2)
CSA	CAN/CSA-Z731-03	Emergency Planning for Industry	A-5.1.5.1.(5)

This Appendix is included for explanatory purposes only and does not form part of the requirements. The numbers that introduce each Appendix Note correspond to the applicable requirements in this Division.

**Table A-1.3.1.2.(1) (Continued)**

Issuing Agency	Document Number	Title of Document	Code Reference
CSA	PLUS 2203 HAZLOC-01	Hazardous Locations: A Guide for the Design, Testing, Construction, and Installation of Equipment in Explosive Atmospheres	A-4.1.4.1.(1)
EPA	EPA 530/UST-90/008	Evaluating Leak Detection Methods: Vapor-Phase Out-of-Tank Product Detectors	A-4.4.2.1.(3)
EPA	EPA 530/UST-90/009	Evaluating Leak Detection Methods: Liquid-Phase Out-of-Tank Product Detectors	A-4.4.2.1.(3)
EUB	Guide 55-2001	Storage Requirements for the Upstream Petroleum Industry	A-4.3.1.2.(1)
FM Global	Data Sheet 7-50 (2002)	Compressed Gases in Cylinders	A-3.2.8.2.(2)
FM Global	Data Sheet 7-83 (2000)	Drainage System for Flammable Liquids	A-4.1.6.1.(1)
FM Global	Data Sheet 8-8 (2001)	Distilled Spirits Storage	A-3.2.3.3.(2)
Govt. of Alberta	NRCC 34018	Alberta Building Code 1990	A-2.1.2.1.(1)
Govt. of Alberta	NRCC 48673	Alberta Building Code 2006	A-1.1.1.1.(1) <sup>(1)</sup> A-1.4.1.2.(1) <sup>(1)</sup> A-2.1.3.1.(1) A-2.1.3.3.(3) A-2.1.3.3.(4) A-2.1.3.4.(1) A-2.1.3.6.(1) A-2.7.1.3.(1) A-2.7.1.4.(2) A-2.7.3.1.(1) A-2.9.3.5.(1) A-3.2.2.3.(5) A-3.2.7.9.(1) A-3.2.7.12.(3) A-3.2.9.2.(7) A-4.1.7.1.(1) A-4.2.7.5.(2) A-4.3.12.1.(2) A-5.6.1.6. A-5.6.1.11.(1) A-6.1.1.2.(1)
Govt. of Alberta		Municipal Government Act	A-5.7.1.
Govt. of Alberta		Safety Codes Act	A-4.1.6.2.(2) A-4.6.1.1.(2) A-4.10.3.3.(1) A-5.1.2.1.(1)
HC	2004	Workplace Hazardous Materials Information System (WHMIS) of the Hazardous Products Act	A-3.2.7.6.(2) A-3.2.7.13.(1)
HC	2001	Consumer Chemicals and Containers Regulations of the Hazardous Products Act	A-3.2.5.2.(1)
HC	1987	Controlled Products Regulations of the Hazardous Products Act	A-3.2.5.2.(1)
NFPA	2003	Fire Protection Handbook, Nineteenth Edition	A-2.4.1.3.(1)
NFPA	10-2002	Portable Fire Extinguishers	A-2.1.5.1.(2) A-4.7.5.1.(1)
NFPA	13-2002	Installation of Sprinkler Systems	A-2.1.3.6.(1) A-3.2.1.1.(1)(a) A-3.2.2.4.(3) A-3.2.3.3.(2)
NFPA	15-2001	Water Spray Fixed Systems for Fire Protection	A-4.1.6.1.(1)

**Table A-1.3.1.2.(1) (Continued)**

Issuing Agency	Document Number	Title of Document	Code Reference
NFPA	30-2003	Flammable and Combustible Liquids Code	A-4.1.1.1.(2) A-4.1.3.1. A-4.1.4.1.(1) A-4.1.6.1.(1) A-4.2.7.6.(1)
NFPA	30B-2002	Manufacture and Storage of Aerosol Products	A-3.2.5.2.(1)
NFPA	36-2004	Solvent Extraction Plants	A-4.1.1.1.(2)
NFPA	55-2005	Storage, Use, and Handling of Compressed Gasses and Cryogenic Fluids in Portable and Stationary Containers, Cylinders, and Tanks	A-3.1.1.4.
NFPA	61-2002	Prevention of Fires and Dust Explosions in Agricultural and Food Products Facilities	A-5.3.1.3.(2)
NFPA	80A-2001	Protection of Buildings from Exterior Fire Exposures	A-2.4.1.1.(6)
NFPA	91-2004	Exhaust Systems for Air Conveying of Vapors, Gases, Mists, and Noncombustible Particulate Solids	A-5.3.1.3.(2)
NFPA	120-2004	Fire Prevention and Control in Coal Mines	A-5.3.1.3.(2)
NFPA	326-2005	Safeguarding of Tanks and Containers for Entry, Cleaning, or Repair	A-4.3.15.3.(1) A-5.6.1.13.(4)
NFPA	484-2006	Combustible Metals, Metal Powders, and Metal Dusts	A-5.3.1.3.(2)
NFPA	497-2004	Classification of Flammable Liquids, Gases, or Vapors and of Hazardous (Classified) Locations for Electrical Installations in Chemical Process Areas	A-4.1.4.1.(1)
NFPA	654-2006	Prevention of Fire and Dust Explosions from the Manufacturing, Processing, and Handling of Combustible Particulate Solids	A-5.3.1.3.(2)
NFPA	655-2001	Prevention of Sulfur Fires and Explosions	A-5.3.1.3.(2)
NFPA	664-2002	Prevention of Fires and Explosions in Wood Processing and Woodworking Facilities	A-5.3.1.3.(2)
NFPA	705-2003	Field Flame Test for Textiles and Films	A-2.3.2.2.(1)
NFPA	1142-2001	Water Supplies for Suburban and Rural Firefighting	A-3.3.2.16.(1)(b)
NRCan	1985	Explosives Act and its Regulations	A-3.2.9.1.(1)
OCIMF	1991	Guide to Purchasing, Manufacturing and Testing of Loading and Discharge Hoses for Offshore Moorings, 4th Edition	A-4.8.8.1.(1)(a)
RMA	IP-2-2003	Hose Handbook, Seventh Edition	A-4.8.8.1.(1)(a)
SFPE	3rd Edition	Handbook of Fire Protection Engineering	A-4.1.6.1.(1)
TC		Transportation of Dangerous Goods Act and its Regulations (TDGR)	A-3.2.7.6.(2) A-4.1.2.1. A-4.2.2.3.(2)
TC		Oil Pollution Prevention Regulations of the Canada Shipping Act	A-4.8.8.1.(1)(a)
ULC	CAN/ULC-S109-03	Flame Tests of Flame-Resistant Fabrics and Films	A-2.3.1.3.(2)
ULC	CAN/ULC-S553-02	Installation of Smoke-Alarms	A-2.1.3.3.(3)
ULC	CAN/ULC-S603.1-03	External Corrosion Protection Systems for Steel Underground Tanks for Flammable and Combustible Liquids	A-4.3.9.3.(2)
ULC	ULC-S603(A)-2001	Refurbishing of Steel Underground Tanks for Flammable and Combustible Liquids	A-4.3.8.3.(2)
ULC	ULC-S615(A)-2002	Refurbishing of Reinforced Plastic Underground Tanks for Petroleum Fuels	A-4.3.8.3.(2)
ULC	ULC/ORD-C58.9-1997	Secondary Containment Liners for Underground and Aboveground Flammable and Combustible Liquid Tanks	A-4.3.8.1.(6)(b)
ULC	ULC/ORD C58.12-1992	Leak Detection Devices for Underground Flammable Liquid Storage Tanks	A-4.3.8.1.(6)(e)

Table A-1.3.1.2.(1) (Continued)

Issuing Agency	Document Number	Title of Document	Code Reference
ULC	ULC/ORD-C107.12-1992	Line Leak Detection Devices for Flammable Liquid Piping	A-4.3.8.1.(6)(f)
ULC	ULC/ORD-C410A-1994	Absorbents for Flammable and Combustible Liquids	A-4.1.6.3.(3)(b)
ULC	ULC/ORD-C971-2005	Nonmetallic Underground Piping for Flammable and Combustible Liquids	A-4.3.8.1.(6)(b)

**Notes to Table A-1.3.1.2.(1):**

(1) Code reference is in Division A.

**A-2.1.2.1.(1)** The Alberta Building Code 1990 introduced changes to the method of determining building height. Application of the current method to existing buildings for the purposes of this Code could result in certain buildings being reclassified as higher buildings. For this reason, the Alberta Fire Code 2006 suggests that building height is that which was established by the building code that was applicable at the time of construction in the case of original construction, or at the time of alteration if additional storeys have been added to the building.

**A-2.1.2.2.(1)** Arena-type buildings are often used for events such as community dances, rallies and trade shows. These events may increase the occupant and fuel loads beyond that for which the space was designed. To ensure safety during such events, additional egress facilities may be required to compensate for the additional occupant load and, in some cases, additional fire suppression measures may be required to compensate for the increased fuel load.

Large public corridors in mercantile occupancies are also used on a temporary basis for community activities, merchandising and for special displays. In these cases, additional egress facilities and fire suppression may be needed, depending on the increase in hazard.

**A-2.1.3.1.(1)** The Alberta Building Code 2006 is most often applied to existing buildings when an owner wishes to rehabilitate a building, change its use, or build an addition; or when an enforcement authority decrees that a building, or a class of buildings, be altered for reasons of public safety. It is not intended that either the Alberta Building Code 2006 or the Alberta Fire Code 2006 be used to enforce the retrospective application of new requirements in the Alberta Building Code 2006 to existing buildings. Although the Alberta Fire Code 2006 could be interpreted to require the installation of fire alarm, standpipe and hose and automatic sprinkler systems in an existing building for which there were no requirements before the Alberta Building Code 2006 was issued, it is the intent that the Alberta Fire Code 2006 not be applied in this manner to these buildings.

It is usually difficult to change structural features of an existing building when undertaking alterations or additions, but the installation of "active" fire protection systems, such as alarms, sprinklers and standpipes, in existing buildings may be possible. These systems may be considered as contributing to an adequate degree of life safety in cases where the structural features of a building do not conform to the Alberta Building Code 2006.

Sentence 2.1.3.1.(1) is intended to address the installation of fire alarm, sprinkler and standpipe systems in existing buildings presently not so equipped, and in existing buildings that do not provide an acceptable level of safety to meet the current installation standards specified in the Alberta Building Code 2006. It is not intended that existing fire protection systems that provide an acceptable level of life safety be upgraded with each new edition of the Alberta Building Code or in conjunction with the inclusion of new requirements not in force at the time that a building was constructed. The authority having jurisdiction is expected to use discretion in enforcing this requirement. The authority having jurisdiction may accept alternatives to strict compliance with the Alberta Building Code 2006 as provided for in Clause 1.2.1.1.(1)(b) of Division A and its Appendix Note. (See also Appendix Note A-1.1.1.1.(1) of Division A and Appendix Note A-1.1.1.1.(1) of Division A of the Alberta Building Code 2006.)

**A-2.1.3.3.(3)** Part 3 and Part 9 of Division B of the Alberta Building Code 2006 and CAN/ULC-S553, "Installation of Smoke-Alarms," contain additional information for locating, installing and interconnecting smoke alarms in dwelling units.

**A-2.1.3.3.(4)** It is not the intent of this Sentence to restrict the use of battery-operated smoke alarms that are installed in addition to required smoke alarms. The requirements ensure that properties constructed after July 5, 1977 are protected by smoke alarms, with permanent connections to an electrical circuit, installed in accordance with the Alberta Building Code.

**A-2.1.3.4.(1)** Editions of the Alberta Building Code prior to 2006 permitted the use of combustible sprinkler piping for wet pipe sprinkler systems in residential and light-hazard occupancies on condition that the piping was protected from exposure to a fire in the space beneath. Article 2.1.3.4. requires that the necessary protection of the piping be maintained so that the performance of the sprinkler system will not be compromised in the event of fire. Some of the conditions included restricting use of the piping to light-hazard occupancies, the piping must be a wet system, use of steel suspension grids and correct tile weight, and integrity of the fire protection covering.

**A-2.1.3.5.(3)(c)** Concern over the impact of halons on the environment is resulting in changes to the regulations of various agencies that affect their use and release to the atmosphere and their reduction, recycling and eventual phase-out as fire extinguishment agents. Standards referenced in the Alberta Fire Code 2006 may not reflect the current status of requirements developed by certain agencies regarding the installation, use and testing of fire suppression systems that employ halons.

**A-2.1.3.6.(1)** This provision is intended to direct the Code user primarily to Subsection 3.2.5. of Division B of the Alberta Building Code 2006, which specifies the appropriate standard for the design and installation of automatic sprinkler systems, i.e. NFPA 13, and provides several exceptions and supplementary requirements. On occasion, other provisions in the Alberta Building Code 2006 may also apply. However, where a specific hazard is not addressed by the Alberta Building Code 2006, such as highly piled storage or the storage of flammable and combustible liquids or rubber tires, the Alberta Fire Code 2006 directly references the applicable NFPA standards that contain design criteria for the sprinkler system required.

**A-2.1.3.7.** This Code requires the installation of several fire safety devices for the control of fire hazards. The inspection, maintenance and testing requirements for many of these devices are referenced in the applicable Articles. However, several Sections of the Code do not include such references for certain fire safety devices, examples of which include, but are not limited to:

- ventilation system interlocks and associated audible alarms for rooms or enclosed spaces containing flammable and combustible liquids (e.g. Subsection 4.1.7.)
- vapour detection alarm systems for rooms or enclosed spaces containing flammable and combustible liquids (e.g. Subsection 4.1.7.)
- bonding and grounding systems for flammable and combustible liquid handling processes (e.g. Subsection 4.1.8.)
- fill pipe backflow prevention systems for aboveground storage tanks for flammable and combustible liquids (e.g. Subsection 4.3.6.)
- leak detection monitoring devices for aboveground storage tanks for flammable and combustible liquids (e.g. Section 4.4.).

**A-2.1.5.1.(2)** It is not the intent of this Article to restrict the use of pump tank extinguishers selected and installed in accordance with NFPA 10, "Portable Fire Extinguishers." This type of extinguisher is used extensively throughout the province in apartment buildings, welding shops, schools, hospitals and offices and is considered to be effective in this type of application. The extinguisher is relatively easy to inspect, refill and maintain. Its continued use, when selected, installed and maintained in accordance with NFPA 10 is considered acceptable.

**A-2.1.5.1.(3)** Following are examples of measures deemed to minimize the risk of injury for portable extinguisher operators: affixing prominent cautionary labels on portable extinguishers and warning signs at entry points to confined spaces, enabling remote applications such as by providing special nozzles, installing special ventilation systems, providing breathing apparatus and other personal protective equipment, and adequately training personnel.

**A-2.3.1.3.(2)** Some authorities having jurisdiction have incorrectly interpreted this Sentence to mean that natural Christmas trees are not allowed in any Group A or Group B occupancy. The intent of this Sentence is to ensure that festive decorations, which include Christmas trees, are sufficiently "flame-resistant" so as not to constitute a fire hazard in occupancies where large numbers of persons gather or are incapacitated.

Festive decorations, including Christmas trees (natural or artificial), that are to be used in any Group A or Group B occupancy are to be resistant to flame either inherently or by the application of approved flame-retardant materials that comply with CAN/ULC-S109, "Flame Tests of Flame-Resistant Fabrics and Films." Natural Christmas trees are considered to be inherently "flame-resistant" if freshly cut and the base is kept in fresh water. A freshly cut tree is one that has been harvested within fourteen days. The tree must be removed from a Group A or Group B occupancy within the fourteen-day time period. Fresh Christmas trees of all common varieties present no significant fire hazard. A fresh tree is one that has not lost an appreciable amount of its natural moisture. However, when dry, Christmas trees are among the most flammable items in a home. Once ignited, the speed and intensity of burning is extreme. A dry tree will appear to explode and be totally consumed (except for the trunk) in a matter of seconds.

**A-2.3.2.2.(1)** The small scale match flame test in NFPA 705, "Field Flame Test for Textiles and Films," is a relatively simple test that can be used to assess the condition of flame retardant treatments on samples from fabrics that have been in use for a while. It is not intended that NFPA 705 be used as the primary standard for the application of fire retardant treatments.

**A-2.4.1.1.(1)** The accumulation of a certain amount of combustible waste material in and around buildings may be necessary for the day-to-day operation of many industrial or commercial premises. If basic measures of good housekeeping are observed, the presence of these combustibles may not constitute an "undue fire hazard."

**A-2.4.1.1.(2)** The defined term "service rooms" includes boiler rooms, furnace rooms, incinerator rooms, garbage rooms, janitors' closets and rooms to accommodate air-conditioning or heating appliances, pumps, compressors and electrical services. The intent of Sentence 2.4.1.1.(2) is to discourage the use of these rooms for the storage of miscellaneous combustible materials. If storage space is needed in a building, a room that does not contain building service equipment should be provided. Even in garbage rooms, combustible materials should not be allowed to accumulate. When the garbage is periodically cleared from the room, the room should be empty, except for the garbage container itself.

**A-2.4.1.1.(6)** Measures such as those described in NFPA 80A, "Protection of Buildings from Exterior Fire Exposures," must be taken to ensure that buildings are protected from fires in outdoor receptacles containing combustible materials.

**A-2.4.1.3.(1)** Generally, self-heating and self-ignition are most commonly encountered in organic materials, such as animal and vegetable solids and oils. A rag saturated with linseed oil, for example, is susceptible to self-heating and self-ignition when crumpled and put in a waste container.

Certain inorganic materials, such as metal powders, may also self-heat and self-ignite under isolated conditions. Materials such as motor or lubricating oils are not subject to self-heating and self-ignition.

Table A.10 of the NFPA "Fire Protection Handbook" provides a list of materials that are susceptible to spontaneous heating and ignition.

**A-2.4.1.3.(9)** Containers for combustible recyclable material should not be located in areas where there is the likelihood of sources of ignition being introduced to the contents. Lunch rooms, coffee rooms and staff lounges are building areas where persons congregate and, in some cases, are permitted to smoke. This creates a potential hazard that can be reduced by prohibiting the containers. If containers are necessary in these areas, they should be noncombustible with suitable covers or lids that would contain the outbreak of fire.

**A-2.4.4.3.(1)** This Sentence applies to the safe storage of gasoline powered maintenance equipment, such as lawnmowers, snow blowers, etc., when the equipment is intended to be stored within a building. It is the intent of this Sentence to ensure that where such equipment is stored within a building, that the room or area is separated by a fire separation having a fire-resistance rating of 1.5 h or that it is stored in a detached building such as a garage or shed.

**A-2.4.4.5.(1)** Propane fuelled vehicles conforming to CAN/CGA-B149.5, "Installation Code for Propane Fuelled Systems and Tanks on Highway Vehicles," will have a green and white window label affixed to the vehicle. A similar replacement label may also be affixed to vehicles that do not conform to the above standard because of the loss of the previous window label due to glass replacement, etc. These replacement window labels will not include the B149.5 parking label and, therefore will be prohibited from parking in enclosed public facilities.

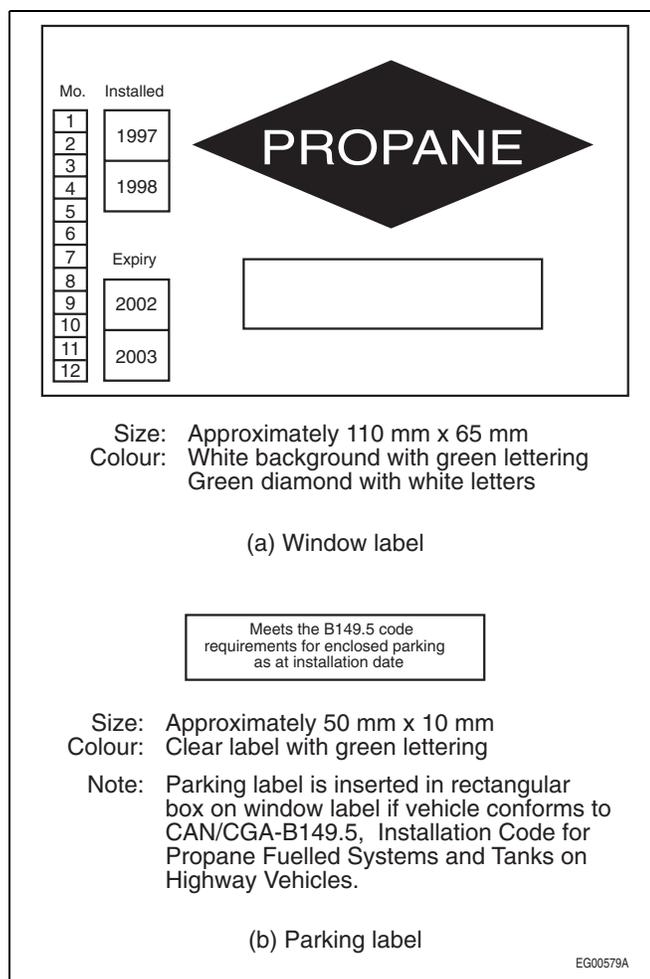


Figure A-2.4.4.5.(1)  
Propane fuelled vehicle window and parking labels

**A-2.4.5.1.(1)** Measures that can be considered to limit fire spread include sufficient clear space between the fire and adjacent buildings, combustibles and woodlands, the size and height of the pile of combustibles to be burned, prevailing meteorological conditions, fire control measures such as hoses and water tanks and, if a receptacle is to be used, the design of the receptacle. In some cases, a permit or licence may be required for open air fires.

**A-2.4.6.1.(1)** Vacant buildings frequently become the target of vandalism and arson. They should be locked, and accessible windows and doors should be barricaded to prevent unauthorized entry. However, fire department access to the interior of the building in the event of a fire should not be made unduly difficult.

**A-2.5.1.3.(1)** The authority having jurisdiction may accept alternatives to the installation of a key box at buildings containing fire protection equipment, elevator control, or door access, as outlined in Sentence 2.5.1.3.(2), where measures have been taken to provide entry to the building on a 24 h basis. Buildings that have on-site security personnel, on-site staff, or alternative access provisions acceptable to the authority having jurisdiction meet the requirements of this Sentence.

**A-2.5.1.5.(2)** Signs that would meet the intent of this Sentence are as follows:

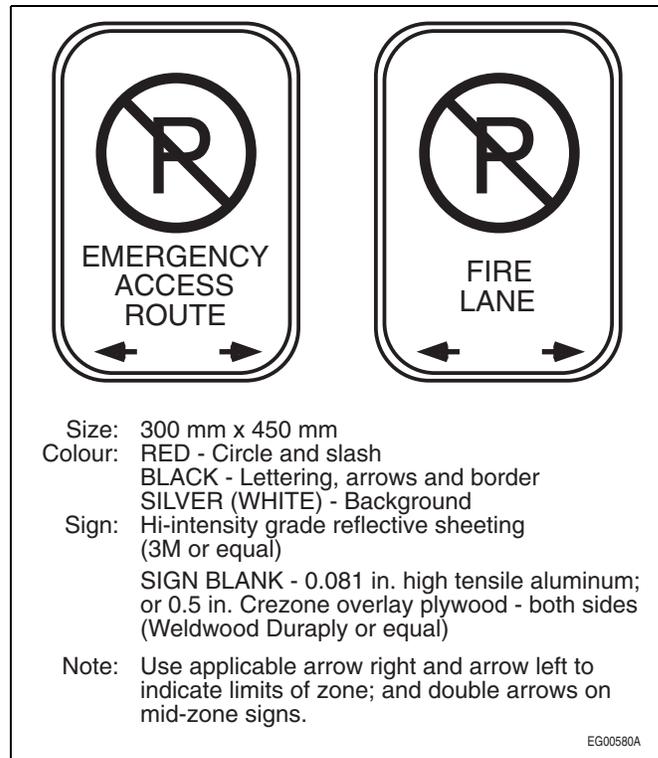


Figure A-2.5.1.5.(2)  
 “No Parking” signs

**A-2.6.1.4.(1)** External inspection of enclosed chimneys and surrounding construction may require the installation of one or more access openings in the enclosure surrounding the chimney. The presence of scorched or charred adjacent combustible construction will indicate the need for further investigation of the cause of the overheating.

Internal inspection of chimneys can be accomplished by lowering a light from the top, insertion of a light at the bottom or at intermediate locations, together with the use of one or more mirrors.

During inspection of a chimney connected to an operating appliance, the presence of dense smoke at the outlet will indicate improper operation of the appliance, incorrect sizing of the chimney or that unsuitable fuels are being used. These factors must be promptly corrected to reduce the accumulation of combustible deposits on the chimney and flue pipe walls.

**A-2.6.1.4.(2)** The presence in a chimney of deposits of soot or creosote in excess of 3 mm thick will indicate the need for immediate cleaning, possible modification of burning procedures, and more frequent inspections.

**A-2.6.1.4.(3)(a)** Structural deficiencies are deviations from required construction, such as the absence of a liner or inadequate design of supports or ties. Instances of decay are cracking, settling, crumbling mortar, distortion, advanced corrosion, separation of sections, or loose or broken supports.

**A-2.6.1.9.(3)** Depending on the amount of cooking equipment usage, the entire exhaust system, including grease extractors, should be inspected at intervals not greater than 7 days to determine if grease or other residues have been deposited within. When grease or other residues are in evidence as deposits within the hood, grease removal devices, or ducts, the system should be cleaned. In general, exhaust systems should be cleaned at intervals not greater than 12 months, but in the case of deep fat cooking, char broiling or similar cooking operations, the systems should be cleaned at intervals not greater than 3 months.

**A-2.7.1.3.(1)** The Alberta Fire Code 2006 uses three criteria to determine the maximum number of persons permitted in a building or floor area where the authority having jurisdiction posts an occupant load.

The maximum occupant load of a building is determined by

- (a) the calculation of the exit capacity of the means of egress,

- (b) the design load calculated by using Table 3.1.17.1. of Division B of the Alberta Building Code 2006, or
- (c) the posting of an occupant load by the building authority having jurisdiction in conformance with the Alberta Building Code.

Table 3.1.17.1. of Division B of the Alberta Building Code 2006 is intended to allow a building designer to calculate a minimum occupant load for the purposes of designing certain building features, such as means of egress and fire alarm systems. The designer may choose to design to accommodate more or fewer persons, in which case the actual design occupant load must be posted in a conspicuous location. In this case, the building authority having jurisdiction will require that a permanent sign indicating the maximum number of persons permitted be posted in the building or floor area.

Table 3.1.17.1. should not be used as the only regulating factor in establishing the maximum occupant load for the building. The initial procedure should include a calculation of the exit capacity of the means of egress system for the building. The result of these calculations may not be consistent with values obtained using Table 3.1.17.1. but will confirm if the capacity of the existing system is adequate for the occupant load.

Area per person in Table 3.1.17.1. is calculated based upon the area of a room or space excluding structural or other permanent features, such as walls, columns or ramps, but includes non-fixed items, such as tables, chairs, millwork and movable partitions. In some circumstances, different design factors in Table 3.1.17.1. may apply to the same floor space. For example, a floor space may have a designated standing space as well as a designated table and chair space. Each area would be calculated for the maximum number of persons permitted.

It should also be noted that Article 2.1.3.1. of this Code requires fire protection systems to be installed in conformance with the Alberta Building Code 2006. This means that if the posted occupant load exceeds the limits for which a protection system is required by the Alberta Building Code 2006, the system must be installed in the building.

**A-2.7.1.4.(2)** Sentence 3.1.17.1.(2) of Division B of the Alberta Building Code 2006 requires that the occupant load used in the design of a floor area be posted if it differs from that determined by Table 3.1.17.1.

**A-2.7.3.1.(1)** Subsections 3.2.7. and 3.4.5. of Division B of the Alberta Building Code 2006 describe the requirements for the placement of exit signs and for emergency and non-emergency lighting.

**A-2.8.1.2.(1)** Adequately trained supervisory staff can be of great value in directing people to move in an orderly fashion in the event of a fire and in carrying out appropriate fire control measures until the public fire department arrives. These measures are, as described in the fire safety plan, developed in cooperation with the fire department. The supervisory staff referred to in this Section are assigned their responsibilities by the building owner, unless the public fire department is prepared to take on these responsibilities. Except in hospitals and nursing homes, it is not intended that supervisory staff should be in the building on a continuous basis, but that they should be available to fulfill their obligations as described in the fire safety plan on notification of a fire emergency. In hospitals and nursing homes, however, staff must be in the building at all times to assist occupants who are not capable of caring for themselves in an emergency.

**A-2.8.2.1.(1)** The fire safety plan may provide important information to the fire department for use in the preparation of plans for firefighting procedures in specific buildings. This is especially true for buildings where flammable or combustible liquids or other dangerous goods are stored.

The development of the fire safety plan for large retail occupancies, especially the bulk merchandising stores, should take into consideration various unique risk factors prevalent in these stores. A bulk merchandising store is characterized as a retail store in which the sales area includes the storage of material usually located in piles, on pallets or on racks up to 3.7 metres in storage height. These mercantile occupancies tend to store and display in the sales area, large quantities of products ranging from compressed gas cylinders, oxidizers, flammable liquids, combustible liquids, foamed plastics, and combustible materials.

Documented evidence of fires in these types of stores has shown that smoke obscuration occurs within 7.5 to 12 min from the inception of a fire. Prompt response by occupants in a fire emergency is therefore critical. Human behaviour studies have shown that occupants in a retail environment tend to delay evacuation for various reasons such as unfamiliarity with exits or a lack of visibility of exits, reluctance to leave check-out lines, and uncertainty about the events unfolding.

The training and education of staff are crucial elements in clearly notifying and instructing occupants during an emergency. A reliable public address system should be an integral part of this plan. The fire safety plan should be commensurate with the known risks and address the concerns identified above.

**A-2.8.2.1.(1)(a)(i)** These procedures should also include training authorized personnel to silence fire alarm and alert signals under specified conditions. If special keys or devices are required to operate the alarm system, they should be readily available to supervisory staff on duty.

**A-2.8.2.1.(1)(a)(iv)** Some occupants of a building may require special assistance during evacuation because cognitive or physical limitations make them unable to proceed independently to a place of safety. Fire safety for these persons will depend to a large extent on preplanning and on their awareness of the fire protection measures incorporated into the building. In some buildings, it may be appropriate to advise such occupants of these provisions by posted notices, handouts or other suitable means. In certain residential occupancies, such as hotels or motels, staff should be aware of rooms occupied by persons requiring special assistance during evacuation and should inform the responding fire department.

**A-2.8.2.7.(1)** The following information, where applicable, may be used in establishing emergency procedures to satisfy the requirements of this Sentence.

- (a) Alert everyone in the suite should fire occur in your suite.
- (b) CALL THE FIRE DEPARTMENT at \_\_\_\_\_ or 911, and give the complete address and suite number, if possible.
- (c) Leave your suite; CLOSE BUT DO NOT LOCK THE DOOR.
- (d) Sound the fire alarm in the corridor.
- (e) If the fire is in the early stage, use the building's firefighting equipment.
- (f) Leave your floor via the stairway AND DO NOT USE AN ELEVATOR.
- (g) Walk, DO NOT RUN, to the lobby.
- (h) Once you have left the fire area, DO NOT RETURN TO IT.
- (i) Meet the fire department in the main lobby, unlock the front door and inform them of the location of the fire.

Further information and assistance may be obtained from the fire department or authority having jurisdiction.

**A-2.8.2.8.(2)** Interruption of normal automatic operation of the fire alarm system for periodic testing purposes constitutes a "temporary shutdown". Appropriate alternative measures for informing building occupants and the fire department of a fire during a shutdown of a fire alarm system should be worked out in cooperation with the local fire department. The alternative measures decided upon should be recorded as part of the building fire safety plan.

**A-2.8.3.1.(1)** A fire safety plan is of little value if it is not reviewed periodically so that all supervisory staff remain familiar with their responsibilities. A fire drill, then, is at least a review of the fire safety plan by supervisory staff. The extent to which non-supervisory staff participate in a fire drill should be worked out in cooperation with the fire department. The decision as to whether all occupants should leave the building during a fire drill should be based on the nature of the occupancy.

It may be necessary to hold additional fire drills outside normal working hours for the benefit of employees on afternoon or night shifts, who should be as familiar with fire drill procedures as those who work during the day. If full scale fire drills are not possible during non-regular working hours, arrangements should be made so that night-shift supervisory staff can participate in fire drills conducted during the daytime.

**A-2.9.3.2.(2)** It is not the intent of this Sentence to require that all vegetation be removed before the placement of temporary circus tents, jump rides, beer tents, etc. The requirement ensures that such structures are not subject to the hazards associated with ground cover fires. Precautions such as wetting of the area and grass mowing should be considered if conditions are not deemed appropriate.

**A-2.9.3.5.(1)** The type of fire alarm and emergency communication system anticipated for tents and air-supported structures will vary according to the hazard and the number of occupants. If a tent or air-supported structure is to be permanent, a fire alarm and emergency communication system, as defined in the Alberta Building Code 2006, may be required. If such structures are to be temporary, however, a somewhat less sophisticated system is anticipated, depending on local conditions.

**A-2.14.1.1.(3)(a)** It is the owner's responsibility to appoint and train a fire crew, to appoint a person to be responsible for fire prevention, and to ensure camp occupants are familiar with fire hazards. These requirements apply for all camps; however, they become more important as the size of the camp increases.

It is not the intent of the Alberta Fire Code 2006 that the fire crew be equipped and trained to the level expected of a municipal volunteer or paid fire department. It is expected the crew will be knowledgeable of the site and building layout and fire safety systems, and capable of performing basic firefighting duties with the fire suppression equipment provided.

In assessing a camp site it is the responsibility of the authority having jurisdiction to ensure the owner has complied with the above.

**A-2.16.** A secondary suite is only permitted where approved by the local authority, in accordance with municipal land use bylaws.

**A-2.16.2.10.(1)** To minimize the passage of smoke, it is expected that all gypsum board joints are properly finished, i.e. taped and mudded. It is also expected that all service penetrations, i.e. pipes, cables and ducts, are tightly fitted or sealed with an appropriate gypsum board finishing compound.

**A-3.1.1.1.(1)** Part 3 applies to the short- or long-term storage of products, whether raw or waste materials, goods in process, or finished goods.

This Part does not deal with products or materials that are directly supplied to appliances, equipment or apparatus through piping, hose, ducts, etc. For example, the gas cylinders that are mounted on propane barbecues are not covered by Part 3: they are considered to be "in use" as opposed to "in storage" and are not intended to be regulated by the storage requirements stated in the Alberta Fire Code 2006.

**A-3.1.1.4.** Part 3 deals mainly with the storage of cylinders of Class 2 gases. It is expected that gas installations that are not covered in the Code will conform to good engineering practice, such as those in NFPA 55, "Storage, Use, and Handling of Compressed Gases and Cryogenic Fluids in Portable and Stationary Containers, Cylinders, and Tanks."

**A-3.1.1.4.(1)(a)** For purposes of this exemption, a distributor is deemed to be a commercial enterprise regularly handling or storing more than 1500 kg of Class 2 gases for purposes of resale. Such distributors are expected to follow the same good engineering practices as their suppliers. The document CGA P-1, "Safe Handling of Compressed Gases in Containers," published by the Compressed Gas Association, represents good engineering practice for the handling of Class 2 gases.

**A-3.1.2.3.(2)** The International Maritime Organization, the International Civil Aviation Organization, the United Nations and Transport Canada are examples of regulatory authorities that may establish standards for the design and construction of packages and containers for dangerous goods.

**A-3.1.2.4.(2)(a)** Methods of preventing valve damage include the use of valve caps, storage in crates (for small cylinders) and the provision of steel rings or protective handles. Certain high pressure cylinders are required by other legislation to be equipped with valve caps.

**A-3.1.2.5.(1)** Reactive substances may include various classes of unstable or reactive dangerous goods, such as Class 4 flammable solids, Class 5 oxidizing substances or unstable Class 2 gases.

When containers of highly reactive oxidizers become damaged or are exposed to excessive heat, moisture or contamination (e.g. sawdust, petroleum products, or other chemicals), a very violent fire or explosion can result. In some cases, depending on the quantity and nature of the oxidizing agent, normal firefighting measures (e.g. sprinklers, fire hose and extinguishers) are ineffective due to the self-yielding of oxygen by the oxidizing agent.

In general, it is unsafe to store highly reactive oxidizers close to liquids with low flash points, combustible products or chemically incompatible products. Quantities of oxidizers should therefore be limited and the storage area should be constructed of noncombustible materials, should be kept cool and ventilated, and should not impede egress.

The following classes of oxidizing substances are noted for their ability to supply oxygen (this list is not meant to be all inclusive): organic and inorganic peroxides; pool chemicals (e.g. calcium hypochlorite and sodium dichloroisocyanurate); oxides; permanganates; perrhenates; chlorates; perchlorates; persulfates; organic and inorganic nitrates; bromates; iodates; periodates; perselenates; chromates, dichromates; ozone; perborates.

**A-3.2.1.1.(1)** Section 3.2. applies to all parts of buildings, including warehousing or storage areas, manufacturing areas, shipping and receiving areas, and sales areas. It does not apply to the storage of unpackaged grain or coal. Additional requirements in Part 5 of this Code address the dust hazard associated with bulk grain or coal storage.

**A-3.2.1.1.(1)(a)** Chapter 5 of NFPA 13, "Installation of Sprinkler Systems," gives an extensive description with numerous examples of commodities for classification purposes and should be consulted. The following is a brief overview of the NFPA 13 classification of commodities:

A Class I commodity is defined as essentially noncombustible products in ordinary corrugated cartons or ordinary paper wrappings, with or without combustible pallets.

A Class II commodity is defined as Class I products in slatted wooden crates, solid wooden boxes, multiple thickness paperboard cartons or equivalent combustible packaging material, with or without combustible pallets.

A Class III commodity is defined as wood, paper, natural fiber, cloth, or Group C plastics, with or without combustible pallets. Products may contain a limited amount of Group A or B plastics.

A Class IV commodity is defined as Class I, II, or III products in corrugated cartons, containing an appreciable amount of Group A plastics or with Group A plastics packaging, with or without combustible pallets. Group B plastics and free-flowing Group A plastics are also included in this class.

Group A plastics include, but are not limited to, ABS, acrylic, butyl rubber, fiberglass reinforced polyester, natural rubber (if expanded), nitrile rubber, polycarbonate, polyester elastomer, polyethylene, polypropylene, polystyrene, polyurethane, highly plasticized PVC, and SBR.

Group B plastics include, but are not limited to, cellulose, fluoroplastics, natural rubber (not expanded), nylon, and silicone rubber.

Group C plastics include, but are not limited to, fluoroplastics, melamine, phenolic resins, rigid PVC, and urea formaldehyde.

**A-3.2.2.2.** The purpose of this Article is to provide adequate access to the interior of the storage area for firefighting and overhaul operations. Means of egress must also be provided in accordance with Section 2.7. of the Alberta Fire Code 2006. The use of dead-end aisles in storage areas should be minimized because of the potential hazard they create with respect to egress. Access aisles required in Sentence (2) include aisles to fire department access panels, or to fire protection equipment such as sprinkler control valves, fire hose stations, portable extinguishers and manual stations.

Sentences (4) to (8) prescribe requirements for main access aisles in the storage area. More than one main access aisle may be required depending on the storage configuration and alternate arrangements to a single main access aisle are permitted in Sentence (7). These requirements are in addition to the general requirement for 2.4 m aisles separating individual storage areas. The width of subsidiary aisles within individual storage areas is determined by material handling needs.

Fire department access to a storage area can be by means of doors or access panels on exterior walls, or through doors from another fire compartment in the building, provided that fire compartment in turn has adequate fire department access. The access points should be as remote from each other as possible. Where practicable, the preferred arrangement is for main aisles to terminate at exterior doors on opposite sides of the building.

Where stored products are liable to expand with the absorption of water, there exists a significant danger of collapse of the products into the aisles. It does not matter whether the products are in racks or not, nor whether the water comes from hose streams or sprinklers. Examples of such products include certain paper products and baled rags. Numerous firefighters have been killed through being crushed by falling products, or through being trapped after their escape routes have become blocked by fallen products. Special consideration should be given in these cases to rack design, aisle widths and layout to prevent such hazards or to minimize their effect.

**A-3.2.2.3.(2)** In unsprinklered buildings, a clear space is required above the storage to permit hose streams to be directed onto the top of storage.

**A-3.2.2.3.(5)** Clearance between stored products and heating equipment must also be maintained in conformance with Section 2.6. of the Alberta Fire Code 2006, which references Part 6 of Division B of the Alberta Building Code 2006 for installation requirements for heating systems. All stored combustible materials should be kept away from hot elements of heating equipment.

**A-3.2.2.4.(3)** Section 12.1.9 of NFPA 13, "Installation of Sprinkler Systems," gives sprinkler system design criteria for areas where combustible pallets are stored, based on the height, area and type of pallets.

**A-3.2.3.2.(2)** For self-contained, multi-tiered structural rack or shelf systems, the storage height should be determined as the height from the lowest floor level to the top of storage on the uppermost tier.

**A-3.2.3.3.(2)** NFPA 13, "Installation of Sprinkler Systems," does not provide sufficient information on the design of sprinkler systems in buildings used for the storage of closed containers of distilled beverage alcohol. Design criteria representing good engineering practice for such sprinkler systems are available in such documents as Data Sheet 8-8, "Distilled Spirits Storage," published by FM Global.

**A-3.2.4.2.(1)** The volume of tires in a storage area can be determined by measuring to the nearest 0.1 m the length, width and height of the piles or racks intended to contain the tires. In racks, the top shelf is assumed to be loaded to maximum possible height, while observing required clearances between structural elements and sprinklers.

**A-3.2.5.1.(1)** Aerosol products that are displayed in mercantile occupancies represent a lower hazard and do not require specific storage limits or additional fire protection provided they have been removed from their combustible cartons or cartons have been display-cut so that only the bottom and the lowest 50 mm of the side panels is retained. The storage of packaged aerosols in mercantile occupancies shall nevertheless conform to this Subsection.

**A-3.2.5.2.(1)** This Code has adopted the aerosol classification system developed by the National Fire Protection Association in NFPA 30B, "Manufacture and Storage of Aerosol Products."

Examples of Level 1 aerosol products include shaving cream, spray starch, window cleaners, alkaline oven cleaners, rug shampoos, some air fresheners and some insecticides. These aerosols are less hazardous than Level 2 or Level 3 aerosols, and represent a storage hazard comparable to Class III commodities.

Examples of Level 2 water-miscible flammable base aerosol products include most personal care products such as deodorants (except for oil-based antiperspirants), and hair sprays. They may also include antiseptics and anesthetics, some furniture polishes and windshield de-icers. Level 2 aerosols are less hazardous than Level 3 aerosols.

Examples of Level 3 aerosol products include some automotive products such as engine and carburetor cleaners, undercoats and lubricants; some wood polishes, paints and lacquers; some insecticides; and oil based antiperspirants.

In Canada, some aerosol products are required by the "Controlled Products Regulations," the "Consumer Chemicals and Containers Regulations," and certain other legislation to bear flammability hazard symbols. The nature of the symbol on the can is determined on the basis of a flame projection test, which measures the susceptibility of the aerosol spray to ignite; this is most important for protecting consumers who, for example, might be smoking while using an aerosol product. A direct comparison between the flammability hazard symbols used in Canadian regulations and the NFPA Level 1, 2 or 3 classification system used in the Alberta Fire Code 2006 is not reliable as the latter measures the overall contribution of flammable base product, combined with flammable gas propellant, to the rate of growth and severity of a fire involving a substantial number of aerosols.

**A-3.2.7.3.(1)(b)** Part 4 of the Alberta Fire Code 2006 specifies ventilation rates to prevent the buildup of dangerous concentrations of flammable vapours in rooms used for storing flammable and combustible liquids. The same principles should apply to dangerous goods capable of releasing toxic gases, or where the accidental mixing of incompatible substances could generate flammable vapours or toxic gases. Where no guidance is given, the design of the ventilation system should conform to good engineering practice. Recommendations in the National Fire Protection Association standards, or in the document "Industrial Ventilation: A Manual of Recommended Practice," produced by the American Conference of Governmental Industrial Hygienists, are considered examples of good engineering practice.

**A-3.2.7.6.(1)** Where combinations of incompatible dangerous goods are marked with an X in Table 3.2.7.6., they shall be stored in separate fire compartments. The fire-resistance rating of the fire separations shall be determined by applicable requirements of the Code. For example, when oxidizing or reactive substances are involved, Sentences 3.2.7.5.(6) and (7) would require a 2 h rating. For flammable and combustible liquids, Subsections 4.2.7. and 4.2.9. may be used and would require a 1 h or 2 h rating depending on the quantities involved. For compressed gases, Subsection 3.2.8. may be used and would require a 1 h or 2 h rating depending on the type of gases. For aerosols, Subsection 3.2.5. could be used following the same reasoning.

**A-3.2.7.6.(2)** It is assumed that Material Safety Data Sheets (MSDS) will in many cases be provided as part of the documentation for the "Transportation of Dangerous Goods Regulations," or the "Workplace Hazardous Materials Information System."

The following are examples of basic principles that should apply to any storage situation involving dangerous goods:

- Chemicals should not be stored using an alphabetical sequence system but should be grouped according to compatibility.
- Organic materials should not be stored with either strong acids or oxidizers.
- Alkalis should not be stored with strong acids or chlorinated hydrocarbons.
- Strong acids should not be stored with oxidizers.
- Sulphites, bisulphites and sulphides should not be stored with acids.

Poisonous chemicals should not be stored together on the basis that they are poisons, but rather on the basis of compatibility. As with the storage of all chemicals, the primary consideration is what might happen in the event of a mishap causing them to be mixed. For instance, the following are all classified as Class 6.1 poisonous substances but will cause serious problems when mixed in the presence of water (such as water used for firefighting purposes):

- sodium azide + dimethyl sulphate = explosion;
- sodium cyanide + anhydrous chloral = highly toxic vapour cloud.

Poisonous substances should not be stored in the vicinity of chemicals that are designated as B.P., B.P.C., U.S.P., F.C.C. and N.F. grades. Many of these chemicals find their way into cosmetics, pharmaceutical drugs and foodstuffs. A spill of poisonous substance would not only cause contamination of the product itself, but also of the outside of the container and of the clean room in which they are processed.

**A-3.2.7.9.(1)** So many types, quantities, and concentrations of dangerous goods could be present in a building that setting maximum quantities allowed in unprotected buildings is very difficult. The hazard presented by the dangerous goods is not necessarily a function of their inherent flammability, but rather a function of their potential for hampering firefighting. If the area involved in dangerous goods storage is large enough, the owner must provide some degree of built-in automatic fire suppression for the building. Therefore, the point at which installation of an active fire suppression system becomes mandatory is based on the total area involved in dangerous goods storage, regardless of the product stored.

The active fire suppression system intended is a sprinkler system, installed throughout the building, not just in the area of dangerous goods storage. The objective is to control both a fire originating in a spot remote from the dangerous goods, so that it never threatens the dangerous goods, and a fire involving the dangerous goods themselves. Even if a fire originates in a dangerous good on which water should not be applied (stored pesticides for example), sprinklers may provide better control than alternative firefighting measures. A sprinkler system should control the fire, limit its spread, and minimize the number of containers that fail. The sprinkler alarm will notify responsible persons who can take corrective action while the fire is small. The amount of water applied to the pesticide by the sprinklers will be small in comparison to what will have to be applied by hose streams once the fire is established.

Article 2.1.3.6. in the Alberta Fire Code 2006 refers to the Alberta Building Code 2006, which sets the basic criteria for sprinkler systems. These criteria may not be appropriate for specific dangerous goods. For example, water may not be the best extinguishing agent to use on a particular product. In such cases, special arrangements may be required, such as isolating that product in an unsprinklered room protected by a fixed fire suppression system conforming to Article 2.1.3.5.

It is assumed that the fire suppression system will be designed by persons experienced in such design, using good engineering practice to establish design criteria, such as type of suppressant to use, and rate of application.

**A-3.2.7.10.(1)** Venting of smoke and other products of combustion can be achieved by opening roof vents, breaking skylights, removing panels or opening windows. Smoke and hot gases should be vented directly to the outside.

**A-3.2.7.12.(2)** Access to at least 2 sides of a building used for the storage of dangerous goods is required so that, if necessary, firefighting operations can be set up on the upwind side of the building to minimize the adverse effects of toxic smoke.

**A-3.2.7.12.(3)** Protective clothing worn by firefighters in a fire involving dangerous goods is bulkier than the usual firefighting turnout gear. Therefore, Sentence 3.2.7.12.(3) requires access openings into buildings used for the storage of dangerous goods to be wider than otherwise required by the Alberta Building Code 2006.

**A-3.2.7.13.(1)** Firefighters need to identify the substances they may encounter in a building during a fire. Labelling of products to comply with the "Workplace Hazardous Materials Information System" (WHMIS) or other provincial, territorial or federal regulations is deemed to satisfy this requirement.

**A-3.2.7.14.(1)** One or more placards at the door into a room used for the storage of dangerous goods are required to inform firefighters that dangerous goods are contained within. In larger storage areas containing a variety of dangerous goods in different individual storage areas, each individual storage area should have placards.

**A-3.2.8.2.(1)(d)** When a flammable mixture of air and vapour/gas/dust is ignited and causes an explosion, the exothermic reaction results in the rapid expansion of heated gases and the corresponding pressure waves travel through the mixture at sonic or supersonic velocities. The pressures developed by an explosion very rapidly reach levels that most buildings and equipment cannot withstand unless specifically designed to do so. Explosion venting consists of devices designed to open at a predetermined pressure to relieve internal pressure buildup inside a room or enclosure, hence limiting the structural and mechanical damage.

The major parameters to be considered in designing an explosion venting system for a building are:

- the physical and chemical properties of the flammable air mixture, such as the particle size or the droplet diameter, the moisture content, the minimum ignition temperature and explosive concentration, the burning velocity or explosibility classification, the maximum explosion pressure and the rate of pressure rise,
- the concentration and dispersion of the flammable mixture in the room,
- the turbulence and physical obstructions in the room,
- the size and shape of the room, the type of construction and its ability to withstand internal pressures, and
- the type, size and location of relief panels, which should also be designed to reduce the possibility of injury to people in the immediate vicinity of the panels.

**A-3.2.8.2.(2)** The following Table gives the specific volume ( $\text{m}^3/\text{kg}$ ) of some common gases at normal temperature and pressure. This information is available from the manufacturer's literature and can be used to convert gas weight (kg) into gas expanded volume ( $\text{m}^3$ ), and vice versa. Cylinder data for industrial gases can also be found in Data Sheet 7-50, "Compressed Gases in Cylinders," published by FM Global.

Table A-3.2.8.2.(2)  
Specific Volume of Common Gases

Gas	Specific Volume, m <sup>3</sup> /kg
Acetylene	0.9
Ammonia, anhydrous	1.4
Arsine	0.3
Butane	0.4
Carbon dioxide	0.5
Chlorine	0.3
Ethylene oxide	0.5
Fluorine	0.6
Hydrogen	12.0
Methane	1.5
Methyl acetylene	0.6
Methyl chloride	0.5
Nitrogen	0.9
Oxygen	0.8
Phosphine	0.7
Propane	0.5
Propylene	0.6

**A-3.2.9.1.(1)** The chemical composition of ammonium nitrate is  $[\text{NH}_4\text{NO}_3]$ , which makes it an inorganic nitrate. It comes in granular, prilled, flaked, crystalline or solid forms. Ammonium nitrate is manufactured in two densities used for different purposes and is treated with a wax or clay protective coating to prevent moisture absorption, which causes caking of the product.

High-density ammonium nitrate is a fertilizer used in the agricultural sector. Subsection 3.2.9. applies only to ammonium nitrate mixtures designated as Class 5.1 dangerous goods, which may be composed of as little as 45% ammonium nitrate. Sentence 3.2.9.1.(1) increases the maximum exempt amount stated in Table 3.2.7.1. from 250 kg to 1 000 kg.

Low-density ammonium nitrate, when sensitized, is a blasting explosive used in the mining and construction sectors. When a carbonaceous or organic substance, such as fuel or diesel oil, nut hulls, or carbon black, is added and admixed with ammonium nitrate, the mixture may become a blasting explosive. This Code does not apply to ammonium-nitrate-based blasting explosives.

Blasting explosives are classified as Class 1 dangerous goods; their storage is regulated under the "Explosives Act" and its Regulations, published by Natural Resources Canada.

**A-3.2.9.2.(6)** Copper and its alloys should not be used where they can come into contact with ammonium nitrate. The presence of copper represents the single biggest hazard with respect to the accidental detonation of ammonium nitrate during a fire.

Steel and wood can be protected with special coatings such as sodium silicate, epoxy, or polyvinyl chloride.

Asphalt and similar hydrocarbon-based roof coverings should not be used. Stored ammonium nitrate may become sensitized during a fire if such roof coverings melt and leak into the interior of the building, causing burning droplets to fall on the stored product.

**A-3.2.9.2.(7)** The minimum spatial separation stated in Subsection 3.2.3. of Division B of the Alberta Building Code 2006 may be increased by the authority having jurisdiction with respect to the nearness of assembly, institutional, residential and mercantile occupancies regarding the proximity of these exposures and congested commercial or industrial areas with due consideration to the exposure of toxic vapours from fires involving ammonium nitrate.

**A-3.2.9.3.(1)** It is recommended that electric or LP-gas-powered industrial trucks be used rather than gasoline- or diesel-fuelled ones so as to reduce the potential for contamination of the ammonium nitrate.

**A-3.2.9.4.(1)** Dry chemical extinguishers are not permitted to be used to fight fires involving ammonium nitrate, but may be used to extinguish fires involving industrial trucks, conveyors, etc.

**A-3.3.1.1.(1)(d)** Hogged material can be described as mill waste consisting mainly of hogged bark but may include a mixture of bark, chips, dust, or other by-products from trees. This also includes material designated as hogged fuel.

**A-3.3.1.1.(1)(e)** Factory-assembled combustible structures, such as mobile or modular homes and office trailers, that are transportable in one or more sections, are designated as manufactured buildings in this Section.

**A-3.3.1.1.(2)(c)** An intermodal shipping container can be described as a standard sized reusable structure into which commodities are packed and designed to be used in more than one mode of transportation.

**A-3.3.1.1.(2)(g)** Treated forest products are those that have been coated or impregnated with flammable or combustible liquids. Ranked piles are typically piles of logs evenly arranged by conveyor, crane or other means.

**A-3.3.2.6.(2)** The width and location of gates in a fire department access route should take into account the connection with public thoroughfares, width of the roadway, radius of curves, and the type and size of fire department vehicles available in the municipality or area where the storage site is located. Padlocks that can be forced and replaced are preferred by fire departments for easy access to the storage site.

**A-3.3.2.16.(1)(b)** Where on-site reservoirs or other established water supplies are used as a fire department draft source, they shall be equipped with dry hydrants in accordance with NFPA 1142, "Water Supplies for Suburban and Rural Firefighting," Annex B.

Other water supply systems or other measures may be used if the systems or measures will provide sufficient fire suppression capability in the circumstances and if the systems or measures are accepted by the authority having jurisdiction.

**A-3.3.2.17.(2)** Experience has shown that water supplies for a yard fire hydrant system capable of supplying four 19 L/s hose streams simultaneously are sufficient to handle the demand created by a well-equipped and manned fire department response. Hydrants with hose threads meeting the requirements of Section 6.8. of this Code located at not more than 75 m intervals and equipped with 60 m of 65 mm hose assist firefighters by permitting rapid hose lays to all parts of the storage areas. Large stream equipment such as portable turrets and deluge sets require 57 to 75 L/s for each unit. Monitor towers may require supplies in excess of 75 L/s for each unit. In large yards, where the hazard is severe, many of these units may be operated simultaneously.

**A-3.3.3.2.(1)** Where the adjoining property is land that may be built upon or used for storage, it is intended that the required clearance be maintained between the stored products and the property line. If the adjoining property does not present a fire exposure hazard, such as a street, right of way, watercourse, or park land, the required clearance could be beyond the property line. In all cases, care should be taken that the storage close to the property line does not defeat the purpose of other safety measures prescribed in this Code.

**A-3.3.6.1.(1)** A pile of this size will contain more than 2 500 and fewer than 10 000 unshredded passenger tires, depending on the degree of compaction and packing obtained. For purposes of estimating tire quantities it can be assumed that a pile such as this will contain approximately 5 000 tires. If the tires are shredded it is estimated that a pile of this size would contain approximately 15 000 passenger tires.

**A-3.3.6.2.(1)** This Subsection applies to the outdoor storage of tires or shredded tires where the bulk volume of stored product exceeds 300 m<sup>3</sup> but does not apply where the stored tires or shredded tires are covered by a minimum depth of 150 mm of noncombustible material as would be the case in a properly operated sanitary landfill. Similarly, in-ground (buried) storage of tires in a lined and covered trench system with a view to future recovery and reuse would not be subject to this Subsection.

**A-4.1.1.1.(1)** The all-inclusive phrase "buildings, structures and open areas" includes, but is not limited to, tank farms, bulk plants, fuel-dispensing stations, industrial plants, refineries, process plants, distilleries, and to piers, wharves and airports that are not subject to overriding federal control.

Part 4 of the Alberta Fire Code 2006 applies wherever flammable or combustible liquids are used or stored, except as specifically exempted in Sentences 4.1.1.1.(2) and (3).

Part 4 contains both general and occupancy-specific provisions. While general provisions apply to all occupancies or operations identified within the scope of Subsection 4.1.1., occupancy-specific provisions apply only to the specific occupancy or operation stated.

To determine the provisions that apply to a given situation, the first step is to confirm which Section or Subsection corresponds to the operation or occupancy: this will help identify the occupancy-specific provisions that apply. The next step is to ensure that all general requirements that apply to the operation or occupancy are also identified.

**A-4.1.1.1.(2)** Certain areas in refineries, chemical plants and distilleries will not meet all Code requirements because of extraordinary conditions. Design should be based on good engineering practice and on such factors as manual fire suppression equipment, daily inspections, automated transfer systems, location of processing units, and special containment systems, piping, controls and materials used. NFPA 30, "Flammable and Combustible Liquids Code," and NFPA 36, "Solvent Extraction Plants," are examples of good engineering practice and can be referred to by the designer and the authority having jurisdiction.

**A-4.1.1.1.(3)(b)** Storage tank systems installed in conformance with CAN/CSA-B139, "Installation Code for Oil-Burning Equipment," must comply with Part 4 for items that are outside of the scope of the CSA standard. This includes, but is not limited to, site sensitivity classification, registration, secondary containment, testing, maintenance, repair, leak detection, corrosion protection testing, and removal of storage tank systems.

**A-4.1.1.1.(3)(c)** Such facilities may include isolated construction sites and earth-moving projects, including gravel pits, quarries, and borrow pits where in the opinion of the authority having jurisdiction, it may not be necessary to comply with the more restrictive requirements of Part 4.

**A-4.1.2.1.** The classification system for flammable liquids used by the "Transportation of Dangerous Goods Regulations" (TDGR) differs from the NFPA classification system used in the Alberta Fire Code 2006. In the Alberta Fire Code 2006, only liquids with a flash point below 37.8°C are referred to as "flammable" liquids, whereas liquids having flash points at or above 37.8°C are "combustible" liquids. In contrast, the TDGR, which regulate "flammable liquids" as Class 3 Dangerous Goods, define "flammable liquids" as liquids having a flash point below 60.5°C. Therefore, the TDGR term "flammable liquids" includes Class II liquids (with a maximum flash point of 60°C), which are referred to as "combustible liquids" in the Alberta Fire Code 2006 terminology. The TDGR do not include Class IIIA liquids that have a flash point above 60°C. The TDGR further classify flammable liquids into Divisions 1, 2, and 3, depending on their flash points. Division 1 flammable liquids have flash points below -18°C; Division 2 flammable liquids have flash points at or above -18°C but below 23°C; and Division 3 flammable liquids have flash points at or above 23°C but below 61°C. For the purpose of comparing the TDGR classification system with the Alberta Fire Code 2006 system, the differences between 23°C and 22.8°C, and between 61°C and 60°C may be ignored. The results of closed-cup flash point tests may vary by as much as 1°C, so nothing is gained by unnecessary precision.

**A-4.1.2.1.(3)(b)** The NFPA classification system for flammable and combustible liquids includes Class IIIB liquids, which have flash points at or above 93.3°C. These liquids are not regulated by Part 4 of the Alberta Fire Code 2006 because they are deemed to represent no greater fire hazard than other combustibles, such as wood or paper products. However, Article 4.1.2.2. clarifies that such liquids are effectively Class I liquids when heated to their flash point temperature.

**A-4.1.2.3.** Used automotive lubricating oil may contain both oil and more volatile Class I liquids, such as gasoline. Tests of representative samples have demonstrated that the flash point of such used oil consistently exceeds 60°C, with an average above 93.3°C. When Class I or II liquids are added to such used oil, the flash point of the resulting mixture will vary with the percentage and flammability of the contaminating liquid and shall be determined by tests.

**A-4.1.3.1.** The kinematic viscosity of a liquid influences the choice of test most appropriate for measuring its flash point. For measurement of kinematic viscosity, the ASTM standards referenced use units of centistokes, or stokes. In Canada, the unit used for kinematic viscosity is mm<sup>2</sup>/s (cgs), not stokes or centistokes. One centistoke has units of 1 millimetre squared per second (1 mm<sup>2</sup>/s).

For purposes of comparison, the kinematic viscosity of water is 1.0038 mm<sup>2</sup>/s at 20°C; of glycerine, approximately 1185 mm<sup>2</sup>/s; and of some common motor oils, near 1000 mm<sup>2</sup>/s. Some paints, lacquers and glues have much higher kinematic viscosities, as indicated by the upper limit of 15000 mm<sup>2</sup>/s in ASTM D 3278, "Flash Point of Liquids by Small Scale Closed-Cup Apparatus."

The viscosity at which a liquid should no longer be treated as a liquid is addressed in NFPA 30, "Flammable and Combustible Liquids Code." The definition of "liquid" in that document states that "any material that has a fluidity greater than that of 300 penetration asphalt, when tested in accordance with ASTM D 5, "Penetration of Bituminous Materials," is considered to be a liquid.

**A-4.1.4.1.(1)** Additional information on determining the extent of Division 1 or 2 zones in Class I locations can be found in CSA PLUS 2203 HAZLOC, "Hazardous Locations: A Guide for the Design, Testing, Construction, and Installation of Equipment in Explosive Atmospheres," in NFPA 30, "Flammable and Combustible Liquids Code," and in NFPA 497, "Classification of Flammable Liquids, Gases or Vapors and of Hazardous (Classified) Locations for Electrical Installations in Chemical Process Areas."

**A-4.1.5.2.(1)** Sources of ignition include, but are not limited to, open flames, smoking, cutting and welding, hot surfaces, frictional heat, static, electrical and mechanical sparks, spontaneous ignition, heat-producing chemical reactions, and radiant heat.

**A-4.1.5.8.** Limited quantities of Class I liquids are permitted to be stored or used in basements where it is clear they will not create a fire hazard. Such factors as the size of the basement, ventilation, wiring, and proximity to sources of ignition should be taken into account in determining whether an unsafe condition exists.

**A-4.1.6.1.(1)** A spill containment system is intended to capture the maximum credible spill of a flammable or combustible liquid. This can be achieved by safely containing the liquid or having it drain to a safe location. Water used for firefighting need not be taken into consideration when determining the capacity of the primary spill containment or drainage system required by Sentence 4.1.6.1.(1).

Once a fire is associated with a spill, water from hose streams, suppression systems, etc. used for firefighting becomes a concern. The quantity of water involved is highly variable as it will depend on the fire conditions and the duration of the fire. As a result, the fire safety plan must address spill management associated with the application of water during firefighting operations.

#### Estimating credible spill capacity

The capacity of a credible spill must be based on the maximum quantity that can be released from containers located in the storage area.

- Where the storage—inside and/or outside—is in drums or small containers (not large vessels, Intermediate Bulk Containers (IBC), tote bins or tanks), the capacity of a credible spill should be at least 1000 L. This will accommodate a spill in the event that lift truck forks spear a single pallet load containing four drums or drop the load. Where drums are not handled on pallets and hand trucks or clamp-type lift trucks are used, the capacity of credible spill may be reduced, but not to less than the capacity of the largest container used.
- For storage in IBC, tote bins or other bulk containers inside or outside buildings, and in tanks inside buildings, the credible spill capacity must be at least equal to the capacity of the largest container in the storage area.
- Outside storage tanks must comply with the provisions of Subsection 4.3.7.

#### Consideration for the fire safety plan

The fire safety plan must ensure that all critical areas, such as buildings, means of egress, fire department access, control valves, fire alarm panels, etc., in the path of a potential overflow remain accessible during the fire emergency and that the flow of liquid is directed away from such areas. The plan must allow for reliable and immediate notification of an emergency, such as by providing an automatic notification system, which will facilitate early intervention by the fire department. The plan must incorporate measures, including design features, that will minimize the impact of effluent on adjoining property and the environment.

The owner of the building is responsible for developing the fire safety plan. The owner may require assistance from the fire department, which can provide some of the relevant information necessary to develop a workable plan. The owner is also responsible for having the plan approved by the chief fire

official and for ensuring the approved plan is implemented. Periodic (e.g. annual) testing of the plan would help identify any limitations of the plan and familiarize staff who have been assigned duties in the plan. The fire safety plan must be modified when original assumptions and conditions change.

**Where small quantities are present**

- Where only small quantities (up to 5000 L) of flammable or combustible liquids are present, acceptable measures to control a spill of the liquids and the water used for firefighting include the provision of manhole or catch-basin covers, sorbent materials and portable dikes. Such measures can prevent contaminated effluents from entering sewers or flowing to other areas.
- For additional information on controlling a spill, reference should be made to NFPA 30, NFPA 15, FM Global Data Sheet 7-83, the SFPE Handbook of Fire Protection Engineering and other industry-specific publications on the subject.

**Where large quantities are present**

- Where a facility stores, handles or processes significant quantities (exceeding 5000 L) of flammable or combustible liquids, a high level of expertise may be required to develop an appropriate fire safety plan. In such cases, the owner must ensure that professionals who have expertise in this area play a lead role in developing and implementing the fire safety plan.
- Where the application of a fire suppression medium, either manual or automatic, may result in significant adverse impact on the community and/or the environment, a controlled burn is an option to consider. Evaluating this option should involve key stakeholders such as the owner, fire department, provincial and/or federal department responsible for the environment, and insurers.

**A-4.1.6.2.(2)** Plumbing regulations made pursuant to the Safety Codes Act define a trap as a fitting or device that is designed to hold a liquid seal that will prevent the passage of gas but will not materially affect the flow of a liquid.

**A-4.1.6.3.** A leak of flammable or combustible liquids usually results in a hazard being created that endangers life, property, health and the environment.

An immediate danger of fire or explosion may result when the escaping liquid or vapour is a flammable liquid with a low flash point. Typically, this involves the migration of the liquid or vapours into nearby buildings, sewers, tunnels or other underground structures, creating a fire or explosion hazard. The prime responsibility for the elimination of this type of hazard falls to the fire official who has responsibility for protection of life and property from fire or explosion.

Health and environmental hazards, including the pollution of potable water supplies, are also present in many instances. These problems often require long-term solutions and although serious, may not create an immediate public danger. The mitigation of this type of hazard rests with health and environmental officials and the owners of the property. Their concerns become paramount once the danger from a fire or explosion hazard is eliminated.

The fire official would be justified in transferring responsibility for cleanup of the environmental problems to environmental officials and the property owner provided they are satisfied that there is no longer a danger to persons or property from fire or explosion.

It must be emphasized that only through cooperation can the hazards be eliminated. It is essential that fire officials recognize the many facets of the problem and that they make a serious effort to secure the assistance and support of all interested parties.

Testing of tanks and piping and the removal of leaking tanks and any liquid in the earth or on water will require equipment, facilities and expertise that are readily available to contractors or to environmental consultants. Industry specialists have qualifications that will be beneficial when dealing with problems of this nature. Their knowledge and experience can be invaluable. Responsible officials should seek their help and guidance whenever possible. It must also be recognized that a major portion of the responsibility rests with the owner of the leaking equipment and not with the fire or environmental officials. The need for cooperation should be stressed to the owner and their assistance and support should be encouraged.

**A-4.1.6.3.(3)(b)** Information on the compatibility and reactivity of liquids can be found in the Material Safety Data Sheets for each liquid.

An absorbent material conforming to ULC/ORD-C410A, "Absorbents for Flammable and Combustible Liquids," is acceptable.

**A-4.1.6.4.** The local fire or emergency response department is the owner's first contact for any leak or spill that requires immediate action to lessen the risk of fire or explosion and, secondly, notification to the authority having jurisdiction.

**A-4.1.7.1.(1)** Article 3.3.1.20. of Division B of the Alberta Building Code 2006 specifies that ventilation must be provided in conformance with Part 6 of that Code if flammable vapour, gas, or dust could create a fire or explosion hazard. However, Part 6 of Division B of the Alberta Building Code 2006 does not provide specific information on the design of ventilation systems to prevent an accumulation of dangerous concentrations of flammable vapours. It refers instead to "good engineering practice" and directs the user to a number of NFPA standards for examples of good practice, which varies according to the nature of the vapours or dusts. Subsection 4.1.7. of the Alberta Fire Code 2006 represents a minimum level of good practice for preventing the accumulation of explosive concentrations of vapours from flammable or combustible liquids.

In the phrase "rooms or enclosed spaces," the word "rooms" does not only designate small and confined areas of a building. It includes large open areas of a building as well as smaller rooms.

**A-4.1.7.2.(3)** Natural ventilation is normally adequate for the storage of flammable liquids and combustible liquids, or the dispensing of Class II and IIIA liquids. Such ventilation should consist of permanent openings at ceiling and floor levels leading to the outside. At least 0.1 m<sup>2</sup> each of free inlet and outlet openings per 50 m<sup>2</sup> of floor area should be provided. A mechanical ventilation rate of at least 18 m<sup>3</sup>/h per square metre of floor area, but not less than 250 m<sup>3</sup>/h, is normally adequate for rooms with low floor to ceiling height or small enclosed spaces where Class I liquids are dispensed. Ventilation for process areas must be designed to suit the nature of the hazard in accordance with good engineering practice.

**A-4.1.8.2.(1)(b)** Build-up of static electric charges near the surface of liquids being poured into non-conducting containers can be controlled or eliminated by: limiting the filling rate to velocities less than 1 m/s, using a grounded lance or nozzle extension to the bottom of the container, limiting free fall, or using antistatic additives.

**A-4.1.8.2.(3)(b)** It is generally considered that liquids with a conductivity greater than 50 pS/m (pico Siemens per metre) will dissipate static charges so that they will not accumulate to a hazardous potential. Experience indicates that most water-miscible liquids, crude oils, residual oils and asphalts do not accumulate static charges.

**A-4.1.8.3.(1)** Products tested and listed by recognized agencies are considered to be designed in conformance with good engineering practice. Underwriters Laboratories Inc. and FM Global are currently listing these products.

**A-4.1.8.3.(3)** Haulers of used oil for recycling or disposal may be inserting a suction hose into the tank to pump out the oil. This practice can damage fibreglass reinforced plastic tanks and can lead to spills when the suction hose is removed. To avoid this, used oil tanks shall be fitted with a suction tube and a leak-tight coupling. Used oil haulers should find this method preferable. The removable suction tube is required to facilitate the unblocking of a plugged suction tube.

**A-4.1.8.4.(1)** The use of movable tanks relates to the use of such tanks in buildings and facilities for the fuelling of industrial floor cleaners, industrial trucks, or equipment used in manufacturing facilities that requires the use of flammable and/or combustible liquids to operate in addition to the use of such tanks at construction or earth-moving sites.

**A-4.2.2.3.(2)** Flammable and combustible liquids are classified as Class 3 dangerous goods in accordance with the "Transportation of Dangerous Goods Regulations." Class 3 dangerous goods include liquids with flash points up to 60.5°C using the closed-cup test method, or 65.6°C using the open-cup test method. This means that Class IIIA liquids with a flash point above 61°C are not treated as dangerous goods. However, for the purposes of this Article, Class IIIA liquids should be treated as Class 3 dangerous goods as described in Table 3.2.7.6.

**A-4.2.5.3.(1)** Article 4.2.5.3. addresses the potential hazard where flammable vapours are released during transfer operations in an improperly ventilated area, and where sources of ignition may not be adequately controlled. It is not intended to prohibit the opening of small containers in retail areas of paint stores for the purpose of tinting paints.

**A-4.2.7.5.(2)**

**A-4.2.7.5.(2)** Sentence 4.2.7.5.(2) sets no limit to the total quantity of flammable and combustible liquids in a separate or detached storage building. Although total quantity limits of Tables 4.2.7.5.A. and 4.2.7.5.B. do not apply, the quantity and height limitations specified for the individual storage areas must be complied with in order to take advantage of the exemption for total quantity limits. Requirements pertaining to the spatial separation of buildings are found in Subsection 3.2.3. of Division B of the Alberta Building Code 2006. The requirements in this Code for the storage of flammable and combustible liquids must be read in conjunction with applicable provisions in the Alberta Building Code 2006 that impose restrictions on the design of a storage building. For example, the size and height of a building, type of construction, automatic fire suppression and street access are governed in part by Subsection 3.2.2. of Division B of the Alberta Building Code 2006. Environmental protection regulations may contain additional requirements that should be considered in the design of a storage building for flammable and combustible liquids.

**A-4.2.7.6.(1)** Options for fixed fire suppression systems for protection of flammable or combustible liquid storage areas include: automatic sprinkler, foam sprinkler, water spray, carbon dioxide, dry chemical or halon systems. Section 6.8 and Annex D of NFPA 30, "Flammable and Combustible Liquids Code," represent good engineering practice for design of sprinkler or foam water systems for flammable and combustible liquid storage areas.

**A-4.2.7.7.(3)** Containers of flammable or combustible liquids could be punctured or deformed if pushed up against a protrusion from a wall. The required wall clearance is intended to prevent such damage, and to permit visual inspection of the sides of the individual storage area. The clearance need not be provided for narrow shelves along a wall, where the backs of the shelves can be inspected from the aisle.

**A-4.2.8.1.(1)** Subsection 4.2.8. applies to those portions of an industrial occupancy where the use, storage and handling of flammable and combustible liquids is only incidental, or secondary to the principal activity. The word "incidental" does not imply "small quantity" or "insignificant amount." Manufacturers of electronic equipment, furniture and reinforced plastic boats, and automobile assembly plants are typical examples of locations where the use of flammable and combustible liquids is secondary to the principal activity of manufacturing consumer products. In storage areas otherwise governed by Part 3 of this Code, Subsection 4.2.8. applies to the "incidental" storage of flammable and combustible liquids that is deemed to be secondary to the principal activity of storing commodities covered in Part 3. This includes the storage of used lubricating oil in the warehouse portion (industrial occupancy) of a retail outlet. Subsection 4.2.8. also applies to the storage of used lubricating oil at motor vehicle repair and service garages because such storage is secondary to the principal activity of repairing and servicing motor vehicles.

**A-4.2.8.3.(1)** The fire separation required by this Sentence should also prevent the passage of vapours.

**A-4.3.1.2.(1)** Tank construction requirements have been in the Alberta Fire Code since 1986 and apply to storage tanks for flammable liquids and combustible liquids operating at pressures from atmospheric to 3.5 kPa (gauge), in all premises, **except tanks:**

- in process plants, as specifically exempted in Sentence 4.1.1.1.(2),
- on farms for individual farm use and isolated construction projects, as specifically exempted in Clause 4.1.1.1.(3)(c),
- for distilled beverage alcohol in distilleries, as specifically exempted in Sentence 4.10.3.1.(1),
- for liquids that may be flammable under certain conditions, as specifically exempted by Clause 4.1.1.1.(3)(g),
- for the storage and handling of liquids mandated under the requirements of EUB Guide 55, "Storage Requirements for the Upstream Petroleum Industry," as specifically exempted by Clause 4.1.1.1.(3)(h),
- containing liquids subject to possible contamination of the liquid or possible rapid corrosion of the tank, as specifically exempted in Sentence 4.3.1.2.(3), and
- containing liquid when the temperature of the liquid is at or above its boiling point, as specifically exempted in Sentence 4.3.1.2.(4).

The Alberta Fire Code 2006 requires tanks to be constructed to meet one of the standards listed in Sentence 4.3.1.2.(1). An integral part of Underwriters' Laboratories of Canada (ULC) standards is that the tank be labelled by a certified testing agency. The certified testing agency in Alberta for either new or refurbished tanks is ULC.

**A-4.3.1.8.(1)(b)** Examples of devices to prevent overflow include automatic sensing devices for interconnection with shut-off equipment at the supply vehicle, automatic overflow shut-off devices of a float valve or other mechanical type, vent restriction devices, and overflow alarm devices of the audible or visual type.

**A-4.3.1.10.** Flammable liquid and combustible liquid storage tanks are required to be refurbished in accordance with the procedures prescribed by ULC.

For a storage tank to be labelled as a ULC refurbished storage tank the refurbishing procedure must be performed by a company currently manufacturing ULC listed storage tanks that have a refurbishing program and listing with ULC.

**A-4.3.2.1.(4)** Boil-over is an event in the burning of certain oils in an open top tank when, after a long period of quiescent burning, there is a sudden increase in fire intensity associated with expulsion of burning oil from the tank. Boil-over occurs when the residues from surface burning become more dense than the unburned oil and sink below the surface to form a hot layer, which progresses downward much faster than the regression of the liquid surface. When this hot layer, called a "heat wave," reaches water or water-in-oil emulsion in the bottom of the tank, the water is first superheated and subsequently boils almost explosively, overflowing the tank. Oils subject to boil-over consist of both light ends and viscous residues. These characteristics are present in most crude oils and can be produced in synthetic mixtures.

Note: A boil-over is an entirely different phenomenon from a slop-over or a froth-over. Slop-over involves a minor frothing that occurs when water is sprayed onto the hot surface of a burning oil. Froth-over is not associated with a fire but results when water is present or enters a tank containing hot viscous oil. Upon mixing, the sudden conversion of water to steam causes a portion of the tank contents to overflow.

**A-4.3.2.5.** Guidelines for the protection of storage tanks can also be found in standards published by the National Fire Protection Association, Insurers' Advisory Organization (1989) Inc., GE Insurance Solutions and FM Global. Such guidelines are considered as good engineering practice in assessing the protection necessary for tanks.

**A-4.3.7.4.** The primary function of a diked enclosure is to contain the maximum anticipated liquid spill, but sufficient distance between dike and tank shell is also required so that a jet of liquid issuing from a puncture will not over-shoot the dike. The reduction of the tank-to-dike distance should be made only after consideration of such factors as the proximity of the tanks to buildings and other hazards, the risk associated with the product in the tanks, the location of sewers or water courses, and the height of the tank.

**A-4.3.7.5.(1)** When the height of a secondary containment wall exceeds 1.8 m, there is an increased potential for heavier-than-air vapour to accumulate at ground level within the contained area. Depending on the nature of such a vapour accumulation, it may be explosive or sufficiently toxic to seriously endanger personnel. Entry into such a contained area should always be preceded by testing for such a vapour accumulation.

**A-4.3.7.5.(2)** Vapours from Class I liquids may reach unsafe concentrations when confined in the small space between the tank and the secondary containment wall. Remotely operated valves or elevated walkways eliminate the need for personnel to enter the bottom of the contained area to operate a valve.

**A-4.3.8.1.(6)(b)** Secondary containment may consist of the following:

#### **Tank Secondary Containment**

All new Class A installations of underground storage tank systems must have a secondary containment system which collects and contains a leak. This can consist of either (a) or (b) or a comparable system approved by the authority having jurisdiction:

- (a) A Double-Walled Tank - if the secondary containment system consists of a double-walled tank, the inner tank must be constructed in accordance with applicable standards listed in Sentence 4.3.1.2.(1) or subsequent ULC listings for double-walled underground storage tanks, where the interstitial space of the double-walled tank can be monitored for tightness.
- (b) An Impervious Liner - if the secondary containment system consists of an impervious liner, the impervious liner shall be constructed in accordance with ULC/ORD-C58.9, "Secondary Containment Liners for Underground and Aboveground Flammable and Combustible Liquid Tanks."

#### **Piping Secondary Containment**

All new Class A installations for underground piping systems must have a secondary containment system which collects and contains a leak. This shall consist of one of the following:

- (a) Double-Walled Piping - if the secondary containment system consists of a double-walled, non-metallic piping, it shall be constructed in accordance with ULC/ORD-C971, "Nonmetallic Underground Piping for Flammable and Combustible Liquids," or
- (b) An Impervious Liner - if the secondary containment system consists of an impervious liner for all piping trenches, it must be constructed in accordance with ULC/ORD-C58.9, "Secondary Containment Liners for Underground and Aboveground Flammable and Combustible Liquid Tanks," and installed with an impervious liner for all tanks such that the trench liner slopes down to the tank excavation at a uniform gradient of 1 to 100.

**A-4.3.8.1.(6)(e)** Leak detection may include the following types of technology:

- (a) Observation wells for monthly monitoring of soil vapours or groundwater for flammable or combustible materials, which are constructed with flush joint, threaded pipe casings with a minimum inside diameter of 50 mm and made of plastic PVC or stainless steel. Well screens must be factory perforated with a slot size adequate to prevent entry of filter material. Filter packs should extend 0.5 m above the perforated screen. All standpipes must have a bottom cap or plug. Deviations from this well design that utilize good engineering practice may be accepted by the authority having jurisdiction. At least one well must be installed at the lowest point within a secondary containment system at Class A sites and below the bottom of the tank. Wells must be sealed or capped so as to prevent liquid from entering the well from the surface and clearly marked as monitoring wells to prevent accidental delivery of product.
- (b) Interstitial monitoring of double-walled tanks and piping using pressure monitoring, vacuum monitoring, electronic monitoring, vapour detection, manual sampling or an equivalent method. Monitoring should be performed on a monthly basis.
- (c) Monthly monitoring using an automatic tank gauging system in conformance with ULC/ORD C58.12, "Leak Detection Devices (Volumetric Type) for Underground Flammable Liquid Storage Tanks," capable of performing daily inventory reconciliation and performing a total system test capable of detection of a leak rate of 0.76 L/h within a period of 24 h with a probability of detection of 0.95 or greater and a probability of false alarm of 0.05 or less.
- (d) Statistical Inventory Reconciliation SIR's which is daily inventory control data that is statistically analysed by computer by a vendor which is approved by the PTMAA on a monthly basis, capable of detection of a leak rate of 0.38 L/h within a period of 24 hours with a probability of detection of 0.95 or greater and a probability of false alarm of 0.05 or less.
- (e) Other technologies that have been approved.

**A-4.3.8.1.(6)(f)** Piping leak detection may include the following types of technology:**Pressurized Piping Systems**

Line leak detectors on pressurized piping systems include a line leak detector constructed in accordance with ULC/ORD-C107.12, "Line Leak Detection Devices for Flammable Liquid Piping," capable of detecting a leak rate of 11.4 L/h or greater, at a line pressure of 69 kPA, with a probability of detection of 0.95 and a probability of false alarm of 0.05 within 1 hour of the occurrence of the start of the leak. The line leak detection must incorporate one of the following:

- (a) an automatic shut-off device,
- (b) a flow restriction device, or
- (c) an alarm that indicates a leak.

Line leak detectors for pressurized piping systems must be tested annually to ensure they are operating properly and must not be bypassed from operation.

Cardlock installations and other unattended facilities must be equipped with leak detection interlock to shut off delivery of flammable and combustible liquids in the event of a detected leak.

**Suction Systems**

Where single-walled piping is installed all suction lines must be equipped with a single, vertical check valve, which is to be installed immediately below the pump. If a check valve is to be located elsewhere, all suction piping trenches must be equipped with a sufficient quantity of monitoring wells, which are to be used monthly to test for the presence of flammable or combustible vapours or free product.

**A-4.3.8.3.(2)** Where applicable, the following ULC standards shall be used to repair structural damage to underground storage tanks:

- ULC-S603(A), "Refurbishing of Steel Underground Tanks for Flammable and Combustible Liquids,"

- ULC-S615(A), "Refurbishing of Reinforced Plastic Underground Tanks for Petroleum Fuels."

**A-4.3.8.8.(1)** The purpose of anchoring or providing overburden on top of underground storage tanks is to prevent them from lifting out of the ground in the event of a rise in the water table or a flood. Any proposed means of anchorage or overburden must be sufficient to resist the uplift forces on tanks when they are empty and completely submerged.

Means that have been successfully employed to protect tanks against uplift are

- (a) anchor straps to concrete supports beneath them,
- (b) ground anchors, and
- (c) reinforced concrete slabs or planks on top of them.

**A-4.3.9.3.(1)** Stray current from an impressed current system can cause corrosion to tanks protected by sacrificial anodes. Consequently, bonding of sacrificial-anode-protected tanks and piping into the impressed current system is necessary.

**A-4.3.9.3.(2)** The anodes on a CAN/ULC-S603.1, "External Corrosion Protection Systems for Steel Underground Tanks for Flammable and Combustible Liquids," cathodically protected tank are designed to protect the tank only. Inadequate corrosion protection of cathodically protected tanks can occur if the tank is not electrically isolated from the piping or other tanks. This appears to be a commonly encountered fault and needs to be emphasized to installers.

**A-4.3.12.1.(2)** The Alberta Fire Code 2006 requires all buildings to conform to the Alberta Building Code 2006 with respect to alarm, sprinkler or standpipe systems, and means of egress. Thus the requirements in the Alberta Building Code 2006 for fire protection systems in F-1 occupancies apply to buildings regulated under this Subsection. However, in applying Alberta Building Code 2006 requirements to existing buildings, the practicality and cost of full compliance, and alternative ways to achieve the desired level of safety, should be taken into consideration.

**A-4.3.12.7.(1)(b)** The area that should be considered for ventilation is the space occupied by the tanks and extending to a distance that is classified electrically as Class I, Zone 2, when no ventilation is provided.

**A-4.3.12.8.(1)** For the design of normal and emergency venting of indoor storage tanks, Sentence 4.3.12.8.(1) refers to Subsection 4.3.4., which in turn refers to API 2000, "Venting Atmospheric and Low-Pressure Storage Tanks: Nonrefrigerated and Refrigerated." However, API 2000 is intended for outdoor tanks rather than indoor tanks. The venting rate reduction factors for water spray on the tank surface, or drainage rates for spilled liquids, should not be used to calculate the emergency venting rate of a storage tank installed inside a building. The effects of water spray cooling, and room drainage on the calculated emergency venting rate must be worked out according to good engineering practice. Increased emergency venting capacity may be required.

**A-4.3.12.9.(2)** Good engineering practice for the design of supports for suspended storage tanks should meet the intent of Subsection 4.3.3. as much as possible. Such factors as the provision of adequate fire resistance for supports, the need to prevent over-stressing of the tank shell or its supports, and resistance to earthquake forces in areas subject to such forces, should be taken into consideration.

**A-4.3.13.4.(1)** Small diameter hose stations are not intended for fighting a flammable or combustible liquid fire. Such fires should be fought using fog nozzles rather than solid water streams, because solid streams may spread the liquid fuel and worsen the situation. The small diameter hoses permitted in lieu of extinguishers are intended to be used for prompt suppression of a small fire in ordinary combustibles, and for prompt wash-down of spilled flammable or combustible liquids, before any fire occurs.

**A-4.3.15.3.(1)** The reason for making holes in the storage tank is to discourage possible future use of it as a container for some edible products, which would be contaminated by residual deposits if the storage tank had ever been used for gasoline containing lead or other toxic additives. NFPA 326, "Safeguarding of Tanks and Containers for Entry, Cleaning, or Repair," and API 2015, "Safe Entry and Cleaning of Petroleum Storage Tanks," provide information on safe procedures for such operations.

**A-4.3.16.1.(1)(c)** Under certain circumstances the removal of all flammable and combustible vapours and residue from an underground storage tank before its removal from the ground may not be possible. Under these circumstances accepted precautions in co-operation with local fire officials may be necessary to ensure removal operations are conducted in a safe manner.

**A-4.4.1.2.(6)** Owners and operators of systems can use a number of methodologies to meet or exceed the leak detection requirements in Section 4.4. A list of leak detection technologies is available from the National Work Group on Leak Detection Evaluations (NWGLDE). The United States Environmental Protection Agency (EPA) has delegated authority to the NWGLDE to determine which test methodologies meet the testing protocol of the EPA.

**A-4.4.2.1.(3)** Other referenced documents also deal with vapour monitoring, such as the United States Environmental Protection Agency (EPA) document, "Evaluating Leak Detection Methods: Vapor-Phase Out-of-Tank Product Detectors." Other referenced documents also deal with groundwater monitoring, such as the EPA protocol, "Evaluating Leak Detection Methods: Liquid-Phase Out-of-Tank Product Detectors."

**A-4.4.2.1.(6)** A continuous in-tank leak detection system involves a combination of statistical inventory reconciliation (SIR) techniques and good quality liquid level and temperature data, which can be obtained from tank gauging systems or probes. It may involve monitoring only a storage tank, but when the piping system is part of the delivery system, it should include the entire system.

This system provides increased sensitivity and accuracy for the following reasons:

- it incorporates the temperature characteristic and an increased frequency of readings into the data, and
- inventory reconciliation may be conducted after each dispensing operation.

The system is designed to meet the monitoring performance standard of detecting a leak rate of 0.76 L/h with a 95% probability of detection and a maximum false positive of 5%.

**A-4.4.2.1.(7)** Low-tech secondary containment monitoring involves a visual examination of the containment area, including conventional open dyke areas or a contiguous interstitial space. Some designs may use visual examination of the liquid gauges, sumps and collection pits.

**A-4.4.2.1.(8)(b)(ii)** The presence or location of leaks in aboveground tanks can be determined through various testing methods, including ultrasonic, magnetic particle and video graphic testing. The location of leaks in the bottom of a tank shell can also be determined by vacuum testing. All testing should be conducted by individuals or companies trained in the proper care and use of the testing equipment. The choice of test methodology should be appropriate for the application.

**A-4.4.2.1.(10)** A precision test is a test approved by the PTMAA that will determine if a tank is tight or not tight. When a precision leak test has been required by the authority having jurisdiction, a leak test report shall be forwarded to the authority having jurisdiction within ten days of the test. The leak test report shall contain, as a minimum, the following information:

- (a) property and tank system owner,
- (b) operator of facility,
- (c) registration number of site,
- (d) identification of tanks tested,
- (e) date of test,
- (f) result of test,
- (g) testing firm, and
- (h) test method used.

**A-4.4.2.1.(10)(b)(ii)** The location of leaks in underground storage tanks can be determined through non-volumetric testing, which includes acoustical, tracer and external product detection methods. The location of leaks in the bottom of a tank shell can also be determined by vacuum testing. All testing should be conducted by individuals or companies trained in the proper care and use of the testing equipment. The choice of test methodology shall be appropriate for the application.

**A-4.4.2.1.(12)** Locating the single vertical check valve anywhere other than immediately under the pump will require an alternate method of line leak detection for the piping system.

**A-4.4.4.1.** Inventory reconciliation and liquid level measurements can only be conducted on storage tanks that have a metered pump, dispenser or some other type of measuring device that can determine the amount of product withdrawn over a specific period of time. Other leak detection methods must be used for piping systems and storage tanks without meters or measuring devices.

Inventory reconciliation leak detection methods used for a storage tank should follow an established procedure in order to minimize errors and determine any trend that indicates a loss of product from the tank.

The recording of pump meter readings, shipments, internal transfers, product delivery receipts or measurements of the level of contents of a storage tank shall not in and of itself constitute a record as required by Article 4.4.4.1. In addition, suppliers of flammable and combustible liquids should provide their customers with sufficient data to conduct proper inventory reconciliation. Inventories, which have been adjusted for volume through temperature compensation, must also be available to operators by volume according to meter measurements.

Inventory reconciliation is not to be confused with statistical inventory reconciliation (SIR), which is a third-party computerized analysis of tank operator inventory data.

Indications of a potential leak from inventory reconciliation practice include:

- (a) any unexplained loss or gain of 0.5 percent or more of the throughput from an underground storage tank or a loss of 2.0 percent or more of the throughput from an aboveground storage tank noted for each stored product in a calendar month, as indicated by the recording and reconciliation of inventory records,
- (b) inventory reconciliations showing five consecutive days of unexplained product losses,
- (c) inventory reconciliations showing 18 days of unexplained losses in one calendar month,
- (d) the level of water at the bottom of an underground storage tank exceeding 50 mm,
- (e) a precision leak detection test that indicates a loss or gain of product,
- (f) a pipe leak detection test that indicates a loss of product,
- (g) analysis or other method that provides evidence of product in a monitoring well or drinking water well,
- (h) the presence of free or dissolved product—whether on-site or offsite—in the soil, groundwater, surface water, sewer lines, utility lines, water supply lines, basements, crawl space or on the ground surface, or
- (i) the triggering of any warning systems associated with monitoring devices.

**A-4.5.6.11.(1)** It is good practice to space hangers for pipe having a nominal diameter of 50 mm or less not more than 3.5 m apart.

**A-4.5.9.2.(1)** Sentence 4.5.9.2.(1) is not intended to apply to small-capacity pumps that operate at low pressures, such as those normally associated with waste oil tanks. Safety measures should nevertheless be taken to protect the pump from mechanical and collision damage, and to control any spillage of liquid resulting from pump damage or failure.

**A-4.6.1.1.** Section 4.6. applies only to the portion of a property where fuel-dispensing operations are conducted. When a facility combines fuel-dispensing operations with other types of business (motor vehicle repair garage, convenience store, restaurant, etc.), Section 4.6. is intended to apply only to the fuel-dispensing operations and the adjacent business shall conform to other Sections of this Code based on its occupancy classification (assembly occupancy for a restaurant, mercantile occupancy for a convenience store, industrial occupancy for a repair garage, etc.).

**A-4.6.1.1.(2)** An increasing number of fuel-dispensing stations have natural- and petroleum-gas-dispensing equipment. Gas regulations made pursuant to the Safety Codes Act outline requirements for installation, handling and dispensing of liquefied gas fuel.

These regulations require attendants to:

- (a) be properly trained and certified,
- (b) not exceed container maximum permitted filling requirements,
- (c) not fill outdated containers or uncertified vehicles,
- (d) be in constant attendance during any transfer or filling operation, and
- (e) not use any dispenser or fill any container that shows evidence of damage, deterioration or incorrect installation.

The authority having jurisdiction in the fire discipline may request the owner or attendant to show proof of their compliance with gas regulations. Irregularities should be reported to the authority having jurisdiction in the gas discipline.

**A-4.6.2.1.(2)** These maximum capacities were deliberately chosen based on typical underground systems now in use, with due regard for fire safety. The maximum individual capacity will accommodate delivery of a single product grade that might be expected. The maximum aggregate capacity allows the service station owner or operator the flexibility needed to offer a full range of fuel products. These underground tank storage capacities are typical of automotive fuel-dispensing stations, which usually have three or four 35 000 to 50 000 L tanks for different grades of gasoline and smaller tanks for diesel fuel.

**A-4.6.2.1.(3)** The hazard to the public due to a fire at a fleet vehicle fuel-dispensing station or cardlock installation where only Class II and Class IIIA liquids such as diesel fuels are dispensed is less than that due to a fire at an automotive fuel-dispensing station where gasoline is primarily dispensed. Recognizing the fleet operators' and cardlock installations' need for relatively large quantities of on-site fuel storage is justified because greater on-site storage capacity means that the aboveground storage tanks will not have to be refilled as often, and therefore there is less chance of a spill during refill transfer operations.

**A-4.6.3.3.(1)(g)** The intent of this Clause is to ensure a spatial separation between dispensers and manhole openings for sanitary or storm water sewers. This distance is intended to prevent spilled flammable liquid or combustible liquid from accidentally entering or being flushed into sewer systems and creating a potential fire and explosion hazard. This reflects Subsection 4.1.6., Spill Control and Drainage Systems, and is to prohibit the entry of flammable liquids and combustible liquids into sewer systems, tunnels or underground structures.

It is not the intent to prohibit openings to oil and water separators that capture and separate product before wastewater is discharged into a sanitary sewer from being placed in appropriate locations.

**A-4.6.8.2.(7)(a)** Video surveillance equipment at an unattended self-service outlet provides the owner and the authority having jurisdiction with the ability to monitor accidents, spills or vandalism that may occur at the site. The authority having jurisdiction may accept a variety of surveillance monitoring methods using technologies other than those described in proprietary or central station monitoring systems. Although live, continuous surveillance is an ideal method, the intent of this Clause is to allow flexibility in the type of system used. A video surveillance tape of an accident, spill or vandalism will assist the owner and the authority having jurisdiction in identifying the cause of an incident.

A monitoring facility may include a ULC listed monitoring service company, a security monitoring service company or monitoring equipment connected to the owner's security monitoring service, which may be located at a corporate office or refinery. The authority having jurisdiction should be consulted regarding the acceptability of the monitoring facility.

**A-4.6.8.4.(1)** The authorized holder of a card or key, having received adequate training in the safe and responsible operation of the equipment, is not considered a member of the "general public." Such is not the case for coin-operated or preset dispensers, which can be operated by anyone.

**A-4.6.8.6.(2)** When gasoline vapour is allowed to enter into a diesel-fuelled engine through the air intake, there is a potential for the diesel engine to run away. In a runaway condition, a diesel engine would accelerate in an uncontrolled manner even if the ignition were switched off, resulting in damage to the engine and potentially causing a fire.

**A-4.6.8.8.(2)** Examples of signs to indicate that smoking is not permitted and that the engine ignition must be turned off while the vehicle is being refuelled:



Figure A-4.6.8.8.(2)  
Fuel-dispensing station signs

**A-4.7.4.** When used in this Subsection, the terms “loading” and “unloading” shall mean the loading and unloading of tank vehicles or tank cars.

**A-4.7.4.4.(2)** Loading racks using bottom loading often load at high flow rates. The thermal expansion capacity at the top of the compartment is often insufficient to prevent an overflow if the requested volume does not fit the compartment (operator error or retain in the compartment). Overflow sensors must be designed to allow adequate time for the control valves to close before the compartment overfills. Retain sensors and/or a well-established operator training program could achieve the same result.

**A-4.7.4.5.** The standard API RP 2003, “Protection Against Ignitions Arising out of Static, Lightning and Stray Currents,” is an example of good engineering practice for the activities described in Article 4.7.4.5.

**A-4.7.5.1.(1)** The intent of this Sentence is to ensure that portable extinguishers used at bulk plants have a sufficient rating to be effective for extra hazard Class B fires. NFPA 10, “Portable Fire Extinguishers,” provides additional guidance for the selection and placement of portable fire extinguishers for Class B fires based on extinguisher ratings and travel distances. These factors need to be considered when assessing portable extinguisher needs for the special hazards of operation and storage encountered at bulk plants.

**A-4.8.8.1.(1)(a)** Section 38 of the “Oil Pollution Prevention Regulations of the Canada Shipping Act,” published by Transport Canada, may apply to flexible cargo hoses described in this Code. The following documents are considered good engineering practice for this application:

“Guide to Purchasing, Manufacturing and Testing of Loading and Discharge Hoses for Offshore Moorings” prepared by the Oil Companies International Marine Forum. It can be obtained from: New York Nautical Instrument and Service Corporation, 158 Duane Street, New York, New York 10013 U.S.A.

“Hose Handbook” prepared by the Rubber Manufacturers Association, Inc. It can be obtained from: The Mail Room, P.O. Box 3147, Medina, Ohio 44258 U.S.A.

**A-4.9.3.4.(1)** Examples of such equipment are dispensing stations, open centrifuges, plate and frame filters, open vacuum filters and surfaces of open equipment.

**A-4.10.1.1.(1)** Beer, wine, and spirits that contain less than 20% by volume alcohol are not considered to be flammable liquids and are not regulated by this Section. Section 4.10. does not apply to wineries where distilled beverage alcohol is used to fortify wine.

**A-4.10.3.2.** Exposed steel supports do not have a 2 h fire-resistance rating, and need protection as much as timber supports for tanks. Due to the water miscibility of beverage alcohols, automatic sprinklers provide an effective means of achieving the necessary protection, provided there is sufficient space under the tank to permit their installation.

**A-4.10.3.3.(1)**

**A-4.10.3.3.(1)** The use of “good engineering practice” in the design of normal and emergency venting is intended to prevent an accumulation of flammable vapours inside the building that may present an explosion hazard. For new tank installations, this can be achieved by directing breather vents and emergency vents, equipped with flame arrestors or pressure/vacuum valves, to the outside of the building. However, on existing tank installations, installation of such vents may be impractical. Venting into the interior space may not constitute an undue hazard where certain measures are taken to ensure an adequate degree of fire safety. Such measures include, but are not limited to: the installation of automatic sprinklers throughout the tank room and under any raised tanks greater than 1.2 m in diameter; the classification of electrical equipment and wiring according to the zone classifications of the electrical regulations made pursuant to the Safety Codes Act, the provision of adequate natural or mechanical ventilation meeting the objectives of Article 4.10.6.1.; and the training of personnel in safe operating procedures.

**A-4.10.5.1.(1)** Piping and pumping systems should be designed to recognized engineering standards and accepted industry practice.

**A-5.1.2.1.(1)** Electrical regulations made pursuant to the Safety Codes Act specify wiring requirements for Class I, II and III hazardous locations. The regulations also provide specific requirements for areas where flammable or combustible liquids are stored or dispensed and wiring requirements for areas where corrosive liquids or vapours or excessive moisture are present.

**A-5.1.5.1.(5)** CAN/CSA-Z731, “Emergency Planning for Industry,” may provide information to assist in establishing a fire safety plan.

**A-5.2.3.4.(1)(b)** The following documents are examples of good engineering practice as regards safety measures for the activities described in Clause 5.2.3.4.(1)(b):

- API 2009, “Safe Welding and Cutting Practices in Refineries, Gasoline Plants and Petrochemical Plants,”
- API 2015, “Safe Entry and Cleaning of Petroleum Storage Tanks,”
- API 2201, “Welding or Hot Tapping on Equipment in Service,” and
- API 2207, “Preparing Tank Bottoms for Hot Work.”

**A-5.3.1.3.(2)** NFPA standards on dust explosions include:

NFPA 61, “Prevention of Fires and Dust Explosions in Agricultural and Food Products Facilities,”  
 NFPA 91, “Exhaust Systems for Air Conveying of Vapors, Gases, Mists, and Noncombustible Particulate Solids,”  
 NFPA 120, “Coal Preparation Plants,”  
 NFPA 484, “Combustible Metals, Metal Powders, and Metal Dusts,”  
 NFPA 654, “Prevention of Fire and Dust Explosions from the Manufacturing, Processing, and Handling of Combustible Particulate Solids,”  
 NFPA 655, “Prevention of Sulfur Fires and Explosions,”  
 NFPA 664, “Prevention of Fires and Explosions in Wood Processing and Woodworking Facilities.”

**A-5.3.3.2.(2)** A conveyor belt having a surface resistivity of less than 300 megaohms is considered to provide protection against electrostatic charge accumulation in a grain handling facility.

**A-5.5.1.1.(1)** The provisions in this Section apply only to laboratory operations involving the use of dangerous goods, including flammable or combustible liquids. They shall not apply to the incidental use of such substances or to their use for maintenance or cleaning purposes only, in which case, requirements in other sections of the Code would apply.

**A-5.5.5.1.(1)** The intent of Sentence 5.5.5.1.(1) is to limit the quantities of dangerous goods that are

- (a) stored outside of storage areas and cabinets referred to in Sentences (2) and (3), and
- (b) kept in the laboratory on a permanent or semi-permanent basis, e.g. dangerous goods that are normally kept out overnight because they are frequently needed.

The intent is not to limit the quantities that are actually “in use” during normal operations, it being understood that experiments or processes may necessitate that greater quantities be brought into the laboratory for the duration of these operations.

Also, the phrase “kept in a laboratory” does not include dangerous goods that supply and are directly connected to appliances, equipment or apparatus as these dangerous goods are considered to be “in use” rather than “in storage.”

**A-5.5.5.5.** Unstable substances are capable of a rapid release of energy by themselves. They are susceptible to reactions when exposed to air, water, pressure, heat, shock, vibration, light or sound waves. These reactions include vigorous polymerization or self-accelerating decomposition.

These substances must be stored, handled, used and processed in a location and manner that will prevent an undesired reaction. Material Safety Data Sheets provide guidance based on the properties of the unstable substance.

Perchloric acid is the most commonly used unstable substance in laboratories. Examples of other unstable substances are hydrazine, peracetic acid, picric acid and sodium hydride. Article 5.5.5.5. has been written specifically for perchloric acid and is not intended to be applied to other unstable substances unless they have properties similar to perchloric acid.

**A-5.5.5.5.(2)** Water can only be used if the unstable substance is compatible. (Perchloric acid is an example of a substance that is compatible with water.) Material Safety Data Sheets indicate whether an unstable substance is compatible with water and provide guidance on the properties and other incompatibilities of the unstable substance.

**A-5.6.1.1.** The degree of application should be determined in advance in conjunction with the authority having jurisdiction. In construction, alteration or demolition operations that do not pose an exposure hazard to other buildings, or to occupants, the degree of application of Section 5.6. may be minimal.

The degree of application of Section 5.6. to each operation should be determined in advance, as part of the fire safety plan for the operation, taking into consideration such issues as the size of the operation, exposure hazards to adjacent buildings or facilities and the site conditions. Operations can range from large multi-storey buildings to small single-storey residences and may include additions or alterations to existing buildings.

**A-5.6.1.2.(1)** Methods or materials to protect adjacent buildings or facilities can range from active to passive systems such as spatial separation, installing water curtains, using construction methods and materials that may include gypsum sheathing, or erecting a temporary fire barrier such as a fire tarpaulin.

**A-5.6.1.3.(1)(c)** The control of fire hazards in and around buildings being constructed, renovated or demolished includes fire protection for combustible construction materials and combustible refuse on the site. The sizes of piles of materials and refuse and the location of such piles in relation to adjacent buildings are factors that should be taken into consideration in determining which fire protection measures to implement. The selection of fire protection measures for demolition operations will also depend on the demolition procedure being used, the specific conditions existing on the site and the firefighting capabilities of the responding fire department.

It is the intent of this Code that requirements regarding the outdoor storage of materials stated in Section 3.3. be referred to and applied at construction and demolition sites.

**A-5.6.1.6.** It is not expected that all aspects of Subsection 3.2.5. of Division B of the Alberta Building Code 2006 are applicable to buildings, parts of buildings, facilities and associated areas undergoing construction, alteration or demolition operations for unoccupied areas.

When the temperature causes freezing conditions, the standpipe should be drained to prevent damage to the equipment. It is not expected that hoses and nozzles be made available in the building under construction, alteration or demolition operations, as they will be brought to the relevant floor by the responding fire department.

This requirement applies only in areas where the standpipe is required under the Alberta Building Code for that building.

**A-5.6.1.10.(1)** A safe area for the location of terminated building services, such as gas and fuel lines, electrical lines, water and steam piping, is in an area away from the building or part thereof that is safe enough so as not to cause damage to the building or part thereof in the event of their accidental breakage. In some cases, terminated services can be located directly outside the building or part thereof if adequate protection is provided, and in others, they can be located at the property line and/or service connection.

**A-5.6.1.11.(1)** Minimum clearances shown on certified heating equipment or as described in Part 6 of Division B of the Alberta Building Code 2006 should be provided between combustible materials and temporary heating equipment, including flues such as exhaust discharges from internal combustion engines.

**A-5.6.1.13.(4)** Guidance on methods of rendering inert tanks, piping and machinery reservoirs is available in NFPA 326, "Safeguarding of Tanks and Containers for Entry, Cleaning, or Repair."

**A-5.6.1.21.(3)** Where exits are obstructed by construction while the building is occupied, an alternative means of egress must be established. Replacing a window with a door and providing the necessary step and walkway could be an acceptable temporary solution.

**A-5.7.1.** Municipalities have the authority to regulate fireworks within their jurisdiction under the Municipal Government Act. Municipalities can use the Municipal Government Act to establish a fireworks permit bylaw allowing the municipality to permit fireworks. A fireworks permit bylaw established by a municipality may have provisions that include or exclude any activity involving fireworks.

**A-5.7.1.7.** Due to the fact that fireworks can be purchased in one municipality and discharged in another, individuals must ensure that written permission is obtained from all of the appropriate authorities if this is the case.

**A-6.1.1.2.(1)** Both the Alberta Building Code 2006 and the Alberta Fire Code 2006 assume that all fire protection features of a building, whether required by Code or voluntarily installed, will be designed in conformance with good fire protection engineering practice and will meet the appropriate installation requirements in relevant standards. Such good design is necessary to ensure that the level of public safety established by the Code requirements is not reduced by a voluntary installation. Thus, a voluntarily installed system should be maintained in operating condition, at least to the extent that it was originally intended to function, in conformance with the applicable installation standards.

**A-6.1.1.3.(1)** Notification of planned or emergency interruption or curtailment of service of fire protection installations is preferably given in advance when possible. The parties to be notified who could be affected may include, but are not necessarily limited to, the fire department, supervisory staff in the building and the occupants of the building.

**A-6.1.1.3.(3)** Water supply systems, whether municipally or privately owned, form an essential component of most fire suppression systems. When planning firefighting strategies and tactics, fire departments place a great deal of reliance on an adequate and dependable supply of water.

The responsibility for the inspection and maintenance of these water supply systems often rests with persons outside the control of the fire department. In many cases, the system is maintained and serviced by a water works or engineering department or by an outside agency.

No matter who is responsible for the system, it is essential that the agencies develop a cooperative approach and that they work together to ensure the best possible protection for the public. Failure to notify the fire department that a hydrant is out of service or that a water main has broken can cause delays, which may result in the loss of lives or excessive damage to property. Such neglect may also expose a municipality or an individual to litigation, which could otherwise be avoided.

**A-6.1.1.4.(1)** Interruption of normal operation of a fire protection system for any purpose constitutes a "temporary shutdown." Types of interruptions include, but are not limited to, periodic inspection or testing, maintenance, and repairs. During a shutdown, alternative measures are necessary to ensure that the level of safety intended by the Code is maintained.

In the shutdown of a fire alarm system, alternative measures should be worked out in cooperation with the fire department to ensure that all persons in the building can be promptly informed, and the fire department notified, should a fire occur while the alarm system is out of service.

When a sprinkler system is shut down, measures that can be taken include the provision of: emergency hose lines and portable extinguishers, extra fire watch service and, where practicable, temporary water connections to the sprinkler system.

**A-6.3.1.3.(1)** The referenced document provides for regular testing and review of the central station facilities and of the connections to the premises containing the fire alarm system. The Code does not mandate a particular series of events from initiation of the fire alarm signal circuits in the building to notification of the fire department. In some cases, the signals to the central station are automatically forwarded to the fire department, whereas in others, the central station initiates the notification of the fire department.

**A-6.3.1.4.(2)** Sentence 6.3.1.4.(2) is intended to ensure that a voice communication system that is not tested as part of an associated fire alarm system, but that will be relied upon during a fire emergency, will be tested periodically.

**A-6.4.1.1.(1)** Water-based fire protection systems include sprinkler systems, standpipes, private hydrants, hose systems, water spray fixed systems, foam-water sprinkler systems, foam-water spray systems, and fire pumps.

**A-6.5.1.1.(2)** CAN/CSA-Z32, "Electrical Safety and Essential Electrical Systems in Health Care Facilities," contains requirements over and above those relating specifically to the inspection, testing and maintenance of emergency equipment: compliance with these other requirements is not intended by the reference in Sentence 6.5.1.1.(2). The standard defines three classes of health care facilities—Class A, Class B, and Class C—but applies only to Class A and Class C facilities. Class B facilities, which accommodate people who, as a result of physical or mental disabilities, are unable to function independently and need daily care by health care professionals, are covered by CAN/CSA-C282, "Emergency Electrical Power Supply for Buildings."

**A-6.5.1.5.(1)** This can be achieved by replenishment as the result of the routine test program required by Article 6.5.1.1.

**A-7.2.1.1.(1)** It is not intended that all equipment be tested on each test occasion. A representative number of devices may be tested on each occasion provided all equipment is tested within the time period agreed to in the fire safety plan.

**A-7.2.3.4.** In practice, the only way the owner can be realistically expected to maintain ventilation equipment properly is if they have a detailed record of all the equipment plus a description of its intended operation.

**A-7.3.1.1.(1)** The testing required in Section 7.3. is not intended to be a complete assessment of the design of the smoke control system, but only a test of the individual pieces of equipment specified.

**A-7.3.2.1.(2)** It is intended that 1/3 of the system be checked each year so that at the end of each three year period the entire system has been tested.



---

## **Division C**

# **Administrative Provisions**



# **Part 1**

## **General**

<b>1.1.</b>	<b>Application</b>	
1.1.1.	Application .....	1- 1
<b>1.2.</b>	<b>Terms and Abbreviations</b>	
1.2.1.	Definitions of Words and Phrases .....	1- 1
1.2.2.	Symbols and Other Abbreviations .....	1- 1



# **Part 1 General**

## **Section 1.1. Application**

### **1.1.1. Application**

#### **1.1.1.1. Application**

**1)** This Part applies to all *buildings* and facilities covered in this Code. (See Article 1.1.1.1. of Division A.)

## **Section 1.2. Terms and Abbreviations**

### **1.2.1. Definitions of Words and Phrases**

#### **1.2.1.1. Non-defined Terms**

**1)** Words and phrases used in Division C that are not included in the list of definitions in Article 1.4.1.2. of Division A shall have the meanings defined in the Safety Codes Act, Alberta Building Code 2006, and National Plumbing Code 2005, or that are commonly assigned to them in the context in which they are used, taking into account the specialized use of terms by the various trades and professions to which the terminology applies.

**2)** Where objectives and functional statements are referred to in Division C, they shall be the objectives and functional statements described in Parts 2 and 3 of Division A.

**3)** Where acceptable solutions are referred to in Division C, they shall be the provisions stated in Parts 2 to 7 of Division B.

**4)** Where alternative solutions are referred to in Division C, they shall be the alternative solutions mentioned in Clause 1.2.1.1.(1)(b) of Division A.

**5)** For words not defined in this Code, the Safety Codes Act, Alberta Building Code 2006, or National Plumbing Code 2005, reference should be made to the Canadian Oxford Dictionary (Second Edition), published by Oxford University Press.

#### **1.2.1.2. Defined Terms**

**1)** The words and terms in italics in Division C shall have the meanings assigned to them in Article 1.4.1.2. of Division A.

### **1.2.2. Symbols and Other Abbreviations**

#### **1.2.2.1. Symbols and Other Abbreviations**

**1)** The symbols and other abbreviations in Division C shall have the meanings assigned to them in Article 1.4.2.1. of Division A.



# **Part 2**

## **Administrative Provisions**

<b>2.1.</b>	<b>Application</b>	
2.1.1.	Application .....	2- 1
<b>2.2.</b>	<b>Administration</b>	
2.2.1.	General .....	2- 1
2.2.2.	Interpretations and Variances .....	2- 2
2.2.3.	Approvals .....	2- 2
2.2.4.	Qualifications .....	2- 3
2.2.5.	Storage Tank Registration .....	2- 3
<b>2.3.</b>	<b>Alternative Solutions</b>	
2.3.1.	Documentation of Alternative Solutions .....	2- 4



## **Part 2**

# **Administrative Provisions**

## **Section 2.1. Application**

### **2.1.1. Application**

#### **2.1.1.1. Application**

**1)** Except as permitted by Sentences (2) and (3), this Part applies to all *buildings* and facilities covered in this Code. (See Article 1.1.1.1. of Division A.)

**2)** Where a provision of this Code requires compliance with one or more requirements of the Alberta Building Code, the provision is deemed to be satisfied if

- a) the *building* or fire protection measure was constructed or installed after April 1, 1974, and conforms with regulations in force under the Uniform Building Standards Act or the Safety Codes Act at the time of construction or installation, or
- b) the *building* or fire protection measure does not conform to Clause (a) but
  - i) meets the requirements of an *approved* guideline issued for a specific *occupancy*, or
  - ii) where no *approved* guideline has been issued, the *building* or fire protection measure is constructed or installed in a manner that provides a level of life safety which is acceptable to the *authority having jurisdiction*.

(See Appendix A.)

**3)** The *authority having jurisdiction* may accept alternatives to strict compliance with the Alberta Fire Code 2006 and Alberta Building Code 2006 as provided for in Clause 1.2.1.1.(1)(b) of Division A. (See Appendix Notes A-1.2.1.1.(1)(b) and A-1.1.1.1.(1) of Division A and Appendix Note A-1.1.1.2. of Division A of the Alberta Building Code 2006.)

## **Section 2.2. Administration**

(See Appendix A.)

### **2.2.1. General**

#### **2.2.1.1. Responsibility**

**1)** Unless otherwise specified, the *owner* or the *owner's* authorized agent shall be responsible for carrying out the provisions of this Code.

**2)** This Code may be cited as the Alberta Fire Code 2006. (See Appendix A.)

#### **2.2.1.2. Records**

**1)** Where this Code requires that plans be provided, or that tests, inspections, maintenance or operational procedures be performed, records shall be made and the original or a copy shall be retained at the premises for examination by the *authority having jurisdiction*.

**2)** The initial verification or test reports for each system shall be retained throughout the life of the systems.

**2.2.1.3.**

**3)** Records of tests, inspections, maintenance or operational procedures undertaken after the initial tests referred to in Sentence (2) shall be retained so that at least the current and the immediately preceding records are available.

**4)** Notwithstanding the conditions stated in Sentence (3), no record shall be destroyed within two years of being prepared.

**2.2.1.3. Intervals Between Inspections and Tests**

**1)** Longer intervals between the inspections and tests specified in this Code may be permitted provided the *authority having jurisdiction* is satisfied that such intervals do not reduce the reliability of the system or equipment requiring inspection or testing.

**2.2.2. Interpretations and Variances****2.2.2.1. Interpretations**

**1)** A person may apply to the *Chief Fire Administrator* in writing for an interpretation of this Code, and the request shall include

- a) specific Code references, and
- b) a statement identifying the ambiguity or lack of clarity resulting in the request for an interpretation.

**2)** After a request submitted pursuant to Sentence (1) has been reviewed, the *Chief Fire Administrator* may issue a written interpretation.

**3)** An interpretation issued pursuant to Sentence (2) is applicable throughout Alberta.

**2.2.2.2. Variances**

(See Appendix A.)

**1)** A person may apply to the *Chief Fire Administrator* in writing for a variance to this Code, and the request shall conform to the requirements stated in Section 2.3.

**2)** After a request submitted pursuant to Sentence (1) has been reviewed, the *Chief Fire Administrator* may issue a written variance.

**3)** The *Chief Fire Administrator* may include terms or conditions in the variance issued pursuant to Sentence (2).

**4)** A variance issued pursuant to Sentence (2) is applicable throughout Alberta.

**2.2.3. Approvals****2.2.3.1. Storage Tank Systems**

**1)** Only individuals *approved* by the *Chief Fire Administrator* are permitted to install, remove, repair or conduct precision tests of *storage tank systems*. (See Appendix A.)

**2)** No person shall install or alter any *storage tank system* referred to in this Part, unless

- a) required permits or approvals have been obtained from the *authority having jurisdiction*,
- b) plans, drawings and specifications of the system or equipment have been examined and accepted by the *authority having jurisdiction*, and
- c) the plans, drawings and specifications referred to in Clause (b) bear the stamp and seal of a professional engineer licensed to practice in Alberta.

**2.2.3.2. Fire Extinguishers**

**1)** All agencies servicing, recharging or carrying out the repair and overhaul of fire extinguishing equipment shall have their facilities and equipment certified

- a) annually by an *approved* fire testing agency, and
- b) by Transport Canada or its appointee for high-pressure hydrostatic testing equipment.

**2.2.4. Qualifications****2.2.4.1. Qualifications**

- 1) Only qualified persons shall install, test or perform maintenance on
  - a) a special fire suppression system (see Appendix A),
  - b) portable extinguishers (see Appendix A), or
  - c) a fire alarm and voice communication systems (see Appendix A).
- 2) Only qualified persons shall perform maintenance on commercial cooking equipment exhaust systems. (See Appendix A.)

**2.2.5. Storage Tank Registration****2.2.5.1. Application**

- 1) This Article does not apply to
  - a) an aboveground *storage tank* with a capacity of less than 2500 L,
  - b) a *storage tank* in an industrial *process plant*, a *refinery* or a *distillery*,
  - c) a flow-through *storage tank* used as part of the process of an industrial *plant, refinery or distillery*,
  - d) aboveground *storage tanks* that are used at a temporary location for less than 1 year, or
  - e) a *pressure vessel* that is used as a *storage tank* and is registered in accordance with the boiler and *pressure vessel* regulations made pursuant to the Safety Codes Act.

**2.2.5.2. General**

- 1) No person shall use a *storage tank* unless the tank is registered under this Article.
- 2) An application for registration shall be submitted to the *Chief Fire Administrator*.
- 3) Where a *storage tank* is divided into two or more compartments, each compartment is considered a separate part of the *storage tank system* and shall be registered separately.
- 4) On receipt of a completed application, the *Chief Fire Administrator* shall register the *storage tank* and issue a registration certificate provided the *storage tank system* is in compliance with all applicable requirements of this Code.
- 5) The *owner* of the *storage tank* shall ensure that the registration certificate is displayed on the premises where the *storage tank* is located.
- 6) A registration certificate
  - a) expires on the anniversary of the date of issue and is renewable for an additional year on application to the *Chief Fire Administrator*,
  - b) is valid only while the *storage tank* remains at the location described in the certificate, and
  - c) is not transferable.
- 7) The *Chief Fire Administrator* may cancel the registration of a *storage tank* under this Article if
  - a) the *Chief Fire Administrator* has reasonable grounds to suspect that the *storage tank* is leaking,
  - b) the *storage tank* is withdrawn from service as described in Subsections 4.3.15. and 4.3.16.,
  - c) the *storage tank* has not been installed in accordance with the Code, or
  - d) the information given on an application for registration is found to be incorrect.
- 8) When the registration of a *storage tank* is cancelled or the *storage tank* is permanently taken out of service or removed, the *owner* shall return the registration certificate to the *Chief Fire Administrator* within 30 days.
- 9) The *owner* of a *storage tank* shall forthwith notify the *Chief Fire Administrator* if a registration certificate is lost, stolen or destroyed.

**10)** Upon receiving notification from an *owner* that a registration certificate has been lost, stolen or destroyed, the *Chief Fire Administrator* shall issue a replacement.

**11)** Where a registered *storage tank* is replaced or materially modified, the *owner* shall apply for a new registration certificate in accordance with Sentence (2) within 30 days after substantial completion of the modifications, alterations, or replacement.

**12)** The *owner* of a *storage tank* shall notify the *Chief Fire Administrator*, in writing, of the sale, lease or other transfer of ownership or any relocation of a *storage tank*.

**13)** Upon receipt of satisfactory evidence of the sale, lease, or other transfer of ownership or any relocation of a *storage tank*, as described in Sentence (12), the *Chief Fire Administrator* may issue a new registration certificate that reflects the new ownership or the new location.

## Section 2.3. Alternative Solutions

### 2.3.1. Documentation of Alternative Solutions

(See Appendix A.)

#### 2.3.1.1. Documentation

**1)** Documentation conforming to this Subsection shall be provided by the person requesting the use of an alternative solution to demonstrate that the proposed alternative solution complies with this Code.

**2)** The documentation referred to in Sentence (1) shall include

- a) a Code analysis outlining the analytical methods and rationales used to determine that the proposed alternative solution will achieve at least the level of performance required by Clause 1.2.1.1.(1)(b) of Division A, and
- b) information concerning any special maintenance or operational requirements, including any component commissioning requirements, that are necessary for the alternative solution to achieve compliance with the Code after the *building* or facility is constructed.

**3)** The Code analysis referred to in Clause (2)(a) shall identify the applicable objectives, functional statements and acceptable solutions, and any assumptions, limiting or restricting factors, testing procedures, engineering studies or performance parameters that will support a Code compliance assessment.

**4)** The Code analysis referred to in Clause (2)(a) shall include information about the qualifications, experience and background of the person or persons taking responsibility for the design.

**5)** The information provided under Sentence (3) shall be in sufficient detail to convey the design intent and to support the validity, accuracy, relevance and precision of the Code analysis.

**6)** Where the design of a *building* or facility includes proposed alternative solutions that involve more than one person taking responsibility for different aspects of the design, the applicant for the permit shall identify a single person to coordinate the preparation of the design, Code analysis and documentation referred to in this Subsection.

**7)** The *authority having jurisdiction* shall forward a copy of what was accepted as an alternative solution to the *Chief Fire Administrator* to be registered as a variance.

**2.3.1.2. Retention of Documentation**

**1)** Documentation conforming to Article 2.3.1.1. shall be retained on the premises to which it pertains for each measure that has been approved by the *authority having jurisdiction* and implemented as an alternative solution to acceptable solutions

- a) in this Code, or
- b) in the Alberta Building Code 2006 that are attributed to the objectives Fire Safety (OS1), Safety in Use (OS3), Fire Protection of the Building (OP1), or Protection of Adjacent Buildings or Facilities from Fire (OP3).





# Appendix A Explanatory Material

**A-2.1.1.1.(2)** The intent of this provision is to identify areas within the Code where existing conditions are permitted to remain. A building or fire protection measure constructed or installed in compliance with previous editions of the Alberta Building Code is deemed to be in compliance with this Code.

Furthermore if an approved guideline has been issued for a specific occupancy and the building has been upgraded to the guideline, the building is deemed to meet the requirements of this Code. An example of an approved guideline is 92-FCR-012, “Approved Fire Safety Guideline for Apartment Buildings,” issued under the Alberta Fire Code 1992.

The Alberta Fire Code 2006 provides direction where compliance with the Alberta Building Code 2006 is required. Similar provision is not made for issues outside the scope of the Alberta Building Code. In these situations the authority having jurisdiction is called upon to use discretion and good judgment in making a case by case assessment of whether the safety objectives of the Alberta Fire Code 2006 are being met.

**A-2.2. Administration.** The Alberta Fire Code 2006 is established as a Regulation under the Safety Codes Act and the Safety Codes Council is responsible for recommending changes. This edition of the Alberta Fire Code 2006 is based on the 2005 National Fire Code of Canada with Alberta-specific amendments approved by the Safety Codes Council. This edition is an Objective-Based Code that includes objectives and functional statements supporting each of the technical requirements.

The Alberta Fire Code 2006 is administered uniformly in Alberta through a system of accredited municipalities, agencies and corporations. These accredited organizations are given powers to interpret, apply and enforce the provisions of the Code. An accredited authority does not have the power to waive, change or alter the Code but may accept “alternative solutions” proposed under Division A and documented under Division C of the Code. An alternative solution must be registered as a variance with the Safety Codes Council.

### Application

The application of the Alberta Fire Code 2006 to the upgrading of existing facilities to provide an acceptable degree of life safety should be based on the judgment of the authority having jurisdiction, who must deal with each case on its own merits.

The Alberta Fire Code 2006 relies on the owner or the owner’s authorized representative to comply with Code requirements. Division C of the Code provides direction for owners and authorities on applying retroactive and upgrading provisions. An owner is expected to communicate with the authority having jurisdiction prior to proceeding with upgrading, at which time the authority may use discretion to accept alternative solutions.

### Authority Having Jurisdiction

The Alberta Fire Code 2006 defines the term “authority having jurisdiction” and identifies what powers are assigned under the Safety Codes Act. The Act requires the authority having jurisdiction to have appropriate certification and designation of powers in order to administer the Code.

The term “authority having jurisdiction” refers to a safety codes officer as the individual responsible for decision making in a number of areas. In most cases, this will be a member of an accredited municipal fire department. In municipalities that use accredited agencies for inspection and enforcement the fire department may not be directly involved. All safety codes officers receive their designation of powers from the Safety Codes Council and must conduct their duties in accordance with the accredited organizations’ approved quality management plan.

This Appendix is included for explanatory purposes only and does not form part of the requirements. The numbers that introduce each Appendix Note correspond to the applicable requirements in this Division.

### Enforcement Options

There are four areas of concern related to the enforcement of the Alberta Fire Code 2006:

1. The inspection of premises,
2. Acceptances (including licenses and permits),
3. Offences and penalties, and
4. Remedial orders.

In Alberta, enforcement provisions are set out in the Safety Codes Act and municipalities are prohibited from enacting bylaws that purport to regulate a matter regulated by the Safety Codes Act.

### Inspection of Premises

Fire safety laws usually include provision for the inspection of premises, the relevant issues of which are as follows:

1. Whether all premises or only some may be entered by an authority having jurisdiction
2. Whether an authority having jurisdiction must have a warrant or a court order before entering any premises without the consent of the owner or occupant
3. For what purposes premises may be inspected
4. At what times an authority having jurisdiction may inspect premises
5. What person, if any, may accompany the authority having jurisdiction
6. Whether the authority having jurisdiction should have the power to conduct any tests on the premises relevant to the purposes of the inspection
7. Whether the authority having jurisdiction should have the power to collect and take away for analysis anything relevant to the purpose of the inspection and, if so, what obligation the authority having jurisdiction may have with respect to the return thereof
8. What obligation should be imposed upon persons such as the owner or the occupant of the premises to provide information and assistance to the authority having jurisdiction
9. Whether it should be an offence for any person to obstruct the authority having jurisdiction in the performance of his or her duties

### Acceptances (Including Licences and Permits)

The Alberta Fire Code 2006 considers that fire safety plans and some activities, materials, devices, processes, products, procedures or structures will require acceptance by an authority having jurisdiction. In some cases the acceptance process may be formalized by a license or permit; in other cases, the acceptance may be less formal.

Where the Safety Codes Act and Alberta Fire Code 2006 require an acceptance, the relevant considerations are:

1. What formalities should be prescribed for application
2. What information or materials must accompany the application
3. What criteria should be prescribed for acceptance in specific cases (for example, the minimum performance characteristics of an extinguisher, or the minimum length of apprenticeship required for a licence to carry on a particular trade)
4. What conditions may be attached to the acceptance
5. The circumstances, if any, in which an acceptance may be suspended or cancelled
6. The rights of appeal, if any, in case of a refusal, suspension or revocation of an acceptance
7. The legal consequences of not having an acceptance when so required by the fire safety law

The Alberta Fire Code 2006 assumes that acceptance in the form of a permit or license may be required under a municipal bylaw for some of the following:

1. Open air fires
2. The operation of fuel-dispensing stations and bulk plants
3. The transportation of flammable and combustible liquids
4. Fireworks displays
5. Activities that create a hazard not anticipated in the original design of a building or facility

The Alberta Fire Code 2006 requires that personnel involved in the installation and maintenance of fire alarm, fire detection and fire suppression systems, the recharging of portable extinguishers and the cleaning of kitchen exhaust systems will be qualified to perform such activities.

### Offences and Penalties

The Safety Codes Act identifies offences as being:

- When a person interferes or hinders an Administrator or authority having jurisdiction (safety codes officer)
- When a person knowingly makes false or misleading statements
- When a person fails to prepare, submit or retain any information required by the Safety Codes Act
- When a person
  - Contravenes the Safety Codes Act
  - Contravenes a condition of a permit, certificate or variance
  - Fails to carry out an action required in an order by a specific time

The Safety Codes Act assigns penalties for first and second offences and makes provisions for fines, imprisonment or both.

### Remedial Orders

The Safety Codes Act contains provisions for authorities to issue orders requiring that premises be closed or that activities cease, that the building be evacuated where an immediate danger to life or property exists, or even that an act already done be undone.

1. In what circumstances and by whom can a remedial order be issued
2. What can be ordered and in what circumstances
3. In what circumstances, if any, an order shall take immediate effect
4. Except for those cases where an order is to take immediate effect, when the order should take effect
5. What person may be required to comply with a remedial order
6. The rights of appeal in respect of remedial orders
7. The consequences of failure to comply with a remedial order

### Notification

The Alberta Fire Code 2006 establishes conditions that require the owner to notify the authority having jurisdiction when certain activities or processes are undertaken. The following are examples of conditions where notification is required:

1. When activities that could lead to a fire or an explosion are to be undertaken
2. When fire protection equipment is to be taken out of service
3. Prior to the resurfacing of bowling alleys
4. When a loss is detected from a storage tank containing flammable or combustible liquids
5. Prior to the removal from service of an underground storage tank for flammable or combustible liquids
6. Prior to fumigation being carried out in a building

**A-2.2.1.1.(2)** The Alberta Fire Code 2006 is a Regulation made pursuant to Section 65 of the Safety Codes Act.

**A-2.2.2.2.** The Chief Fire Administrator and safety codes officers both evaluate and issue variances using the procedures for alternative solutions described in Section 2.3. The difference is one of scope and application.

A variance issued by the Chief Fire Administrator under Article 2.2.2.2. is applicable throughout the province and is published on the Alberta Municipal Affairs and Housing Web site. The application to the Chief Fire Administrator must show that the issue is province-wide and is not applicable to only a single location or project. The Chief Fire Administrator, in accordance with policy, does not issue project-specific variances.

A variance issued by a safety codes officer is project-specific and does not set a precedent: each request for a variance must be evaluated on its own merits and within its own particular circumstances.

**A-2.2.3.1.(1)** The powers, duties and functions of the Chief Fire Administrator in Sentence 2.2.3.1.(1) and Subsection 2.2.5. have been delegated by the Minister to the Petroleum Tank Management Association of Alberta (PTMAA) in accordance with the Storage Tank System Management Regulation (Alta. Reg. 254/2000 as amended).

**A-2.2.4.1.(1)(a)** Persons are considered qualified in the maintenance of special fire suppression systems when

- (a) they have acquired a certificate of training from a public post-secondary educational institution,

- (b) they comply with the ULC “Certificate Service for the Installation and Servicing of Fire Suppression Systems,”<sup>(1)</sup> or
- (c) they have acquired a certificate of training from a manufacturer.

**A-2.2.4.1.(1)(b)** Persons are considered qualified in the maintenance of portable fire extinguishers when they have acquired a certificate of training from a public post-secondary educational institution, and they own or are employed by an agency that is certified by a recognized testing agency.

**A-2.2.4.1.(1)(c)** Persons are considered qualified in the maintenance of fire alarm and voice communication systems when they have acquired a certificate of training from

- (a) a public post-secondary educational institution,
- (b) the International Brotherhood of Electrical Workers (IBEW), or
- (c) the Canadian Fire Alarm Association (CFAA).

**A-2.2.4.1.(2)** Persons are considered qualified to clean commercial cooking exhaust systems when they have completed recognized training in duct cleaning procedures from outside sources such as those listed below:

- (a) International Kitchen Exhaust Cleaning Association (IKECA)
- (b) Pressure Washers of North America (PWNA)
- (c) Applied Science Technologists & Technicians of BC (ASTTBC), or
- (d) Phil Ackland / DELCO Kitchen Exhaust Cleaning School

**A-2.3.1. Documentation of Alternative Solutions.** Beyond the purposes of demonstrating compliance and acquiring a building permit, there are other important reasons for requiring that the proponent of an alternative solution submit project documentation (i.e. a compliance report) to the authority having jurisdiction and for the authority having jurisdiction to retain that documentation for a substantial period following the construction of the building or facility:

- Most jurisdictions require that a building or facility be maintained in compliance with the codes under which it was built. Alternative solutions made possible by objective-based codes may have special maintenance requirements, which would be described in the documentation.
- Documentation helps consultants perform code compliance assessments of existing buildings or facilities before they are sold and informs current owners or prospective buyers of existing buildings or facilities of any limitations pertaining to their future use or development.
- Documentation provides design professionals with the basic information necessary to design changes to an existing building or facility.
- An alternative solution could be invalidated by a proposed alteration to a building or facility. Designers and regulators must therefore know the details of the particular alternative solutions that were integral to the original design. Complete documentation should provide insight as to why one alternative solution was chosen over another.
- Documentation is the “paper trail” of the alternative solution negotiated between the designer and the regulator and should demonstrate that a rational process led to the acceptance of the alternative solution as an equivalency.
- It is possible that over time a particular alternative solution may be shown to be inadequate. It would be advantageous for a jurisdiction to know which buildings or facilities included that alternative solution as part of their design: documentation will facilitate this type of analysis.
- Project documentation provides important information to a forensic team that is called to investigate an accident or why a design failed to provide the level of performance expected.

This subject is discussed in further detail in “Recommended Documentation Requirements for Projects Using Alternative Solutions in the Context of Objective-Based Codes,” which was prepared for the CCBFC Task Group on Implementation of Objective-Based Codes and is available at [www.nationalcodes.ca](http://www.nationalcodes.ca).

---

(1) Recognizing persons certified under the ULC program restricts the individual to performing maintenance only on those systems for which they have a current manufacturer’s certificate.

# Index

## A

- Abbreviations, 1.4.2.1.[A]
- Absorbent materials
- dangerous goods spills, 3.2.7.11.
  - flammable and combustible liquid spills, 4.1.6.3., 4.2.7.11., 4.2.8.3., 4.6.7.1., 4.6.8.6., 4.6.9.2.
  - laboratories, 5.5.3.3.
- Acceptable solutions, 1.2.1.1.[A]
- Access control (see also Fencing)
- card- or key-activated dispensers at fuel-dispensing stations, 4.6.8.2., 4.6.8.4.
  - dangerous goods storage, 3.2.7.16., 3.3.2.6.
  - electrical equipment vaults, 2.6.3.2.
  - laboratories, 5.5.3.1.
  - outdoor storage tanks at fuel-dispensing stations, 4.6.2.1.
  - outdoor storage, general, 3.3.2.6.
  - piers and wharves, 4.8.7.1.
  - vacant buildings, 2.4.6.1.
- Access for firefighting, 2.5.
- buildings (to), 2.5.1.1., 2.5.1.3.
  - covered malls, 2.12.1.5.
  - fire department connections, 2.5.1.4.
  - fire protection equipment (to), 2.5.1.4., 2.12.1.5., 3.2.2.2.
  - indoor storage of dangerous goods, 3.2.7.12.
  - indoor storage of flammable and combustible liquids, 4.1.5.6., 4.2.7.8.
  - indoor storage, general, 3.2.2.2.
  - keys (to), 2.5.1.3., 2.8.1.3.
  - obstructions, 2.5.1.2., 2.5.1.4., 2.5.1.5., 3.3.2.6., 4.1.5.6., 4.1.6.2.
  - outdoor storage of flammable and combustible liquids, 4.1.5.6., 4.2.11.3., 4.3.2.4., 4.3.7.5.
  - outdoor storage of tires, 3.3.3.3.
  - outdoor storage, general, 3.3.2.5., 3.3.2.7.
  - panels and windows, 2.5.1.2.
  - roof access, 2.5.1.3.
- Access to exits (see also Means of egress), 1.4.1.2.[A]
- Administration, 2.2.[C]
- Aerosol storage, 3.2.2., 3.2.5.
- Air-supported structures, 1.4.1.2.[A], 2.9.
- Aisles (see also Access for firefighting, Individual storage areas)
- business and personal services occupancies, 2.7.1.2.
  - indoor storage of aerosols, 3.2.5.9.
  - indoor storage of combustible fibres, 3.2.6.4.
  - indoor storage of flammable and combustible liquids, 4.2.7.8., 4.2.9.3.
  - indoor storage, general, 3.2.2.2.
  - industrial occupancies, 2.7.1.2., 3.2.2.2., 3.2.5.9., 3.2.6.4., 4.2.7.8., 4.2.9.3.
  - mercantile occupancies, 2.7.1.2.
  - nonfixed seating, 2.7.1.5.
  - open floor areas, 2.7.1.2.
- Alternative solutions, 1.2.1.1.[A]
- documentation, 2.3.1.[C]
- Alternatives to Code requirements, 1.2.1.1.[A], 2.12.1.3., 3.1.1.4., 3.2.1.1., 3.3.2.15., 4.1.1.1., 4.2.3.3., 4.3.1.2., 4.3.9.1., 4.3.12.8., 4.5.2.2., 5.1.2.2.
- Ammonium nitrate storage, 3.1.2.2., 3.2.2., 3.2.9.
- Appliances (see also Heating, ventilating and air-conditioning systems), 1.4.1.2.[A]
- Application of Code, 1.1.1.1.[A]
- Application of Division B, 1.3.3.[A]
- Approvals
- fire extinguishers, 2.2.3.2.[C]
  - storage tank systems, 2.2.3.1.[C]
- Assembly occupancies (Group A), 1.4.1.2.[A]
- drapes, curtains and decorative materials, 2.3.2.1.
  - emergency planning, 2.8.
  - fire safety plan, 2.8.1.1., 2.8.2.1., 2.8.2.3.
  - flaming meals and drinks, 2.4.3.2.
  - flammable and combustible liquids, 4.2.4., 4.2.6., 5.5.5.1.
  - Group A major occupancies, 5.5.5.1.
  - hazardous activities in, 2.1.2.2.
  - means of egress, 2.7.1.5.
  - nonfixed seating, 2.7.1.5.
  - occupant load signs, 2.7.1.4.
  - open flames in processions, 2.4.3.1.
  - supervisory staff, 2.8.2.3.
  - tents and air-supported structures, 2.9.3.2.
- Atmospheric storage tanks (see also Storage tanks for flammable and combustible liquids), 1.4.1.2.[A], 4.3.1.2., 4.3.1.3., 4.3.4.1.
- Attendants at fuel-dispensing stations, 4.6.4.2., 4.6.8., 4.6.9.2.
- Authority having jurisdiction, 1.4.1.2.[A], 2.1.1.1.[C], 2.1.2.2., 2.2.1.2.[C], 2.2.1.3.[C], 2.2.3.1.[C], 2.3.1.2.[C], 2.4.1.3., 2.4.4.3., 2.4.4.5., 2.5.1.3., 2.7.1.4., 2.9.3.4., 2.15.1.1., 3.3.2.16., 3.3.2.17., 3.3.6.7., 4.1.5.5., 4.1.6.4., 4.3.3.4., 4.3.8.1., 4.3.15.1.,

[A] – Reference occurs in Division A. [C] – Reference occurs in Division C. All other references occur in Division B.

4.3.15.2., 4.3.16.1., 4.3.16.2., 4.4.4.1., 4.5.6.5.,  
4.6.4.2., 4.6.8.2., 4.6.10.4., 4.11.2.6., 5.1.5.1.,  
6.1.1.2., 6.1.1.5., 7.1.1.3., 7.2.3.1., 7.3.1.1.

## B

Balloons, flammable gases prohibited, 2.4.4.2.  
Barbecues, solid fuel-fired, 2.4.5.1.  
Basements, 1.4.1.2.[A]  
    ammonium nitrate storage buildings, 3.2.9.2.  
    flammable and combustible liquids, 4.1.5.8.,  
    4.2.4.3., 4.2.5.2., 4.2.7.5.  
    pits for submerged pumps, 4.5.9.3., 4.6.2.6.  
    process plants, 4.9.3.3.  
Blower engines for air-supported structures, 2.9.3.6.  
Boarding houses, 2.11.  
Boil-over liquids, 4.3.2.1.  
Bonding (see Grounding and bonding)  
Bowling alleys (see Floor finishing)  
Breeching, 1.4.1.2.[A]  
Bulk plants, 4.7.  
Business and personal services occupancies (Group  
D), 1.4.1.2.[A]  
    aisles in open floor areas, 2.7.1.2.  
    drapes, curtains and decorative materials, 2.3.2.1.  
    flammable and combustible liquids, 4.2.6., 5.5.5.1.  
    Group D major occupancies, 5.5.5.1.  
    means of egress, 2.7.1.2.

## C

Care or detention occupancies (Group B), 1.4.1.2.[A]  
    drapes, curtains and decorative materials, 2.3.2.1.  
    emergency planning, 2.8.  
    fire drill frequency, 2.8.3.2.  
    fire safety plan, 2.8.1.1., 2.8.2.1., 2.8.2.2.  
    flaming meals and drinks, 2.4.3.2.  
    flammable and combustible liquids, 4.2.6., 4.2.10.3.,  
    5.5.5.1.  
    Group B major occupancies, 2.8.3.2., 5.5.5.1.  
    hazardous activities in, 2.1.2.2.  
    hospital textiles, 2.3.2.3.  
    open flames in processions, 2.4.3.1.  
    supervisory staff, 2.8.2.2.  
Cargo hose for flammable and combustible liquids,  
4.8.7.2., 4.8.7.3., 4.8.8., 4.8.9.1., 4.8.11.  
Cargo pumps for flammable and combustible liquids,  
4.8.9., 4.8.10.  
Cathodic protection (see Corrosion protection)  
Change in fire hazard, 2.1.2.2., 2.1.3.1., 2.1.3.5., 2.8.2.1.,  
2.12.1.2.  
Chimneys, flues and flue pipes, 1.4.1.2.[A], 2.6.1.4.  
Class A fires, 1.4.1.2.[A]  
Class B fires, 1.4.1.2.[A], 4.3.13.4.  
Class C fires, 1.4.1.2.[A]  
Class D fires, 1.4.1.2.[A]  
Classification  
    aerosols, 3.2.5.2.  
    buildings, 2.1.2., 3.2.9.2., 4.2.4.1., 4.10.2.1.

    compressed gases, 3.2.7.1.  
    corrosive substances, 3.2.7.1.  
    dangerous goods, 3.1.2.1., 3.2.7.1., 4.2.2.3.  
    dedicated storage areas for aerosols, 3.2.5.4.,  
    3.2.5.6., 3.2.5.7.  
    flammable and combustible liquids, 3.2.7.1., 4.1.2.,  
    4.2.2.3.  
    flammable solids, 3.2.7.1.  
    hazardous locations for electrical equipment,  
    3.1.4.1., 4.1.4.1., 5.1.2.1., 5.5.3.4.  
    heated combustible liquids, 4.1.2.2.  
    major occupancies, 2.1.2.  
    oxidizing substances, 3.2.7.1.  
    poisonous and infectious substances, 3.2.7.1.  
    reactive substances, 3.1.2.5.  
    stored commodities, 3.2.1.1.  
    stored plastics, 3.2.1.1.  
    used lubricating oil, 4.1.2.3.  
Clearances  
    aboveground outdoor piping for flammable and  
    combustible liquids, 4.5.6.3.  
    building openings (from), 3.3.5.3., 4.1.7.4., 4.3.5.2.,  
    4.3.6.4., 4.3.10.3., 4.3.11.3., 4.5.9.1., 4.6.3.3., 4.6.6.4.  
    buildings and property lines (from), 4.2.11.1.,  
    4.3.2.1., 4.3.8.1., 4.5.9.1., 4.6.3.3., 4.6.6.4., 4.7.2.4.,  
    4.7.4.1., 4.9.2.1.  
    bulk plant loading and unloading facilities, 4.7.4.1.  
    combustible fibres, 3.2.6.4.  
    floors and roofs, 3.2.2.3., 3.2.7.5., 4.2.7.7.  
    heating equipment, 2.6.1.5.  
    indoor container storage of flammable and  
    combustible liquids, 4.2.7.7.  
    indoor storage, general, 3.2.2.3.  
    indoor storage of dangerous goods, 3.2.2.3.  
    indoor storage tanks for flammable and  
    combustible liquids, 4.3.13.2.  
    liquefied petroleum gas cylinders and tanks,  
    4.3.2.3.  
    loading facilities at bulk plants, 4.7.4.1.  
    outdoor container storage of flammable and  
    combustible liquids, 4.2.11.1., 4.7.2.4.  
    outdoor storage, general, 3.3.2.3., 3.3.3.2.  
    outdoor storage of compressed gases, 3.3.5.3.,  
    4.3.2.3.  
    outdoor storage of dangerous goods, 3.3.4.2.  
    outdoor storage tanks for flammable and  
    combustible liquids, 4.3.2.1., 4.3.2.3., 4.7.4.1.  
    piers and wharves, 4.8.2.1.  
    secondary containment walls, 4.3.2.3., 4.3.7.4.  
    sprinkler deflectors, 3.2.2.3., 4.2.7.7.  
    walls, 3.2.2.3., 3.2.6.4., 4.2.7.7., 4.3.13.2.  
Closed containers (see also Containers for flammable  
and combustible liquids), 1.4.1.2.[A]  
Closures, 1.4.1.2.[A], 2.2.2.  
    fire separations, obstructions, 2.2.2.4.  
    smoke control measures in high buildings, 7.2.3.1.,  
    7.3.  
Combustible construction, 1.4.1.2.[A]  
    chimneys, flue pipes and appliances, clearances,  
    2.6.1.5.

- indoor storage of flammable gases, 3.2.8.2.
- piers and wharves, 4.8.9.2.
- Combustible display or exhibit, 2.3.1.5.
- Combustible dusts (see also Dust-producing processes), 1.4.1.2.[A]
- Combustible fibres, 1.4.1.2.[A]
  - electrical installations, 3.1.4., 5.1.2.
  - indoor storage, 3.2.2., 3.2.6.
- Combustible liquids (see also Flammable and combustible liquids), 1.4.1.2.[A]
- Combustible materials
  - accumulation and removal, 2.4.1.1., 2.4.1.2., 3.2.7.4., 3.3.2.7., 4.1.5.4., 5.2.3.2., 5.3.2.2.
  - artwork and teaching aids, 2.3.1.3.
  - compressed gases (near), 3.2.8.3.
  - construction sites, 5.6.1.3.
  - dangerous goods (near), 3.2.7.4., 3.2.7.17., 3.3.4.4.
  - day-care centres, 2.10.3.
  - demolition sites, 5.6.1.3.
  - deposits and residue, 5.5.3.4., 5.5.3.6.
  - flammable and combustible liquids (near), 4.1.5.4., 4.2.7.10.
  - heating equipment (near), 2.6.1.5.
  - hot works (near), 5.2.3.
  - indoor storage of, 3.2.
  - laboratories, 5.5.3.2., 5.5.3.5., 5.5.4.4.
  - open flames (near), 2.4.3.3.
  - outdoor storage of, 3.3.
  - oxidizing substances (near), 3.2.7.8.
  - piping for flammable and combustible liquids (near), 4.5.6.8.
  - tents and air-supported structures, 2.9.3.2.
- Commercial cooking equipment, 2.6.1.9.
- Compliance, 1.2.1.1.[A]
- Compressed gases (see also Dangerous goods)
  - ambient conditions, 3.1.2.2., 3.2.7.3.
  - balloons (to inflate), 2.4.4.2.
  - classification, 3.1.2., 3.2.7.1.
  - corrosive gases, 3.2.8.3., 3.3.5.3.
  - cylinders, 3.1.2.4., 5.2.2.
  - electrical installations, 3.1.4., 5.1.2.
  - flammable gases, 2.4.4.2., 2.12.1.7., 2.12.1.9., 3.1.1.4., 3.2.8.2., 3.3.5.3., 4.3.2.3., 4.6.1.1., 5.2.3.4., 5.2.3.5.
  - fuel-dispensing stations, 3.1.1.4., 4.6.1.1., 4.6.3.3.
  - hot works, 5.2.2., 5.2.3.4., 5.2.3.5.
  - indoor cylinder storage, 3.2.7.5., 3.2.7.9., 3.2.8.
  - laboratories, 5.5.5.3.
  - liquefied petroleum gas, 3.1.1.4., 4.3.2.3., 4.6.1.1., 4.6.3.3.
  - manufacturing, filling, distributing, 3.1.1.4.
  - natural gas, 3.1.1.4., 4.6.1.1., 4.6.3.3.
  - outdoor cylinder storage, 3.3.5.
  - oxidizing gases, 3.2.8.3.
  - piping, 5.2.3.4., 5.2.3.5., 5.5.5.3.
  - poisonous gases, 3.2.8.3., 3.3.5.3.
  - prohibited locations, 3.1.2.4.
  - propane, 3.1.1.4., 4.3.2.3., 4.6.1.1., 4.6.3.3.
- Conflicting requirements, 1.5.1.2.[A]
- Construction sites, 5.6.
  - fire safety practices, 5.6.
- Containers for dangerous goods, 3.1.2.3.
  - compressed gases, 2.4.4.6., 3.1.2.4.
  - damaged or leaking, 3.2.7.4., 3.3.4.7.
  - identification, 3.2.7.13., 3.3.4.5., 5.5.5.3., 5.5.5.6.
  - intermodal shipping containers, 3.3.4.8.
  - organic peroxides, 3.2.7.5.
  - reactive substances, 3.1.2.5.
  - storage arrangements, 3.2.7.5., 3.3.4.2.
- Containers for flammable and combustible liquids, 4.2.
  - assembly occupancies, 4.2.4.
  - basement storage, 4.1.5.8., 4.2.4.3., 4.2.7.2.
  - bonding and grounding, 4.1.8.2.
  - bulk plants, 4.7.2.4.
  - business and personal services occupancies, 4.2.6.
  - care or detention occupancies, 4.2.6.
  - closed containers, 3.2.1.1., 3.2.3.1., 3.2.3.2., 3.2.3.3., 4.1.7.2., 4.2.1.1., 4.2.5.2., 4.2.6.2., 4.2.7.1., 4.2.8.2., 4.2.10.1., 4.6.2.2., 4.7.2.1., 4.10.2.1., 4.10.4.2., 5.5.5.4.
  - containers, 4.2.3.
  - dispensing and transfer, 4.1.7., 4.1.8.3., 4.2.5.3., 4.2.7.4., 4.2.8.3., 4.2.9., 4.7.3.3.
  - distilleries, 4.10.3., 4.10.4.
  - drums, 4.2.3.1., 4.10.3.1., 4.10.4.1., 4.10.4.2.
  - dwelling units, 4.1.5.8., 4.2.4.5., 4.2.4.6.
  - educational facilities, 4.2.6.
  - fuel-dispensing stations, 4.6.2.
  - identification, 4.2.3.2., 4.6.2.2., 5.5.5.6.
  - incidental use, 4.2.8.
  - industrial occupancies, 4.2.7.
  - laboratories, 4.1.1.1., 5.5.5.
  - mercantile occupancies, 4.2.5.
  - outdoor storage, 4.2.11.
  - plastic or glass containers, 4.2.3.3.
  - portable containers, 4.2.3.1.
  - portable tanks, 4.2.1.1., 4.2.3.1., 4.2.8.2.
  - prohibited locations, 4.2.2.1.
  - refrigerated storage, 4.1.4.1., 5.5.5.4.
  - residential occupancies, 4.2.4.
  - safety containers, 4.2.3.1.
  - separation from other dangerous goods, 4.2.2.3., 4.2.6.5., 4.2.7.9., 4.2.8.3.
  - storage arrangements, 4.2.2.2., 4.2.5.1., 4.2.7.5., 4.2.9.1., 4.2.9.3., 4.2.11.1.
  - storage cabinets, 4.2.10.
- Contaminated soil, 4.1.6.3., 4.3.8.7.
- Corrosion protection
  - aboveground storage tanks for flammable and combustible liquids, 4.3.1.2., 4.3.1.5., 4.3.3.1., 4.10.3.1.
  - ammonium nitrate, 3.2.9.2.
  - containers for flammable and combustible liquids, 4.2.3.3., 4.10.3.1.
  - dangerous goods, 3.2.7.7., 5.5.2.1., 5.5.4.4.
  - piping for flammable and combustible liquids, 4.5.2.2., 4.5.3., 4.6.2.4., 4.10.5.1.
  - underground storage tanks for flammable and combustible liquids, 4.3.1.2., 4.3.9.
- Corrosive substances (see Dangerous goods)

Covered malls, 2.12.  
fire safety plan, 2.12.1.1.  
Cylinders, gases (see Compressed gases)

## D

Dangerous goods (see also Containers for dangerous goods), 1.4.1.2.[A]  
access control, 3.2.7.16., 3.3.2.6., 5.5.3.1.  
access for firefighting, 3.2.7.12., 3.3.2.5.  
ambient conditions, 3.1.2.2., 3.1.2.5., 3.2.7.3., 3.3.4.7.  
classification, 3.1.2.1., 3.1.2.5., 3.2.7.1., 4.1.2.  
fire safety plan, 3.1.2.6., 3.2.2.5., 3.3.2.9., 4.1.5.5.  
fire safety practices, 2.4.4.  
fire suppression systems, 3.2.7.5., 3.2.7.9.  
indoor storage, 3.2.2., 3.2.7.  
interior finish materials, 3.2.7.8., 5.5.2.1.  
laboratories, 5.5.5.  
outdoor storage, 3.3.2., 3.3.4.  
packages and containers, 3.1.2.3., 3.2.7.4., 3.3.4.7.  
placards, 3.2.7.14.  
refrigerated storage, 3.1.2.2.  
separation from combustibles, 3.2.7.8., 3.2.7.17., 3.3.4.4., 5.5.3.2.  
separation from other dangerous goods, 3.2.7.6., 3.3.4.3., 4.2.2.3.  
small quantity exemptions, 3.2.7.1.  
spill control, 3.2.7.4., 3.2.7.11., 3.3.2.13., 5.5.3.3.  
training, 3.2.7.15., 3.3.4.6., 5.5.3.1.  
Day-care centres, 2.10.  
fire drill frequency, 2.8.3.2.  
fire prevention inspections, 2.10.4.1.  
handicapped children, 2.10.2.1.  
staffing ratios, 2.10.2.1.  
Dedicated storage areas for aerosols, 3.2.5.4.  
type A, 3.2.5.6.  
type B, 3.2.5.7.  
Definitions, 1.4.1.[A]  
Demolition sites, 5.6.  
continuity of fire protection, 5.6.1.6.  
fire safety practices, 5.6.  
Dikes (see Secondary containment for aboveground storage tanks)  
Dipping and coating processes, 5.4.6.  
Dispensers for flammable and combustible liquids  
bulk plants, 4.7.3.2.  
card- or key-activated, 4.6.4.2., 4.6.8.3., 4.6.8.4.  
containers, 4.1.8.3., 4.1.8.4., 4.2.9.4., 4.6.2.2.  
fuel-dispensing stations, 4.6.3., 4.6.4.2., 4.6.8.3., 4.6.8.4.  
outdoor storage, general, 3.3.2.12.  
shut-off devices, 4.6.4.  
shut-off valves, 4.5.7.2., 4.6.6.  
storage tanks, 4.1.8.3., 4.1.8.4.  
underground storage tanks, 4.3.10.3.  
Dispensing and transfer of flammable and combustible liquids, 3.2.7.5., 3.2.9.3., 3.3.2.12., 4.1.7., 4.1.8., 4.2.5.3., 4.2.7.4., 4.2.8.3., 4.2.9., 4.3.13., 4.5.9., 4.5.10., 4.6.3., 4.6.4., 4.6.6., 4.7.3., 4.7.4., 4.8.7., 4.8.8., 4.8.11., 4.11.3.

Distilled beverage alcohols, 1.4.1.2.[A], 3.2.2., 3.2.3., 4.10.  
Distilleries, 1.4.1.2.[A], 4.10.  
Doors in fire separations, 2.2.2.4.  
Doors in means of egress  
impediments, 2.7.2.1.  
release hardware, 2.7.2.1.  
smoke control measures in high buildings, 7.3.1.2. tests, 2.7.2.  
Drainage for flammable and combustible liquids (see also Spill control), 4.1.6.  
dispensing and transfer of flammable and combustible liquids, 4.2.8.3., 4.6.3.3.  
distilleries, 4.10.7.  
helicopter landing areas, 2.13.2.6.  
piping for flammable and combustible liquids in trenches, 4.5.6.9.  
secondary containment for aboveground storage tanks, 4.3.7.8.  
spills and leaks, 4.1.6.2., 4.1.6.3.  
Drums (see Containers for flammable and combustible liquids)  
Dry cleaning plants, 5.4.2.  
Dry powder coating operations, 5.4.5.  
Dust collection, 5.3.1.3.  
dust collectors, 5.3.1.4.  
dust removal, 5.3.1.2.  
grain handling and storage, 5.3.3.1.  
woodworking operations, 5.3.2.1.  
Dust-producing processes, 5.3.  
Dwelling units, 1.4.1.2.[A]  
flammable and combustible liquids, 4.1.5.8., 4.2.4.5., 4.2.4.6.  
smoke alarms, 2.1.3.3.  
ventilating and air-conditioning systems, 2.6.1.6.

## E

Educational facilities  
fire drill frequency, 2.8.3.2.  
flammable and combustible liquids, 4.2.6., 5.5.5.1.  
Egress (see Means of egress)  
Electrical equipment vaults, 2.6.3.  
Electrical installations, 3.1.4., 4.1.4., 5.1.2.  
dispensers at fuel-dispensing stations, 4.6.3.3.  
electrical equipment vaults, 2.6.3.  
fire safety practices, 2.4.7.  
flammable and combustible liquids, 4.1.4.  
floor finishing, 5.4.4.4.  
fumigation, 5.4.3.4.  
hazardous locations, 3.1.4.1., 4.1.4.1., 5.1.2.1.  
heating of piping for flammable and combustible liquids, 4.5.8.3., 4.5.8.4.  
indoor storage tanks for flammable and combustible liquids, 4.3.12.7.  
laboratories, 5.5.3.4.  
outdoor storage beneath power lines, 3.3.2.4.  
refrigerators for flammable and combustible liquids, 5.5.5.4.

- tents and air-supported structures, 2.9.3.1.
  - use and maintenance, 2.4.7., 5.5.3.6.
  - Elevators
    - maintenance, 7.1.1.4.
    - tests, 7.2.2.
  - Emergency lighting
    - inspection, 6.5.1.6., 6.5.1.7.
    - tests, 6.5.1.6.
  - Emergency planning (see also Fire safety plan), 2.8.
    - assembly occupancies, 2.8.2.3.
    - care or detention occupancies, 2.8.2.2.
    - construction sites, 5.6.1.3.
    - demolition sites, 5.6.1.3.
    - fire emergency procedures, 2.8.1.1.
    - fire safety plan, 2.8.2.1.
    - flammable and combustible liquids, 4.1.5.5.
    - fuel-dispensing stations, 4.6.4.2., 4.6.8.4.
    - hazardous locations, 5.1.5.
    - high buildings, 2.8.2.4.
    - indoor storage, general, 3.2.2.5.
    - indoor storage of dangerous goods, 3.2.7.15.
    - laboratories, 5.5.3.1.
    - outdoor storage, general, 3.3.2.9.
    - piers and wharves, 4.8.6.1.
    - pipng for flammable and combustible liquids, 4.5.9.4., 4.5.10.
    - process plants, 4.9.4.4.
    - refineries, 4.9.4.4.
    - tank vehicles, 4.11.3.4.
    - training of supervisory staff, 2.8.1.2.
  - Emergency power systems, 6.5.
    - instructions for switching to, 6.5.1.3.
    - unit lighting equipment, 6.5.1.6.
  - Emergency shutoff valves, in schools, 2.4.4.4.
  - Engines (see Internal combustion engines)
  - Evacuation of buildings, procedures, 2.8.2.1.
  - Exit doors (see Doors in means of egress)
  - Exit lighting, 2.7.3.
  - Exit signs, 2.7.3.
  - Exits (see also Means of egress), 1.4.1.2.[A]
  - Explosion prevention systems, 4.3.2.5., 4.9.4.2., 5.3.1.7.
  - Explosion venting
    - container storage of flammable and combustible liquids, 4.2.9.5.
    - dust-producing processes, 5.3.1.6.
    - flammable gas storage, 3.2.8.2.
    - grain handling and storage, 5.3.3.2.
    - processing buildings, 4.9.3.1.
    - processing equipment, 4.9.2.1., 4.9.4.2.
    - storage tanks for flammable and combustible liquids, 4.3.13.3.
  - Explosives
    - handling and use, 5.1.1.2.
    - storage, 3.1.1.3.
  - Exterior passageways, 2.7.1.7.
- F**
- Fencing
    - aerosol storage, 3.2.5.6.
    - bulk plants, 4.7.2.6., 4.7.3.2.
    - outdoor container storage of flammable and combustible liquids, 4.2.11.5.
    - outdoor storage, general, 3.3.2.6.
    - outdoor storage of compressed gases, 3.3.5.2.
    - piers and wharves, 4.8.7.1.
  - Festive decorations, 2.3.1.3.
  - Fiberglass reinforced plastic products (see Organic peroxide coating operations)
  - Fire alarm systems
    - fire safety plan, 2.8.2.1., 3.3.2.9.
    - helicopter landing areas, 2.13.2.2.
    - inspection, tests and maintenance, 6.3.1., 7.2.3.2., 7.2.4.2.
    - installation, 2.1.3.1.
    - shutdown for repairs, 6.1.1.4.
    - smoke alarms, 2.1.3.3., 6.7.1.1.
    - tents and air-supported structures, 2.9.3.5.
    - transmission to fire department, 2.8.2.7.
    - voice communication, 2.1.3.2., 6.3.1.4.
  - Fire compartments (see also Fire separations), 1.4.1.2.[A]
  - Fire dampers (see also Closures), 1.4.1.2.[A]
  - Fire detection systems
    - inspection and tests, 6.3.1.2.
    - where required, 2.1.3.1.
  - Fire drills
    - fire safety plan, 2.8.2.1.
    - frequency, 2.8.3.2.
    - laboratories, 5.5.3.1.
    - procedures, 2.8.3.1.
  - Fire emergency procedures (see also Emergency planning), 2.8.
  - Fire extinguishers (see Portable extinguishers)
  - Firefighting procedures (see also Access for firefighting)
    - emergency planning, 2.8.2.1.
    - employee training, 3.2.7.15., 4.5.10.2.
  - Fire-protection rating (see also Closures), 1.4.1.2.[A]
  - Fire protection systems (see also Fire alarm systems, Fire suppression systems, Sprinkler systems, Standpipe and hose systems)
    - access to fire protection equipment, 2.5.1.4., 2.12.1.5., 3.2.2.2., 3.3.2.7.
    - access to keys, 2.8.1.3.
    - change in fire hazard, 2.1.3.1., 2.1.3.5.
    - commercial cooking equipment, 2.6.1.9.
    - employee training, 3.2.7.15., 4.5.10.2.
    - maintenance, 2.1.3.1., 6.1.1.2.
    - outdoor storage, general, 3.3.2.7., 3.3.2.15.
    - outdoor storage tanks for flammable and combustible liquids, 4.3.2.1., 4.3.2.5.
    - process plants, 4.9.4.3.
    - processing equipment, 4.9.2.1.
    - shutdown for repairs, 6.1.1.4.
    - special hazards, 2.1.3.5., 4.1.5.1., 6.6.1.1.
    - tents and air-supported structures, 2.9.3.5.
  - Fire-resistance rating (see also Fire Separations), 1.4.1.2.[A]
  - Fire safety plan, 2.8.1.1., 2.8.2.
    - assembly occupancies, 2.8.2.3.

care or detention occupancies, 2.8.2.2.  
 commercial cooking equipment, 2.6.1.9.  
 construction sites, 5.6.1.3.  
 covered malls, 2.12.1.1.  
 dangerous goods, 3.1.2.6., 3.2.2.5.  
 day-care centres, 2.10.4.1.  
 demolition sites, 5.6.1.3.  
 distribution, 2.8.2.6.  
 flammable and combustible liquids, 4.1.5.5.,  
 4.5.10.6.  
 hazardous processes and operations, 5.1.5.  
 high buildings, 2.8.2.4.  
 hot works, 5.2.3.7.  
 hotels and motels, 2.8.2.7.  
 indoor storage, general, 3.2.2.5.  
 laboratories, 5.5.3.1.  
 measures, 2.8.2.1., 3.2.2.5., 4.1.5.5.  
 outdoor storage, general, 3.3.2.9.  
 placards, 3.2.7.14., 4.3.13.5.  
 posting, 2.8.2.7.  
 process plants, 4.9.4.4.  
 radioactive materials, 3.1.2.6., 5.1.5.  
 refineries, 4.9.4.4.  
 retention, 2.8.2.5.  
**Fire separations, 1.4.1.2.[A], 2.2.**  
 aerosol storage, 3.2.5.7.  
 ammonium nitrate storage, 3.2.9.2.  
 closures, 2.2.2.  
 combustible fibre storage, 3.2.6.3.  
 compressed gas storage, 3.2.8.2., 3.2.8.3.  
 container storage of flammable and combustible  
 liquids, 4.2.6.3., 4.2.7.3., 4.2.7.5., 4.2.9.1.  
 damaged, 2.2.1.2., 2.2.2.2.  
 dangerous goods storage, 3.2.7.5., 3.2.7.9.  
 incidental use of flammable and combustible  
 liquids, 4.2.8.3.  
 laboratories, 5.5.2.2.  
 openings, 2.2.2.1.  
 outdoor storage, general, 3.3.2.14., 3.3.3.2.  
 processing buildings, 4.9.3.2.  
 storage tanks for flammable and combustible  
 liquids, 4.3.12.4., 4.3.12.5., 4.3.13.1.  
 tire storage, 3.2.4.2.  
**Fire stop flaps, 1.4.1.2.[A]**  
 inspection and maintenance, 2.2.2.4.  
**Fire suppression systems (see also Sprinkler systems),**  
 2.1.3.5., 6.6.  
 distilleries, 4.10.3.2.  
 indoor container storage of flammable and  
 combustible liquids, 4.2.7.5., 4.2.7.6., 4.2.9.1.  
 indoor storage of dangerous goods, 3.2.7.5., 3.2.7.9.  
 indoor storage tanks for flammable and  
 combustible liquids, 4.3.12.4.  
 laboratories, 5.5.4.3., 5.5.4.4.  
 outdoor storage tanks for flammable and  
 combustible liquids, 4.3.2.1., 4.3.2.5.  
 process plants, 4.9.4.3.  
**Fire watch**  
 construction sites, 5.6.1.15.  
 demolition sites, 5.6.1.15.  
 helicopter operations (during), 2.13.2.4.  
 hot works, 5.2.3.1., 5.2.3.3.  
 tents and air-supported structures, 2.9.3.4.  
**Firewalls, 1.4.1.2.[A]**  
 container storage of flammable and combustible  
 liquids, 4.2.7.5.  
**Fireworks (see also Explosives)**  
 fireworks, 3.1.1.3., 5.1.1.2., 5.7.  
 indoor storage, 3.2.10.  
**First storey, 1.4.1.2.[A]**  
 dispensers at fuel-dispensing stations, 4.6.3.3.  
 indoor container storage of flammable and  
 combustible liquids, 4.2.4.3., 4.2.7.5.  
 indoor storage tanks for flammable and  
 combustible liquids, 4.3.12.4.  
**Flame resistance, 2.3.2.**  
**Flame retardant treatment, 2.3.2.2., 2.9.2.1.**  
**Flame-spread rating, 1.4.1.2.[A], 2.3.1., 5.5.4.4.**  
**Flammable and combustible liquids (see also**  
**Containers for flammable and combustible**  
**liquids, Storage tanks for flammable and**  
**combustible liquids), 1.4.1.2.[A]**  
 aboveground storage tanks, 4.3.2.  
 absorbent materials, 4.1.6.3., 4.2.7.11., 4.6.8.6.,  
 4.6.9.2., 5.5.3.3.  
 assembly occupancies, 4.2.4.  
 basement storage, 4.1.5.8., 4.2.4.3., 4.2.5.2., 4.2.7.5.,  
 4.3.12.4., 4.9.3.3.  
 bonding and grounding, 4.1.8.2.  
 bulk plants, 4.7.  
 business and personal services occupancies, 4.2.6.  
 care or detention occupancies, 4.2.6.  
 classification, 4.1.2.  
 containers, 4.2., 4.2.3.  
 covered malls, 2.12.1.7.  
 day-care centres, 2.10.3.3.  
 dipping and coating processes, 5.4.6.  
 dispensing and transfer, 4.1.8., 4.2.5.3., 4.2.7.4.,  
 4.2.8.3., 4.2.9., 4.5.9., 4.6.3., 4.7.3., 4.7.4., 4.8.7.,  
 4.11.3.  
 distilled beverage alcohols, 3.2.2., 3.2.3., 4.10.  
 distilleries, 4.10.  
 drainage, 4.1.6.2., 4.3.7.8.  
 dry cleaning plants, 5.4.2.  
 dwelling units, 4.1.5.8., 4.2.4.5., 4.2.4.6.  
 educational facilities, 4.2.6.  
 electrical installations, 3.1.4., 4.1.4., 5.1.2.  
 emergency planning, 4.1.5.5.  
 fire prevention and protection, 4.1.5.  
 fire safety practices, 2.4.4.1.  
 flash point, 4.1.3.  
 floor finishing, 5.4.4.  
 fuel-dispensing stations, 4.6.  
 fuel supply, 4.3.12.2.  
 fumigation, 5.4.3.  
 handling, 4.1.8.  
 hot works, 4.1.5.7., 4.11.2.2., 5.2.3.4.  
 identification, 4.2.3.2., 4.3.1.7., 4.3.13.5., 4.6.2.2.,  
 5.5.5.6.  
 incidental use, 4.2.8.  
 indoor container storage, 4.2.7.  
 indoor storage tanks, 4.3.12.

- industrial occupancies, 4.2.7., 4.2.8., 4.3.12.
  - industrial ovens, 5.4.1.
  - laboratories, 4.1.1.1., 5.5.5.1.
  - mercantile occupancies, 4.2.5.
  - outdoor container storage, 4.2.11.
  - outdoor storage tanks, 4.3.2.
  - piers and wharves, 4.8.
  - pipng and pumping systems, 4.5.
  - portable extinguishers, 4.3.13.4., 4.5.10.4., 4.6.9.1., 4.7.5.1., 4.8.6.1., 4.10.8.1., 4.11.2.1.
  - process plants, 4.1.1.1., 4.9.
  - residential occupancies, 4.2.4.
  - special processes involving, 5.4.
  - spills and leaks, 2.6.1.8., 3.3.2.13., 4.1.6., 4.2.9.2., 4.2.11.4., 4.3.6.4., 4.3.7.1., 4.3.7.7., 4.3.8.7., 4.3.11.3., 4.4., 4.5.6.3., 4.5.10.5., 4.6.7., 4.6.8.6., 4.7.2.5., 4.7.6., 4.8.4.8., 4.8.7.2., 4.8.11.1., 4.8.11.4., 4.9.4.1., 4.10.7., 4.11.2.3., 4.11.3.4.
  - spray coating processes, 5.4.5.
  - storage cabinets, 4.2.10.
  - storage tanks, delivery and removal from, 4.3.1.9.
  - storage tanks, general, 4.3., 4.3.1., 4.4.
  - tank vehicles, 4.11.
  - underground storage tanks, 4.3.8.
  - ventilation, 4.1.7.
  - Flammable gases
    - covered malls, 2.12.1.7., 2.12.1.9.
    - drying ovens (in), 5.4.1.1.
    - fuel-dispensing stations, 3.1.1.4., 4.6.1.1.
    - hot works, 5.2.3.4., 5.2.3.5.
    - indoor storage, 3.2.8.2.
    - outdoor storage, 3.3.5.3.
    - prohibited in balloons, 2.4.4.2.
    - storage tanks for flammable and combustible liquids (near), 4.3.2.3.
  - Flammable solids (see Dangerous goods)
  - Flash point, 1.4.1.2.[A], 4.1.3.
    - container storage of flammable and combustible liquids, 4.2.7.5., 4.2.11.2.
  - Flood protection, 4.3.3.3., 4.3.8.8., 4.3.12.9., 4.10.3.2.
  - Floor area, 1.4.1.2.[A], 2.3.2.1., 2.7.1.2., 2.7.1.4., 2.8.2.7., 3.2.4.4., 4.2.5.1., 6.3.1.4., 7.2.3.1., 7.2.3.3.
  - Floor finishing, 5.4.4.
  - Flow coating operations, 5.4.6.
  - Flue collars, 1.4.1.2.[A]
  - Flue pipes, 1.4.1.2.[A], 2.6.1.
  - Flues, 1.4.1.2.[A], 2.6.1.4., 2.6.2.3.
  - Fuel-dispensing stations, 1.4.1.2.[A], 4.6.
    - attendants, 4.6.8., 4.6.9.2.
    - compressed gases, 4.6.1.1.
    - dispensers, 4.6.3., 4.6.8.3., 4.6.8.4.
    - dispensing hose and nozzles, 4.6.5.
    - fire prevention and protection, 4.6.9.
    - flammable and combustible liquids, 4.6.2.
    - ignition sources, 4.6.8.7., 4.6.8.8.
    - leakage detection, 4.4.
    - marine fuel-dispensing stations, 4.6.3.5., 4.6.4.3., 4.6.5.1., 4.6.5.2., 4.6.6.5., 4.6.8.5.
    - portable extinguishers, 4.6.9.1.
    - remote pumping systems, 4.6.6.
    - self-service outlets, 4.6.4.2., 4.6.5.1., 4.6.5.2., 4.6.8.
    - shut-off devices, 4.6.4.
    - smoking, 4.6.8.7., 4.6.8.8.
    - spill control, 4.6.7.
    - storage tanks for flammable and combustible liquids, 4.6.2.1.
    - supervision and dispensing procedures, 4.6.8.
    - tank vehicles, 4.11.3.7.
  - Fumigation and thermal insecticidal fogging, 5.4.3.
  - Functional statements, 3.2.1.1.[A]
    - application, 3.1.1.2.[A]
- ## G
- Grain handling and storage, 5.3., 5.3.3.
  - Ground surface, 3.3.2.3., 3.3.2.11., 4.1.5.4.
    - clearance above, 4.3.5.2., 4.3.7.5., 4.3.10.3.
    - ground cover, 4.3.8.2., 4.8.3.1.
    - supports and foundations, 4.3.3.3., 4.3.8.8., 4.3.12.9., 4.8.3.1., 4.10.3.2.
  - Grounding and bonding
    - bulk plants, 4.7.4.5.
    - dispensing and transfer of flammable and combustible liquids, 4.1.8.2., 4.7.3.3., 4.7.4.5., 4.8.11.2., 4.11.3.3.
    - dust-producing processes, 5.3.1.2., 5.3.1.5., 5.3.3.2.
    - heating of piping for flammable and combustible liquids, 4.5.8.4.
    - indoor storage tanks for flammable and combustible liquids, 4.3.12.10.
    - piers and wharves, 4.8.5., 4.8.11.2.
    - protection against grounding, 4.5.8.4.
    - railway tracks, 4.7.4.5., 4.8.5.
    - tank vehicles, 4.7.4.5., 4.11.3.3.
    - tank vessels, 4.8.11.2.
  - Group A occupancies (see Assembly occupancies)
  - Group B occupancies (see Care or detention occupancies )
  - Group C occupancies (see Residential occupancies )
  - Group D occupancies (see Business and personal services occupancies)
  - Group E occupancies (see Mercantile occupancies)
  - Group F occupancies (see Industrial occupancies)
  - Group F, Division 1 occupancies (see High-hazard industrial occupancies)
  - Group F, Division 2 occupancies (see Medium-hazard industrial occupancies)
  - Group F, Division 3 occupancies (see Low-hazard industrial occupancies)
- ## H
- Hazardous activities, 5.1.1.1.
    - change in fire hazard, 2.1.2.2.
    - fire safety plan, 3.3.2.9., 5.2.3.7.
    - prohibited, 2.1.2.2.
  - Hazardous materials (see Dangerous goods, Flammable and combustible liquids)
  - Hazardous processes and operations, 5.1.1.1.

Heating, ventilating and air-conditioning systems, 2.6.  
ammonium nitrate storage, 3.2.9.2.  
distilleries, 4.10.6.  
dust-producing processes, 5.3.1.3., 5.3.1.10., 5.3.3.1.  
fire safety practices, 2.6.1.6.  
flammable and combustible liquids, 4.1.5.2., 4.1.7., 4.2.10.6., 4.3.12.7., 4.3.13.1., 4.6.3.3., 4.9.3.4.  
floor finishing, 5.4.4.3., 5.4.4.4.  
fumigation, 5.4.3.6.  
hazardous processes and operations, 5.1.3.1.  
indoor storage, general, 3.2.2.3.  
indoor storage of combustible fibres, 3.2.6.5.  
indoor storage of compressed gases, 3.2.8.2., 3.2.8.3.  
indoor storage of dangerous goods, 3.2.7.2., 3.2.7.3.  
laboratories, 5.5.4., 5.5.5.5.  
leakage prevention, 2.6.1.8.  
piping for flammable and combustible liquids, 4.5.6.9., 4.5.8.  
processing buildings, 4.9.3.4.  
Helicopter landing areas, 2.13.  
High buildings  
fire drills, 2.8.3.2.  
fire protection systems required, 2.1.3.1.  
fire safety plan, 2.8.2.4., 2.8.2.5.  
High-hazard industrial occupancies (Group F, Division 1) (see also Industrial occupancies), 1.4.1.2.[A]  
dead end aisles, 2.7.1.2.  
distilleries, 4.10.2.1.  
fire separations, 2.2.1.1.  
Homes and hospitals, 2.15.  
Hoods, ducts, filters  
hot works, 2.6.1.8.  
inspection and cleaning, 2.6.1.3., 2.6.1.9., 5.5.3.6.  
Hose for firefighting, 6.8.  
Hose for flammable and combustible liquids  
cargo, 4.6.6.5., 4.8.7.2., 4.8.7.3., 4.8.8., 4.8.11.3., 4.8.11.4.  
dispensing, 4.6.5.1.  
Hose stations (see also Standpipe and hose systems)  
distilleries, 4.10.8.1., 4.10.8.2.  
indoor storage tanks for flammable and combustible liquids, 4.3.13.4.  
process plants, 4.9.4.3.  
standpipe and hose systems, 6.4.1.  
Hospital textiles, 2.3.2.3.  
Hot works, 5.2.  
construction sites, 5.6.1.7.  
demolition sites, 5.6.1.7.  
duct work, 2.6.1.8.  
flammable and combustible liquids, 4.1.5.7.  
piping for flammable and combustible liquids, 4.5.5.2., 4.5.10.7., 5.2.3.4.  
piping for flammable gases, 5.2.3.4., 5.2.3.5.  
tank vehicles, 4.11.2.2.  
training, 5.2.1.2., 5.2.3.3.  
Hydrant systems (see also Water supplies)  
maintenance and inspection, 6.4.1.1.  
notification, repairs, 6.1.1.3.

outdoor storage, general, 3.3.2.7., 3.3.2.17.  
process plants, 4.9.4.3.

## Identification

bulk plants, transfer areas, 4.7.4.7.  
containers for flammable and combustible liquids, 4.2.3.2., 4.6.2.2.  
control switches for power-ventilated enclosures, 5.5.4.3.  
dangerous goods, 3.2.2.5., 3.2.7.13., 3.2.7.14., 3.3.2.9., 3.3.4.5., 5.1.5.1., 5.5.3.1., 5.5.5.6.  
emergency telephones at fuel-dispensing stations, 4.6.8.4.  
fire suppression system controls, 2.1.3.5.  
piping for compressed gases in laboratories, 5.5.5.3.  
piping for flammable and combustible liquids, 4.5.4.  
shut-off devices for dispensers at fuel-dispensing stations, 4.6.4.1.  
sprinkler system design criteria, 3.2.2.5.  
storage cabinets for flammable and combustible liquids, 4.2.10.4.  
storage tanks for flammable and combustible liquids, 4.3.1.7., 4.3.13.5.  
stored commodities, 3.2.2.5., 3.3.2.9., 5.1.5.1.  
valves controlling flammable and combustible liquids, 4.5.7.5., 4.5.7.6., 4.5.10.3., 4.5.10.7., 4.8.4.6., 4.8.4.7.  
Ignition sources (see also Open flames, Smoking)  
dust-producing processes, 5.3.1.5., 5.3.1.9., 5.3.1.10., 5.3.3.2., 5.3.3.3.  
flammable and combustible liquids, 4.1.5.2., 4.2.3.2., 4.2.8.3., 4.2.10.4., 4.3.6.4., 4.3.11.3., 4.6.3.3., 4.6.8., 4.11.3.2.  
floor finishing, 5.4.4.4.  
fumigation, 5.4.3.3.  
hot works, 5.2.  
indoor storage of combustible fibres, 3.2.6.5.  
indoor storage of dangerous goods, 3.2.7.2.  
laboratories, 5.5.3.5., 5.5.5.5.  
outdoor incinerators, 3.3.2.8.  
outdoor storage, general, 3.3.2.8.  
piers and wharves, 4.8.11.1.  
piping for flammable and combustible liquids, 4.5.8., 4.5.10.5.  
static electricity, 4.1.8.2., 4.7.4.5., 4.11.3.3., 5.3.1.5., 5.3.1.10., 5.3.3.2.  
Incidental use of flammable and combustible liquids, 3.2.3.1., 4.2.8.  
Incinerators, 2.6.2., 3.3.2.8.  
Individual storage areas, 1.4.1.2.[A]  
combustible products in, 3.2.7.17., 3.3.4.4., 4.2.7.10.  
fire safety plan, 3.2.2.5., 3.3.2.9.  
indoor container storage of flammable and combustible liquids, 4.2.7.5., 4.2.7.10., 4.2.8.4.  
indoor storage, general, 3.2.3.2., 3.2.3.3.  
indoor storage of combustible fibres, 3.2.6.4.

- indoor storage of dangerous goods, 3.2.7.9., 3.2.7.10., 3.2.7.12., 3.2.7.14., 3.2.7.17.
  - indoor storage of pallets, 3.2.2.4.
  - indoor storage of tires, 3.2.4.3.
  - outdoor container storage of flammable and combustible liquids, 4.2.11.1.
  - outdoor storage, general, 3.3.2.2., 3.3.2.3., 3.3.2.5., 3.3.2.14., 3.3.2.15., 3.3.3.2.
  - outdoor storage of dangerous goods, 3.3.4.2., 3.3.4.4.
  - Indoor storage, 3.2.
    - aerosols, 3.2.2., 3.2.5.
    - ammonium nitrate, 3.2.9.
    - basements, 3.1.5.
    - combustible fibres, 3.2.2., 3.2.6.
    - compressed gases, 3.1.1.4., 3.1.2.4., 3.2.8., 5.5.5.3.
    - containers for flammable and combustible liquids, 3.2.3.1., 4.2., 4.7.2.4., 5.5.5.1., 5.5.5.2.
    - dangerous goods, 3.1.2., 3.2.2., 3.2.7., 5.5.5.1.
    - distilled beverage alcohols, 3.2.2., 3.2.3., 4.10.4.
    - explosives, 3.1.1.3.
    - general, 3.2.2.
    - general commodities, 3.2.2., 3.2.3.
    - radioactive materials, 3.1.1.2., 3.1.2.6.
    - reactive substances, 3.1.2.5.
    - storage tanks for flammable and combustible liquids, 4.3.12., 4.8.3., 4.10.3., 4.10.4.
    - tires, 3.2.2., 3.2.4.
  - Industrial occupancies (Group F), 1.4.1.2.[A]
    - access for firefighting in storage areas, 3.2.2.2.
    - aisles in open floor areas, 2.7.1.2.
    - compressed gases near exits, 3.1.2.4.
    - distilleries, 4.10.2.1.
    - drapes, curtains and decorative materials, 2.3.2.1.
    - Group F major occupancies, 2.1.2.2., 3.2.6.2.
    - process plants, 4.9.
    - separation from other occupancies, 2.1.2.2., 2.2.1.1.
    - storage of combustible fibres, 3.2.6.2.
    - storage of flammable and combustible liquids, 4.1.1.1., 4.2.7., 4.2.8., 4.2.9., 4.2.10.3., 4.3.12.1., 4.7.2.4.
  - Industrial ovens, 5.4.1.
  - Industrial relocatable accommodation, 2.14.
  - Industrial trucks, 3.1.3.
    - ammonium nitrate storage, 3.2.9.3.
    - portable extinguishers, 3.2.9.4., 3.3.2.10., 4.10.8.1.
  - Information, posted (see also Identification, Labels, Placards, Signs), 2.1.4.
    - maintenance, 2.1.4.2.
    - posting, 2.1.4.1.
  - Insecticides (see Fumigation and thermal insecticidal fogging)
  - Inspection
    - cargo hose for flammable and combustible liquids, 4.8.11.1.
    - cathodic protection equipment, 4.3.8.3.
    - chimneys, flues, flue pipes, 2.6.1.4.
    - closures, 2.2.2.4.
    - conveying equipment, 5.3.3.2.
    - elevators, 7.2.2.
    - emergency lighting equipment, 6.5.1.6., 6.5.1.7.
    - emergency power systems, 6.5.1.1.
    - fire alarm systems, 6.3.1.2.
    - fire pumps, 6.4.1.1.
    - hoods, ducts and filters, 2.6.1.3.
    - hot work equipment, 5.2.2.2.
    - hot works, 5.2.3.1., 5.2.3.3.
    - hydrants, 6.4.1.1.
    - industrial ovens, 5.4.1.2.
    - laboratories, 5.5.3.6., 5.5.4.4.
    - pipng for flammable and combustible liquids, 4.4., 4.5.9.3., 4.5.10.5., 4.8.4.6., 4.10.5.1.
    - portable extinguishers, 6.2.1.1.
    - reservoirs, 6.4.1.1.
    - smoke control measures in high buildings, 7.3.
    - special fire suppression systems, 6.6.1.1.
    - sprinkler heads, 6.4.1.1.
    - sprinkler valves, 6.4.1.1.
    - standpipe and hose systems, 6.4.1.1.
    - storage tanks for flammable and combustible liquids, 4.3.7.7., 4.3.8.3., 4.3.13.2., 4.4.
    - valves for flammable and combustible liquids, 4.5.10.5., 4.5.10.6., 4.6.6.3., 4.8.4.6.
    - voice communication systems, 6.3.1.4.
  - Institutional occupancies (see Care or detention occupancies)
  - Interconnected floor spaces, 1.4.1.2.[A], 2.3.1.4.
  - Interior finish materials, 2.3.1.1.
    - ammonium nitrate storage buildings, 3.2.9.2.
    - dangerous goods, 3.2.7.8., 5.5.2.1.
    - dust-collecting systems, 5.3.1.3.
    - hot works, 5.2.3.1., 5.2.3.2.
    - laboratories, 5.5.2.1., 5.5.4.4.
  - Interlocks
    - conveying equipment, 5.3.3.2.
    - dispensing of flammable and combustible liquids, 4.6.5.2., 4.6.6.5., 4.7.3.2., 4.7.4.4.
    - dust-collecting systems, 5.3.1.8.
    - dust-producing processes, 5.3.1.8., 5.3.3.2.
    - laboratories, 5.5.4.1.
    - ventilation for flammable vapours, 4.1.7.2., 4.1.7.6., 5.5.4.1.
  - Intermodal shipping containers, 3.3.1.1., 3.3.4.8.
  - Internal combustion engines
    - emergency power systems, 6.5.
    - fuel dispensing, 4.6.8.6., 4.6.8.8.
    - fuel supplies, 4.3.12.2.
    - power blowers in air-supported structures, 2.9.3.6.
    - tank vehicles, 4.11.3.6.
  - Internal combustion powered equipment, 2.4.4.3.
  - Interpretations and variances
    - interpretations, 2.2.2.1.[C]
    - variances, 2.2.2.2.[C]
  - Intervals between inspections and tests, 2.2.1.3.[C]
- ## K
- Keys
    - access to firefighting equipment, 2.8.1.3.
    - access to roofs for firefighting, 2.5.1.3.
    - elevators, 7.1.1.4., 7.2.2.

## L

- Labels (see also Information, posted)
  - containers for dangerous goods, 3.2.7.13., 3.3.4.5., 5.5.3.1., 5.5.5.6.
  - containers for flammable and combustible liquids, 4.2.3.2., 4.6.2.2.
  - pipng for compressed gases in laboratories, 5.5.5.3.
  - pipng for flammable and combustible liquids, 4.5.4.1., 4.8.4.7.
  - storage cabinets for flammable and combustible liquids, 4.2.10.4.
  - storage tanks for flammable and combustible liquids, 4.3.1.7.
  - valves controlling flammable and combustible liquids, 4.5.7.6., 4.5.10.7., 4.8.4.7.
- Laboratories, 5.5.
- Leakage (see also Spill control)
  - dangerous goods, 3.2.7.4., 3.2.7.11., 3.3.4.7.
  - flammable and combustible liquids, 4.1.6.3., 4.3.6.4., 4.3.11.3., 4.7.4.3., 4.8.7.2., 4.8.11.1., 4.10.7.1., 4.11.2.3.
  - heating equipment, 2.6.1.8.
- Leakage detection, 4.4.
  - cargo hose for flammable and combustible liquids, 4.8.8.2., 4.8.11.1., 4.8.11.3.
  - continuous, 4.4.1.2., 4.4.2.1., 4.4.4.2.
  - hot work equipment, 5.2.2.2.
  - inventory reconciliation, 4.4.1.2., 4.4.2.1., 4.4.4.1.
  - liquid media leakage tests, 4.4.1.2., 4.4.2.1., 4.4.3.5., 4.4.3.6.
  - pipng for flammable and combustible liquids, 4.4.1.2., 4.5.10.5., 4.8.4.8.
  - pneumatic leakage tests, 4.4.1.2., 4.4.2.1., 4.4.3.2., 4.4.3.3., 4.4.3.4.
  - precision leak detection, 4.4.1.2., 4.4.2.1., 4.4.3.1.
  - remedial action, 4.4.1.3.
  - storage tanks for flammable and combustible liquids, 4.3.7.7., 4.4.
- Lift trucks (see Industrial trucks)
- Lightning protection equipment, 6.9.
- Lint traps, 2.4.1.4.
- Liquid level measurements
  - openings in storage tanks, 4.3.6.3., 4.3.11.2., 4.3.14.2.
  - storage tanks for flammable and combustible liquids, 4.3.15.2., 4.4.1.2., 4.4.2.1., 4.4.4.1.
- Lodging houses, 2.11.
- Low-hazard industrial occupancies (Group F, Division 3) (see also Industrial occupancies), 1.4.1.2.[A]
  - dead end aisles, 2.7.1.2.
- Low pressure storage tanks (see also Storage tanks for flammable and combustible liquids), 1.4.1.2.[A], 4.3.1.3., 4.3.4.1.
- Lower explosive limit, 1.4.1.2.[A]
  - distilleries, 4.10.6.1.
  - flammable and combustible liquids, 4.1.7.2., 4.1.7.6., 4.1.8.2.
  - laboratories, 5.5.3.4.

- Lumber and forest products
  - indoor storage, 3.2.2., 3.2.3.
  - outdoor storage, 3.3.2., 3.3.3.

## M

- Maintenance
  - access for firefighting, 2.5.1.5., 3.2.2.2., 3.3.2.7., 4.1.5.6.
  - cargo hose for flammable and combustible liquids, 4.8.8.2.
  - losures, 2.2.2.4.
  - combustible deposits and residue, 5.5.5.5.
  - combustible material accumulation, 3.2.7.4., 3.2.8.3., 4.1.5.4., 4.3.7.9., 5.2.3.2., 5.5.3.2.
  - commercial cooking equipment, 2.6.1.9.
  - conveying equipment, 5.3.3.2.
  - dust accumulation, 5.3.1.2., 5.3.3.2.
  - electrical installations, 2.4.7., 5.5.3.6.
  - emergency lighting, 2.7.3., 6.5.
  - fire alarm systems, 6.3.1.
  - fire emergency systems, 6.5., 7.1.1.4.
  - fire protection installations, 6.1.1.2.
  - ground vegetation, 3.3.2.3., 4.1.5.4.
  - heating, ventilating and air-conditioning systems, 2.6.1., 5.5.3.6.
  - hot work equipment, 5.2.2.1.
  - hydrants, 3.3.2.7., 6.4.1.1.
  - industrial ovens, 5.4.1.2.
  - industrial trucks, 3.1.3., 3.2.9.3.
  - laboratories, 5.5.3.4., 5.5.3.6., 5.5.4.1., 5.5.5.5.
  - means of egress, 2.7.1.6.
  - outdoor incinerators, 2.6.2.2., 3.3.2.2.
  - pipng for flammable and combustible liquids, 4.5.4.1., 4.5.9.3., 4.5.10.7., 4.7.2.3., 4.7.4.3., 5.5.3.6.
  - portable extinguishers, 6.2.1.1.
  - posted information, 2.1.4.2.
  - secondary containment for aboveground storage tanks, 4.3.7.8.
  - spark arrestors, 2.6.2.3.
  - special fire suppression systems, 6.6.
  - sprinkler systems, 6.4.1.1.
  - standpipe and hose systems, 6.4.1.1.
  - valves for flammable and combustible liquids, 4.6.6.3., 4.7.2.3., 5.5.3.6.
  - ventilation systems for flammable vapours, 4.1.7.8., 5.5.3.4., 5.5.3.6., 5.5.4.1., 5.5.5.5.
  - water supplies, 3.3.2.7., 6.4.1.1.
- Major occupancies, 1.4.1.2.[A]
  - classification, 2.1.2.1.
  - fire separations, 2.2.1.1.
  - Group A, Division 2, 5.5.5.1.
  - Group B, 2.8.3.2., 5.5.5.1.
  - Group D, 5.5.5.1.
  - Group F, Division 1, 2.1.2.2.
  - Group F, Division 2, 3.2.6.2.
- Manufactured buildings, outdoor storage, 3.2.2., 3.3.3.

Marine fuel-dispensing stations (see also Fuel-dispensing stations), 1.4.1.2.[A]  
access to, 4.6.3.5.  
dispensing hose, 4.6.5.1.  
dispensing nozzles, 4.6.5.2.  
duties of attendants, 4.6.8.5.  
shut-off valves, 4.6.4.3.  
storage tanks for flammable and combustible liquids, 4.6.6.5.

Matches (see Dangerous goods)

Means of egress, 1.4.1.2.[A], 2.7.1.  
business and personal services occupancies, 2.7.1.2.  
combustible materials, 2.4.1.1.  
drainage of flammable and combustible liquid spills, 4.1.6.2.  
industrial occupancies, 2.7.1.2.  
maintenance, 2.7.1.6., 2.7.1.7.  
mercantile occupancies, 2.7.1.2.  
nonfixed seating, 2.7.1.5.  
obstructions, 2.4.1.1., 2.7.1.6., 2.7.1.7., 2.9.3.4.  
open floor areas, 2.7.1.2.  
smoke control doors in high buildings, 7.3.1.2.  
storage of compressed gases, 3.1.2.4.  
storage of flammable and combustible liquids, 4.2.2.1.  
tents and air-supported structures, 2.9.3.4.

Medium-hazard industrial occupancies (Group F, Division 2) (see also Industrial occupancies), 1.4.1.2.[A]  
dead end aisles, 2.7.1.2.  
distilleries, 4.10.2.1.

Mercantile occupancies (Group E), 1.4.1.2.[A]  
aisles in open floor areas, 2.7.1.2.  
covered malls, 2.12.  
drapes, curtains and decorative materials, 2.3.2.1.  
flammable and combustible liquids, 4.1.5.8., 4.2.5.

Movable partitions and screens  
flame-spread rating, 2.3.1.2.  
hot works, 5.2.3.2.

## N

Natural gas (see Compressed gases)

Noncombustible construction, 1.4.1.2.[A]  
hot works, 5.2.3.1.  
indoor storage of flammable gases, 3.2.8.2.  
piers and wharves, 4.8.3.1., 4.8.9.2.  
piping for flammable and combustible liquids, 4.5.6.3.

Nonfixed seating, 2.7.1.5.

## O

Objectives, 2.2.1.1.[A]  
application, 2.1.1.2.[A]

Occupancies (see also entries under Group occupancies), 1.4.1.2.[A]

Occupant load, 1.4.1.2.[A], 2.7.1.

Open air fires, 2.4.5., 3.3.2.8.

Open flames (see also Ignition sources), 2.4.3.  
combustible materials (near), 2.4.3.3.  
dust-producing processes, 5.3.1.10.  
flaming meals and drinks, 2.4.3.2.  
flammable and combustible liquids, 4.1.5.2., 4.2.3.2., 4.2.10.4.  
floor finishing, 5.4.4.4.  
fumigation, 5.4.3.3.  
hot works, 5.2.  
indoor storage of dangerous goods, 3.2.7.2.  
laboratories, 5.5.5.5.  
outdoor storage, general, 3.3.2.8.  
piers and wharves, 4.8.11.1.  
piping for flammable and combustible liquids, 4.5.8.5., 4.5.10.5.  
processions, 2.4.3.1.  
tents and air-supported structures, 2.9.3.3.

Open floor areas, 2.7.1.2.

Organic peroxides (see Oxidizing substances)

Outdoor storage, 3.3.  
access control, 3.3.2.6.  
access for firefighting, 3.3.2.5., 3.3.2.7.  
combustible materials near buildings, 2.4.1.1., 3.3.3.2.  
compressed gases, 3.1.1.4., 3.1.2.4., 3.3.5.  
construction sites, 5.6.1.3.  
containers for flammable and combustible liquids, 4.2.11., 4.6.2.2., 4.7.2.4.  
dangerous goods, 3.1.2., 3.3.2., 3.3.4.  
demolition sites, 5.6.1.3.  
general, 3.3.2.  
general commodities, 3.3.2., 3.3.3.  
intermodal shipping containers, 3.3.1.1., 3.3.4.8.  
lumber and forest products, 3.3.2., 3.3.3.  
storage tanks for flammable and combustible liquids, 4.3.2., 4.6.2.1., 4.7.2., 4.8.3.  
tires, 3.3.2., 3.3.3.

Ovens  
industrial, 5.4.1.

Oxidizing substances (see also Dangerous goods)  
fire separations, 3.2.7.5.  
flooring materials, 3.2.7.8.  
organic peroxides, 3.2.7.1., 3.2.7.5.  
oxidizing gases, 3.2.7.9., 3.2.8.3.  
reactive substances, 3.1.2.5.

## P

Pallets  
indoor storage, 3.2.2.4.  
outdoor storage, 3.3.2., 3.3.3.

Panic doors (see Doors in means of egress)

Partitions, 1.4.1.2.[A]  
aerosol storage, 3.2.5.6., 3.2.5.7.  
clearances from, 3.2.9.4.  
flame-spread rating, 2.3.1.1., 2.3.1.2.

Piers and wharves handling flammable and combustible liquids, 4.8.

Piping and pumping systems for flammable and combustible liquids, 4.5.  
bulk plants, 4.7.2.3., 4.7.4.  
cargo pumps, 4.8.9., 4.8.10.  
corrosion protection, 4.5.2.2., 4.5.3., 4.6.2.4.  
distilleries, 4.10.5.  
expansion and contraction, 4.5.6.13.  
fuel-dispensing stations, 4.6.2.3., 4.6.6.  
heating, 4.5.8.  
identification, 4.5.4., 4.5.7.6., 4.5.10.3., 4.5.10.7., 4.8.4.6., 4.8.4.7.  
joints, 4.5.5.  
leakage detection, 4.4., 4.5.10.5., 4.8.4.8.  
location and arrangement of piping, 4.5.6.  
maintenance, 4.5.4.1., 4.5.9.3., 4.5.10.7., 4.7.2.3., 4.7.4.3., 5.5.3.6.  
materials, 4.5.2.  
methods of transfer, 4.1.8.3., 4.5.9.  
operating procedures, 4.5.10.  
piers and wharves, 4.8.4., 4.8.7., 4.8.9.  
pits for submerged pumps, 4.5.9.3., 4.6.2.6.  
portable extinguishers, 4.5.10.4., 4.8.6.1.  
pumps for piping systems, 4.5.9., 4.6.6., 4.10.5.  
site sensitivity, 4.5.6.5.  
valves, 4.1.6.2., 4.5.6.7., 4.5.7., 4.5.10., 4.6.6.3., 4.6.6.5., 4.8.4.

Placards (see also Information, posted), 3.2.7.14., 4.3.13.5.

Poisonous and infectious substances (see Dangerous goods)

Portable containers (see Containers for flammable and combustible liquids)

Portable extinguishers, 2.1.5., 6.2.  
boarding and lodging houses, 2.11.2.1.  
bulk plants, 4.7.5.1.  
distilleries, 4.10.8.1.  
distribution and sale, 2.1.5.1.  
flammable and combustible liquids, 4.3.13.4., 4.5.10.4., 4.6.9.1., 4.7.5.1., 4.8.6.1., 4.10.8.1., 4.11.2.1.  
fuel-dispensing stations, 4.6.9.1.  
grain handling and storage, 5.3.3.4.  
hot works, 5.2.3.6.  
indoor storage of tires, 3.2.4.4.  
industrial trucks, 3.2.9.4., 3.3.2.10., 4.10.8.1.  
installation and maintenance, 6.2.  
outdoor storage, general, 3.3.2.10.  
piers and wharves, 4.8.6.1.  
records, tags, 6.1.1.5.  
restaurants, 2.4.3.2.  
tank vehicles, 4.7.5.1., 4.11.2.1.  
woodworking operations, 5.3.2.3.

Portable tanks (see Containers for flammable and combustible liquids)

Power lines, storage beneath, 3.3.2.4.

Prepackaged containers (see Closed containers)

Pressure vessels, 1.4.1.2.[A], 4.3.1.3.  
piping for flammable and combustible liquids, 4.5.1.1., 4.5.9.5., 4.5.9.6.

Process plants, 1.4.1.2.[A], 4.1.1.1., 4.9.

Propane (see Compressed gases)

Pumps (see also Piping and pumping systems for flammable and combustible liquids)  
containers and storage tanks for flammable and combustible liquids, 4.1.8.3., 4.1.8.4., 4.2.9.4., 4.6.2.2.  
fire, 6.4.1.1.

## Q

Qualifications  
commercial cooking equipment, 2.2.4.1.[C]  
fire alarm and voice communication systems, 2.2.4.1.[C]  
portable extinguishers, 2.2.4.1.[C]  
special fire suppression systems, 2.2.4.1.[C]

## R

Racks (see also Individual storage areas), 1.4.1.2.[A]  
indoor container storage of flammable and combustible liquids, 4.2.7.5.  
indoor storage, general, 3.2.1.1., 3.2.2., 3.2.3.  
indoor storage of aerosols, 3.2.5.3., 3.2.5.8., 3.2.5.9.  
indoor storage of dangerous goods, 3.2.7.5., 3.2.7.7.

Radioactive materials, 3.1.1.2.  
fire safety plan, 3.1.2.6., 5.1.5.  
separation from dangerous goods, 3.2.7.6.

Reactive substances (see also Dangerous goods), 3.1.2.5.  
fire separations, 3.2.7.5.  
perchloric acid, 5.5.5.5.  
ventilation systems in laboratories, 5.5.3.4., 5.5.3.6., 5.5.4.4., 5.5.5.5.

Records  
disconnect switches, 2.6.1.6.  
doors in means of egress, tests, 2.7.2.2.  
emergency power systems, tests, 6.5.1.4.  
emergency procedures, 3.3.2.9.  
fire drill frequency, 2.8.3.2.  
fire protection equipment, forms, 6.1.1.5.  
fire safety plan, high buildings, 2.8.2.5.  
flame retardant treatments, 2.3.2.2.  
location of dangerous goods, 3.2.2.5.  
piping and pumping systems for flammable and combustible liquids, plans, 4.5.4.2.  
retention, 2.2.1.2.[C], 2.3.2.2., 2.6.1.6., 2.7.2.2., 2.8.3.2., 4.3.15.1., 4.4.1.4., 4.5.10.6., 4.6.10.4., 6.1.1.5., 6.5.1.4., 6.7.1.1., 7.1.1.3., 7.2.3.4., 7.3.1.1.  
smoke alarms, 6.7.1.1.  
sprinkler systems, design, 3.2.2.5.  
sprinkler systems, tests, 3.2.2.5.  
storage tanks and piping systems for flammable and combustible liquids, leakage tests, 4.4.1.4.  
underground storage tanks, 4.3.15.1.

Recycling containers (see Waste receptacles)

Referenced documents, 1.5.1.[A], 1.3.1.

Refineries, 1.4.1.2.[A], 4.9.

Renovations, 5.6.1.1.  
continuity of fire protection, 5.6.1.6.

## Repairs

- chimneys, 2.6.1.4., 2.6.1.8.
- continuity of fire protection, 6.1.1.4.
- fire protection installations, 6.1.1.3.
- fire separations and closures, 2.2.1.2., 2.2.2.2., 2.2.2.4.
- heating equipment, 2.6.1.8.
- helicopters, 2.13.2.5.
- hot work equipment, 5.2.2.2.
- means of egress, 2.7.1.6.
- piers and wharves, 4.8.11.1.
- piping for flammable and combustible liquids, 4.5.10.5., 4.5.10.7.
- spark arrestors, 2.6.2.3.
- storage tanks for flammable and combustible liquids, 4.3.8.3., 4.4.1.3.

## Residential occupancies (Group C) (see also Dwelling units), 1.4.1.2.[A]

- flammable and combustible liquids, 4.2.4.
- hazardous activities in, 2.1.2.2.

## Roll coating operations, 5.4.6.

## Room dividers (see Movable partitions and screens)

# S

## Secondary containment for aboveground storage tanks, 4.1.6.1., 4.3.2.3., 4.3.7., 4.5.6.3.

## Secondary suites

- application, 2.16.1.1.
- bedroom windows, 2.16.2.2.
- definition, 1.4.1.2.[A]
- dwelling unit separations, 2.16.2.11.
- exit doors, 2.16.2.8.
- exit stairs, 2.16.2.3.
- furnace room separation, 2.16.2.13.
- handrails and guards, 2.16.2.5.
- heating and ventilating systems, 2.16.2.14.
- height of rooms and spaces, 2.16.2.1.
- landings, 2.16.2.4.
- means of egress, 2.16.2.9.
- protection of exits, 2.16.2.10.
- protection of public corridors, 2.16.2.12.
- public and exit corridor width, 2.16.2.6.
- smoke alarm inspection, testing and maintenance, 2.16.2.16.
- smoke alarm installation, 2.16.2.15.
- unenclosed exterior stair or ramp, 2.16.2.7.

## Self-service outlets (see also Fuel-dispensing stations), 1.4.1.2.[A]

- attendants, 4.6.8.1., 4.6.8.2.
- dispensers, card- or key-activated, 4.6.8.4.
- dispensers, special, 4.6.8.3.
- dispensing hose, 4.6.5.1.
- dispensing nozzles, 4.6.5.2.
- emergency shut-off devices, 4.6.4.2.
- unattended, 4.6.8.2.

## Service equipment, 2.6.

## Service rooms, 1.4.1.2.[A], 2.4.1.1.

## Service spaces, 1.4.1.2.[A], 2.4.1.1.

## Service stations (see Fuel-dispensing stations)

## Shutdown

- continuity of fire protection, 6.1.1.4.
- emergency power systems, 6.5.1.2.
- fire alarm systems, 2.8.2.8., 6.1.1.4.
- fire protection systems, 6.1.1.4.
- heating, ventilating and air-conditioning systems, 2.6.1.6., 2.6.1.8.

## Signs (see also Information, posted, Smoking), 2.1.4.

- access for firefighting, obstruction prohibited, 2.5.1.5.
- exit signs, 2.7.3.
- fumigation, 5.4.3.6.
- indoor storage, general, 3.2.2.5.
- indoor storage of dangerous goods, 3.2.7.14., 5.5.3.1.
- indoor storage tanks for flammable and combustible liquids, 4.3.13.5.
- laboratories, 5.5.3.1., 5.5.5.5.
- notification of fire department, 2.8.2.7.
- occupant load, 2.7.1.4.
- outdoor storage of dangerous goods, 3.3.4.5.
- piping for flammable and combustible liquids, 4.5.6.3.
- smoking prohibited, 2.4.2., 4.1.5.3., 4.6.8.8.
- storage tanks for flammable and combustible liquids, 4.3.1.7.
- valves controlling flammable and combustible liquids, 4.5.10.3., 4.8.4.6.

## Smoke alarms, 1.4.1.2.[A], 2.1.3.3., 6.7.1.1.

## Smoking, 2.4.2.

- dust-producing processes, 5.3.1.10.
- flammable and combustible liquids, 4.1.5.3.
- floor finishing, 5.4.4.4.
- fuel-dispensing stations, 4.6.8.7.
- helicopter landing areas, 2.13.2.3.
- indoor storage of dangerous goods, 3.2.7.2.
- laboratories, 5.5.3.5.
- outdoor storage, general, 3.3.2.8.
- permitted areas, ash trays, 2.4.2.1.
- prohibited areas, signs, 2.4.2., 4.1.5.3., 4.6.8.8.
- tank vehicles, 4.11.2.2., 4.11.3.2.
- tents and air-supported structures, 2.9.3.3.

## Snow and ice clearing, 2.7.1.7., 3.3.2.7.

## Space-heating appliances, 2.6.1.

- indoor storage of combustible fibres, 3.2.6.5.
- indoor storage of dangerous goods, 3.2.7.2.
- indoor storage of flammable gases, 3.2.8.2.

## Special fire suppression systems (see also Fire suppression systems), 2.1.3.5., 6.6.

## Spill control (see also Absorbent materials, Leakage detection)

- absorbent materials, 3.2.7.11., 4.1.6.3., 4.2.8.3., 4.2.7.11., 4.6.8.6., 4.6.9.2., 5.5.3.3.
- ammonium nitrate, 3.2.9.2.
- bulk plants, 4.7.2.5., 4.7.6.
- container storage of flammable and combustible liquids, 4.2.8.3., 4.2.9.2., 4.2.11.4., 4.7.2.5.
- containment, 4.1.6.1.
- dangerous goods, 3.2.7.4., 3.2.7.11., 3.3.2.13., 5.5.3.3.
- distilleries, 4.10.7.
- drainage, 4.1.6.2.

- flammable and combustible liquids, 4.1.6.
- fuel-dispensing stations, 4.6.3.3., 4.6.7., 4.6.8.5.
- laboratories, 5.5.3.3.
- notification of, 4.1.6.4.
- outdoor storage, general, 3.3.2.13.
- piers and wharves, 4.8.7.2., 4.8.11.4.
- pipng for flammable and combustible liquids, 4.5.6.3., 4.5.6.9., 4.5.10.7.
- process plants, 4.9.4.1.
- storage tanks for flammable and combustible liquids, 4.3.1.8., 4.3.7., 4.3.8.7., 4.3.12.7., 4.3.13.1., 4.3.15.2., 4.7.2.5.
- Spray coating operations, 5.4.5.
- Sprinkler systems (see also Fire suppression systems), 6.4.1.1.
  - change in fire hazard, 2.1.3.1., 2.1.3.5., 2.12.1.2.
  - design and installation, 2.1.3.1., 3.2.3.3., 2.1.3.6.
  - design records, 3.2.2.5.
  - distilleries, 4.10.8.2.
  - indoor container storage of flammable and combustible liquids, 4.2.5.1., 4.2.7.5., 4.2.7.6., 4.2.9.1.
  - indoor storage, general, 3.2.3.2., 3.2.3.3.
  - indoor storage of aerosols, 3.2.5.5.
  - indoor storage of combustible fibres, 3.2.6.3., 3.2.6.4.
  - indoor storage of dangerous goods, 3.2.7.5., 3.2.7.9.
  - indoor storage of tires, 3.2.4.3.
  - indoor storage tanks for flammable and combustible liquids, 4.3.12.4.
  - main drain test, 3.2.2.5.
  - maintenance, 6.1.1.2., 6.4.1.1.
  - notification of impairments, 6.1.1.3.
  - notification of tests, 6.1.1.3.
  - tests, 6.4.1.1.
- Standpipe and hose systems, 6.4.1.1.
  - distilleries, 4.10.8.2.
  - grain handling and storage, 5.3.3.4.
  - indoor storage tanks for flammable and combustible liquids, 4.3.13.4.
  - notification of impairments, 6.1.1.3.
  - notification of tests, 6.1.1.3.
  - where required, 2.1.3.1.
- Static electricity (see also Grounding and bonding), 4.1.8.2., 4.7.4.5., 4.11.3.3., 5.3.1.5., 5.3.1.10., 5.3.3.2.
- Storage arrangements (see also Individual storage areas)
  - aerosols, 3.2.5.
  - ammonium nitrate, 3.2.9.
  - combustible fibres, 3.2.6.
  - containers for flammable and combustible liquids, 4.2.2.2., 4.2.5.1., 4.2.7.5., 4.2.9.1., 4.2.9.3., 4.2.11.1.
  - dangerous goods, 3.2.7.5., 3.3.4.2.
  - indoor storage, general, 3.2.3.2.
  - lumber and forest products, 3.3.3.2.
  - outdoor storage, general, 3.3.2.2., 3.3.2.15., 3.3.3.2.
  - pallets, 3.2.2.4., 3.3.3.2.
  - tires, 3.2.4., 3.3.3.2.
  - wood chips, 3.3.3.2.
- Storage cabinets for flammable and combustible liquids, 4.2.10.
  - assembly occupancies, 4.2.4.2., 4.2.4.3.
  - business and personal services occupancies, 4.2.6.2.
  - care or detention occupancies, 4.2.6.2., 4.2.10.3.
  - educational facilities, 4.2.6.2.
  - industrial occupancies, 4.2.10.3.
  - laboratories, 5.5.5.1.
  - residential occupancies, 4.2.4.2., 4.2.4.3.
- Storage tanks for flammable and combustible liquids, 1.4.1.2.[A], 4.3.
  - aboveground storage tanks, 4.3.2., 4.3.15.2., 4.4., 4.6.2., 4.7.2., 4.7.4.1., 4.8.3.
  - access for firefighting, 4.1.5.6., 4.3.2.4., 4.3.7.5.
  - anchorage, 4.3.3.3., 4.3.8.8., 4.3.12.9., 4.10.3.2.
  - approvals, 2.2.3.[C]
  - bulk plants, 4.7.2., 4.7.3.2., 4.7.4.1., 4.7.4.3., 4.7.4.5.
  - corrosion protection, 4.3.1.5., 4.3.9.
  - design, construction and use, 4.3.1.
  - dispensing and transfer, 4.1.7., 4.1.8., 4.2.8.3., 4.3.13., 4.7.3.2., 4.7.3.3., 4.7.4.3., 4.7.4.5.
  - disposal, 4.3.15.3.
  - distilleries, 4.10.3., 4.10.4.
  - documentation, required, 4.3.1.9.
  - emergency power systems, fuel supplies, 6.5.1.5.
  - fill piping, 4.3.6.4., 4.3.11.3., 4.3.14.1., 4.5.6.2.
  - fire protection systems, 4.3.2.1., 4.3.2.5.
  - fire suppression systems, 4.3.2.1., 4.3.2.5., 4.3.12.4.
  - fuel-dispensing stations, 4.6.2.
  - ground cover, 4.3.8.2.
  - identification, 4.3.1.7., 4.3.13.5.
  - incidental use, 4.2.8.2., 4.2.8.3.
  - indoor storage tanks, 4.2.8.2., 4.2.8.3., 4.3.12., 4.8.3., 4.10.3.
  - installation and use, 4.3.1.9.
  - leakage detection, 4.3.7.7., 4.4.
  - marine fuel-dispensing stations, 4.6.6.5.
  - mechanical damage, protection against, 4.3.3.4.
  - movable tanks, 4.1.8.4.
  - openings other than vents, 4.3.6., 4.3.11., 4.3.14., 4.3.15.3.
  - overflow protection, 4.3.1.8., 4.11.3.7.
  - piers and wharves, 4.8.3.
  - pipng and valves, 4.3.6.1., 4.3.6.2., 4.3.7.2., 4.3.7.5., 4.3.14.1., 4.3.15.2., 4.5., 4.5.6.2., 4.5.7.2., 4.6.6.5., 4.7.3.2., 4.7.4.3.
  - portable tanks, 4.2.1.1., 4.2.3.1.
  - removal of underground storage tanks, 4.3.16.1.
  - reuse, 4.3.1.10.
  - rooms for indoor storage tanks, 4.3.13.
  - secondary containment, 4.1.6.1., 4.3.2.3., 4.3.7., 4.5.6.3.
  - site sensitivity, 4.3.8.1., 4.5.6.5.
  - spill control, 4.3.1.8., 4.3.7., 4.3.8.7., 4.3.12.7., 4.3.13.1., 4.7.2.5.
  - supports and foundations, 4.3.3., 4.3.8.5., 4.3.12.9., 4.8.3., 4.10.3.2.
  - temporarily out of service, 4.3.15.
  - underground storage tanks, 4.3.8., 4.8.3.

underground storage tanks, abandon in place, 4.3.16.2.  
 vents, 4.3.4., 4.3.7.6., 4.3.10., 4.3.12.8., 4.10.3.3.  
 withdrawal from service, 4.3.15., 4.3.16.

Storage tank registration  
 application, 2.2.5.1.[C]  
 general, 2.2.4.1.[C]

Storeys (see also First storey), 1.4.1.2.[A]  
 high buildings, fan controls, 7.2.4.1.  
 high buildings, smoke control equipment, 7.3.2.  
 indoor container storage of flammable and combustible liquids, 4.2.7.5.  
 indoor storage of ammonium nitrate, 3.2.9.2.  
 indoor storage of dangerous goods, access openings, 3.2.7.12.  
 indoor storage tanks for flammable and combustible liquids, 4.3.12.4.  
 outdoor container storage of flammable and combustible liquids, 4.2.11.1.  
 portable extinguishers, 2.11.2.1.

Streets, 1.4.1.2.[A]  
 access for firefighting, 2.5.1.1., 2.5.1.5.  
 clearances from underground storage tanks for flammable and combustible liquids, 4.3.8.1.  
 fuel-dispensing stations, 4.6.8.6.  
 tank vehicles, 4.11.3.7.

Suites, 1.4.1.2.[A]  
 mercantile occupancies, flammable and combustible liquids, 4.2.5.1.  
 open floor areas, 2.7.1.2.

Supervisory staff, 1.4.1.2.[A], 2.8.1.2., 2.8.1.3., 2.8.2., 2.8.3.1., 2.8.3.2., 6.5.1.2.

Symbols, 1.4.2.1.[A]

## T

Tank cars, loading and unloading, 4.7.4.

Tank farms (see Bulk plants)

Tank vehicles, 1.4.1.2.[A], 4.11.  
 bulk plants, 4.7.4., 4.7.5.1.  
 loading and unloading, 4.7.4., 4.11.3.  
 parking, 4.11.2.3., 4.11.2.4.  
 portable extinguishers, 4.7.5.1., 4.11.2.1.

Tanks for flammable and combustible liquids (see Storage tanks for flammable and combustible liquids)

Tents, 2.9.

Tests (see also Leakage detection)  
 alarm systems, 6.3.1.2.  
 cargo hose for flammable and combustible liquids, 4.8.8.2.  
 containers and storage tanks for flammable and combustible liquids, hot works, 5.2.3.4.  
 doors in means of egress, 2.7.2.  
 emergency lighting unit equipment, 6.5.1.6.  
 emergency power systems, 6.5.1.1., 6.5.1.4.  
 fire alarm systems, 6.3.1.2.  
 fire pumps, 6.4.1.1.  
 high buildings, central alarm and control facility, 7.2.4.

high buildings, elevators, 7.2.2.  
 high buildings, fan controls, 7.2.4.1.  
 high buildings, hold-open devices, 7.2.4.2.  
 high buildings, smoke control measures, 7.3.  
 high buildings, venting facilities to aid firefighters, 7.2.3.  
 high buildings, vestibule doors, 7.2.4.2., 7.3.1.2.  
 hydrants, 6.4.1.1.  
 laboratories, 5.5.3.6.  
 piping for flammable and combustible liquids, control valves, 4.5.10.6.  
 piping for flammable and combustible liquids, hot works, 5.2.3.4.  
 piping for flammable and combustible liquids, thermal electrical conduction heating, 4.5.8.4.  
 piping for flammable gases, hot works, 5.2.3.4.  
 portable extinguishers, 6.2.1.1.  
 special fire suppression systems, 6.6.1.1.  
 sprinkler systems, 6.4.1.1.  
 sprinkler systems, main drain test, 3.2.2.5.  
 standpipe and hose systems, 6.4.1.1.  
 voice communication systems, 6.3.1.4.

Tires  
 indoor storage, 3.2.2., 3.2.4.  
 outdoor storage, 3.3.2., 3.3.3.  
 outdoor storage, used, 3.3.6.

## Training

conveying equipment, 5.3.3.2.  
 dangerous goods, 3.2.7.15., 3.3.4.6., 5.5.3.1.  
 dispensing and transfer of flammable and combustible liquids, 4.3.1.8., 4.5.10.2., 4.6.8., 4.8.6.2., 4.8.11.1., 4.11.3.4.  
 fire emergency procedures, 2.8.1.2.  
 fuel-dispensing stations, 4.6.8.  
 high buildings, supervisory staff, 2.8.2.4.  
 hot works, 5.2.1.2., 5.2.3.3.  
 laboratories, 5.5.3.1.  
 leakage detection of storage tanks, 4.4.  
 piers and wharves, 4.8.6.2., 4.8.11.1.  
 supervisory staff, 2.8.2.1.  
 tank vehicles, 4.11.3.4.

Transfer of flammable and combustible liquids (see Dispensing and transfer of flammable and combustible liquids)

Transformer vaults, 2.6.3.

## U

Unit equipment for emergency lighting, 6.5.1.6.

Unstable liquids, 1.4.1.2.[A]  
 container storage and handling, 4.2.1.1.  
 laboratories, 5.5.4.2.  
 process plants, 4.9.2.1., 4.9.3.1., 4.9.3.2.  
 storage tanks, 4.3.2.1., 4.3.2.2., 4.3.4.2.

## V

Vacant buildings, 2.4.6.

Valves controlling flammable and combustible liquids  
 access to, 4.3.7.5., 4.5.7.2., 4.8.4.6., 4.8.7.1.  
 bulk plants, 4.7.3.2., 4.7.4.3., 4.7.4.4.  
 check, 4.3.14.2., 4.5.9.5., 4.7.4.3.  
 containers, 4.1.8.3., 4.2.9.4.  
 design, 4.5.7.1.  
 diaphragm, 4.5.7.3.  
 dispensing and transfer, 4.5.7.1., 4.5.7.2., 4.5.10.3.,  
 4.6.4.3., 4.6.5.2., 4.6.6.3., 4.6.6.5., 4.7.3.2., 4.7.4.3.,  
 4.7.4.4., 4.8.4.5., 4.11.3.4.  
 drainage systems, 4.1.6.2.  
 emergency, 4.5.7.1., 4.5.10.3., 4.6.6.3., 4.7.3.2.  
 fuel-dispensing stations, 4.6.5.2., 4.6.6.3.  
 globe, 4.5.7.4.  
 hose nozzle, 4.5.7.1., 4.6.5.2., 4.6.8.6.  
 hydraulic transfer systems, 4.5.9.5.  
 identification, 4.5.7.6., 4.5.10.3., 4.5.10.7., 4.8.4.6.,  
 4.8.4.7.  
 indicating, 4.5.7.5.  
 inert gas transfer systems, 4.5.9.6.  
 inspection and tests, 4.5.10.5., 4.5.10.6., 4.8.4.6.  
 maintenance, 4.6.6.3.  
 marine fuel-dispensing stations, 4.6.4.3., 4.6.6.5.  
 materials, 4.5.2., 4.5.7.2.  
 operational procedures, 4.5.10.1., 4.5.10.2.  
 piers and wharves, 4.8.4., 4.8.7.1., 4.8.7.3., 4.8.9.1.  
 piping at entrances to buildings, 4.5.6.7., 4.5.7.2.  
 piping for flammable and combustible liquids,  
 4.1.6.2., 4.5.6.7., 4.5.7., 4.5.10., 4.6.6.3., 4.6.6.5.,  
 4.8.4.  
 relief, 4.8.9.1.  
 self-closing, 4.1.8.3., 4.2.9.4., 4.3.14.2., 4.7.4.4.  
 shut-off, 4.5.6.7., 4.5.7.2., 4.5.10.2., 4.5.10.3., 4.6.4.3.,  
 4.7.4.4., 4.8.4.5., 4.8.7.3.  
 solenoid, 4.6.6.5., 4.7.3.2.  
 storage tanks, 4.1.8.3., 4.3.6.1., 4.3.6.2., 4.3.7.5.,  
 4.3.14.1., 4.3.14.2., 4.5.7.2., 4.6.6.5., 4.7.3.2., 4.7.4.3.  
 tank vehicles, 4.7.4.4., 4.11.3.4.

Valves controlling water supplies, 3.3.2.7., 4.1.6.1.  
 Valves for fire protection equipment, 4.5.10.2., 4.5.10.3.

Vaults, electrical equipment, 2.6.3.

Vehicles, propane fuelled, 2.4.4.5., 2.12.1.9.

#### Ventilation

ammonium nitrate storage, 3.2.9.2.  
 compressed gas storage, 3.2.8.2., 3.2.8.3.  
 container storage of flammable and combustible  
 liquids, 4.2.10.6.  
 dangerous goods storage, 3.2.7.3., 3.2.7.10.  
 dispensing of flammable and combustible liquids,  
 4.2.7.4., 4.2.8.3., 4.3.13.1., 4.6.3.3.  
 distilleries, 4.10.6.  
 flammable and combustible liquids, 4.1.7.  
 floor finishing, 5.4.4.3.  
 fumigation, 5.4.3.6.  
 grain storage bins, 5.3.3.1.  
 hazardous locations, 5.1.3.  
 incidental use of flammable and combustible  
 liquids, 4.2.8.3.  
 interlocks, 4.1.7.2., 4.1.7.6., 5.5.4.1.  
 laboratories, 5.5.3.6., 5.5.4., 5.5.5.5.

piping for flammable and combustible liquids in  
 trenches, 4.5.6.9.

processing buildings, 4.9.3.4.

storage cabinets for flammable and combustible  
 liquids, 4.2.10.6.

storage tanks for flammable and combustible  
 liquids, 4.3.12.7., 4.3.13.1.

Vertical service spaces, 1.4.1.2.[A], 7.3.2.1.

Voice communication systems

tests, 6.3.1.4.

where required, 2.1.3.2., 2.9.3.5.

## W

Waste disposal (see also Spill control)

absorbent materials for spills and leaks, 3.2.7.11.,  
 4.1.6.3.

ashes, 2.4.1.3.

combustible waste, 2.4.1., 5.2.3.2.

dangerous goods, 3.2.7.4., 5.5.5.6.

day-care centres, 2.10.3.2.

greasy and oily rags, 2.4.1.3., 4.1.5.4., 5.4.4.5.

incinerators, 2.6.2., 3.3.2.8.

receptacles, 2.4.1.3.

shavings and sawdust, 5.2.3.2., 5.3.2.2.

spray deposits and residue, 5.2.3.2.

Waste materials

accumulation, 2.4.1.1.

receptacles, 2.4.1.3.

storage rooms, 2.4.1.2.

Waste receptacles, 2.4.1.3., 4.1.5.4., 4.1.6.3., 5.3.2.2.,  
 5.4.4.5.

Water-based fire protection systems, 6.4.

maintenance, 6.4.1.1.

tests, 6.4.1.1.

Water supplies, 3.3.2.7., 3.3.2.16., 4.1.6.2., 4.9.4.3.

Water used for firefighting, 3.2.2.3., 4.3.7.3., 5.3.3.4.

Welding and cutting (see Hot works)

Wood chips (see Lumber and forest products)

Woodworking operations, 5.3., 5.3.2.

---

### Conversion Factors

To Convert	To	Multiply by
°C	°F	1.8 and add 32
kg	lb.	2.205
kPa	lbf/in. <sup>2</sup> (psi)	0.1450
kPa	lbf/ft. <sup>2</sup>	20.88
L	gal. (imp.)	0.2200
L/s	gal./min (gmp)	13.20
L/h	gal./min (gmp)	0.00367
L/m <sup>2</sup>	gal./ft. <sup>2</sup>	0.0204
m	ft.	3.281
m <sup>2</sup>	ft. <sup>2</sup>	10.76
m <sup>3</sup>	ft. <sup>3</sup>	35.314475
mm	in.	0.03937
m/s	ft./min	196.8